



(12) **United States Patent**
Taras et al.

(10) **Patent No.:** **US 11,448,430 B2**
(45) **Date of Patent:** ***Sep. 20, 2022**

(54) **HEAT PUMP AND WATER HEATER**

(71) Applicant: **Climate Master, Inc.**, Oklahoma City, OK (US)
(72) Inventors: **Michael F. Taras**, Oklahoma City, OK (US); **Michael S. Privett**, Tuttle, OK (US); **Jeremy R. Smith**, Edmond, OK (US)

(73) Assignee: **Climate Master, Inc.**, Oklahoma City, OK (US)

(*) Notice: Subject to any disclaimer, the term of this patent is extended or adjusted under 35 U.S.C. 154(b) by 0 days.

This patent is subject to a terminal disclaimer.

(21) Appl. No.: **17/129,558**

(22) Filed: **Dec. 21, 2020**

(65) **Prior Publication Data**

US 2021/0131709 A1 May 6, 2021

Related U.S. Application Data

(63) Continuation of application No. 15/634,434, filed on Jun. 27, 2017, now Pat. No. 10,871,314.
(Continued)

(51) **Int. Cl.**
F25B 30/02 (2006.01)
F25B 13/00 (2006.01)
(Continued)

(52) **U.S. Cl.**
CPC *F25B 6/04* (2013.01); *F25B 13/00* (2013.01); *F25B 30/02* (2013.01); *F25B 41/20* (2021.01);
(Continued)

(58) **Field of Classification Search**
CPC .. F25B 30/02; F25B 6/04; F25B 13/00; F25B 2339/047; F25B 2400/0403; F25B 2400/0409; F25B 2600/2501
See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

3,460,353 A 8/1969 Ogata et al.
3,916,638 A 11/1975 Schmidt
(Continued)

FOREIGN PATENT DOCUMENTS

CA 1178268 11/1984
CN 1987397 A 6/2007
(Continued)

OTHER PUBLICATIONS

“134-XS and 134-S Series Compressors ECONomizer (EA-12-03-E),” 134-XS and 134-S series—Application and Maintenance Manual, Technical report EA1203E, RefComp Refrigerant Compressors, undated but believed to be publicly available at least as early as Mar. 2014 (4 pages).

(Continued)


Primary Examiner — Lionel Nouketcha

(74) *Attorney, Agent, or Firm* — Neal, Gerber & Eisenberg LLP; Thomas E. Williams

(57) **ABSTRACT**

An embodiment of the instant disclosure comprises a reversible heat pump and water heating system for conditioning a space and heating water. The system comprises a refrigerant circuit that includes a compressor, a source heat exchanger, a space heat exchanger, and an expansion device. A 4-way reversing valve alternates between heating and cooling modes of operation. The system includes a heat exchanger for heating water in the water heating loop, and a 3-way valve that either actuates the refrigerant flow through the water heater heat exchanger or bypasses at least a portion of the refrigerant flow around the water heater heat exchanger. The heat pump system is operable in at least five modes—space heating only, space cooling only, water heating only, and either space heating or space cooling combined with water heating. Use of a modulating 3-way valve allows the amount of the refrigerant flow through the water heating

(Continued)

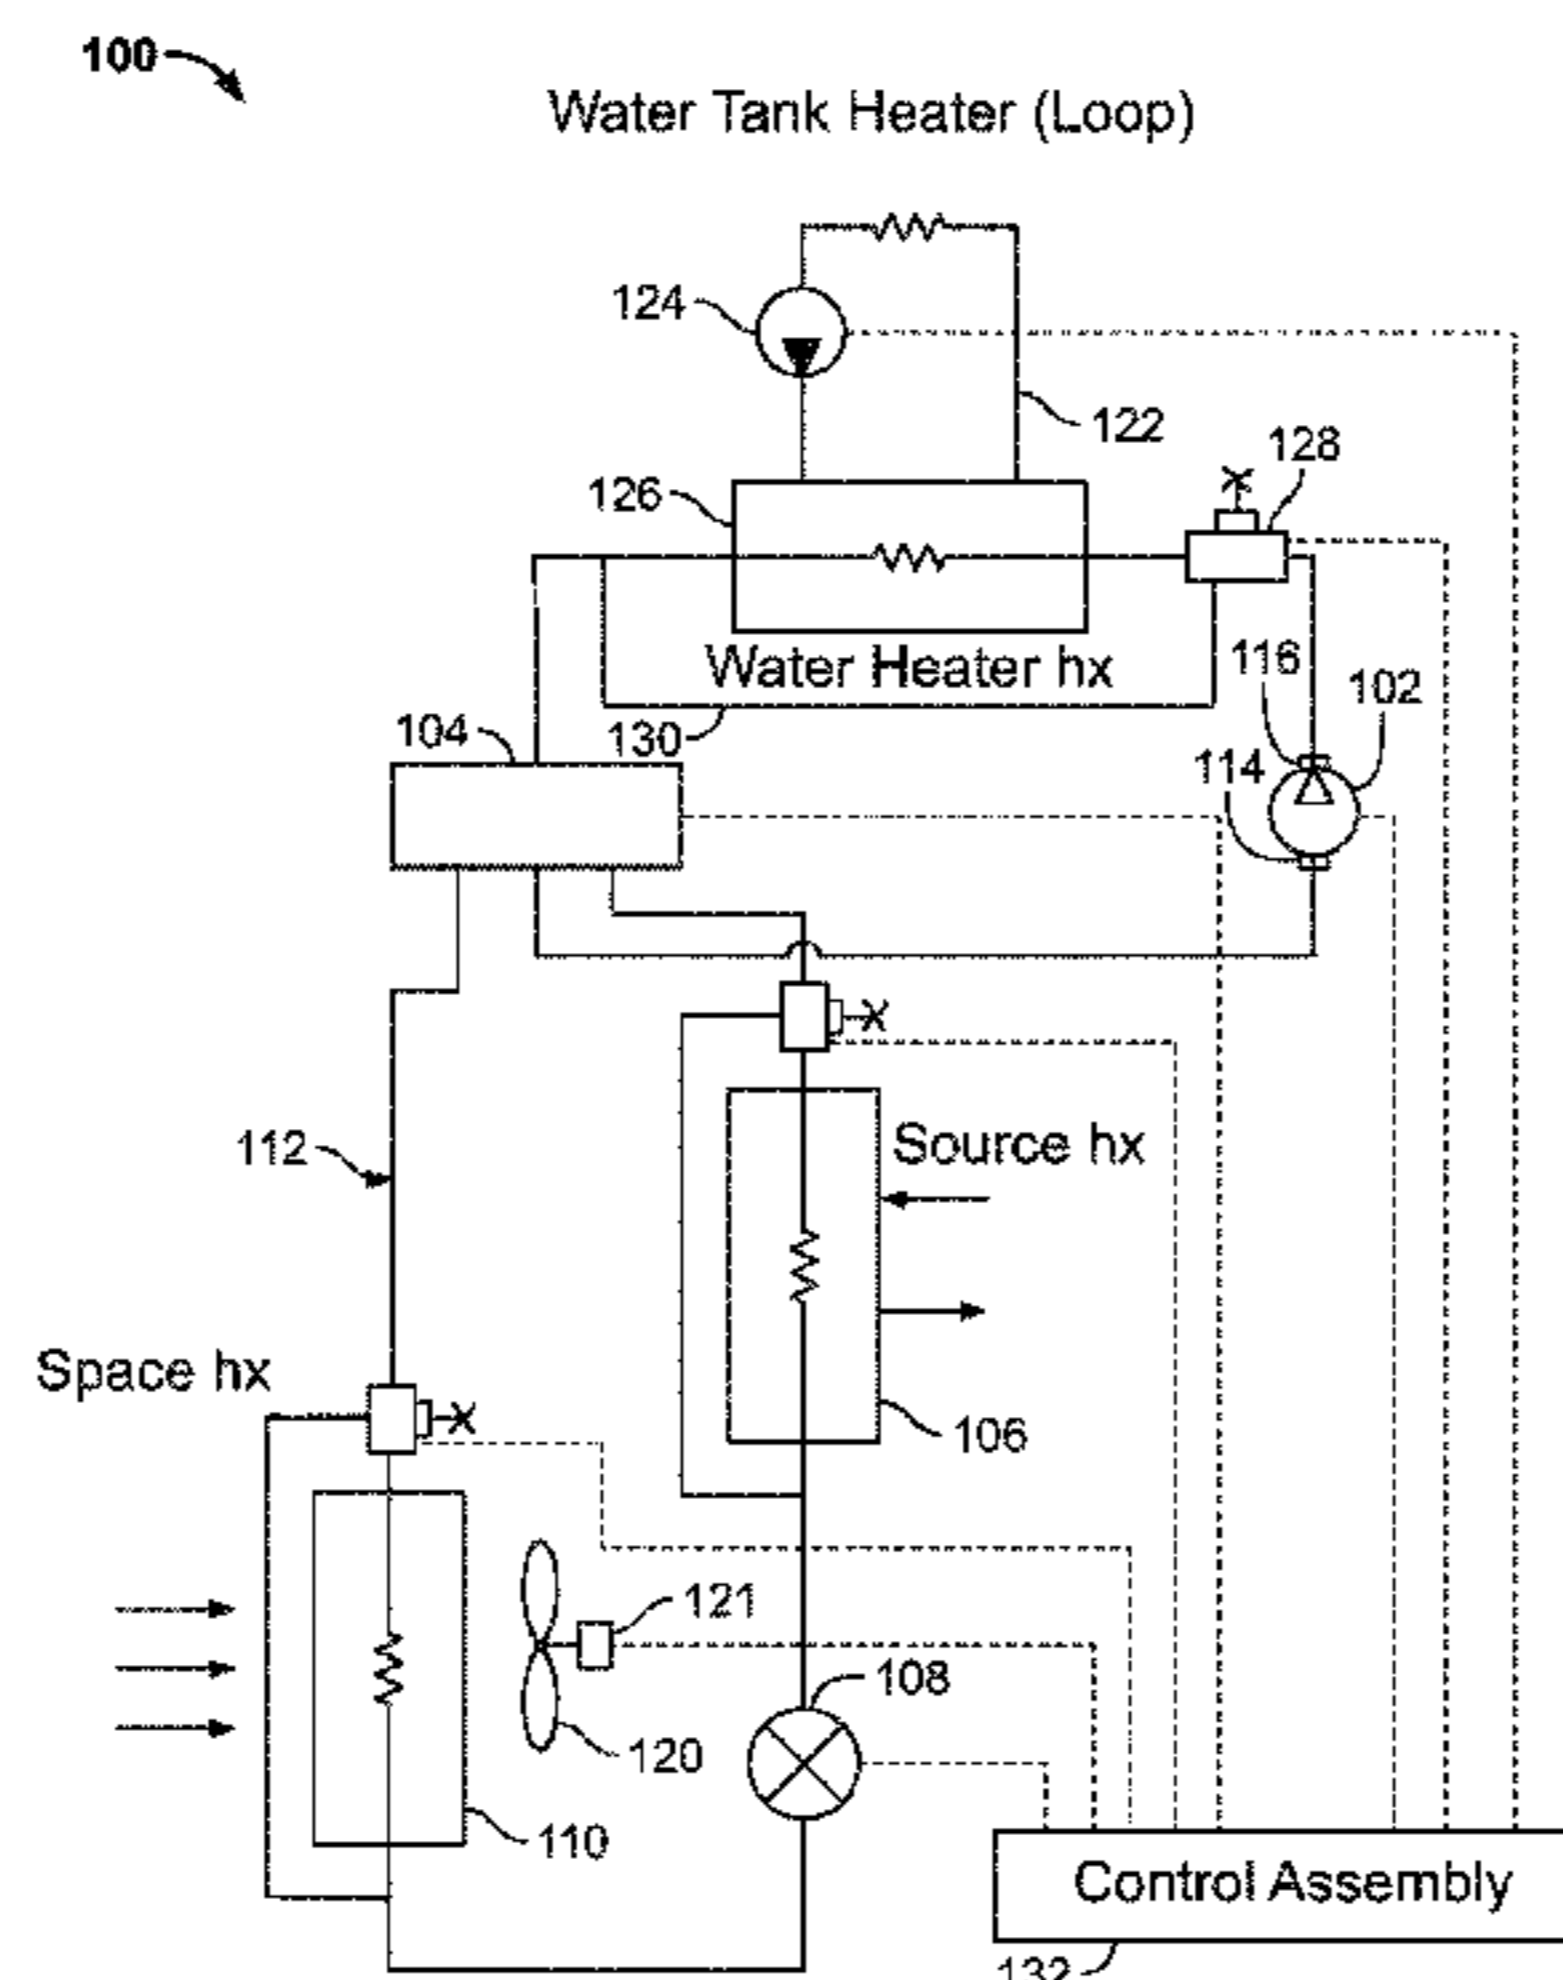

heat exchanger to be adjusted to precisely match space conditioning and water heating demands and stable operation of the heat pump system. Either of the space and source heat exchangers may be bypassed and deactivated to reduce the heat pump system power consumption.

15 Claims, 7 Drawing Sheets

Related U.S. Application Data

- (60) Provisional application No. 62/359,798, filed on Jul. 8, 2016.
- (51) **Int. Cl.**
F25B 6/04 (2006.01)
F25B 41/20 (2021.01)
- (52) **U.S. Cl.**
 CPC *F25B 2313/0233* (2013.01); *F25B 2313/02321* (2013.01); *F25B 2339/047* (2013.01); *F25B 2400/0403* (2013.01); *F25B 2600/2501* (2013.01)

(56) **References Cited**

U.S. PATENT DOCUMENTS

3,938,352 A	2/1976	Schmidt
4,072,187 A	2/1978	Lodge
4,173,865 A	11/1979	Sawyer
4,179,894 A	12/1979	Hughes
4,299,098 A	11/1981	Derosier
4,399,664 A	8/1983	Derosier
4,441,901 A	4/1984	Endoh
4,493,193 A	1/1985	Fisher
4,528,822 A	7/1985	Glamm
4,538,418 A	9/1985	Lawrence et al.
4,575,001 A	3/1986	Oskarsson et al.
4,592,206 A	6/1986	Yamazaki et al.
4,598,557 A	7/1986	Robinson et al.
4,645,908 A	2/1987	Jones
4,646,538 A	3/1987	Blackshaw et al.
4,685,307 A	8/1987	Jones
4,693,089 A	9/1987	Bourne et al.
4,698,978 A	10/1987	Jones
4,727,727 A	3/1988	Reedy
4,766,734 A	8/1988	Dudley
4,776,180 A	10/1988	Patton et al.
4,796,437 A	1/1989	James
4,798,059 A	1/1989	Morita
4,799,363 A	1/1989	Nakamura
4,835,976 A	6/1989	Torrence
4,856,578 A	8/1989	McCahill
4,893,476 A	1/1990	Bos et al.
4,909,041 A	3/1990	Jones
4,920,757 A	5/1990	Gazes et al.
4,924,681 A	5/1990	De Vit et al.
4,938,032 A	7/1990	Mudford
5,038,580 A	8/1991	Hart
5,044,425 A	9/1991	Tatsumi et al.
5,081,848 A	1/1992	Rawlings et al.
5,088,296 A	2/1992	Hamaoka
5,099,651 A	3/1992	Fischer
5,105,629 A	4/1992	Parris et al.
5,136,855 A	8/1992	Lenarduzzi
5,172,564 A	12/1992	Reedy
5,187,944 A	2/1993	Jarosch
5,224,357 A	7/1993	Galiyano et al.
5,269,153 A	12/1993	Cawley
5,305,822 A	4/1994	Kogetsu et al.
5,309,732 A	5/1994	Sami
5,323,844 A	6/1994	Sumitani et al.
5,339,890 A	8/1994	Rawlings
5,355,688 A	10/1994	Rafalovich et al.

5,372,016 A	12/1994	Rawlings
5,438,846 A	8/1995	Datta
5,461,876 A	10/1995	Dressier
5,465,588 A	11/1995	McCahill et al.
5,477,914 A	12/1995	Rawlings
5,497,629 A	3/1996	Rafalovich et al.
5,507,337 A	4/1996	Rafalovich et al.
5,533,355 A	7/1996	Rawlings
5,564,282 A	10/1996	Kaye
5,613,372 A	3/1997	Beal et al.
5,619,864 A	4/1997	Reedy
5,628,200 A	5/1997	Pendergrass
5,651,265 A	7/1997	Grenier
5,669,224 A	9/1997	Lenarduzzi
5,689,966 A	11/1997	Zess et al.
5,729,985 A	3/1998	Yoshihara et al.
5,758,514 A	6/1998	Genung et al.
5,802,864 A	9/1998	Yarbrough et al.
5,927,088 A	7/1999	Shaw
6,032,472 A	3/2000	Heinrichs et al.
6,070,423 A	6/2000	Hebert
6,082,125 A	7/2000	Savtchenko
6,123,147 A	9/2000	Pittman
6,149,066 A	11/2000	Perry et al.
6,167,715 B1	1/2001	Hebert
6,212,892 B1	4/2001	Rafalovich
6,227,003 B1	5/2001	Smolinsky
6,253,564 B1	7/2001	Yarbrough et al.
6,347,527 B1	2/2002	Bailey et al.
6,385,983 B1	5/2002	Sakki et al.
6,418,745 B1	7/2002	Ratliff
6,434,960 B1	8/2002	Rousseau
6,474,087 B1	11/2002	Lifson
6,536,221 B2	3/2003	James
6,655,164 B2	12/2003	Rogstam
6,662,864 B2	12/2003	Burk et al.
6,668,572 B1	12/2003	Seo et al.
6,694,750 B1	2/2004	Lifson et al.
6,729,151 B1	5/2004	Thompson
6,751,972 B1	6/2004	Jungwirth
6,804,975 B2	10/2004	Park
6,817,205 B1	11/2004	Lifson et al.
6,826,921 B1	12/2004	Uselton
6,857,285 B2	2/2005	Hebert
6,892,553 B1	5/2005	Lifson et al.
6,915,656 B2	7/2005	Ratliff
6,931,879 B1	8/2005	Wiggs
6,938,438 B2	9/2005	Lifson et al.
6,941,770 B1	9/2005	Taras et al.
7,000,423 B2	2/2006	Lifson et al.
7,059,151 B2	6/2006	Taras et al.
7,114,349 B2	10/2006	Lifson et al.
7,150,160 B2	12/2006	Herbert
7,155,922 B2	1/2007	Harmon et al.
7,185,505 B2	3/2007	Kamimura
RE39,597 E	5/2007	Rousseau
7,210,303 B2	5/2007	Zhang et al.
7,228,707 B2	6/2007	Lifson et al.
7,234,311 B2	6/2007	Lifson et al.
7,254,955 B2	8/2007	Otake et al.
7,263,848 B2	9/2007	Bhatti
7,272,948 B2	9/2007	Taras et al.
7,275,385 B2	10/2007	Abel et al.
7,325,414 B2	2/2008	Taras et al.
7,454,919 B2	11/2008	Ookoshi et al.
7,484,374 B2	2/2009	Pham et al.
7,617,697 B2	11/2009	McCaughan
7,654,104 B2	2/2010	Groll et al.
7,716,943 B2	5/2010	Seefeldt
7,770,405 B1	8/2010	Dillon
7,823,404 B2	11/2010	Hanson
7,845,190 B2	12/2010	Pearson
7,854,137 B2	12/2010	Lifson et al.
7,856,834 B2	12/2010	Haley
7,913,501 B2	3/2011	Ellis et al.
7,937,960 B2	5/2011	Matsui
7,958,737 B2	6/2011	Lifson et al.
7,975,495 B2	7/2011	Voorhis et al.
7,975,506 B2	7/2011	James et al.

(56)

References Cited

U.S. PATENT DOCUMENTS

7,997,092 B2	8/2011	Lifson et al.	2011/0061413 A1	3/2011	Setoguchi
8,037,713 B2	10/2011	Haley et al.	2011/0079032 A1	4/2011	Taras et al.
8,074,459 B2	12/2011	Murakami et al.	2011/0088426 A1	4/2011	Lochtefeld
8,079,228 B2	12/2011	Lifson et al.	2011/0094248 A1	4/2011	Taras et al.
8,079,229 B2	12/2011	Lifson et al.	2011/0094259 A1	4/2011	Lifson et al.
8,082,751 B2	12/2011	Wiggs	2011/0132007 A1	6/2011	Weyna et al.
8,136,364 B2	3/2012	Lifson et al.	2011/0174014 A1	7/2011	Scarcella et al.
8,191,376 B2	6/2012	Fox et al.	2011/0203299 A1	8/2011	Jing et al.
8,220,531 B2	7/2012	Murakami et al.	2011/0209490 A1	9/2011	Mijanovic et al.
8,286,438 B2	10/2012	McCahill	2011/0259025 A1	10/2011	Noh et al.
8,418,482 B2	4/2013	Bush et al.	2011/0289950 A1	12/2011	Kim et al.
8,418,486 B2	4/2013	Taras et al.	2011/0289952 A1	12/2011	Kim et al.
8,424,326 B2	4/2013	Mitra et al.	2012/0011866 A1	1/2012	Scarcella et al.
8,459,052 B2	6/2013	Bush et al.	2012/0067965 A1	3/2012	Rajasekaran et al.
8,528,359 B2	9/2013	Lifson et al.	2012/0103005 A1	5/2012	Kopko et al.
8,561,425 B2	10/2013	Mitra et al.	2012/0198867 A1	8/2012	Ng et al.
8,650,893 B2	2/2014	Hanson	2012/0205077 A1	8/2012	Zinger et al.
8,733,429 B2	5/2014	Harrison et al.	2012/0247134 A1	10/2012	Gurin
8,756,943 B2	6/2014	Chen et al.	2012/0291460 A1	11/2012	Aoyagi
8,769,982 B2	7/2014	Ignatiev et al.	2013/0014451 A1	1/2013	Russell et al.
8,984,903 B2	3/2015	Itoh et al.	2013/0031934 A1	2/2013	Huff et al.
9,052,125 B1	6/2015	Dostal	2013/0098085 A1	4/2013	Judge et al.
9,562,700 B2	2/2017	Watanabe	2013/0104574 A1	5/2013	Dempsey et al.
10,072,856 B1	9/2018	Akin et al.	2013/0180266 A1	7/2013	Bois
10,118,462 B2	11/2018	Kohigashi et al.	2013/0269378 A1	10/2013	Wong
10,119,738 B2	11/2018	Hammond et al.	2013/0305756 A1	11/2013	Gomes et al.
10,345,004 B1	7/2019	Hern et al.	2014/0013782 A1	1/2014	Kopko et al.
10,753,661 B2	8/2020	Hammond et al.	2014/0013788 A1	1/2014	Kopko et al.
10,866,002 B2	12/2020	Taras et al.	2014/0033753 A1	2/2014	Lu et al.
10,871,314 B2	12/2020	Taras et al.	2014/0033755 A1	2/2014	Wong
10,935,260 B2	3/2021	Taras et al.	2014/0053585 A1	2/2014	Huff
2003/0061822 A1	4/2003	Rafalovich	2014/0060101 A1	3/2014	Styles et al.
2003/0221436 A1	12/2003	Xu	2014/0123689 A1	5/2014	Ellis et al.
2003/0221445 A1	12/2003	Smolinsky	2014/0245770 A1	9/2014	Chen et al.
2006/0010908 A1	1/2006	Taras et al.	2014/0260392 A1	9/2014	Hawkins et al.
2006/0218949 A1	10/2006	Ellis et al.	2015/0052937 A1	2/2015	Hung
2006/0225445 A1	10/2006	Lifson et al.	2015/0059373 A1	3/2015	Maiello et al.
2007/0074536 A1	4/2007	Bai	2015/0204586 A1	7/2015	Burg et al.
2007/0289319 A1	12/2007	Kim et al.	2015/0285539 A1	10/2015	Kopko
2007/0295477 A1	12/2007	Mueller et al.	2017/0010029 A9	1/2017	Reytblat et al.
2008/0016895 A1	1/2008	Kim et al.	2017/0227250 A1	8/2017	Karamanos
2008/0041072 A1	2/2008	Seefeldt	2018/0010829 A1	1/2018	Taras et al.
2008/0173034 A1	7/2008	Shaw	2018/0128506 A1	5/2018	Taras et al.
2008/0196418 A1	8/2008	Lifson et al.	2018/0313555 A1	11/2018	Henderson
2008/0197206 A1	8/2008	Murakami et al.	2019/0032981 A1	1/2019	Hammond et al.
2008/0209930 A1	9/2008	Taras et al.	2019/0178509 A1	6/2019	Taras et al.
2008/0256975 A1	10/2008	Lifson et al.	2020/0072510 A1	3/2020	Brown
2008/0282718 A1	11/2008	Beagle	2020/0378667 A1	12/2020	Hammond et al.
2008/0296396 A1	12/2008	Corroy et al.	2021/0018234 A1	1/2021	Lingrey et al.
2008/0302113 A1	12/2008	Yin et al.	2021/0095872 A1	4/2021	Taras et al.
2008/0302118 A1	12/2008	Chen et al.	2021/0180807 A1	6/2021	Taras et al.
2008/0302129 A1	12/2008	Mosemann et al.			
2008/0307813 A1	12/2008	Lifson et al.			
2009/0000611 A1	1/2009	Kaiser			
2009/0107656 A1	4/2009	Marois			
2009/0208331 A1	8/2009	Haley et al.			
2009/0294097 A1	12/2009	Rini et al.			
2009/0314014 A1	12/2009	Ericsson			
2010/0005821 A1	1/2010	McCahill			
2010/0005831 A1	1/2010	Vaisman et al.			
2010/0024470 A1	2/2010	Lifson et al.			
2010/0058781 A1	3/2010	Lifson et al.			
2010/0064710 A1	3/2010	Slaughter			
2010/0064722 A1	3/2010	Taras			
2010/0077788 A1	4/2010	Lewis			
2010/0114384 A1	5/2010	Maxwell			
2010/0132399 A1	6/2010	Mitra et al.			
2010/0199715 A1	8/2010	Lifson et al.			
2010/0251750 A1	10/2010	Lifson et al.			
2010/0281894 A1	11/2010	Huff			
2010/0287969 A1	11/2010	Ueda et al.			
2010/0326100 A1	12/2010	Taras et al.			
2011/0023515 A1	2/2011	Kopko et al.			
2011/0036119 A1	2/2011	Fujimoto et al.			
2011/0041523 A1	2/2011	Taras et al.			

FOREIGN PATENT DOCUMENTS

CN	201944952 U	8/2011
CN	102353126 A	2/2012
CN	203231582 U	10/2013
CN	103471275 A	12/2013
CN	203396155 U	1/2014
CN	203432025 U	2/2014
EP	134015	3/1985
EP	1983275 A1	10/2008
JP	2000046417	2/2000
JP	2000274786	10/2000
JP	2000314563	11/2000
JP	2001248931	9/2001
KR	100963221 B1	6/2010
WO	9600370	1/1996
WO	2001/90663	11/2001
WO	2006/033782	3/2006
WO	2008/045086	4/2008
WO	2008/048252	4/2008
WO	2010/005918	1/2010
WO	2010/054498	5/2010
WO	2010/104709	9/2010
WO	2013/142760	9/2013

(56)

References Cited

FOREIGN PATENT DOCUMENTS

WO 2014/031559 A1 2/2014
 WO 2014/031708 A1 2/2014

OTHER PUBLICATIONS

“Economized Vapor Injection (EVI) Compressors,” Emerson Climate Technologies Application Engineering Bulletin AE4-1327 R2, Revised Sep. 2006 (9 pages).

“Enhanced Vapour Injection (EVI) for ZH*KVE Scroll Compressors,” Emerson Climate Technologies—Technical Information, C7.4.3/1107-0512/E, May 2012 (10 pages).

“Heat Pump Mechanics” <http://www.geo4va.vt.edu/A3/A3.htm#A3sec3c> (Accessed Apr. 20, 2011) (19 pages).

“Heat pumps in residential and commercial buildings” <http://www.heatpumpcentre.org/en/aboutheatpumps/heatpumpsinresidential/Sidor/default.aspx> (Accessed Apr. 20, 2011) (2 pages).

B.P. Rasmussen et al., “Model-Driven System Identification of Transcritical Vapor Compression Systems,” IEEE Transactions on Control Systems Technology, May 2005, pp. 444-451, vol. 13 (8 pages).

Ekaterina Vi Nogradova, “Economizers in Chiller Systems,” Bachelor’s Thesis, Mikkelin Ammattikorkeakoulu, Nov. 2012 (50 pages).

Haraldsson et al., “Measurement of Performance and Evaluation of a Heat Pump—with Scroll Compressor EVI and Economizer,” Lunds Institute of Technology, 2006 (4 pages).

Honeywell, VFF1, VFF2, VFF3, VFF6 Resilient Seat Butterfly Valves with Flanged Connections Jan. 2013, p. 1, 1st column, last paragraph. (Year: 2013) (20 pages).

International Preliminary Report on Patentability issued in International Application No. PCT/US2013/033433 dated Sep. 23, 2014 (7 Pages).

International Search Report and Written Opinion issued in International Application No. PCT/US2013/033433 dated Aug. 9, 2013 (11 Pages).

John P. Elson et al., “Scroll Technology: An Overview of Past, Present and Future Developments,” International Compressor Engineering Conference, 2008, Paper 1871 (9 pages).

Korean Intellectual Property Office, International Search Report in International Application No. PCT/US2009/049734 (dated Jan. 20, 2010) (2 pages).

Korean Intellectual Property Office, International Search Report in International Application No. PCT/US2010/026010 (dated Sep. 28, 2010) (2 pages).

Lund et al., “Geothermal (Ground-Source Heat Pumps—A World Overview,” GHC Bulletin, Sep. 2004 (edited and updated version of the article from *Renewal Energy World*, (Jul.-Aug. 2003), vol. 6 No. 4) (10 pages).

Michael F. Taras, “Reheat Which Concept is Best,” ASHRAE Journal: 35-40 (Dec. 2004) (7 pages).

Murphy et al., “Air-Source Integrated Heat Pump for Net-Zero-Energy Houses Technology Status Report,” *Oak Ridge National Laboratory*, ORNL-TM-2007-112 (Jul. 2007) (93 pages).

Murphy et al., “Ground-Source Integrated Heat Pump for Net-Zero-Energy Houses Technology Status Report,” *Oak Ridge National Laboratory*, ORNL-TM-2007-177 (Dec. 2007) (78 pages).

Third Party Submission dated Nov. 10, 2014 filed in U.S. Appl. No. 13/848,342 (13 Pages).

Tolga N. Aynur, “Variable Refrigerant Flow Systems: A Review, Energy and Buildings,” Jan. 2010, pp. 1106-1112, vol. 42 (7 pages).

Wei Yang et al., “The Design Method of U-Bend Geothermal Heat Exchanger of DX-GCHP in Cooling Model,” IEEE, 2011, pp. 3635-3637 (English Abstract) (3 pages).

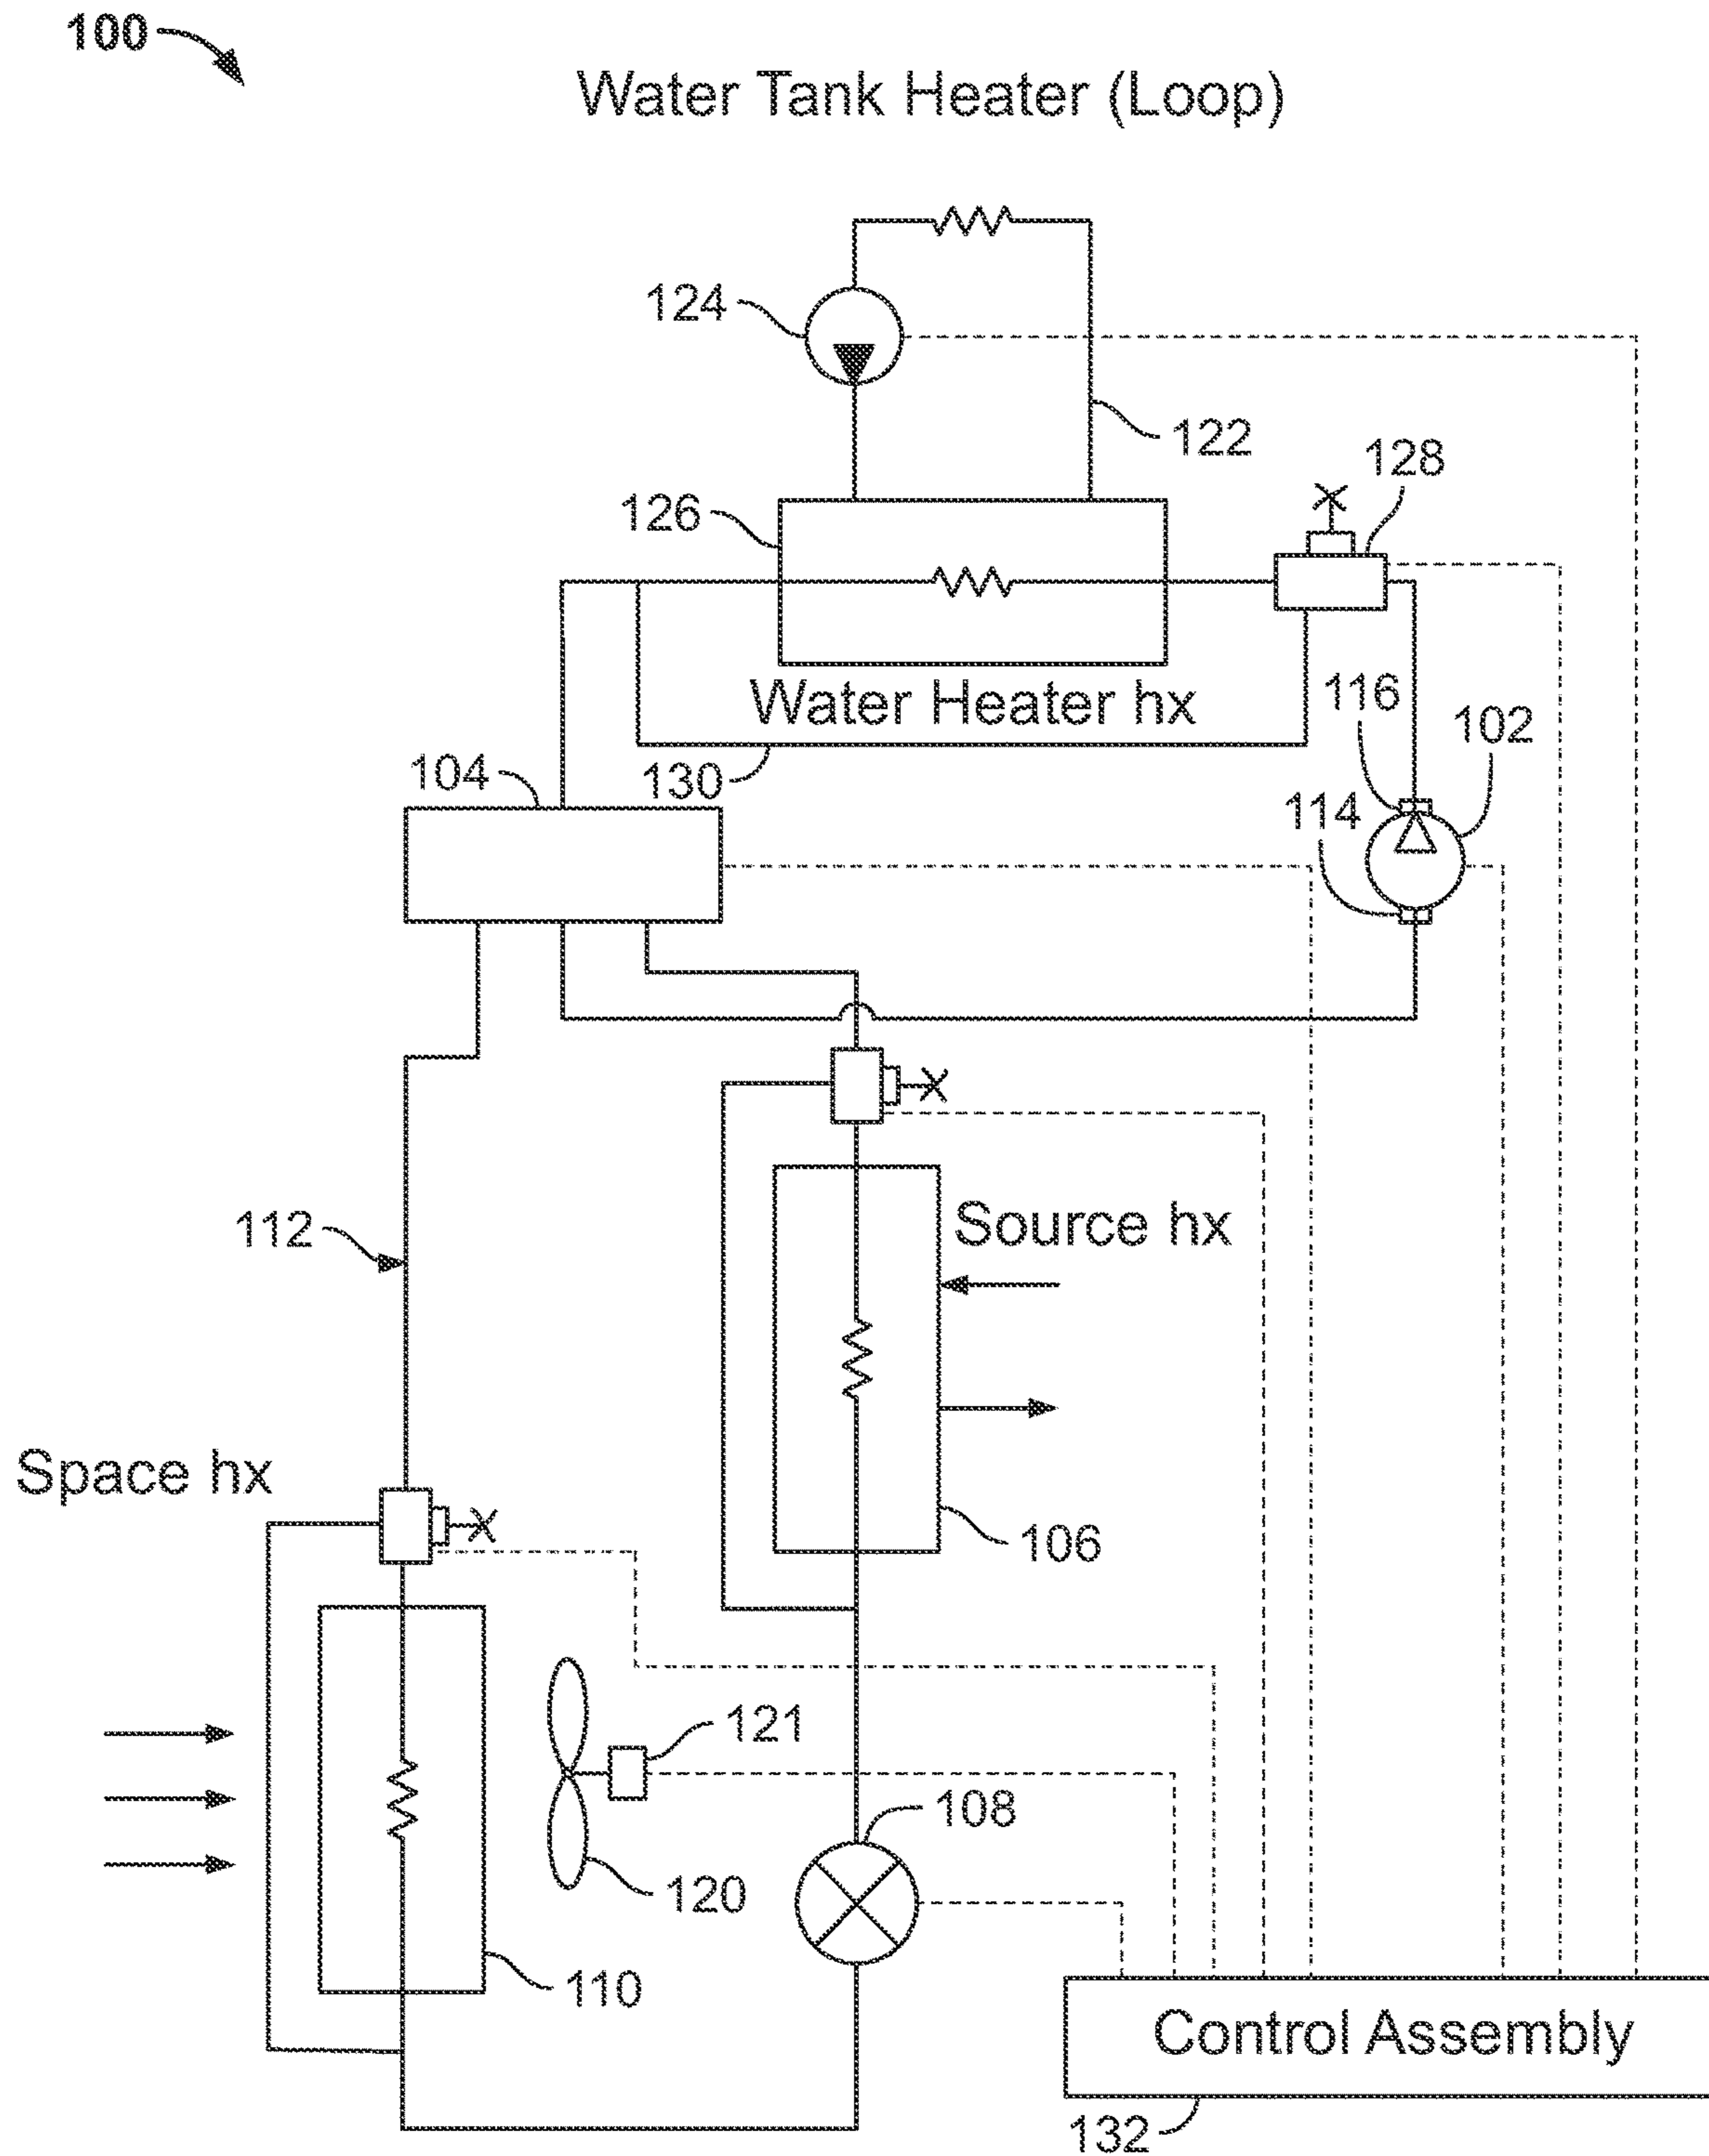


FIG. 1

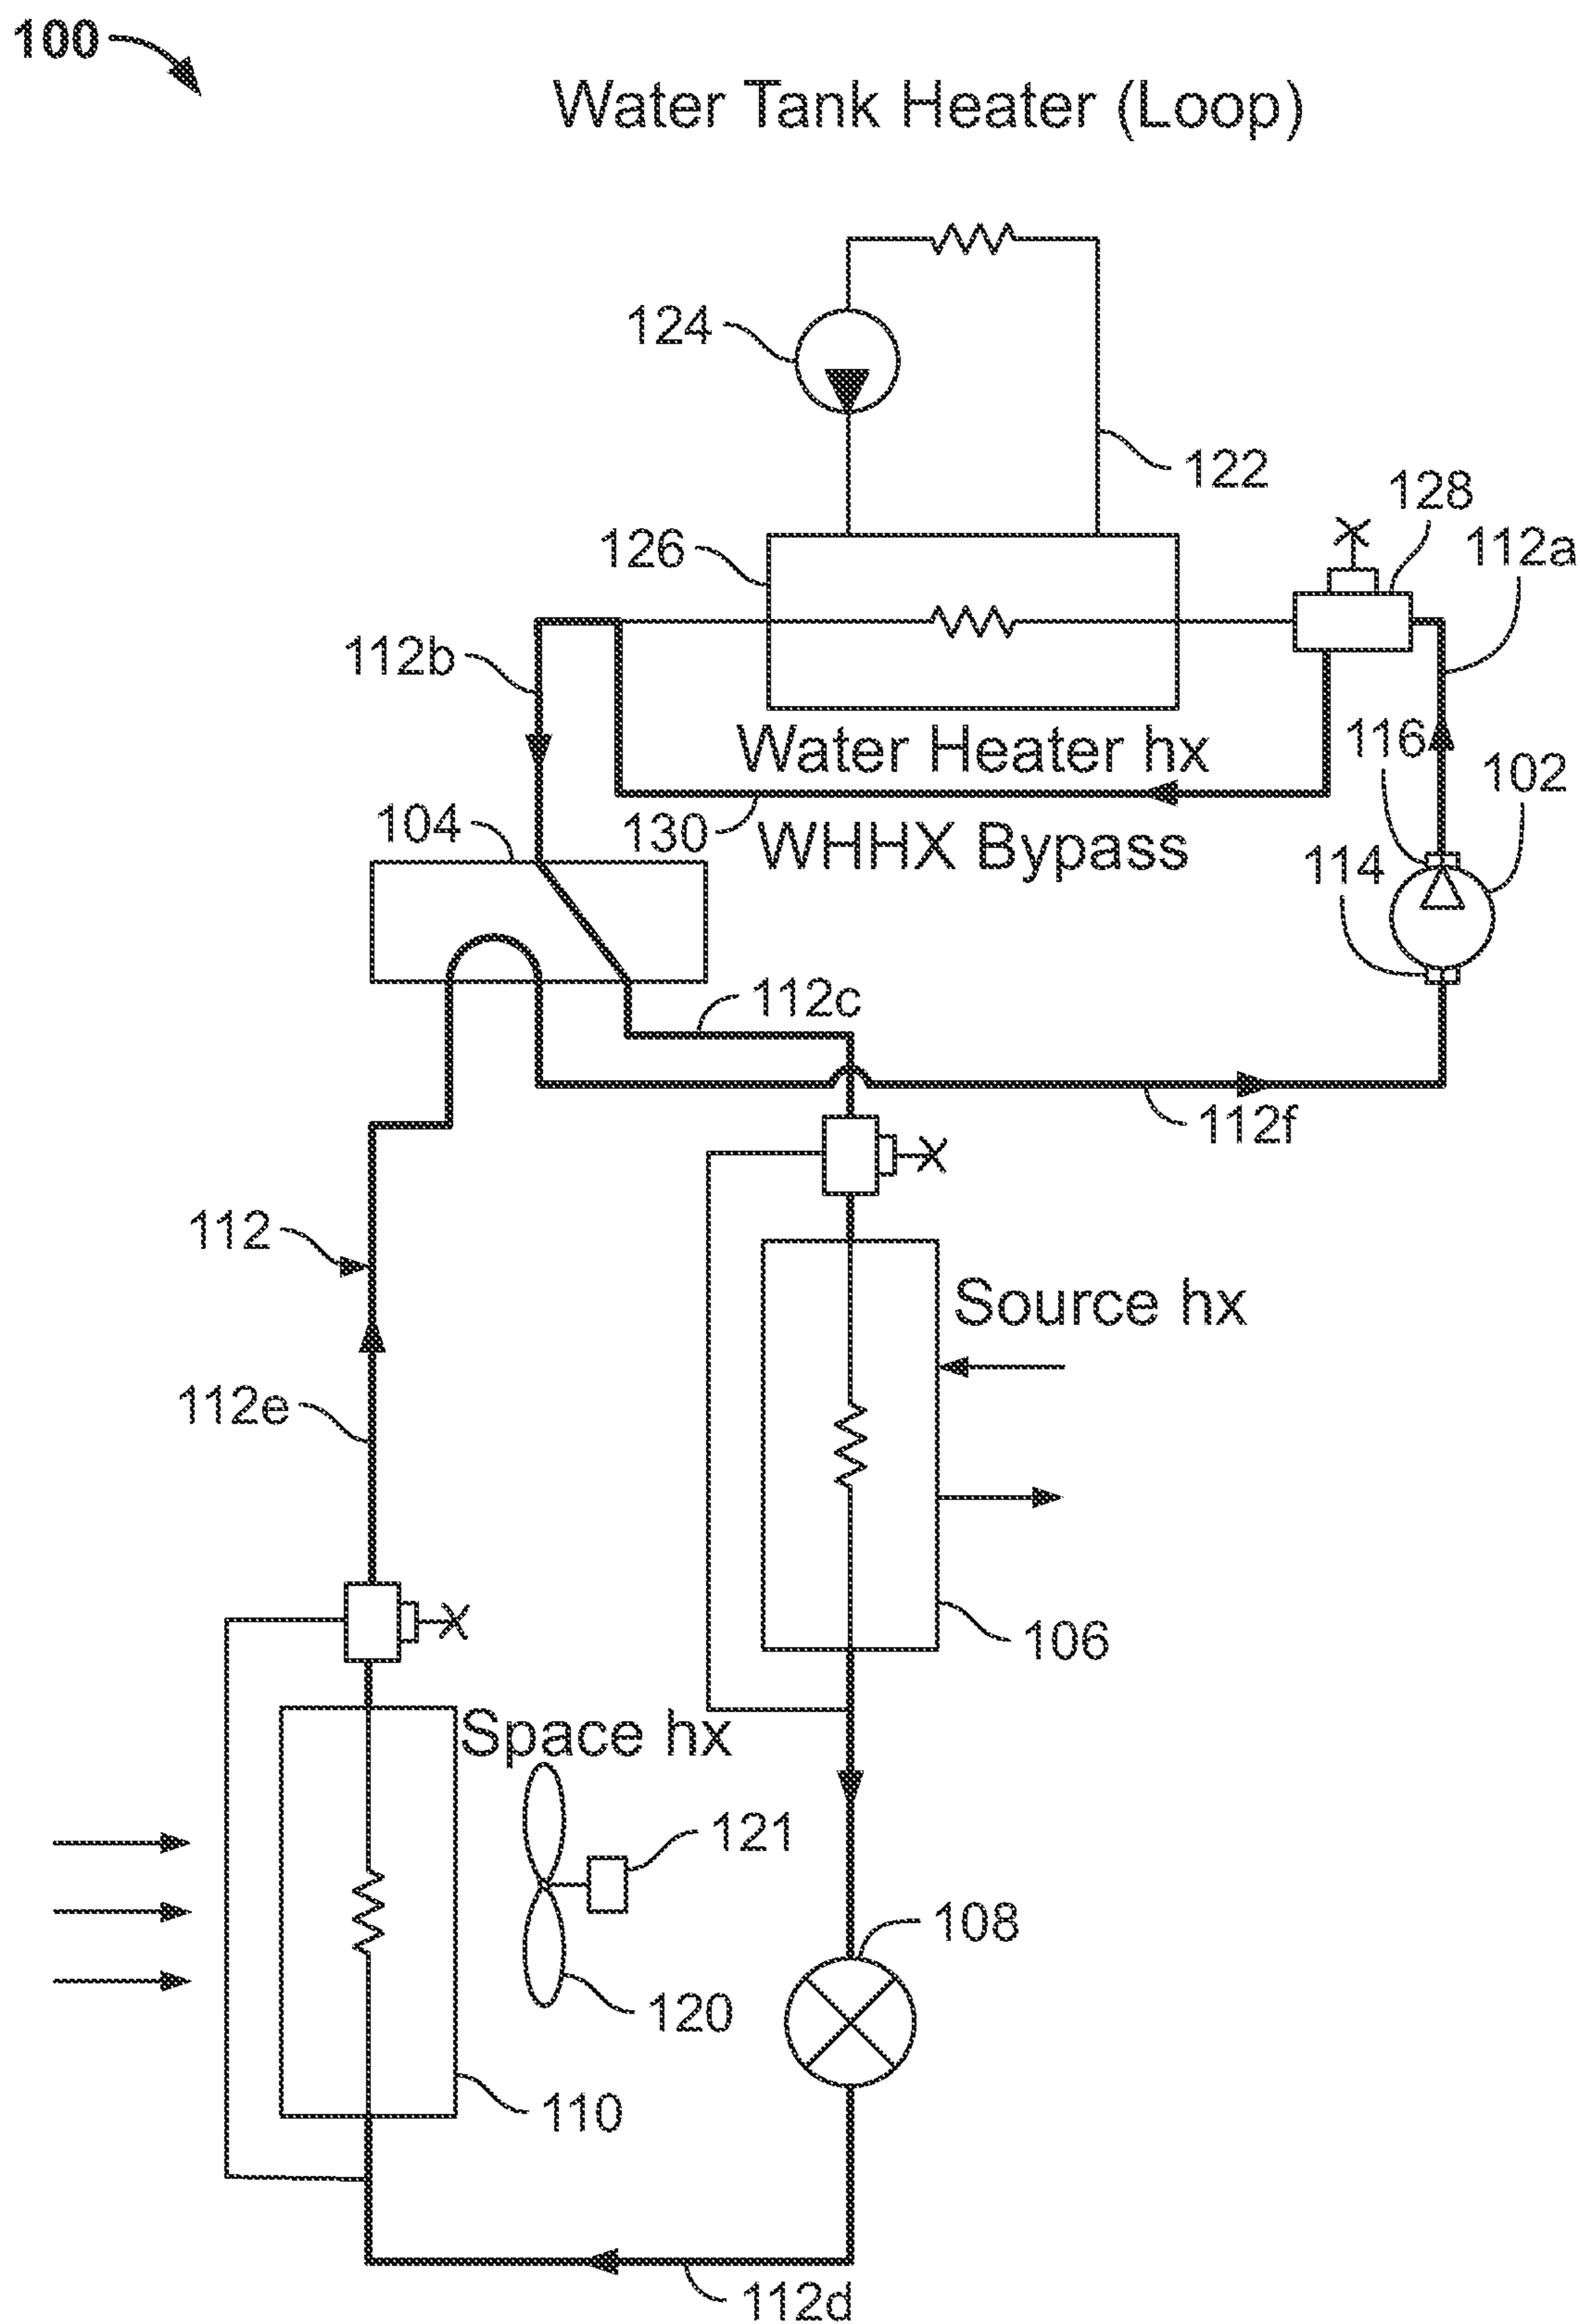


FIG. 2

Water Tank Heater (Loop)

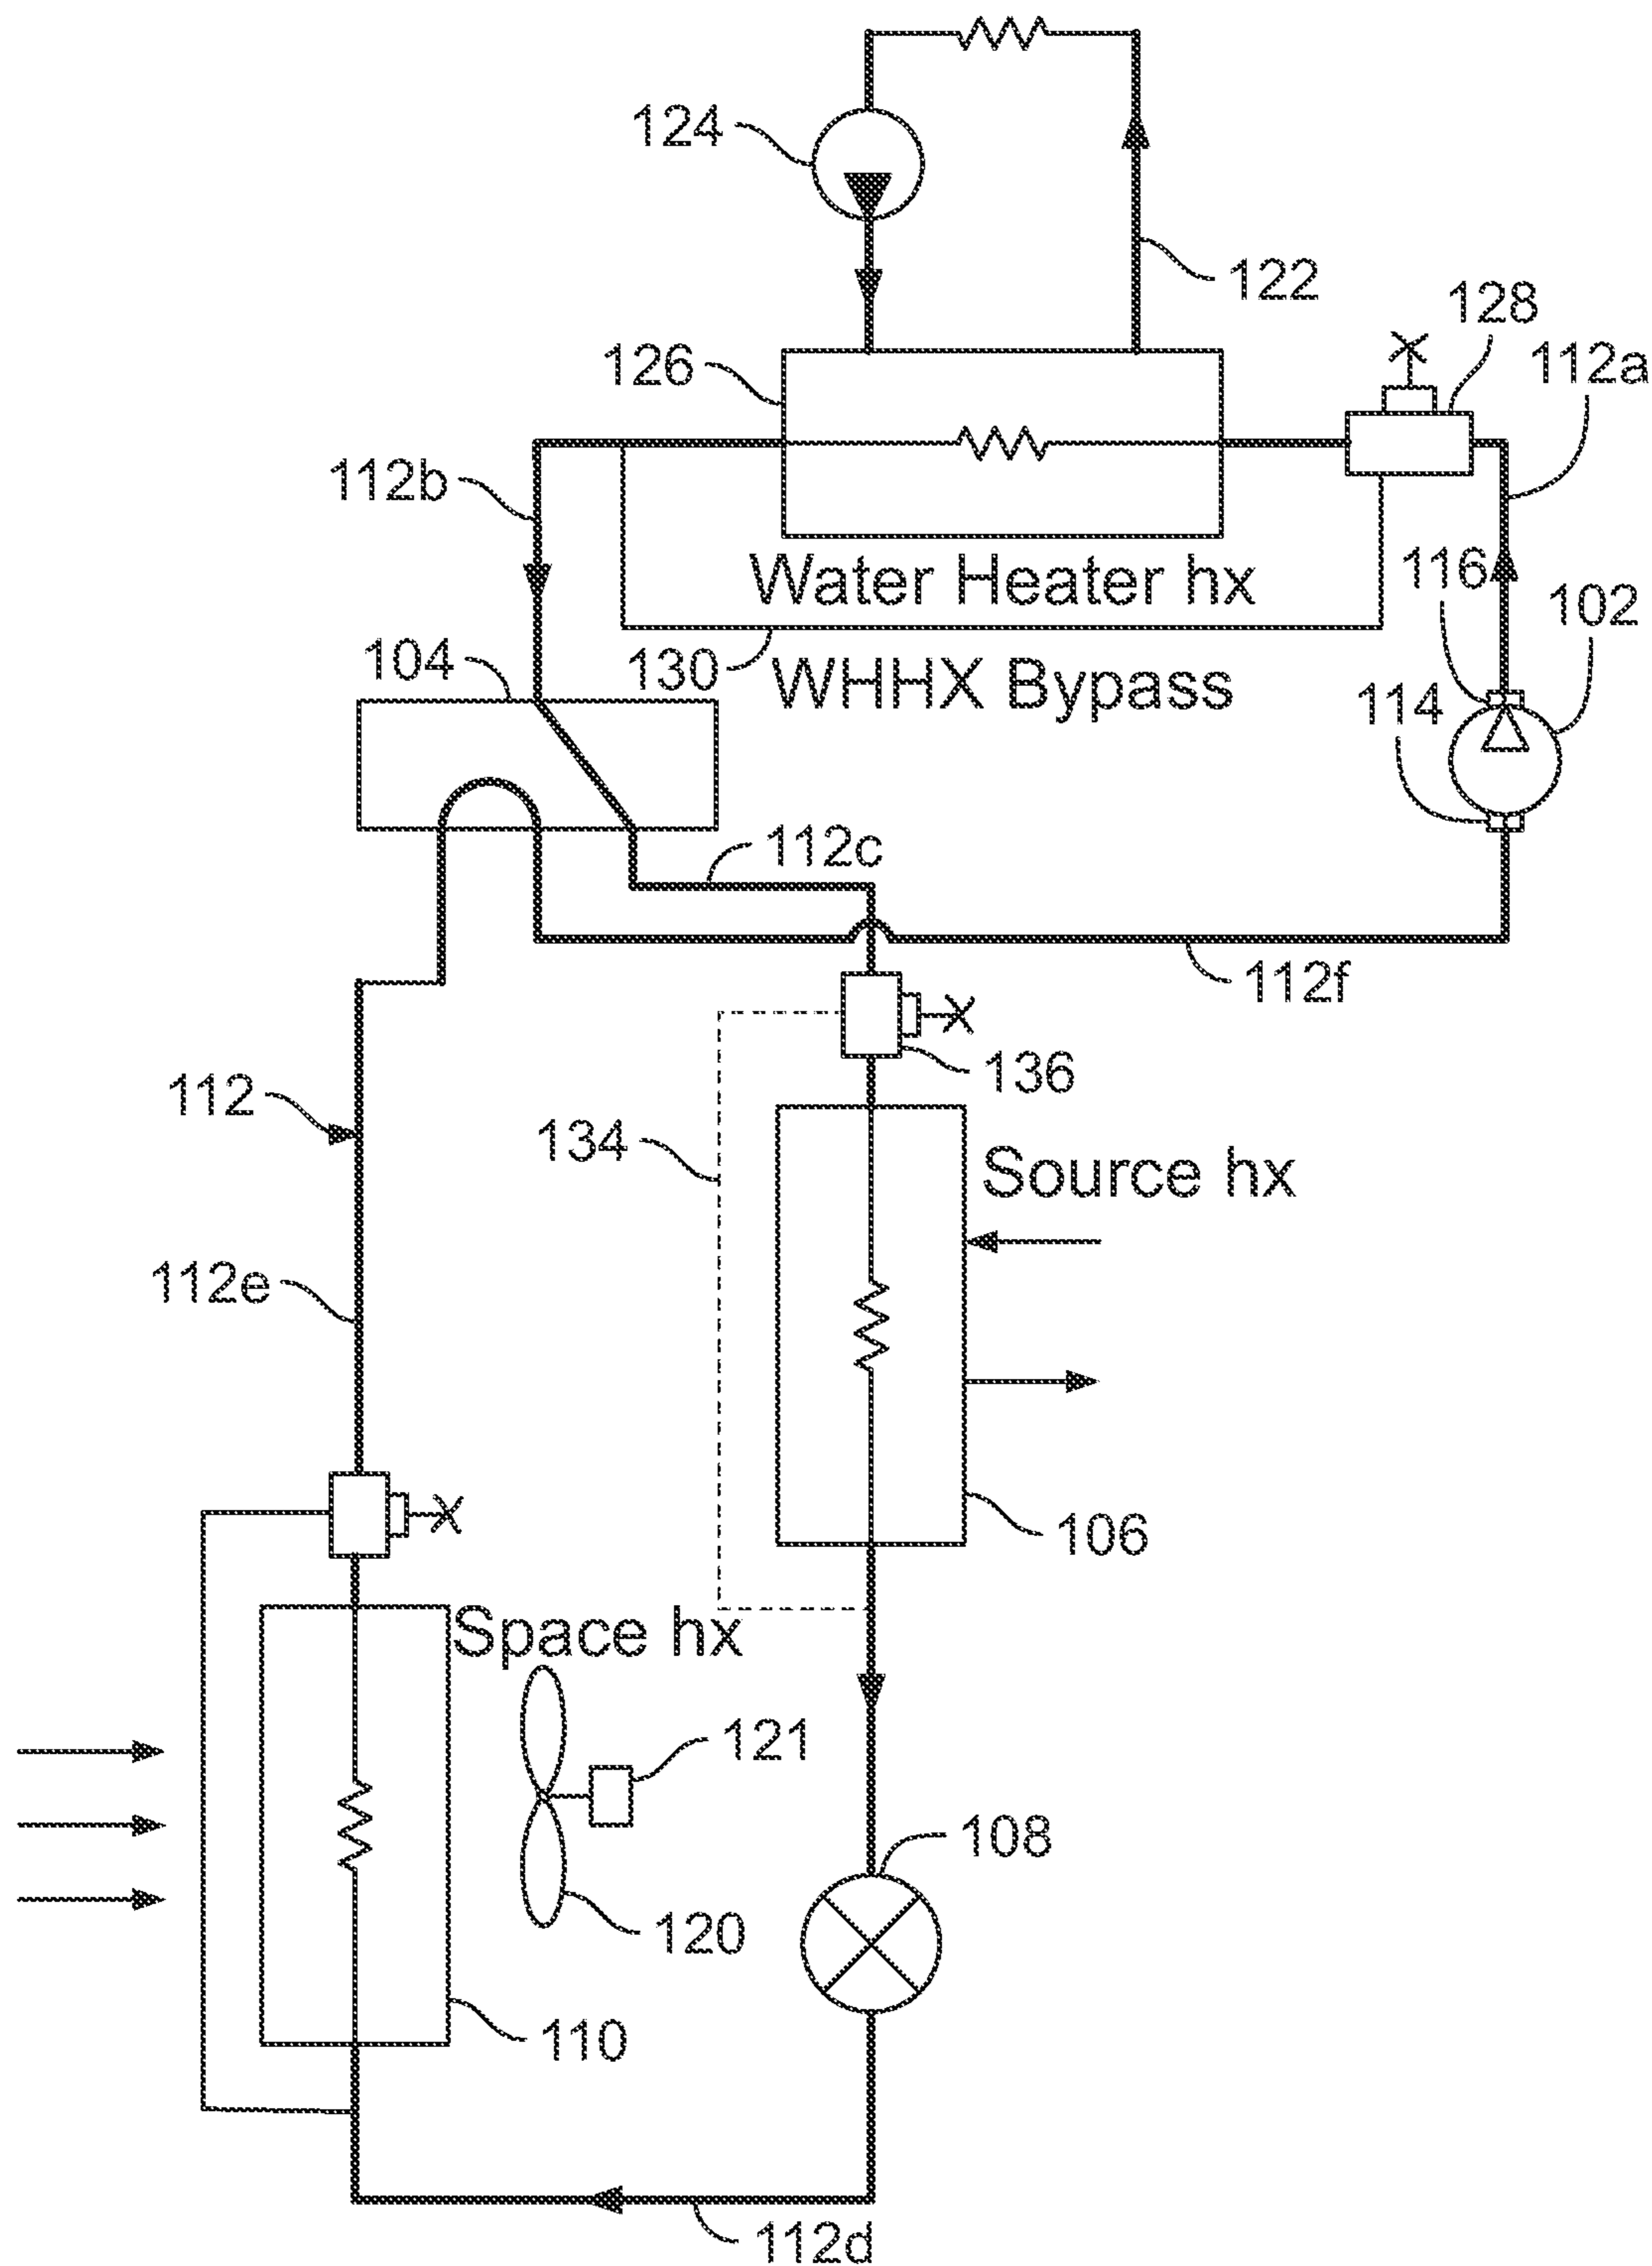


FIG. 3

Water Tank Heater (Loop)

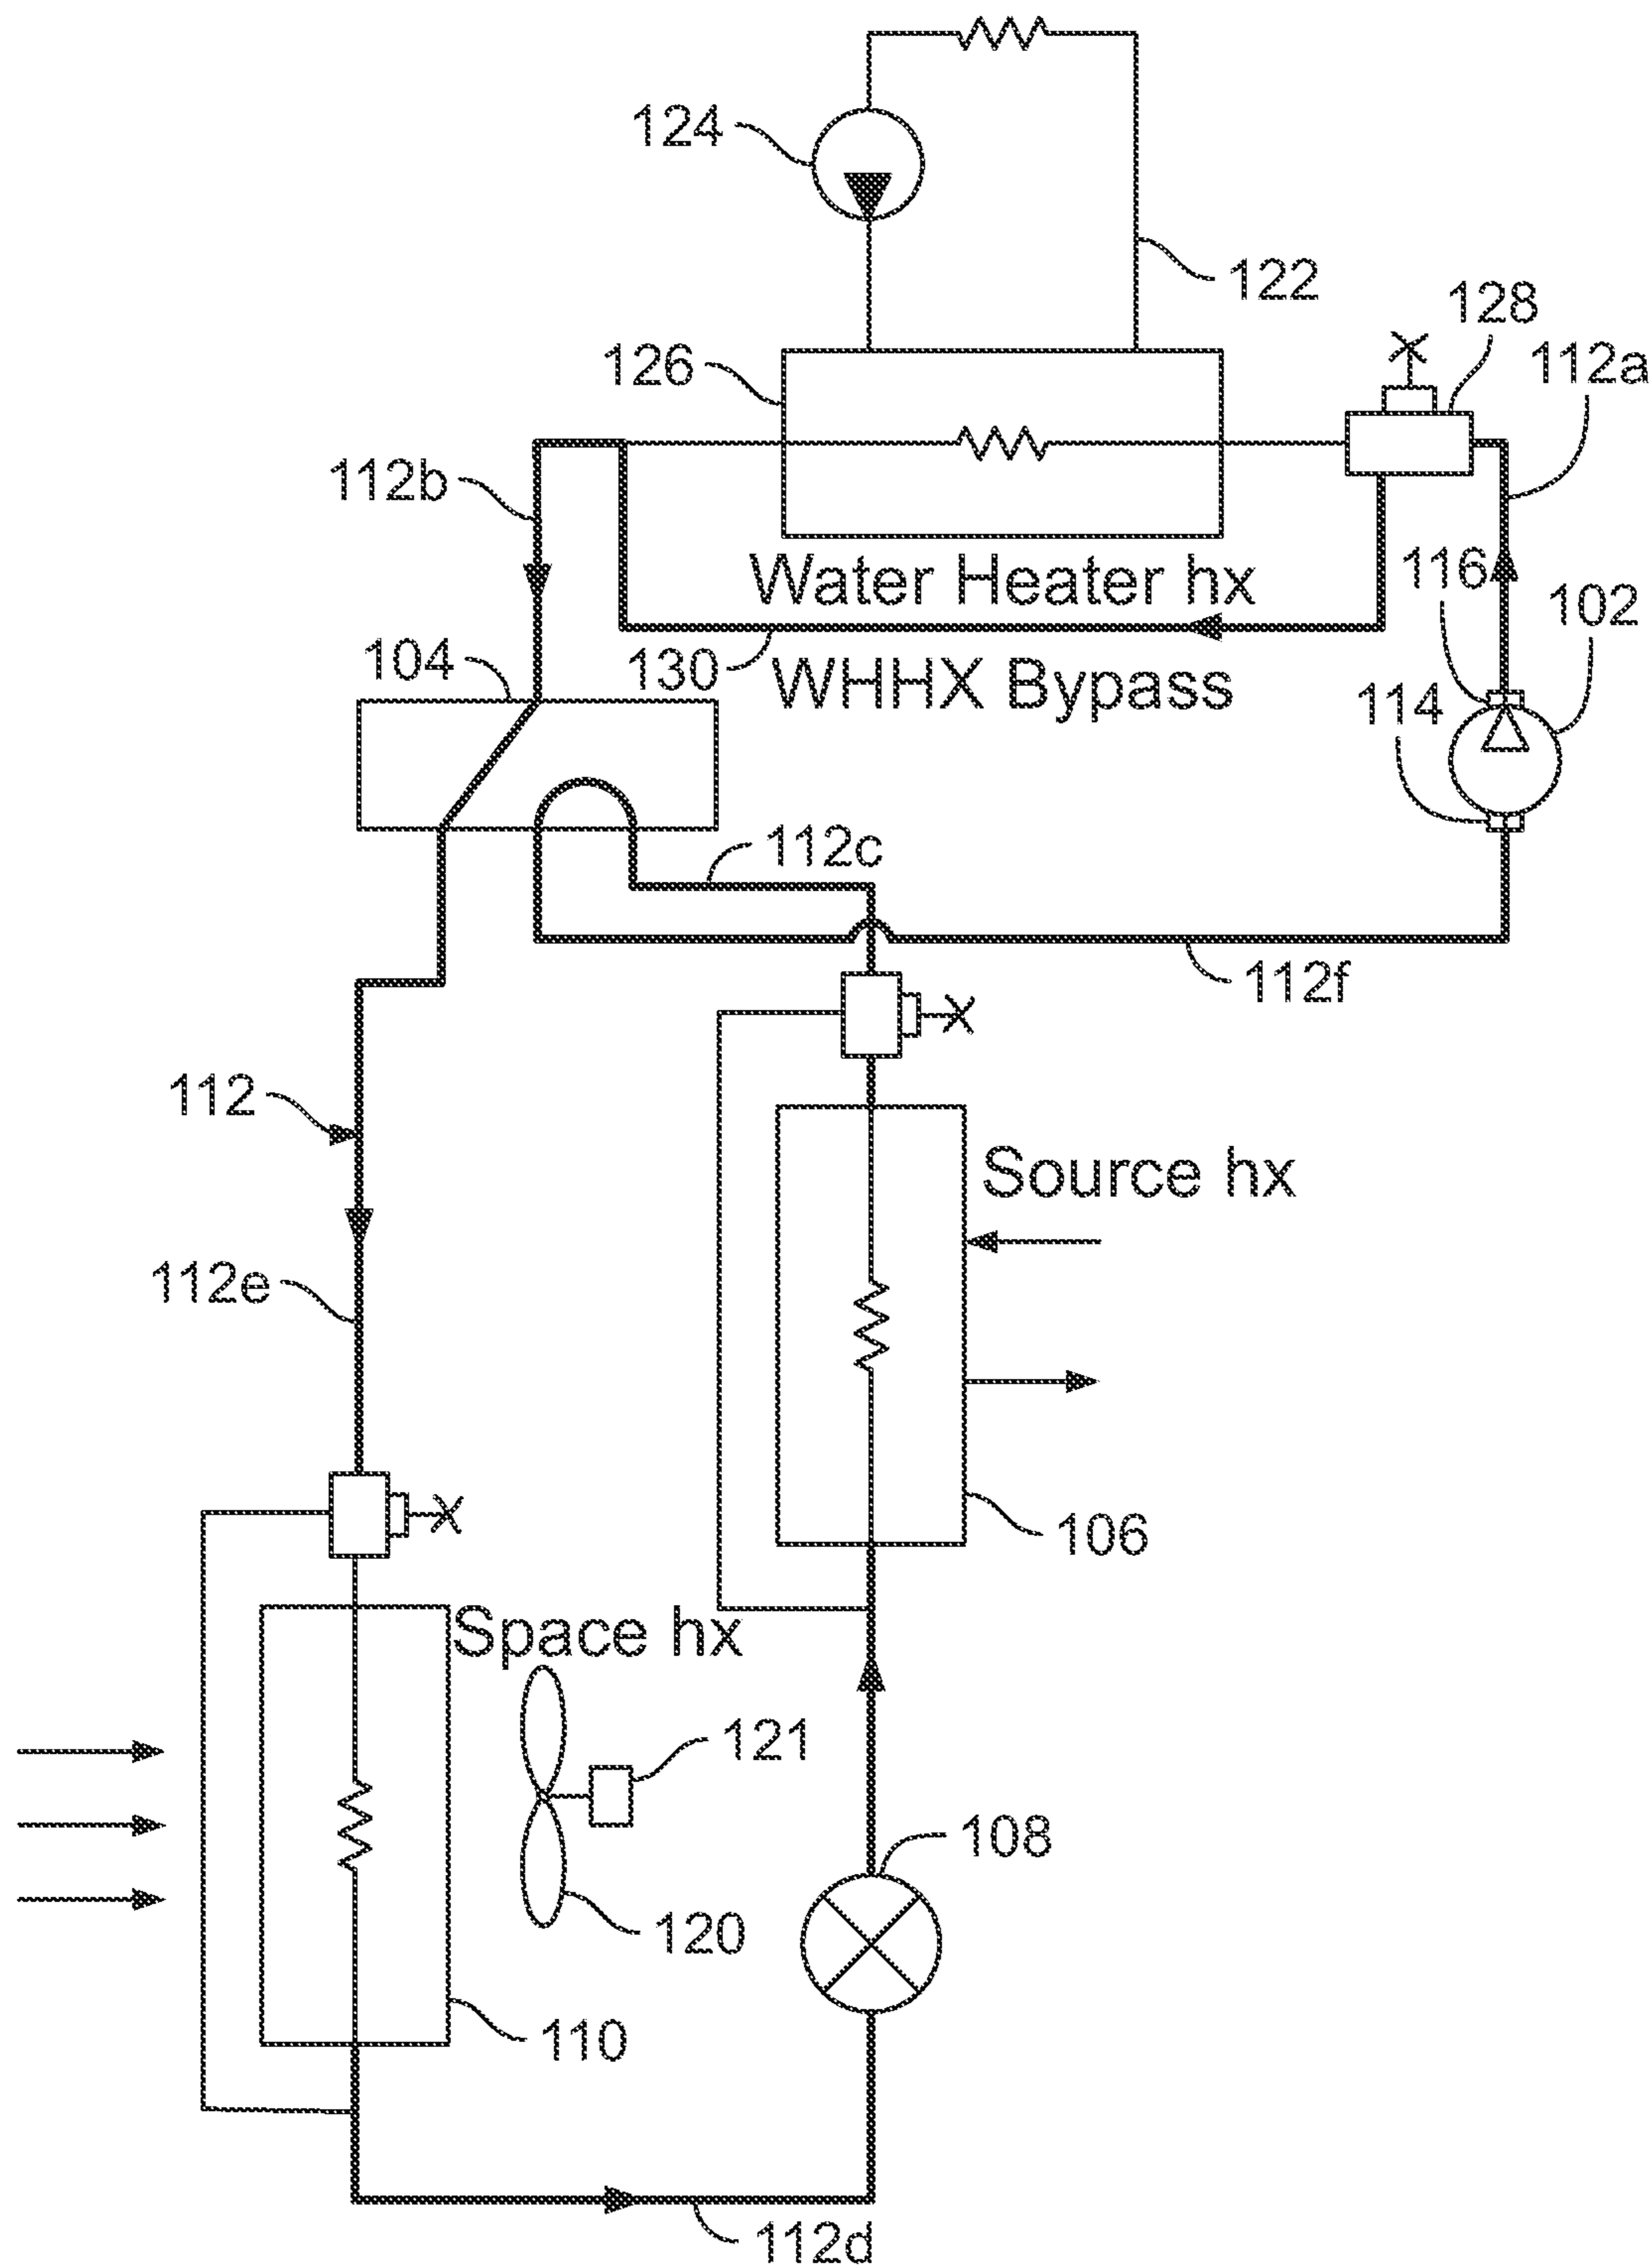


FIG. 4

Water Tank Heater (Loop)

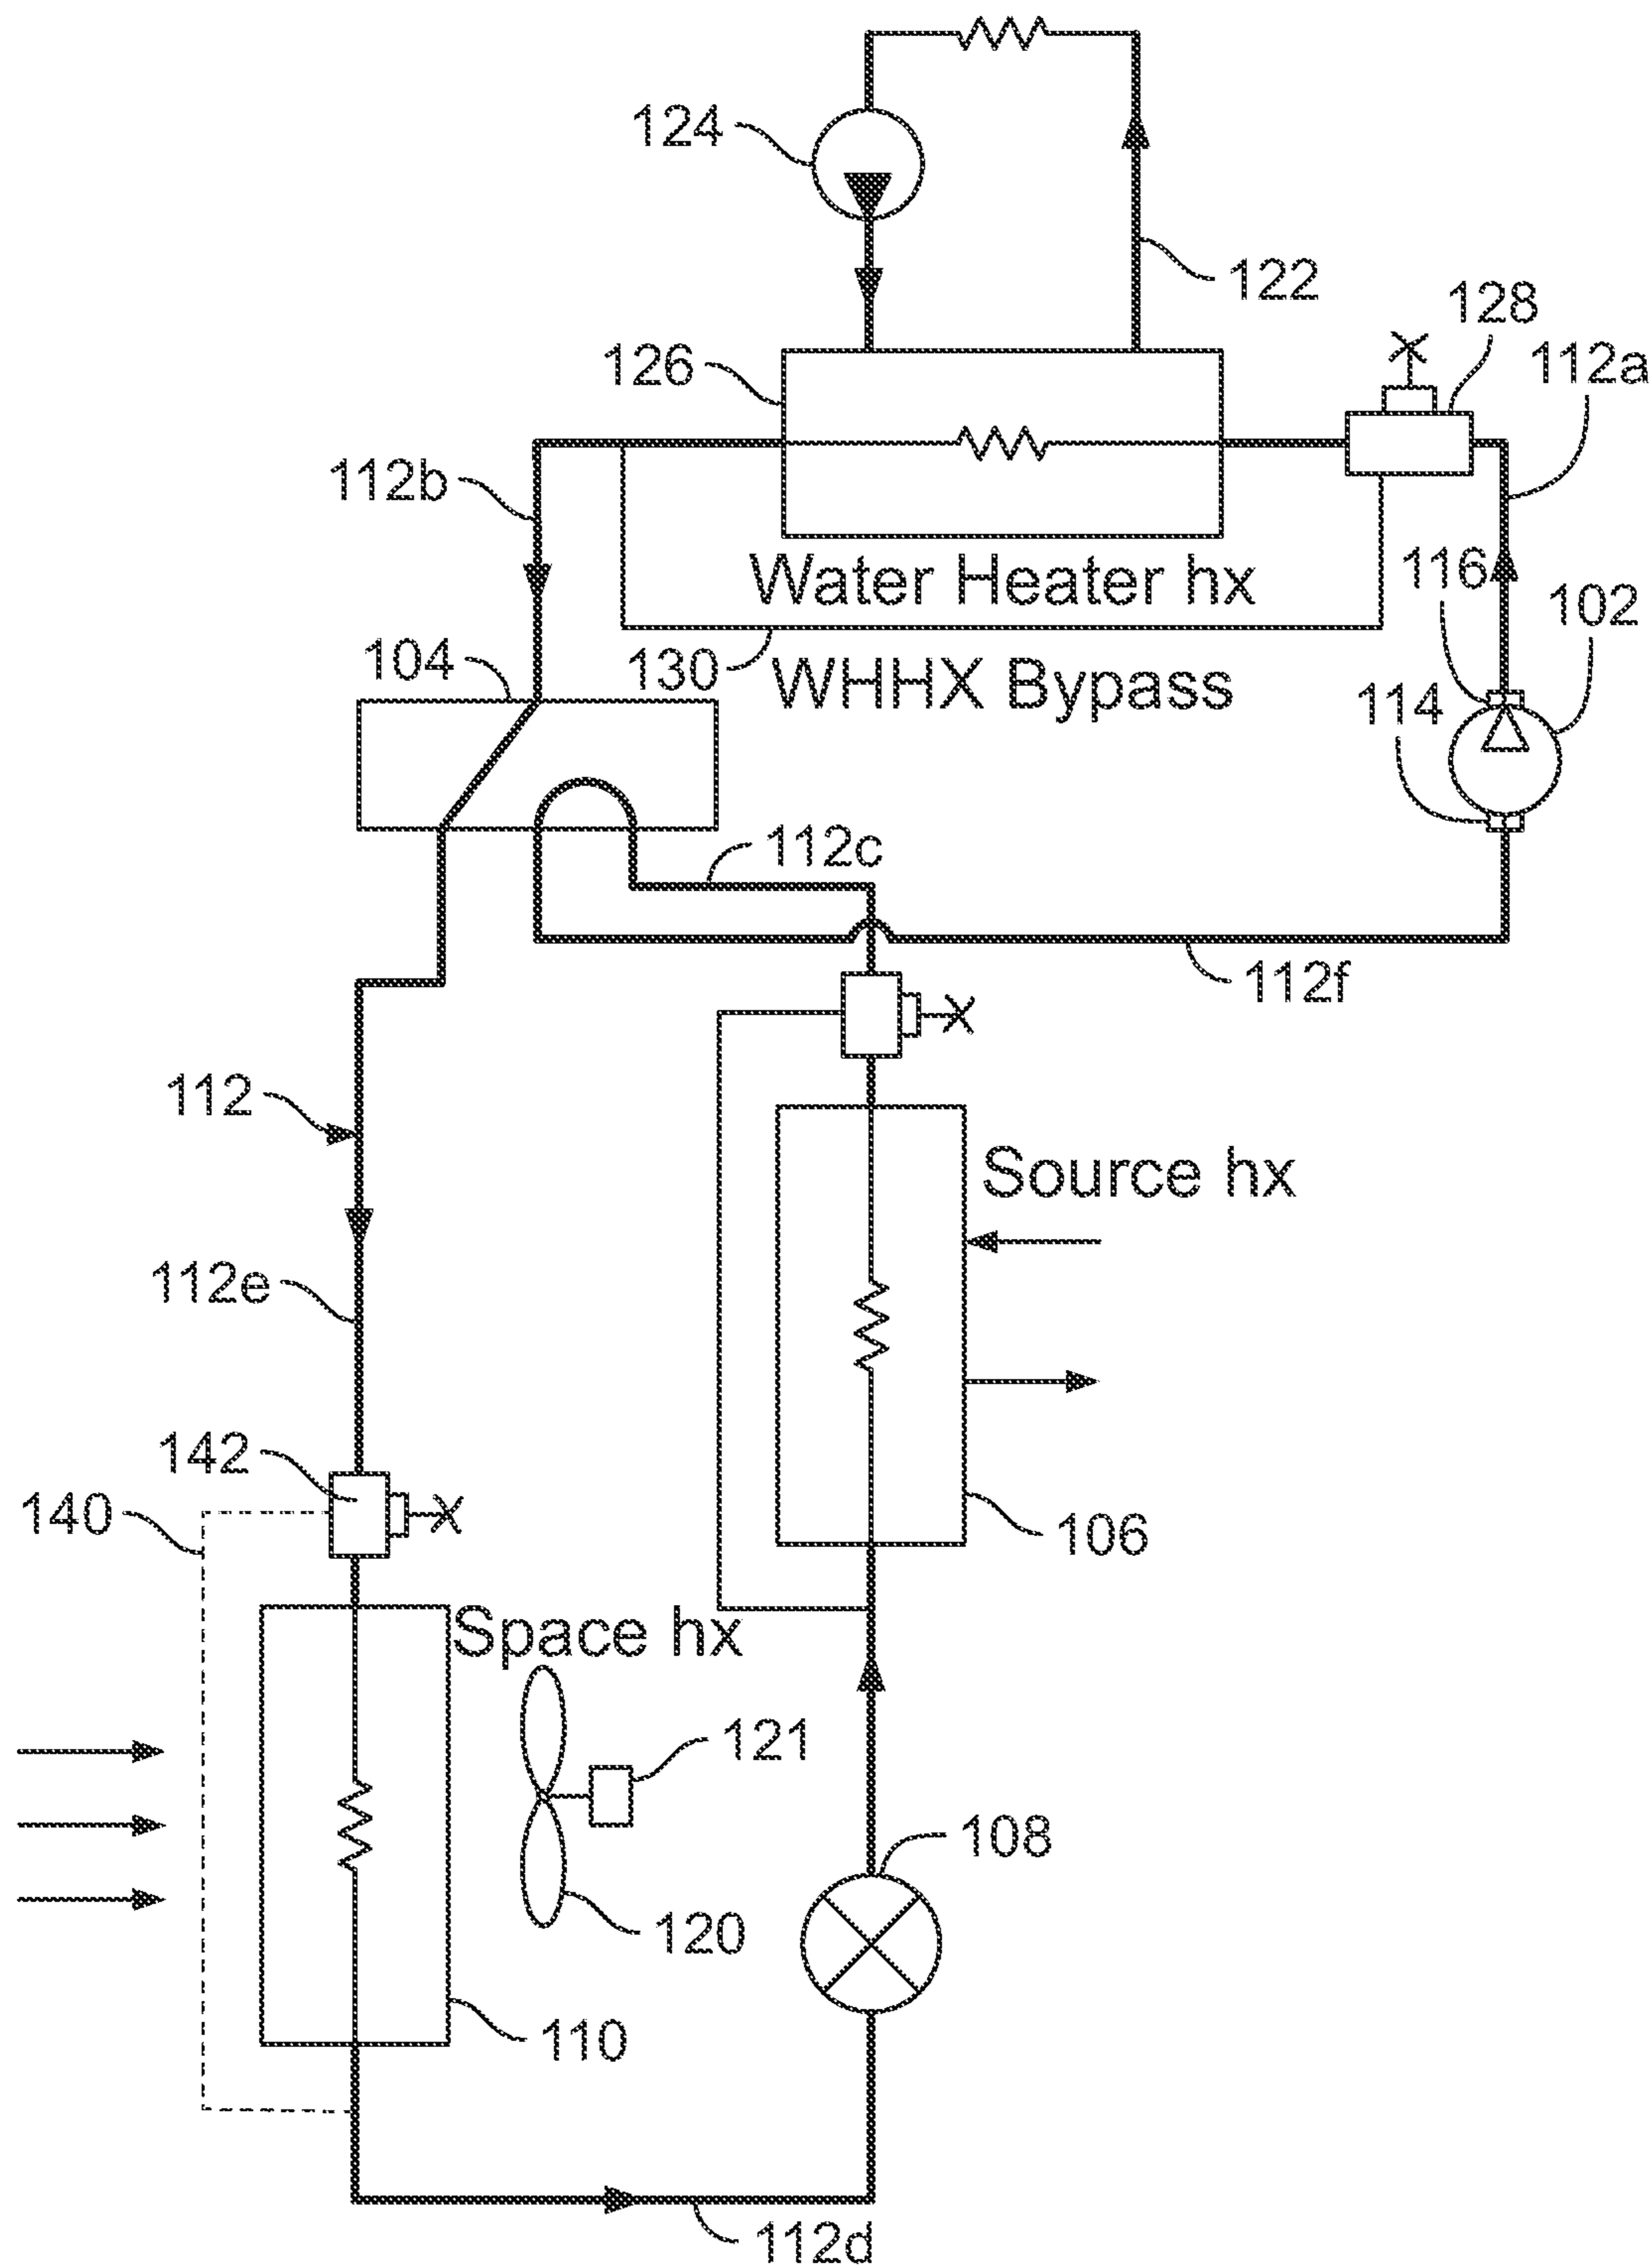


FIG. 5

Water Tank Heater (Loop)

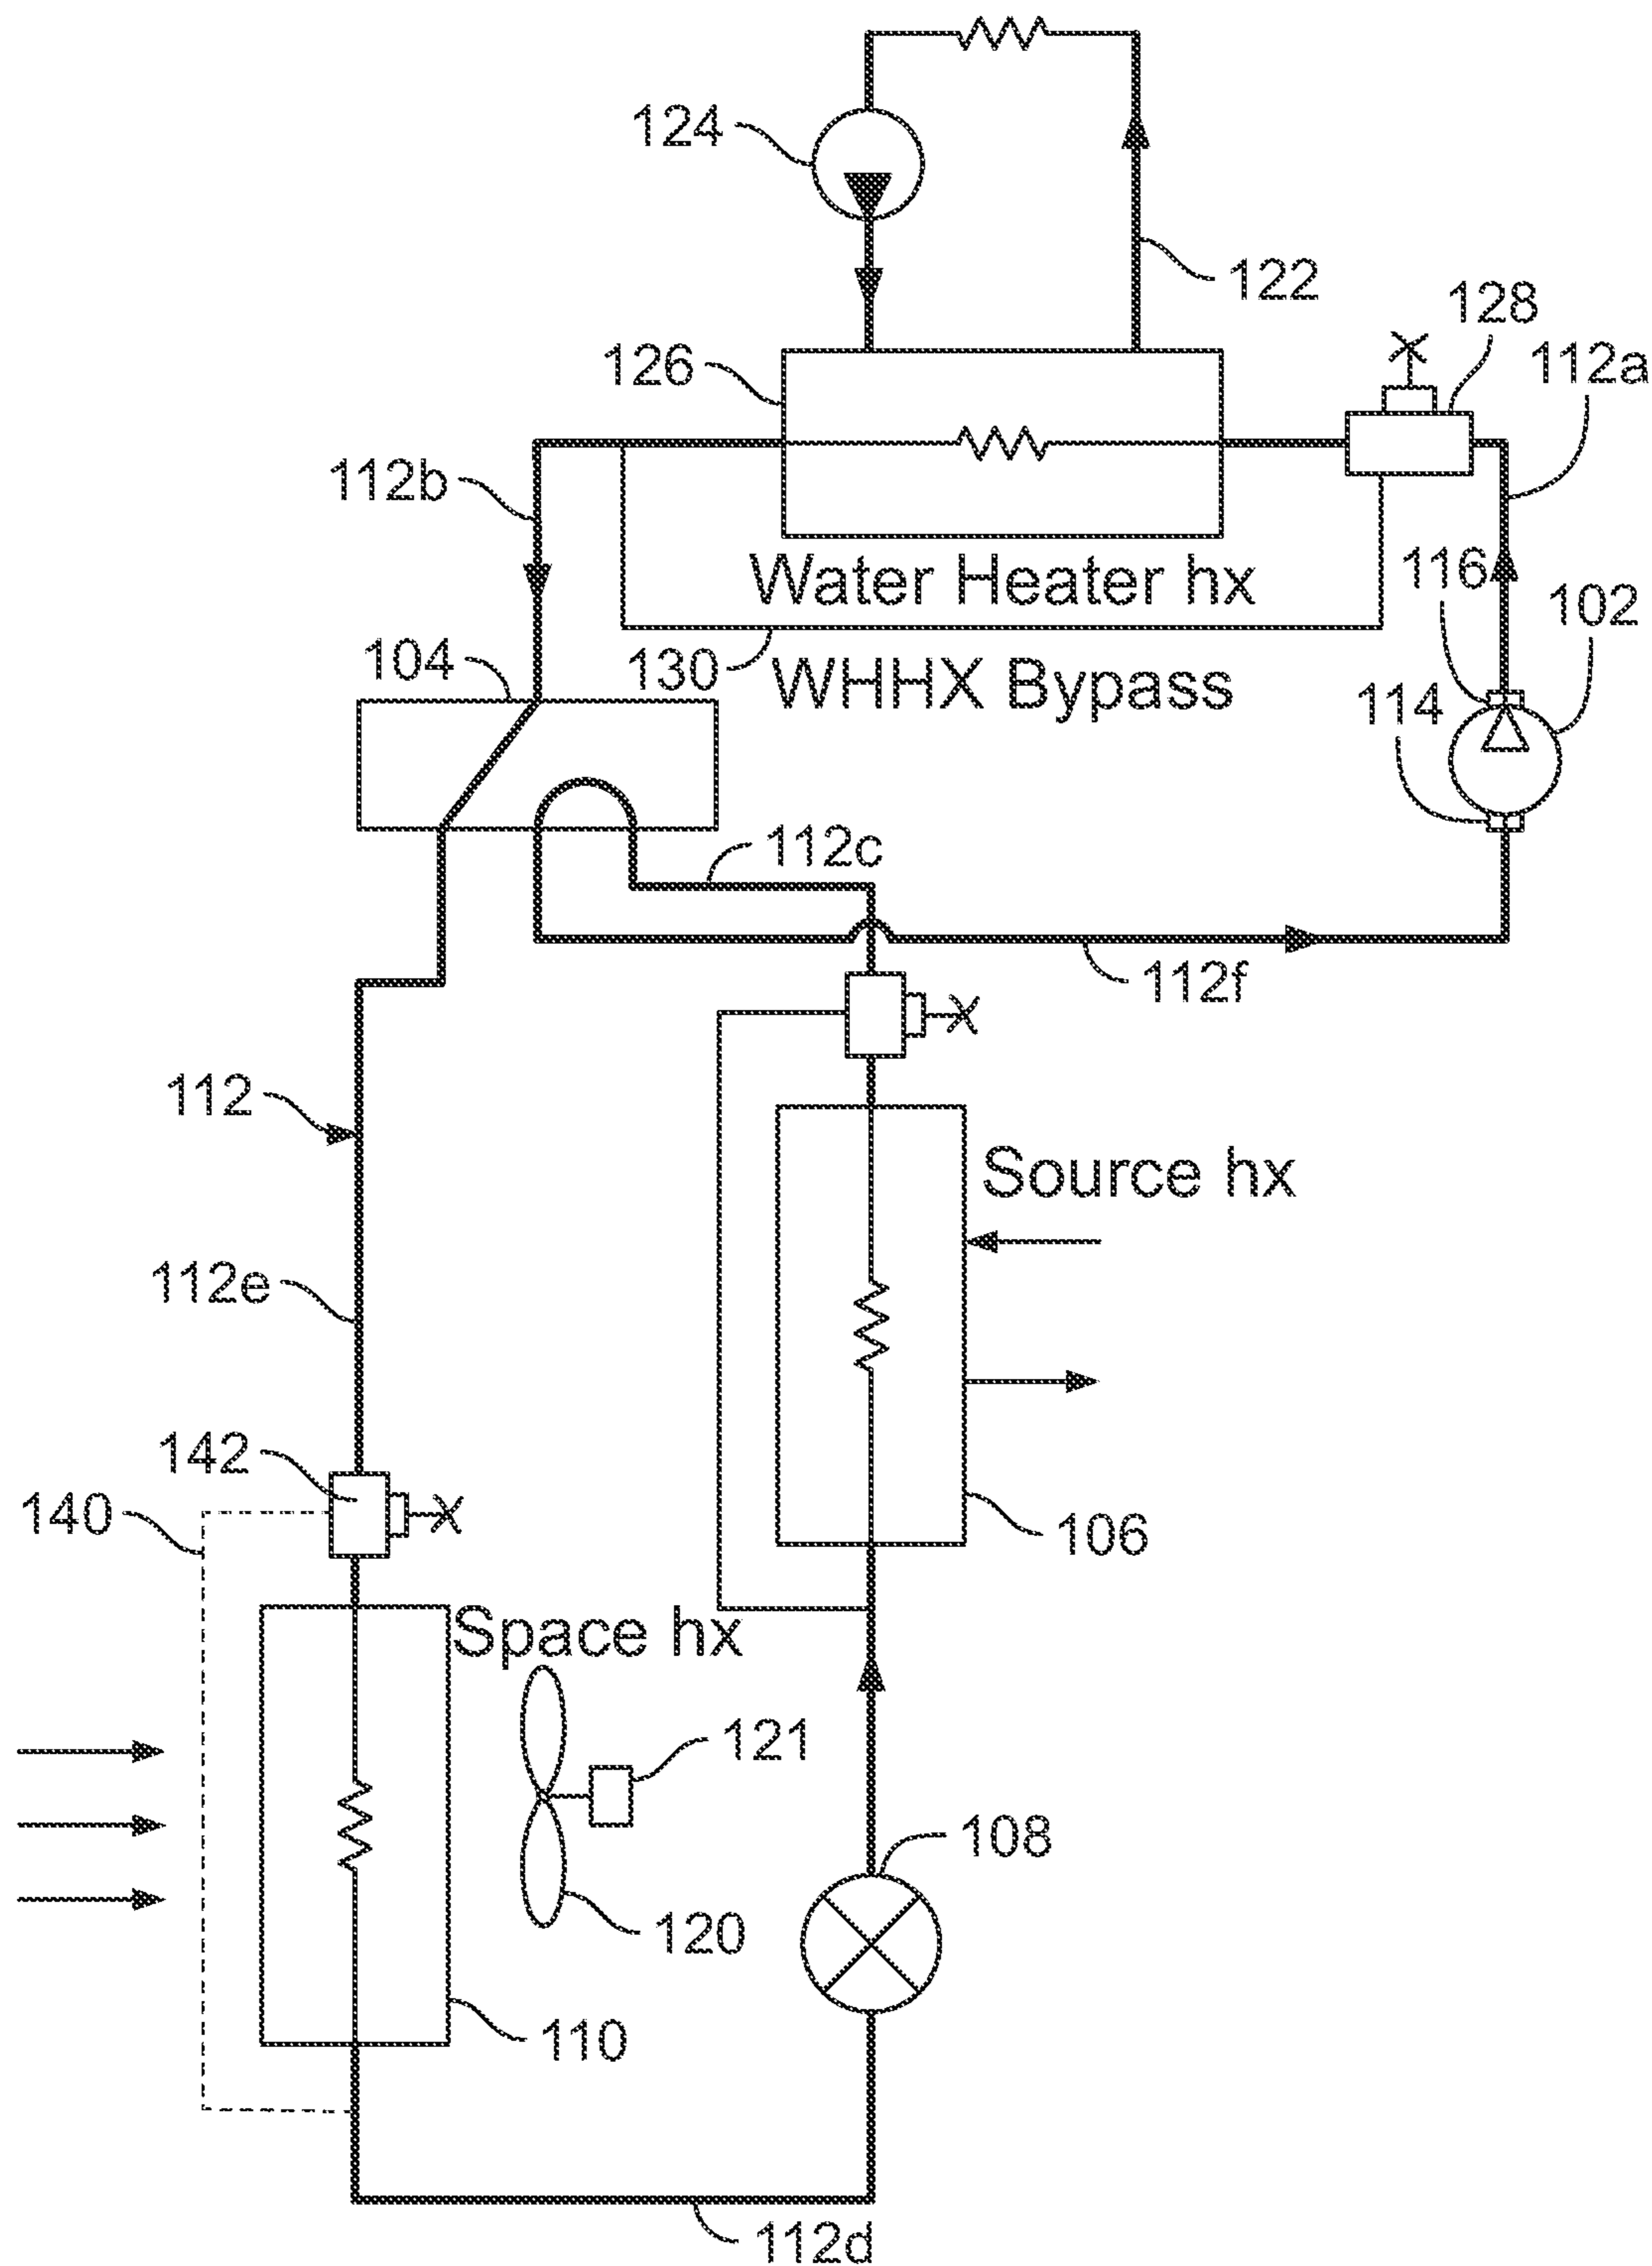


FIG. 6

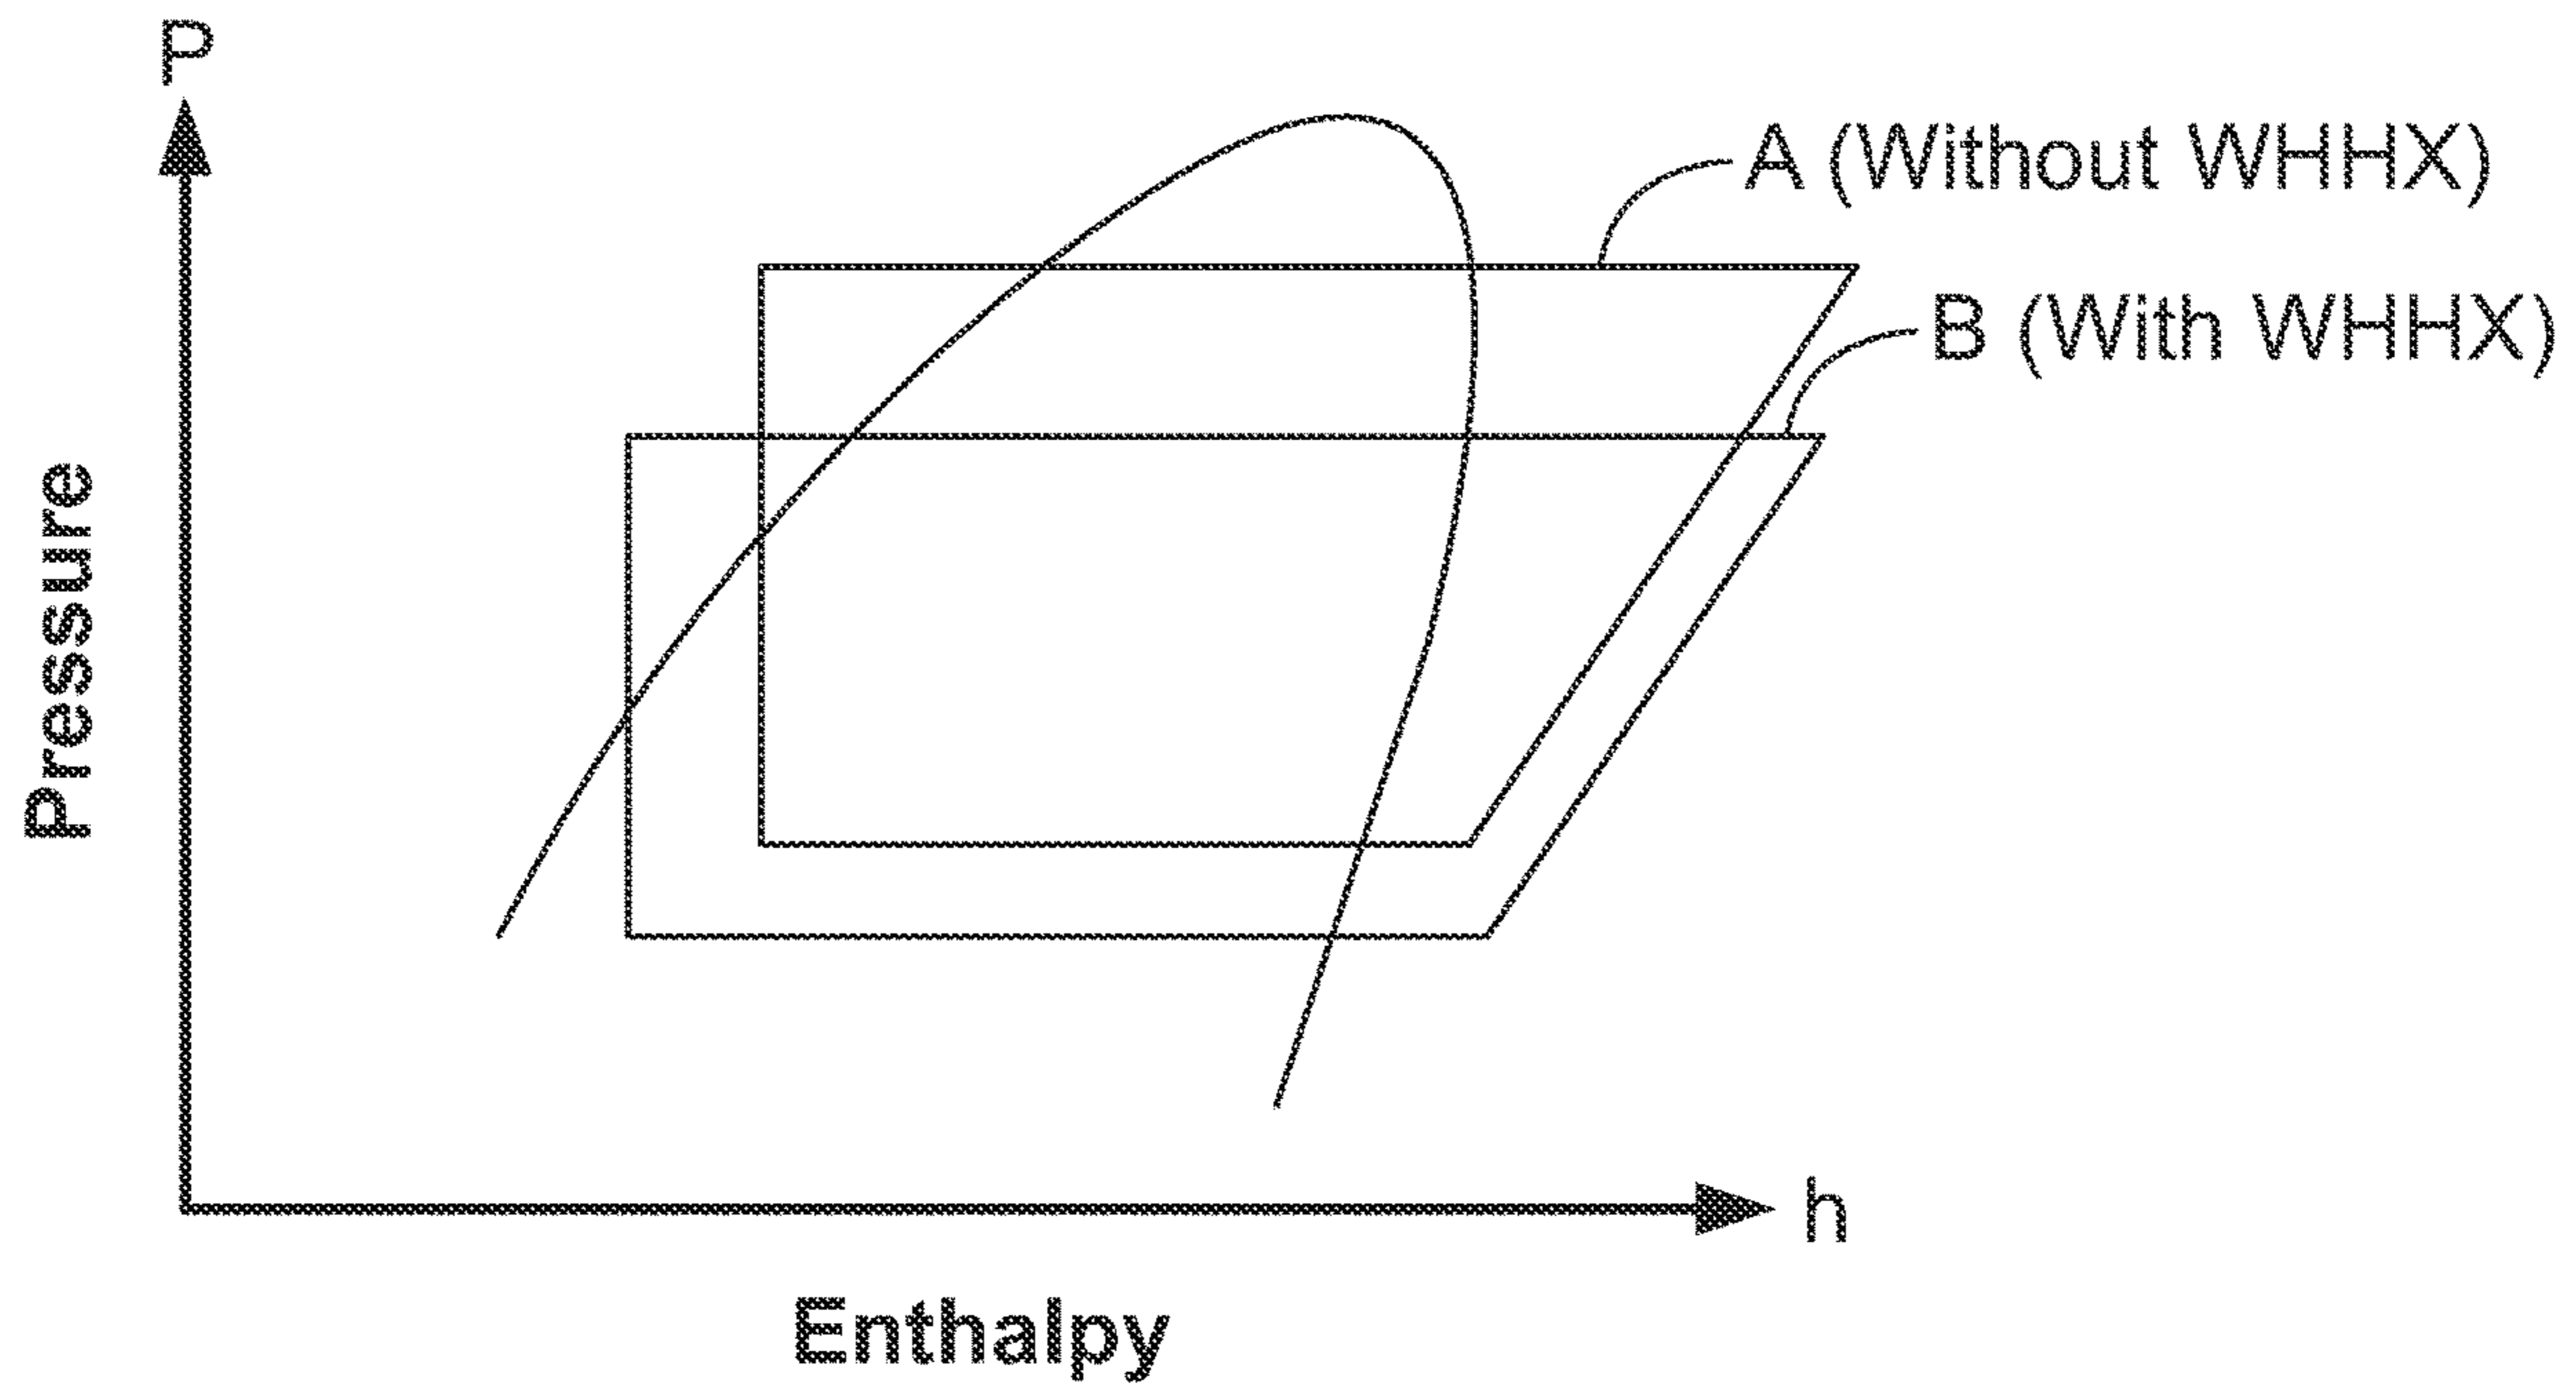


FIG. 7

HEAT PUMP AND WATER HEATER**CROSS-REFERENCE TO RELATED APPLICATIONS**

This application is a continuation of U.S. Nonprovisional application Ser. No. 15/634,434, filed on Jun. 27, 2017, which claims the benefit of U.S. Provisional Application No. 62/359,798 filed on Jul. 8, 2016. These applications are incorporated by reference herein in their entirety.

STATEMENT REGARDING FEDERALLY SPONSORED RESEARCH AND DEVELOPMENT

This application is not federally sponsored.

FIELD

The instant disclosure relates generally to heating, ventilation, and air conditioning systems and methods and, more particularly but without limitation, to heat pump systems and control methods.

BACKGROUND

Modern reversible heat pump systems are designed with improved efficiency and reduced energy consumption to comply with the heating, air conditioning, and ventilation industry trends, sustainability initiatives, and governmental regulations to increase efficiency thresholds in both heating and cooling modes of operation. In particular, integration of the water heating option into the heat pump design in commercial and residential applications (in place of electric or gas heaters) is becoming increasingly popular and allows for more efficient energy utilization to reduce an overall building waste heat disposal. However, due to limitations imposed by the system design and operating conditions, the cycle schematics that integrate the water heating option known to date are relatively costly, complex, inflexible in operation, and less reliable. They also employ extra refrigerant charge and often lack desirable control options and features. There exists a need, therefore, to solve these problems.

SUMMARY

A heat pump and water heating system for conditioning a space and heating water is disclosed, comprising: (a) a heat pump refrigerant circuit comprising a refrigerant circuit that fluidly interconnects: (i) a compressor having a discharge outlet and a suction port; (ii) a source heat exchanger; (iii) a space heat exchanger; (iv) an expansion valve positioned between the space heat exchanger and the source heat exchanger; (v) a reversing valve positioned on the discharge side of the compressor and configured to alternately direct refrigerant flow from the discharge outlet of the compressor to the one of the source heat exchanger and the space heat exchanger and to alternately return flow from the other of the source heat exchanger and the space heat exchanger to the suction port of the compressor; (vi) a water heater heat exchanger positioned on the discharge side of the compressor between the compressor and the reversing valve; (vii) a water heating valve on the discharge side of the compressor; (viii) a water heater heat exchanger bypass line connecting the water heating valve and the refrigerant line between the water heater heat exchanger and the reversing valve and

configured to alternately direct at least a portion of refrigerant from the discharge outlet of the compressor to one of the bypass line or the water heater heat exchanger; and (b) controls for operating the heat pump and water heating system in response to the space conditioning demands and the water heating demands.

The water heating valve may be a regulating valve and the system controls may operate the regulating valve in response to the water heating demands to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line. The water heating valve may be a rapid cycle valve and the system controls may operate the rapid cycle valve in response to the water heating demands to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line. The water heating valve may be a pulse width modulation valve and the system controls may operate the pulse width modulation modulating valve in response to the water heating demands to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line.

The water heating valve may be a 3-way valve. The water heating valve may be a pair of conventional 2-way valves. The water heating valve may be positioned upstream the water heating heat exchanger with respect to the refrigerant flow. A check valve may be positioned downstream the water heating heat exchanger with respect to refrigerant flow. The water heating valve may be positioned downstream the water heating heat exchanger with respect to refrigerant flow.

The heat pump and water heating system may include a bypass circuit around the source heat exchanger, where the bypass circuit around the source heat exchanger may include a bypass refrigerant line and a bypass valve. The heat pump and water heating system may include a bypass circuit around the space heat exchanger, where the bypass circuit around the space heat exchanger may include a bypass refrigerant line and a bypass valve. The heat pump system may be one of water-to-air, water-to-water, air-to-water, and air-to-air system. The heat pump and water heating system may include air and water circulation devices assisting in heat interaction for space conditioning and water heating, where at least one of the compressor and the water circulating or air circulating devices may be a variable capacity device.

A method is disclosed for operating a heat pump system for conditioning a space and heating water wherein the heat pump system comprises a water heater heat exchanger, a water heater heat exchanger bypass line, and a water heater valve configured to direct refrigerant from the discharge side of the compressor in the heat pump system in selected relative percentages through the water heater heat exchanger and the water heater heat exchanger bypass line. The method includes operating the water heater valve in response to the space conditioning and water heating demands to adjust the selected relative percentages of refrigerant being directed through the water heater heat exchanger and the water heater heat exchanger bypass line.

The selected relative percentages of the refrigerant being directed through the water heater heat exchanger and the water heater heat exchanger bypass line may be in the range from zero percent to one hundred percent. The space conditioning demand may take a priority over water heating demand.

The water heating valve may be a regulating valve, and the method may include operating the regulating valve in

3

response to the water heating demands of the space to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line. The water heating valve may be a rapid cycle valve, and the method may include operating the rapid cycle valve in response to the water heating demands of the space to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line. The water heating valve may be a pulse width modulation valve, and the method may include operating the pulse width modulation valve in response to the water heating demands of the space to adjust the relative amount of refrigerant flow directed through the water heater heat exchanger and the water heater heat exchanger bypass line. The water heating valve may be a 3-way valve. The water heating valve may be a pair of conventional 2-way valves.

The water heating valve may be positioned upstream of the water heating heat exchanger with respect to the refrigerant flow. The check valve may be positioned downstream of the water heating heat exchanger with respect to refrigerant flow. The water heating valve may be positioned downstream of the water heating heat exchanger with respect to refrigerant flow. The heat pump system may include a bypass circuit around the source heat exchanger and the bypass circuit around the source heat exchanger may include a bypass refrigerant line and a bypass valve. The heat pump system may include a bypass circuit around the space heat exchanger and the bypass circuit around the space heat exchanger may include a bypass refrigerant line and a bypass valve. The heat pump system may be one of water-to-air, water-to-water, air-to-water, and air-to-air system. The heat pump system may include air and water circulation devices assisting in heat interaction for space conditioning and water heating and the at least one of the compressor and the water circulating or air circulating devices may be a variable capacity device.

BRIEF DESCRIPTION OF THE DRAWINGS

The accompanying drawings, which are incorporated into and form a part of the specification, illustrate one or more embodiments and, together with this description, serve to explain the principles of the disclosure. The drawings merely illustrate various embodiments of the disclosure and are not to be construed as limiting the scope of the instant disclosure.

FIG. 1 is a schematic diagram of a heat pump and water heating system constructed in accordance with various embodiments of the instant disclosure.

FIG. 2 is a schematic diagram of the heat pump and water heating circuit of FIG. 1 shown operating in a space cooling mode. The system controls are omitted to simplify the illustration.

FIG. 3 is a schematic diagram of the heat pump and water heating circuit of FIG. 1 shown operating in a space cooling and water heating mode.

FIG. 4 is a schematic diagram of the heat pump and water heating circuit of FIG. 1 shown operating in a space heating mode.

FIG. 5 is a schematic diagram of the heat pump and water heating circuit of FIG. 1 shown operating in a space heating and water heating mode.

FIG. 6 is a schematic diagram of the heat pump and water heating circuit of FIG. 1 shown operating in a water heating mode.

4

FIG. 7 shows the refrigerant cycles of the system of the present invention graphed onto a P-h (pressure-enthalpy) chart. The cycle designated as "A" illustrates the refrigerant cycle operating without the water heater heat exchanger (WHHX) and the cycle designated as "B" illustrates the refrigerant cycle operating with the water heater heat exchanger.

DETAILED DESCRIPTION OF THE PREFERRED EMBODIMENT(S)

The instant disclosure discloses a heat pump and water heater system having a simplified, reliable, flexible and inexpensive design that provides five distinct modes of operation that can be extended to numerous combinations thereof. In at least one embodiment, this is accomplished in principle by the addition of a water heating heat exchanger and a refrigerant bypass line around the water heating heat exchanger. A three-way valve allows the refrigerant flow through the bypass line to be actuated and controlled. The refrigerant circuit configurations in cooling and heating modes of operation for the conditioned space disclosed herein can integrate water heating with the space conditioning or employ water heating independently from the space conditioning. Furthermore, the system design is not susceptible to the refrigerant charge migration common in conventional systems. The system provides an advantage of requiring a lower refrigerant charge amount (which may be critical for the conversion to the low global warming refrigerants), provides enhanced efficiency in all modes of operation, and allows for an extended operational envelope.

Referring to FIG. 1, the heat pump system 100 comprises a compressor 102, a four-way reversing valve 104, a source heat exchanger 106, an expansion device 108, and a space heat exchanger 110, all interconnected by refrigerant lines designated collectively at 112. The compressor 102 has a suction inlet port 114 and discharge outlet port 116. The compressor 102 compresses refrigerant from a low pressure P_1 to a high pressure P_2 and circulates refrigerant throughout the refrigerant circuit.

The compressor 102 may be a variable capacity compressor, such as a variable speed compressor, a compressor with an integral pulse width modulation option, or a compressor incorporating various unloading options. These types of compressors allow for better control of the operating conditions and manage the thermal load on the heat pump system 100.

The source heat exchanger 106 may be a refrigerant-to-water, refrigerant-to-brine, or refrigerant-to-air heat exchanger and is not limited to any particular heat exchanger type or configuration. The associated fan or pump (not shown) may be of a variable flow type, such as being driven by a variable speed motor, a pulse width-modulated motor, or an ON/OFF cycling motor, to enhance operation and control of the heat pump system 100.

The expansion device 108 may be an electronic expansion valve, a mechanical expansion valve, or a fixed-orifice/capillary tube/accumulator. The expansion device 108 may have bi-directional design or may be replaced by a pair of unidirectional expansion devices with the associated check valve bypass options to provide refrigerant re-routing when the flow changes direction throughout the refrigerant cycle.

The space heat exchanger 110 may be a refrigerant-to-air, refrigerant-to-water or refrigerant-to-brine heat exchanger and is not limited to any particular heat exchanger type or configuration. In the case of the exemplary air-to-refrigerant heat exchanger shown in the drawings, the associated air

management system may be a fan 120 of any known type and may be equipped with a variable flow capability feature, such as being driven by a variable speed motor 121, to enhance operation and control of the heat pump system 100. Alternately, the motor 121 may be a pulse width modulated motor or an ON/OFF cycling motor. Of course, in the case of a water-to-refrigerant or brine-to-refrigerant heat exchanger, the fan 120 and motor 121 are replaced by a pump and a motor that may incorporate similar variable capacity capability.

The heat pump system 100 includes a water tank heater loop 122 for heating water in the structure (not shown). A pump 124 circulates water through the loop 122 and a water heater heat exchanger (WHHX) 126. The pump 124 may have a variable flow capability, such as being driven by a variable speed motor, pulse width modulated motor, or ON/OFF cycling motor, to better control operating conditions for the heat pump system 100 and water temperature within the water tank (not shown). The water heater heat exchanger 126, which is typically a refrigerant-to-water heat exchanger, is connected in-line between the discharge side of the compressor 102 and the 4-way reversing valve 104. The water heater heat exchanger 126 operates as a desuperheater and a condenser when it is engaged within the active refrigerant circuit of the heat pump system 100.

A 3-way valve 128 interposed between the compressor 102 and water heater heat exchanger 126 allows the system control 132 for the heat pump system 100 to command the operation of the loop 122. A bypass line 130 (WHHX bypass) connects the 3-way valve 128 to the outlet side of the water heater heat exchanger 126 to direct at least a portion of refrigerant around the water heater heat exchanger 126 when the water tank heater loop 122 is not actuated. In at least one embodiment, the 3-way valve 128 is a modulating type and can be controlled by a stepper motor (not shown) permitting the system control 132 for the heat pump system 100 to modulate the percentage of the refrigerant flow directed through the bypass line 130 thus allowing for a better control of operating conditions for the heat pump system 100 and improved operation of the water heater heat exchanger 126.

Alternately, the 3-way valve 128 may be replaced by a pair of conventional valves, such as a pair of rapid cycle solenoid valves, or by a rapid cycle three-way valve. Furthermore, to prevent refrigerant migration while switching between different modes of operation, a check valve (not shown) may be positioned downstream the water heater heat exchanger 126 with respect to the refrigerant flow. Additionally, the 3-way valve 128 may be positioned at the exit of the water heater heat exchanger 126 with respect to the refrigerant flow.

The heat pump system 100 has five distinct modes of operation that are primarily controlled by the 4-way valve 104 and the 3-way valve 128, while augmented by the multiple variable capacity devices, such as compressors, fans and pumps, integrated into the system. These modes of operation are space cooling only, space cooling and water heating, space heating only, space heating and water heating, and water heating only. Additionally, the heat pump system 100 may adjust operation in any of the modes depicted above and exactly match the space conditioning and water heating requirements without excessive ON/OFF cycling that negatively impacts system reliability and fluctuations in operating conditions.

In the space cooling mode of operation depicted in FIG. 2, the refrigerant is compressed in the compressor 102 and discharged from the compressor discharge port 116 into the

discharge refrigerant line 112a connecting the compressor 102 to the 3-way valve 128. In the cooling mode of operation, the 3-way valve 128 directs the refrigerant flow through the bypass line 130 around the water heater heat exchanger 126 and refrigerant line 112b connecting the 3-way valve 128 and the 4-way valve 104.

The 4-way valve 104 is configured to connect the refrigerant to the source heat exchanger 106 through the refrigerant line 112c. In this mode, the source heat exchanger 106 is operating as a condenser to desuperheat, condense, and subcool the refrigerant and rejects heat from the refrigerant system to the environment (not shown).

Downstream the source heat exchanger 106, the refrigerant flows through the expansion device 108, where it is expanded from a high pressure to a lower pressure and its temperature is reduced. The refrigerant is then directed to the refrigerant line 112d and the space heat exchanger 110 that is acting as an evaporator and superheater in the cooling mode of operation, while removing heat and reducing humidity in the conditioned space (not shown). Downstream of the space heat exchanger 110, refrigerant line 112e connects the space heat exchanger 110 to the 4-way valve 104, which is configured to direct the refrigerant to the suction port 114 of the compressor 102 through the refrigerant line 112f to complete the refrigerant circuit.

In the space cooling and water heating mode of operation depicted in FIG. 3, the 3-way valve 128 is configured to direct at least a portion of refrigerant through the water heater heat exchanger 126, instead of the bypass refrigerant line 130. In this mode of operation, the water heating heat exchanger 126 may operate as a desuperheater and partial condenser or, alternately, as a desuperheater, condenser, and subcooler. In the former case, the source heat exchanger 106 is used to complete the condensation process and subcool the refrigerant. In the latter case, the source heat exchanger 106 is used to further subcool the refrigerant and improve operational efficiency and dehumidification capability of the heat pump system 100 (see FIG. 7). Alternatively, in the latter case, the source heat exchanger 106 may be bypassed through a bypass line 134 using a 3-way valve 136 (as shown in broken lines) and the water supply for the source heat exchanger 106 may be shut down to reduce input power for the circulating pump (not shown). The 3-way valve 136 may have a variable capability feature and may be utilized as an auxiliary performance control and pressure control device. In all other aspects, this mode of operation is similar to the cooling mode of operation of FIG. 2.

It will be understood that, if the 3-way valve 128 has regulating (modulating) capability, the refrigerant flow between the bypass refrigerant line 130 and the water heating heat exchanger 126 can be adjusted in any proportion from zero to one hundred percent (0%-100%), precisely satisfying the water heating demand typically defined and measured by the temperature transducer integrated into the water tank, reducing a number of ON/OFF cycles, and thus improving system efficiency and reliability. Such flexibility of the 3-way modulating valve 128 may be combined with other variable capacity devices of the heat pump system 100 described above.

In the space heating mode of operation depicted in FIG. 4, the refrigerant is compressed in the compressor 102 and discharged from the compressor discharge port 116 into the discharge refrigerant line 112a connecting the compressor 102 to the 3-way valve 128. In the heating mode of operation, the 3-way valve 128 directs the refrigerant flow through the bypass line 130 around the water heater heat exchanger 126 and refrigerant line 112b connecting the 3-way valve

and the 4-way valve **104**. The 4-way valve **104** is configured to direct the refrigerant through the refrigerant line **112e** to the space heat exchanger **110**, which in this mode operates as a condenser to desuperheat, condense, and subcool the refrigerant while heating the conditioned space (not shown). Downstream of the space heat exchanger **110**, the refrigerant is directed through the refrigerant line **112d** to the expansion device **108** where it is expanded from a high pressure to a lower pressure while its temperature is reduced. The refrigerant is then passed through the source heat exchanger **106** acting as an evaporator and superheater, in the heating mode of operation. Downstream of the source heat exchanger **106**, the 4-way valve **104** is configured to direct the refrigerant through the refrigerant line **112f** to the suction port **114** of the compressor **102** to complete the refrigerant cycle.

In the space heating and water heating mode of operation depicted in FIG. 5, the 3-way valve **128** is configured to direct at least a portion of refrigerant through the water heater heat exchanger **126**, instead of the bypass refrigerant line **130**. In this mode of operation, the water heating heat exchanger **126** may operate as a desuperheater and partial condenser or, alternately, as a desuperheater, condenser, and subcooler. In the former case, the space heat exchanger **110** may be used to complete the condensation process and subcool the refrigerant. In the latter case, the space heat exchanger **110** may be used to further subcool the refrigerant to improve operational efficiency of the heat pump system **100** (see FIG. 7). Alternatively, in the latter case, at least a portion of refrigerant flow may bypass the space heat exchanger **110** through bypass line **140** using a 3-way valve **142** (as shown in broken lines in FIG. 6) and the airflow for the source heat exchanger **106** may be adjusted to reduce input power for the for the circulating fan (not shown). The 3-way valve **142** may have a variable capability feature and may be utilized as an auxiliary performance control and pressure control device. In all other aspects, this mode of operation is similar to the heating mode of operation depicted in FIG. 4.

It will be understood that the space heating requirements take the priority over the water heating and that water heating may be supplemented, if required, with a gas or electric heater (not shown). Furthermore, if the 3-way valve **128** has regulating (modulating) capability, the refrigerant flow between the bypass refrigerant line **130** and the water heating heat exchanger **126** can be adjusted in any proportion from zero to one hundred percent (0%-100%) precisely satisfying the water heating demand typically defined and measured by the temperature transducer integrated into the water tank, reducing a number of ON/OFF cycles, and thus improving system efficiency and reliability. Such flexibility of the 3-way modulating valve **128** may be combined with other variable capacity devices of the heat pump system **100** described above.

In the water heating only mode of operation depicted in FIG. 6, the 3-way valve **128** is configured to direct the refrigerant through the water heater heat exchanger **126**, instead of the bypass refrigerant line **130**. In this mode of operation, the water heating heat exchanger **126** operates as a desuperheater, condenser, and subcooler. In this mode of operation, the airflow or water flow through the space heat exchanger **110** is deactivated. Alternatively, the space heat exchanger **110** may be bypassed through the bypass line **140** using the 3-way valve **142** to reduce the refrigerant side parasitic pressure drop. In all other aspects, this mode of operation is similar to the space heating and water heating mode of operation shown in FIG. 5.

Returning now to FIG. 1, the heat pump system **100** includes the controls **132** operatively connected to the electronic expansion device **108**, the fan motor **121** controlling the speed and operation of the fan **120**, the 4-way reversing valve **104**, the variable speed compressor **102**, the three-way valve **128**, and the pump motor controlling the speed and operation of the pump **124** in the water heater loop **122**. The system controls **132** for the heat pump system **100** will also include various sensors (not shown), such as temperature sensors to report the air temperature in the space, the water temperature of the water in the water tank loop, and temperatures, pressures, flow rates and speed of the various components driven by electric motors, throughout the heat pump system **100**.

The control logic will be programmed to selectively operate the water heater heat exchanger loop or/and to at least partially bypass it using the three-way valve **128**. The control logic preferably is set up to allow for the space conditioning as the higher priority over water heating. The refrigerant head pressure control, to ensure safe and reliable operation of the system components such as the 4-way reversing valve **104** and compressor **102**, can be accomplished by adjusting the compressor speed, fan speed, pump speed, and the amount of refrigerant flowing through the water heater heat exchanger bypass refrigerant lines **130**, **134** and **140**.

The selective utilization of the water heating heat exchanger **126**, in combination with the space heat exchanger **110** or the source heat exchanger **106** and air/water moving devices, such as the fan **120** and the water heater heat exchanger loop pump **124**, respectively in the heating and cooling mode of operation, allows for the system performance (capacity and efficiency) optimization and dehumidification capability improvement.

As described above, the heat pump system **100** of the present disclosure offers many advantages and benefits. By way of example, as depicted above and illustrated in the P-h diagram of FIG. 7, when the water heater heat exchanger is included in the active operating circuit of the heat pump system **100**, the system efficiency is enhanced, compressor power is reduced, and dehumidification capability is improved. The system provides augmented performance and control as well as offers reduced cost, improved operational flexibility, and enhanced reliability.

The embodiments shown and described above are exemplary. Many details are often found in the art and, therefore, many such details are neither shown nor described herein. It is not claimed that all of the details, parts, elements, or steps described and shown were invented herein. Even though numerous characteristics and advantages of the present disclosure have been described in the drawings and accompanying text, the description is illustrative only. Changes may be made in the details, especially in matters of shape, size, and arrangement of the parts within the principles of the instant disclosure to the full extent indicated by the broad meaning of the terms of the attached claims. The description and drawings of the specific embodiments herein do not point out what an infringement of this patent would be, but rather provide an example of how to use and make the invention as defined by the appended claims. Likewise, the abstract is neither intended to define the invention, which is measured by the appended claims, nor is it intended to be limiting as to the scope of the instant disclosure in any way. Rather, the limits of the invention and the bounds of patent protection are measured by and defined in the following claims.

What is claimed is:

1. A heat pump system for conditioning air in a space, comprising:

a variable speed compressor configured to circulate a refrigerant through a refrigerant circuit, the variable speed compressor having a discharge outlet port and an inlet suction port;

a refrigerant-to-liquid heat exchanger configured to exchange heat between the refrigerant and a heat exchange liquid;

a refrigerant-to-air heat exchanger configured to exchange heat between the refrigerant and the air, the air conditioned thereby for use in the space;

a bi-directional expansion valve disposed on the refrigerant circuit and positioned between the refrigerant-to-liquid heat exchanger and the refrigerant-to-air heat exchanger;

a desuperheater heat exchanger configured to exchange heat between the refrigerant and water to heat the water;

a 3-way valve disposed along the refrigerant circuit between the variable speed compressor and the desuperheater heat exchanger, wherein the 3-way valve is connected to a desuperheater bypass circuit to permit the refrigerant to bypass the desuperheater heat exchanger, wherein the 3-way valve is configured to selectively direct the refrigerant from the variable speed compressor to either the desuperheater heat exchanger or the desuperheater bypass circuit;

a reversing valve disposed along the refrigerant circuit, the reversing valve including a first port configured to receive the refrigerant from the desuperheater bypass circuit and/or from the desuperheater heat exchanger, a second port connected to the inlet suction port of the variable speed compressor, a third port connected to the refrigerant-to-air heat exchanger, and a fourth port connected to the refrigerant-to-liquid heat exchanger, wherein in a first operating mode the reversing valve is configured to convey the refrigerant from the first port to the fourth port and from the second port to the third port to cause the refrigerant to flow to the refrigerant-to-liquid heat exchanger configured to operate as a condenser, through the bi-directional expansion valve, and to the refrigerant-to-air heat exchanger configured to operate as an evaporator, and

wherein in a second operating mode the reversing valve is configured to convey the refrigerant from the first port to the third port and from the second port to the fourth port to cause the refrigerant to flow to the refrigerant-to-air heat exchanger configured to operate as a condenser, through the bi-directional expansion valve, and to the refrigerant-to-liquid heat exchanger configured to operate as an evaporator.

2. The heat pump system of claim 1, including a fan driven by a variable speed motor, the fan configured to flow air over a portion of the refrigerant-to-air heat exchanger.

3. The heat pump system of claim 1, wherein the bi-directional expansion valve is a fixed orifice valve, a mechanical valve, or an electronic valve.

4. The heat pump system of claim 1, wherein the desuperheater heat exchanger is a second refrigerant-to-liquid heat exchanger configured to exchange heat between the refrigerant in the refrigerant circuit and the water in a water storage loop.

5. The heat pump system of claim 4, including a variable speed water pump for circulating heated water in the water storage loop and through the desuperheater heat exchanger.

6. The heat pump system of claim 1, including a variable speed pump disposed on a source loop for circulating the heat exchange liquid through the refrigerant-to-liquid heat exchanger.

7. The heat pump system of claim 1, including a controller configured to control operation of the variable speed compressor, the reversing valve, the 3-way valve, the bi-directional expansion valve, a first variable speed pump for circulating the water through the desuperheater heat exchanger, and a second variable speed pump for circulating the heat exchange liquid through the refrigerant-to-liquid heat exchanger.

8. The heat pump system of claim 1, wherein the reversing valve and the 3-way valve are configured to alter the flow of the refrigerant to change a mode of operation between the first operating mode defining a space cooling mode, a space cooling and water heating mode, the second operating mode defining a space heating mode, a space heating and water heating mode, and a primary water heating mode.

9. The heat pump system of claim 8, including a second 3-way valve connected to a refrigerant-to-liquid heat exchanger bypass circuit to permit the refrigerant to bypass the refrigerant-to-liquid heat exchanger in the space cooling and water heating mode.

10. The heat pump system of claim 9, including a third 3-way valve connected to a refrigerant-to-air heat exchanger bypass circuit to permit the refrigerant to bypass the refrigerant-to-air heat exchanger in the space heating and water heating mode and in the water heating mode.

11. The heat pump system of claim 8, wherein to operate in the space cooling mode,

the 3-way valve is configured to direct the refrigerant from the variable speed compressor to the reversing valve via the desuperheater bypass circuit;

the reversing valve is configured to direct the refrigerant, via the first port and the fourth port, to the refrigerant-to-liquid heat exchanger that is configured to operate as a condenser,

the bi-directional expansion valve is configured to receive the refrigerant from the refrigerant-to-liquid heat exchanger,

the refrigerant-to-air heat exchanger is configured as an evaporator and receive the refrigerant from the bi-directional expansion valve, and

the reversing valve is configured to receive, via the third port, the refrigerant from the refrigerant-to-air heat exchanger and direct, via the second port, the refrigerant to the variable speed compressor.

12. The heat pump system of claim 8, wherein to operate in the space cooling and water heating mode,

the 3-way valve is configured to direct the refrigerant from the variable speed compressor to the desuperheater heat exchanger,

the reversing valve is configured to receive, via the first port, the refrigerant from the desuperheater heat exchanger and direct, via the fourth port, the refrigerant to the refrigerant-to-liquid heat exchanger that is configured to operate as a condenser,

the bi-directional expansion valve is configured to receive the refrigerant from the refrigerant-to-liquid heat exchanger,

the refrigerant-to-air heat exchanger is configured to operate as an evaporator and receive the refrigerant from the bi-directional expansion valve, and

the reversing valve is configured to receive, via the third port, the refrigerant from the refrigerant-to-air heat

11

exchanger and direct, via the second port, the refrigerant to the variable speed compressor.

13. The heat pump system of claim 8, wherein to operate in the space heating mode,

the 3-way valve is configured to direct the refrigerant from the variable speed compressor to the reversing valve via the desuperheater bypass circuit;

the reversing valve is configured to direct the refrigerant, via the first port and the third port, to the refrigerant-to-air heat exchanger that is configured to operate as a condenser,

the bi-directional expansion valve is configured to receive the refrigerant from the refrigerant-to-air heat exchanger,

the refrigerant-to-liquid heat exchanger is configured to operate as an evaporator and receive the refrigerant from the bi-directional expansion valve, and

the reversing valve is configured to receive, via the fourth port, the refrigerant from the refrigerant-to-liquid heat exchanger and direct, via the second port, the refrigerant to the variable speed compressor.

14. The heat pump system of claim 8, wherein to operate in the space heating and water heating mode,

the 3-way valve is configured to direct the refrigerant from the variable speed compressor to the desuperheater heat exchanger,

the reversing valve is configured to receive, via the first port, the refrigerant from the desuperheater heat exchanger and direct, via the third port, the refrigerant to the refrigerant-to-air heat exchanger that is configured to operate as a condenser,

12

the bi-directional expansion valve is configured to receive the refrigerant from the refrigerant-to-air heat exchanger,

the refrigerant-to-liquid heat exchanger is configured to operate as an evaporator and receive the refrigerant from the bi-directional expansion valve,

the reversing valve is configured to receive, via the fourth port, the refrigerant from the refrigerant-to-liquid heat exchanger and direct, via the second port, the refrigerant to the variable speed compressor.

15. The heat pump system of claim 8, wherein to operate in the primary water heating mode,

the 3-way valve is configured to direct the refrigerant from the variable speed compressor to the desuperheater heat exchanger that is configured to operate as a desuperheater, condenser, and subcooler,

the reversing valve is configured to receive, via the first port, the refrigerant from the desuperheater heat exchanger and direct, via the third port, the refrigerant toward the refrigerant-to-air heat exchanger,

the bi-directional expansion valve is configured to subsequently receive the refrigerant,

the refrigerant-to-liquid heat exchanger is configured to operate as an evaporator and receive the refrigerant from the bi-directional expansion valve, and

the reversing valve is configured to receive, via the fourth port, the refrigerant from the refrigerant-to-liquid heat exchanger and direct, via the second port, the refrigerant to the variable speed compressor.

* * * * *

UNITED STATES PATENT AND TRADEMARK OFFICE
CERTIFICATE OF CORRECTION

PATENT NO. : 11,448,430 B2
APPLICATION NO. : 17/129558
DATED : September 20, 2022
INVENTOR(S) : Michael F. Taras et al.

Page 1 of 1

It is certified that error appears in the above-identified patent and that said Letters Patent is hereby corrected as shown below:

In the Claims

In Column 9, Claim 1, Line 40, delete “second” and replace with --third--

In Column 9, Claim 1, Line 40, delete “third” and replace with --second--

In Column 9, Claim 1, Line 48, delete “second” and replace with --fourth--

In Column 9, Claim 1, Line 48, delete “fourth” and replace with --second--

Signed and Sealed this
Twelfth Day of November, 2024
Katherine Kelly Vidal

Katherine Kelly Vidal
Director of the United States Patent and Trademark Office