



US 20090040029A1

(19) **United States**

(12) **Patent Application Publication**
Bridges et al.

(10) **Pub. No.: US 2009/0040029 A1**

(43) **Pub. Date: Feb. 12, 2009**

(54) **TRANSCEIVER AND CHARGING COMPONENT FOR A POWER AGGREGATION SYSTEM**

(75) Inventors: **Seth W. Bridges**, Seattle, WA (US);
Seth B. Pollack, Seattle, WA (US);
David L. Kaplan, Seattle, WA (US)

Correspondence Address:
LEE & HAYES, PLLC
601 W. RIVERSIDE AVENUE, SUITE 1400
SPOKANE, WA 99201 (US)

(73) Assignee: **V2GREEN, INC.**, Seattle, WA (US)

(21) Appl. No.: **12/252,209**

(22) Filed: **Oct. 15, 2008**

Related U.S. Application Data

(63) Continuation-in-part of application No. 11/837,407, filed on Aug. 10, 2007.

(60) Provisional application No. 60/980,663, filed on Oct. 17, 2007, provisional application No. 60/822,047, filed on Aug. 10, 2006, provisional application No. 60/869,439, filed on Dec. 11, 2006, provisional application No. 60/915,347, filed on May 1, 2007.


Publication Classification

(51) **Int. Cl.**
G05B 11/01 (2006.01)

(52) **U.S. Cl.** **340/310.11**

(57) **ABSTRACT**

Systems and methods are described for a power aggregation system. In one implementation, a system includes a transceiver device physically coupled to an electric resource, the transceiver device being configured to provide information about the electric resource to a charging component. Additionally, such a system may include a charging component, the charging component being coupled to the electric resource via a charging medium and communicatively coupled to the transceiver device. The charging component may also be configured to receive the electric resource information from the transceiver and, in response, effectuate charge control management of the electric resource.

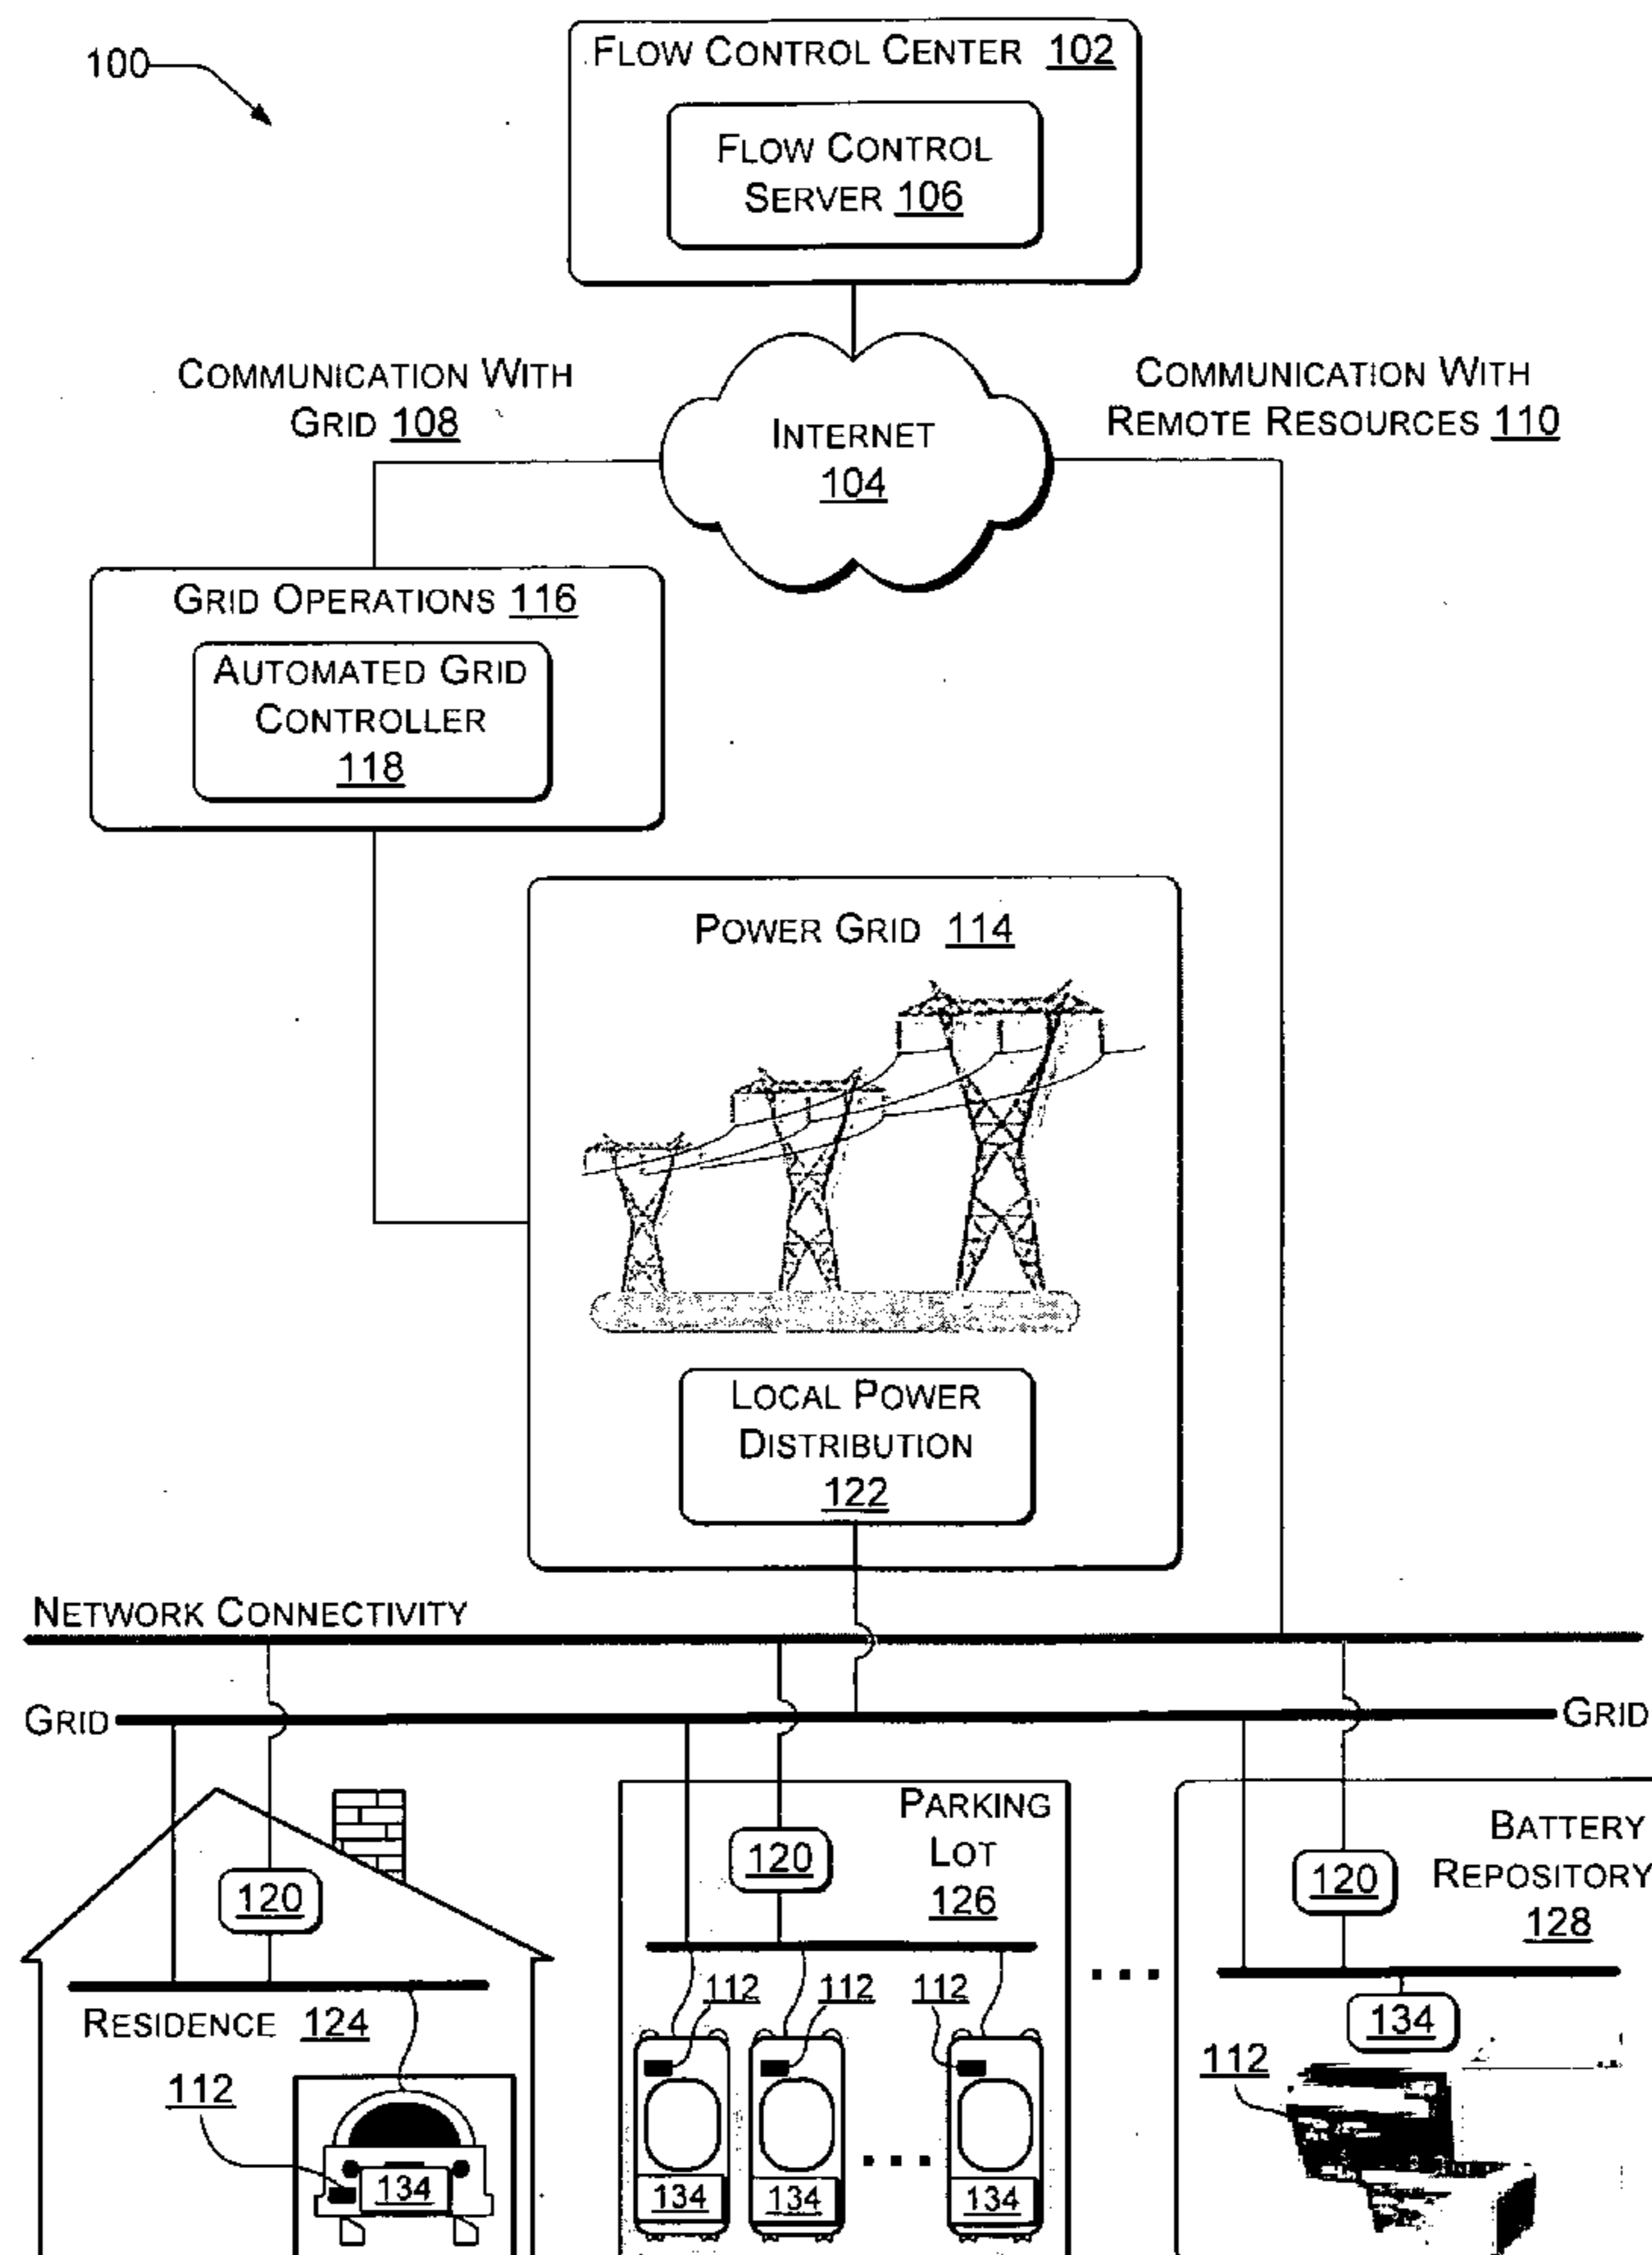

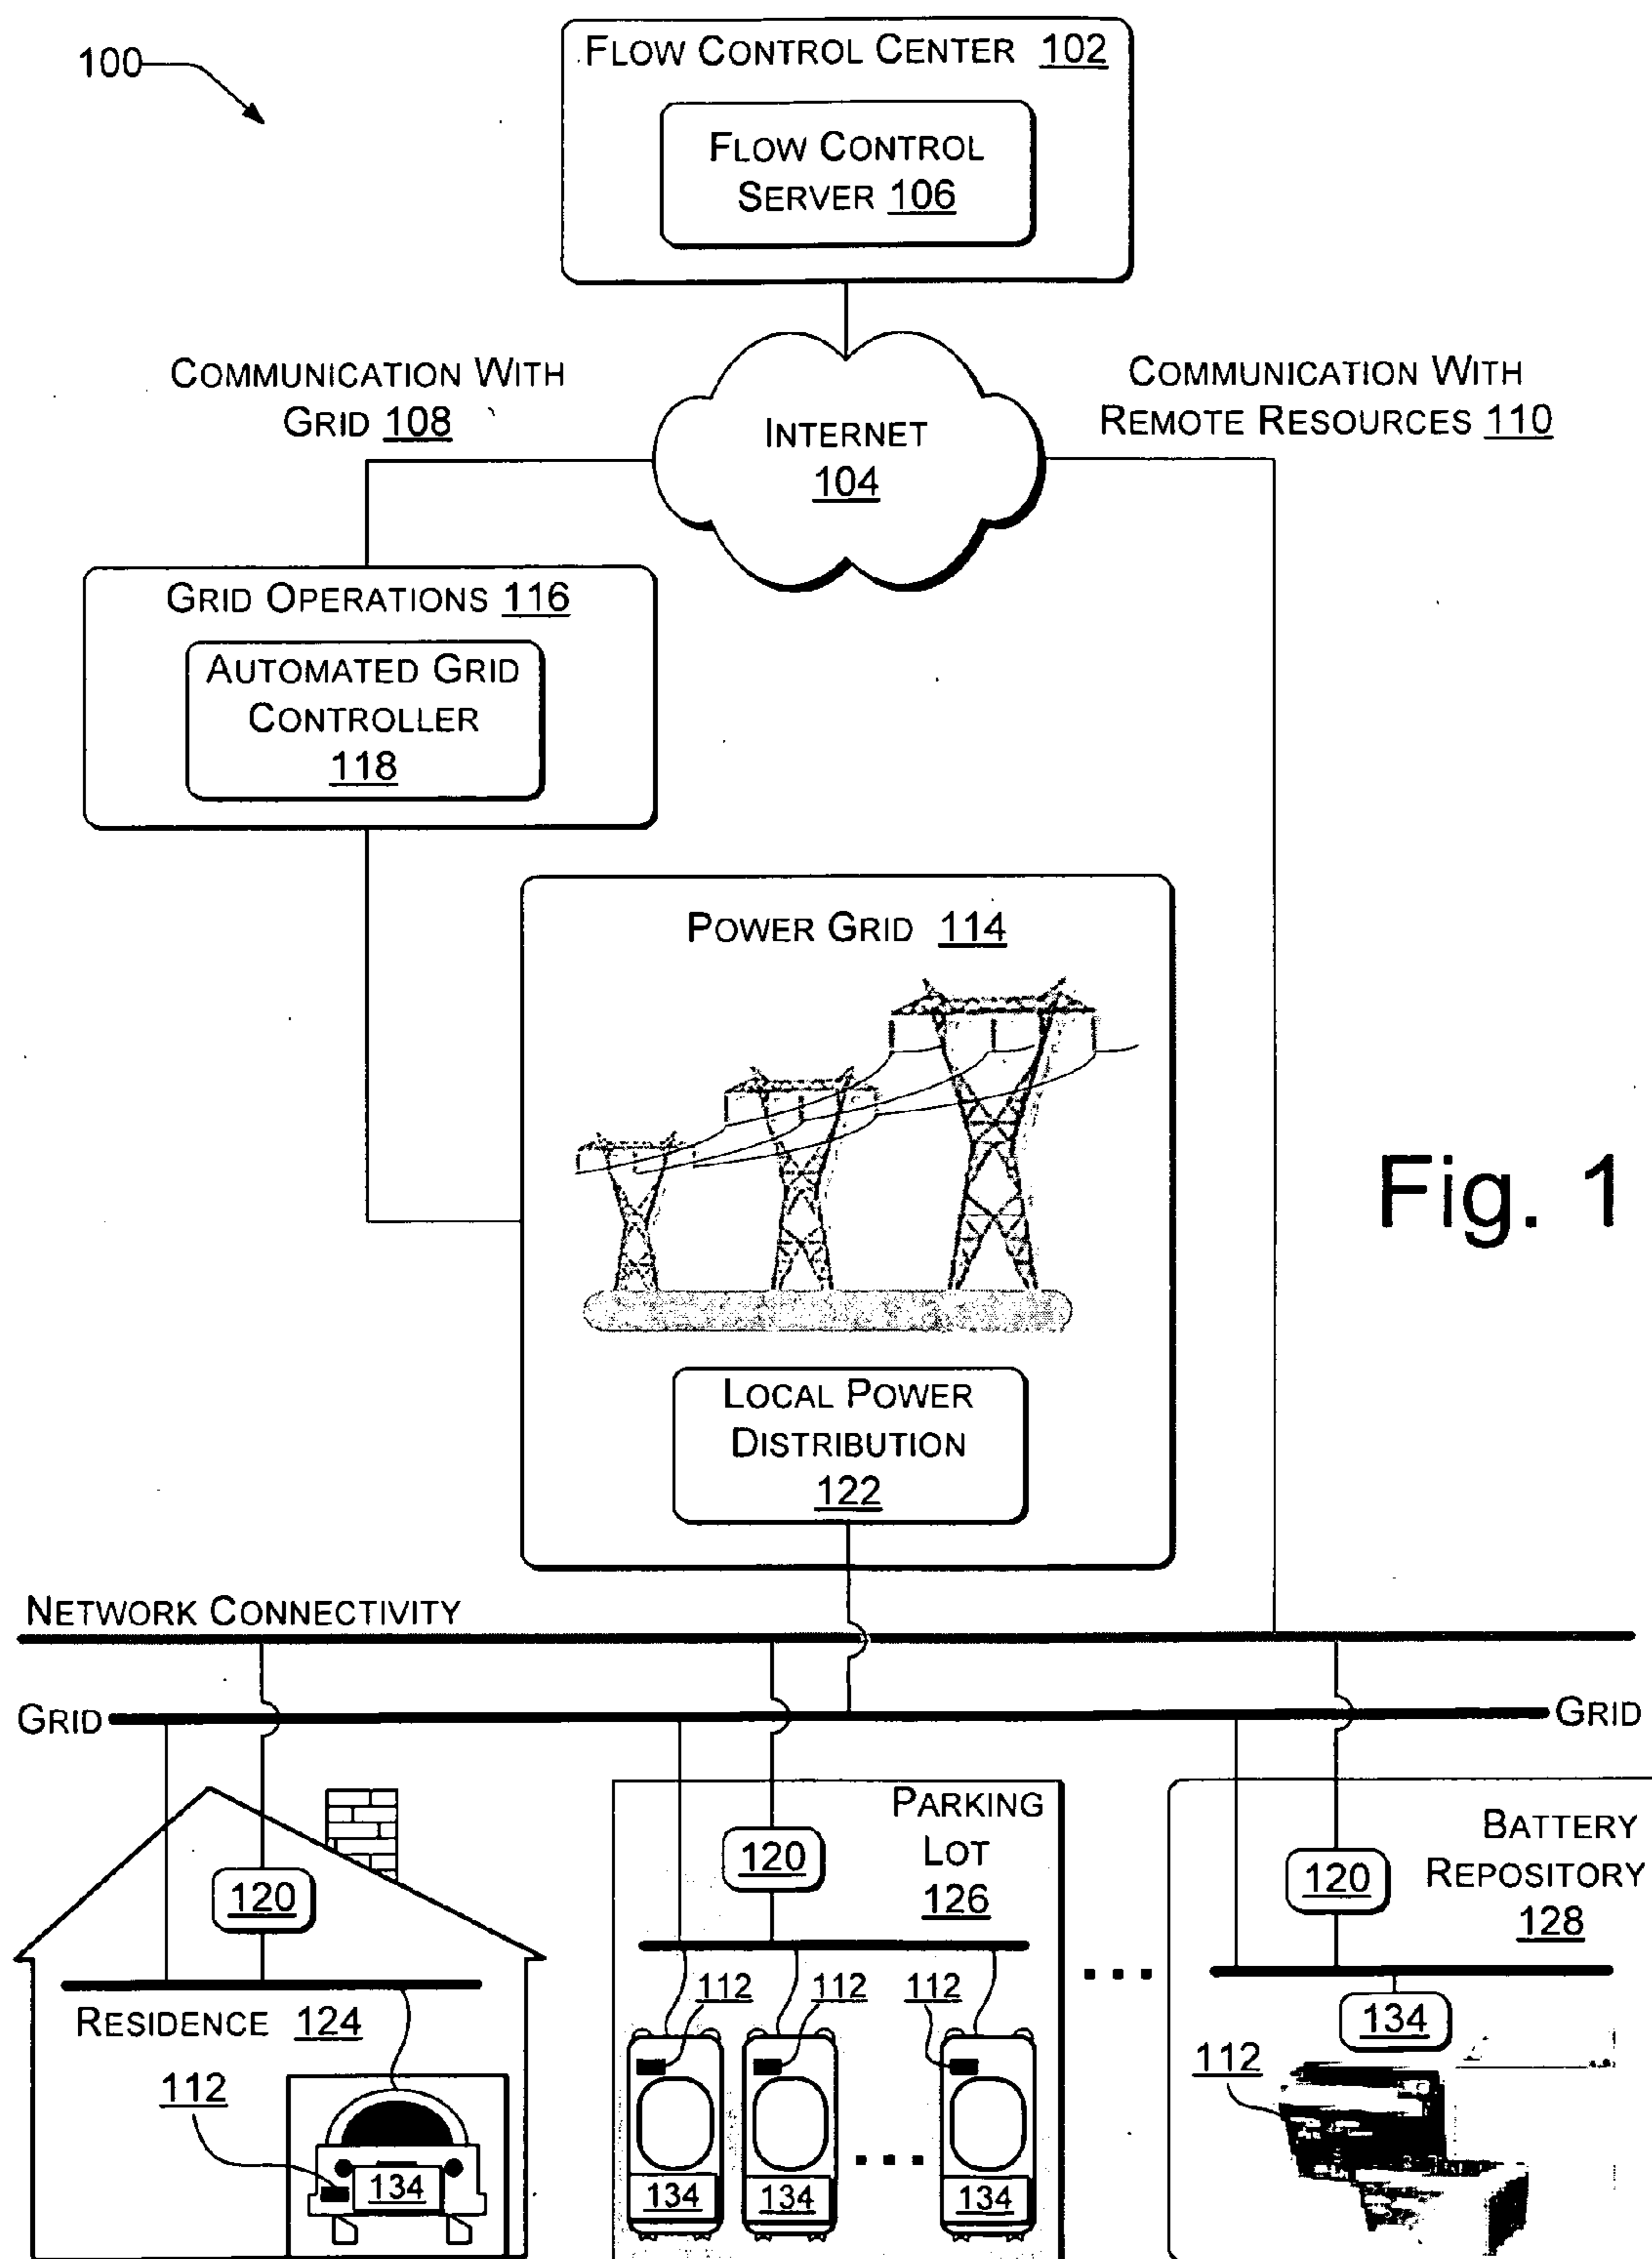


Fig. 1

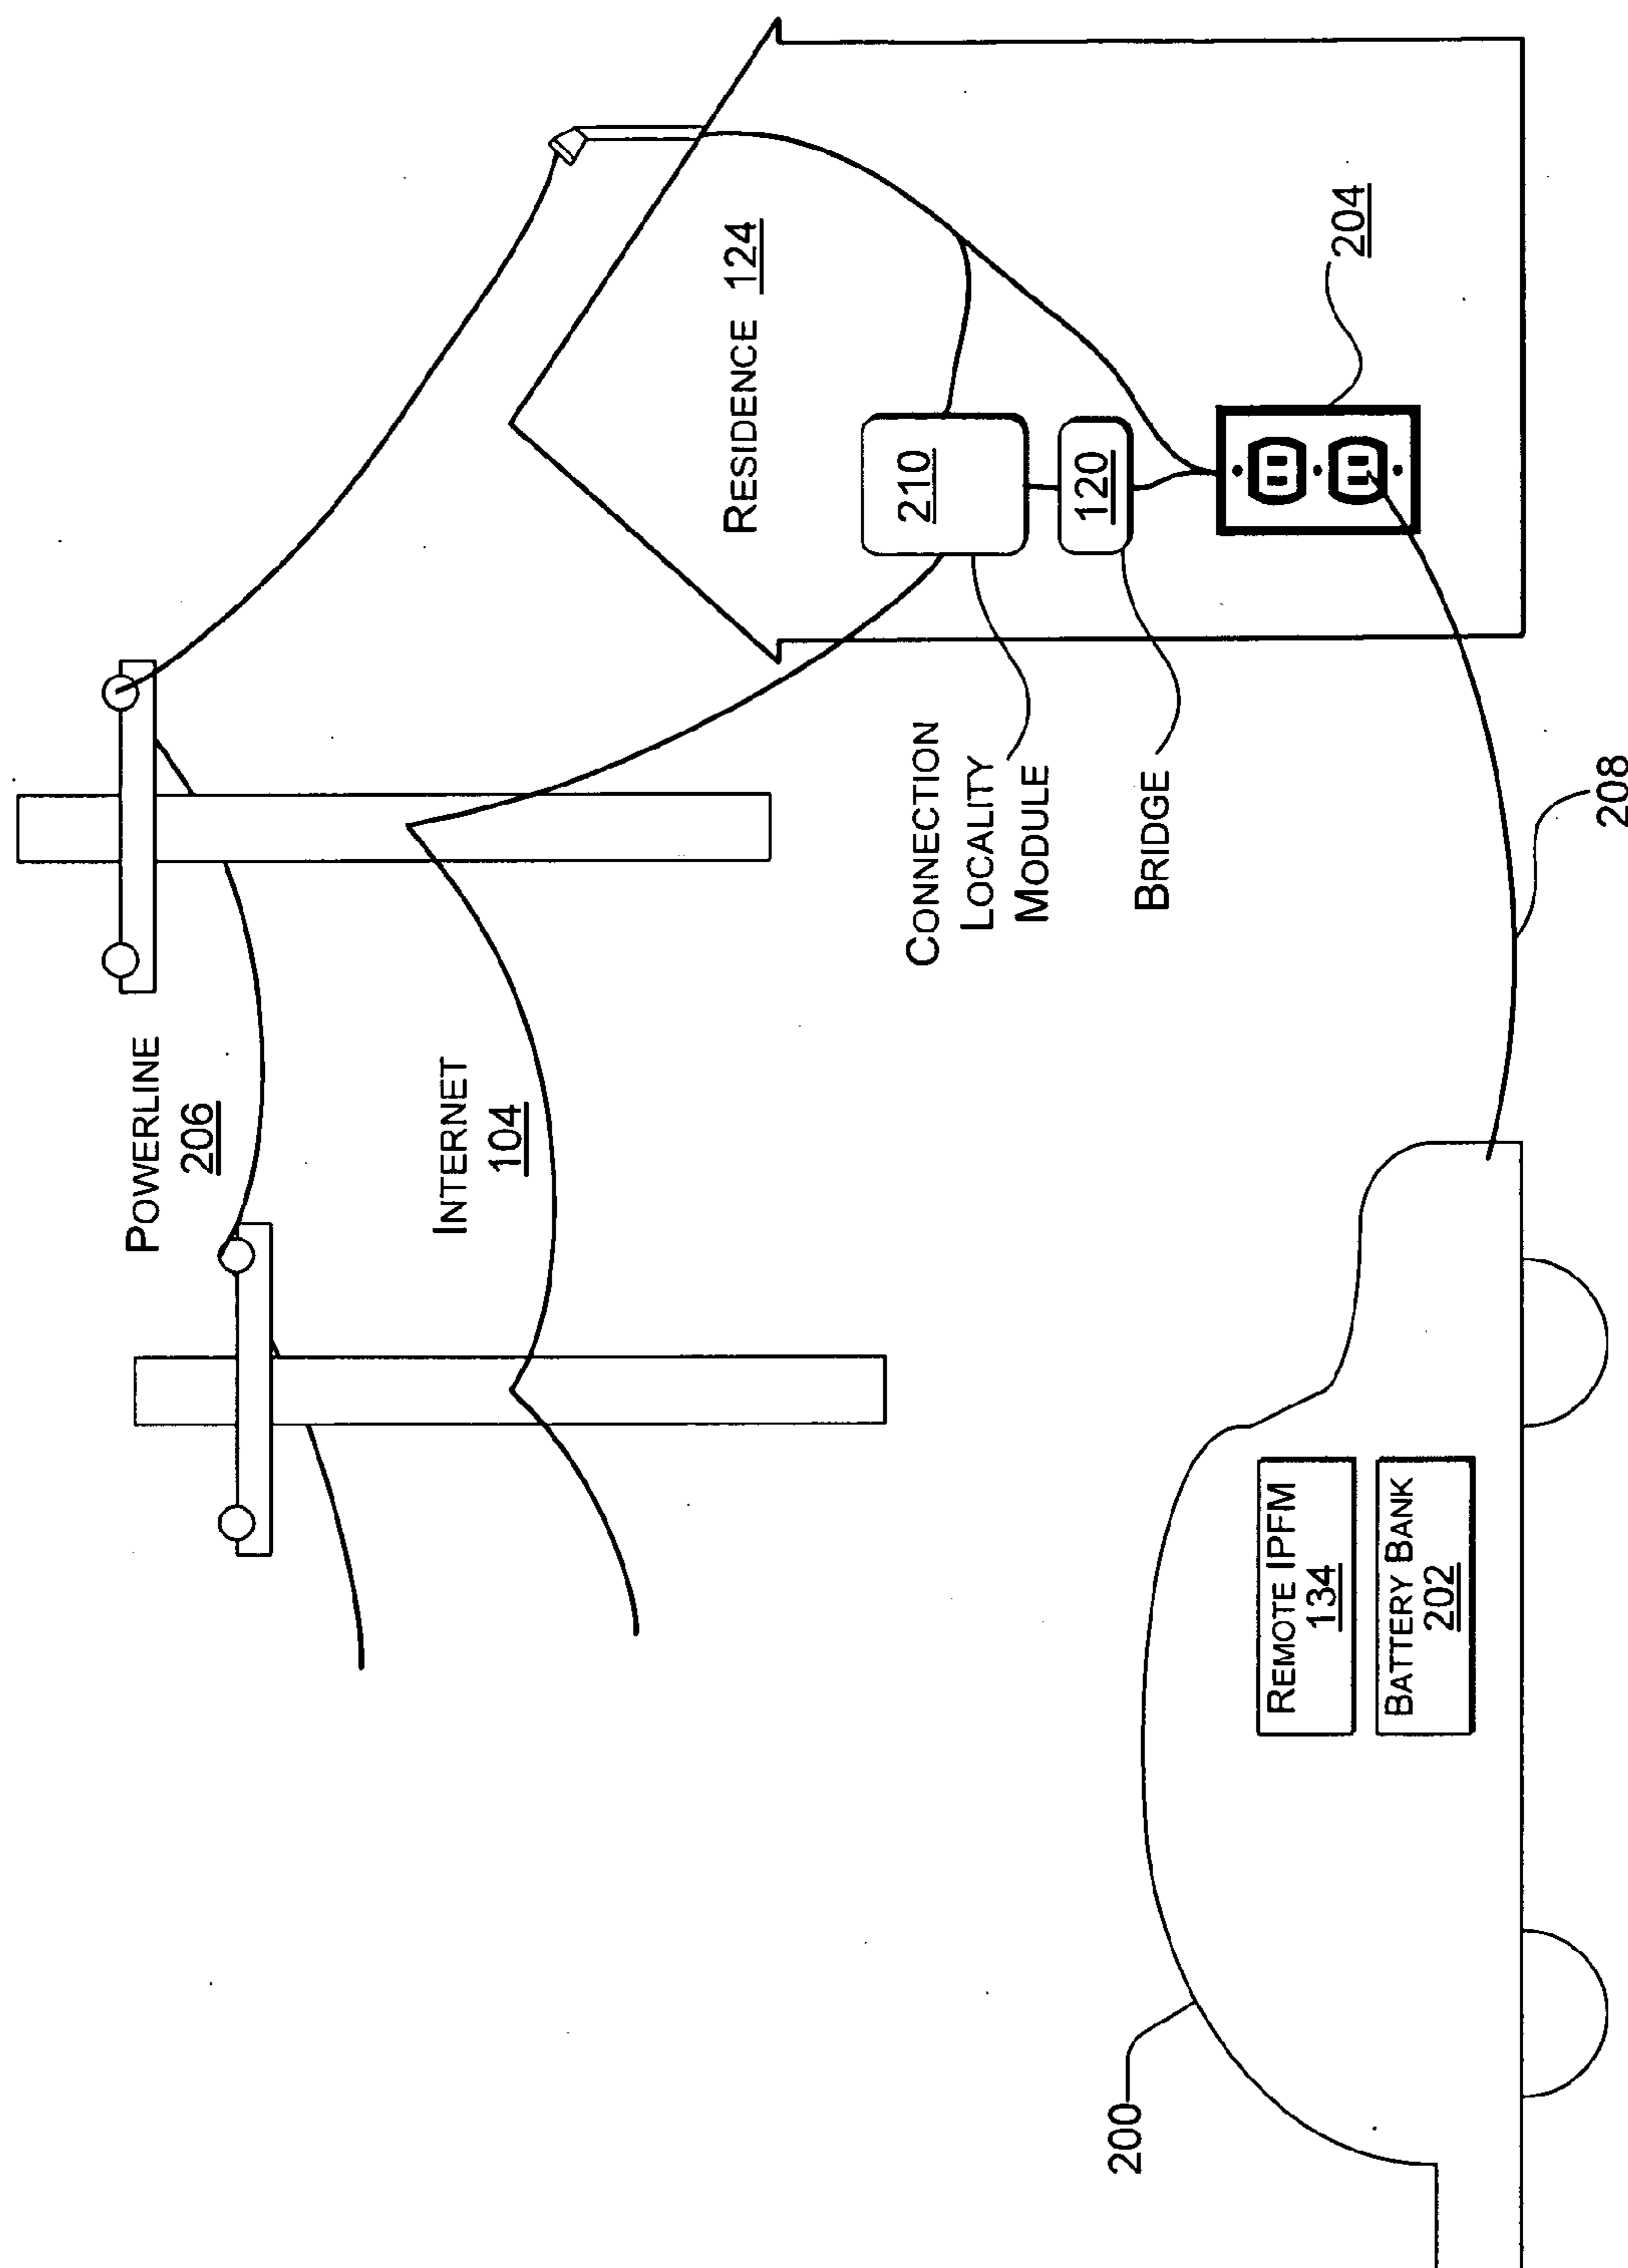


Fig. 2A

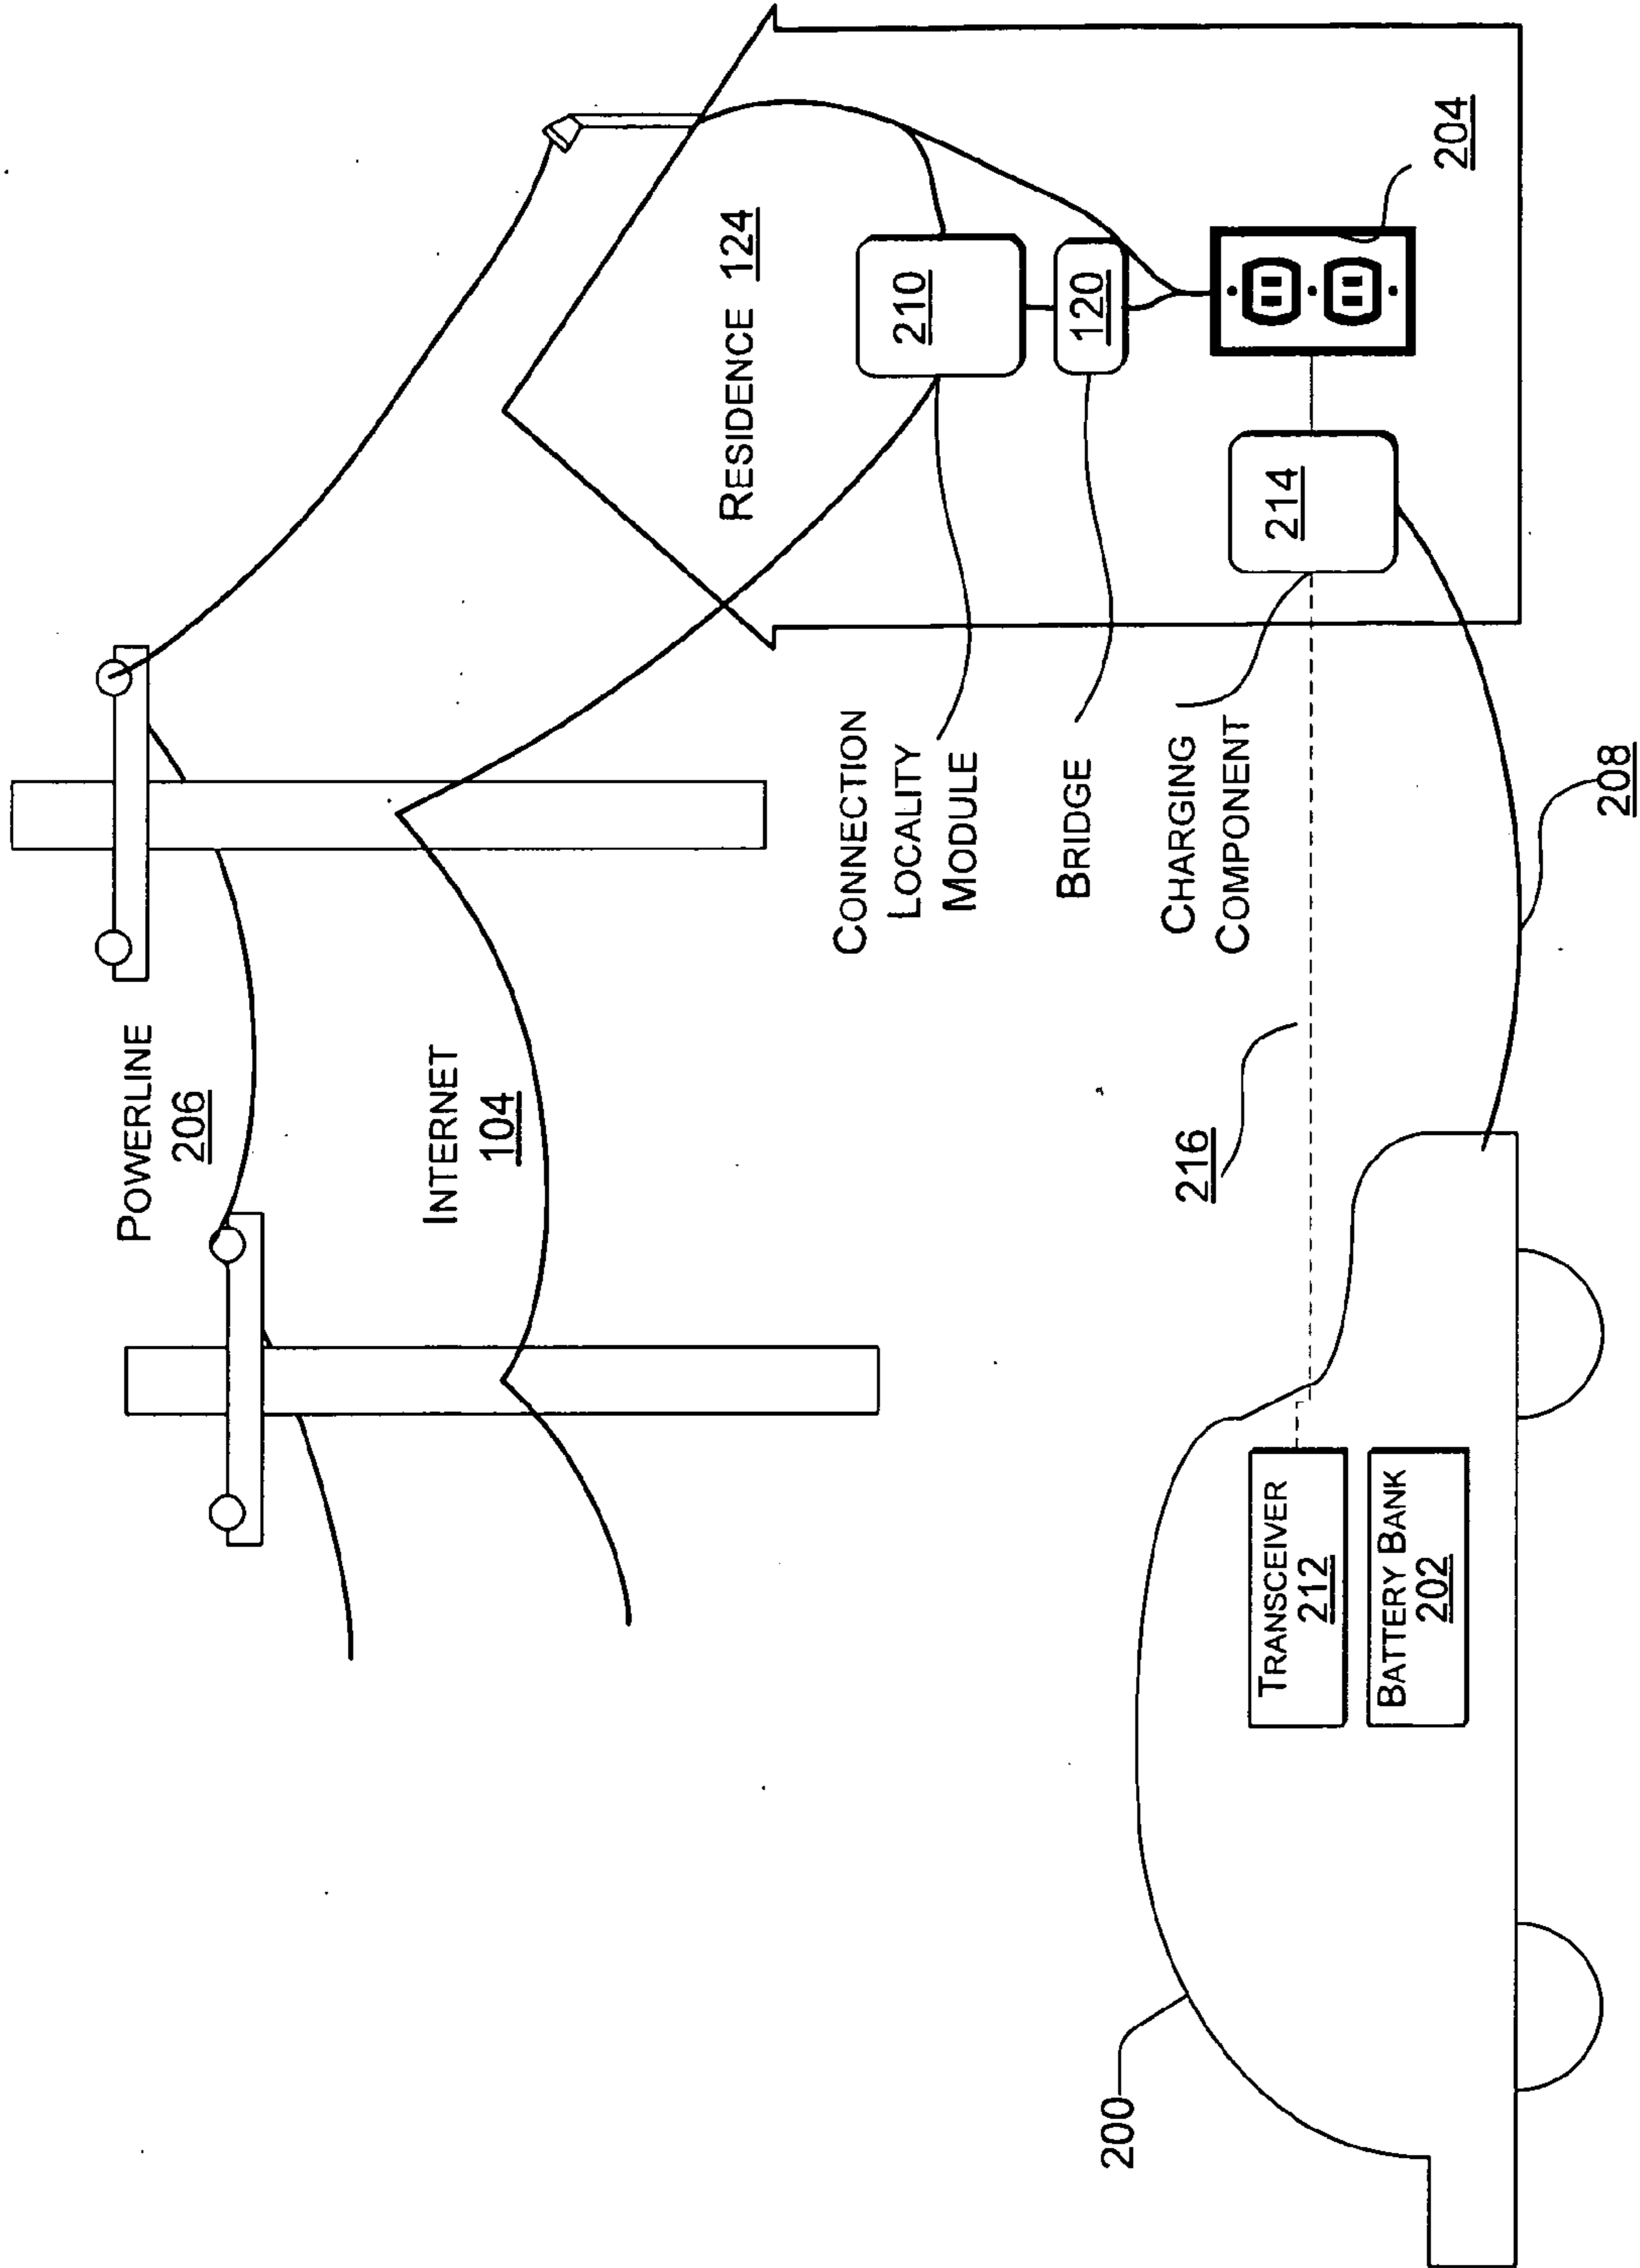


Fig. 2B

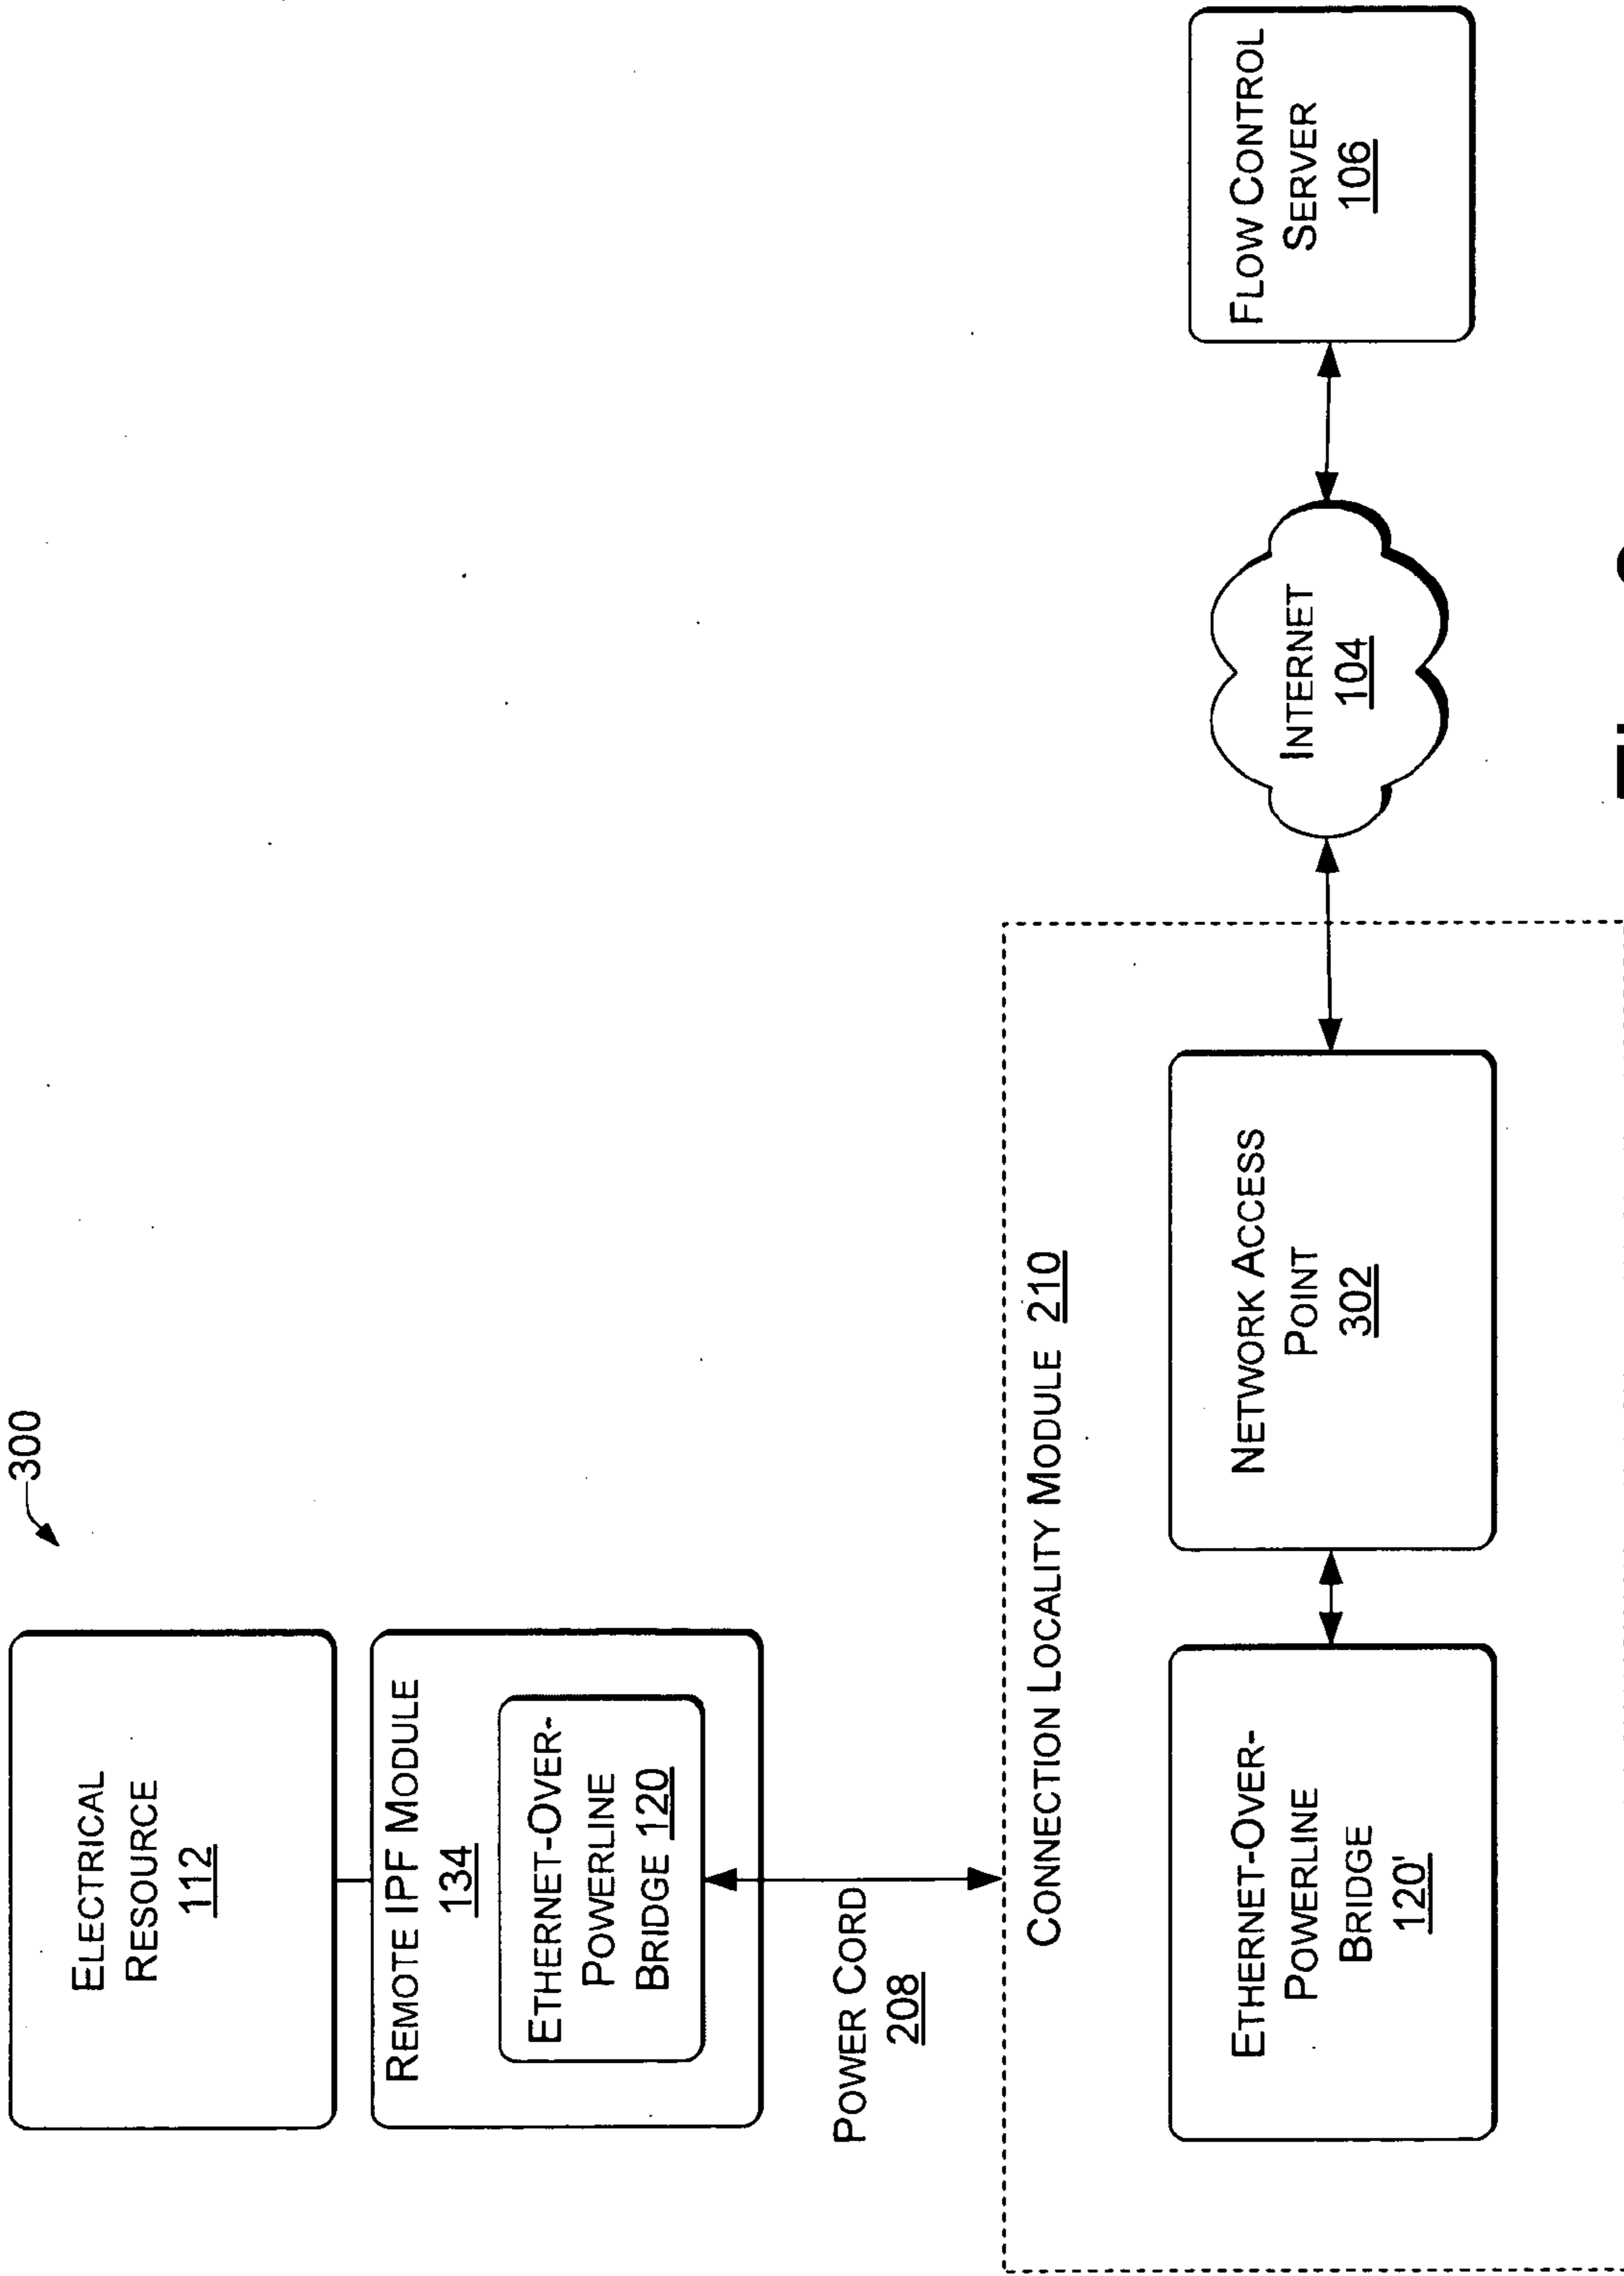


Fig. 3

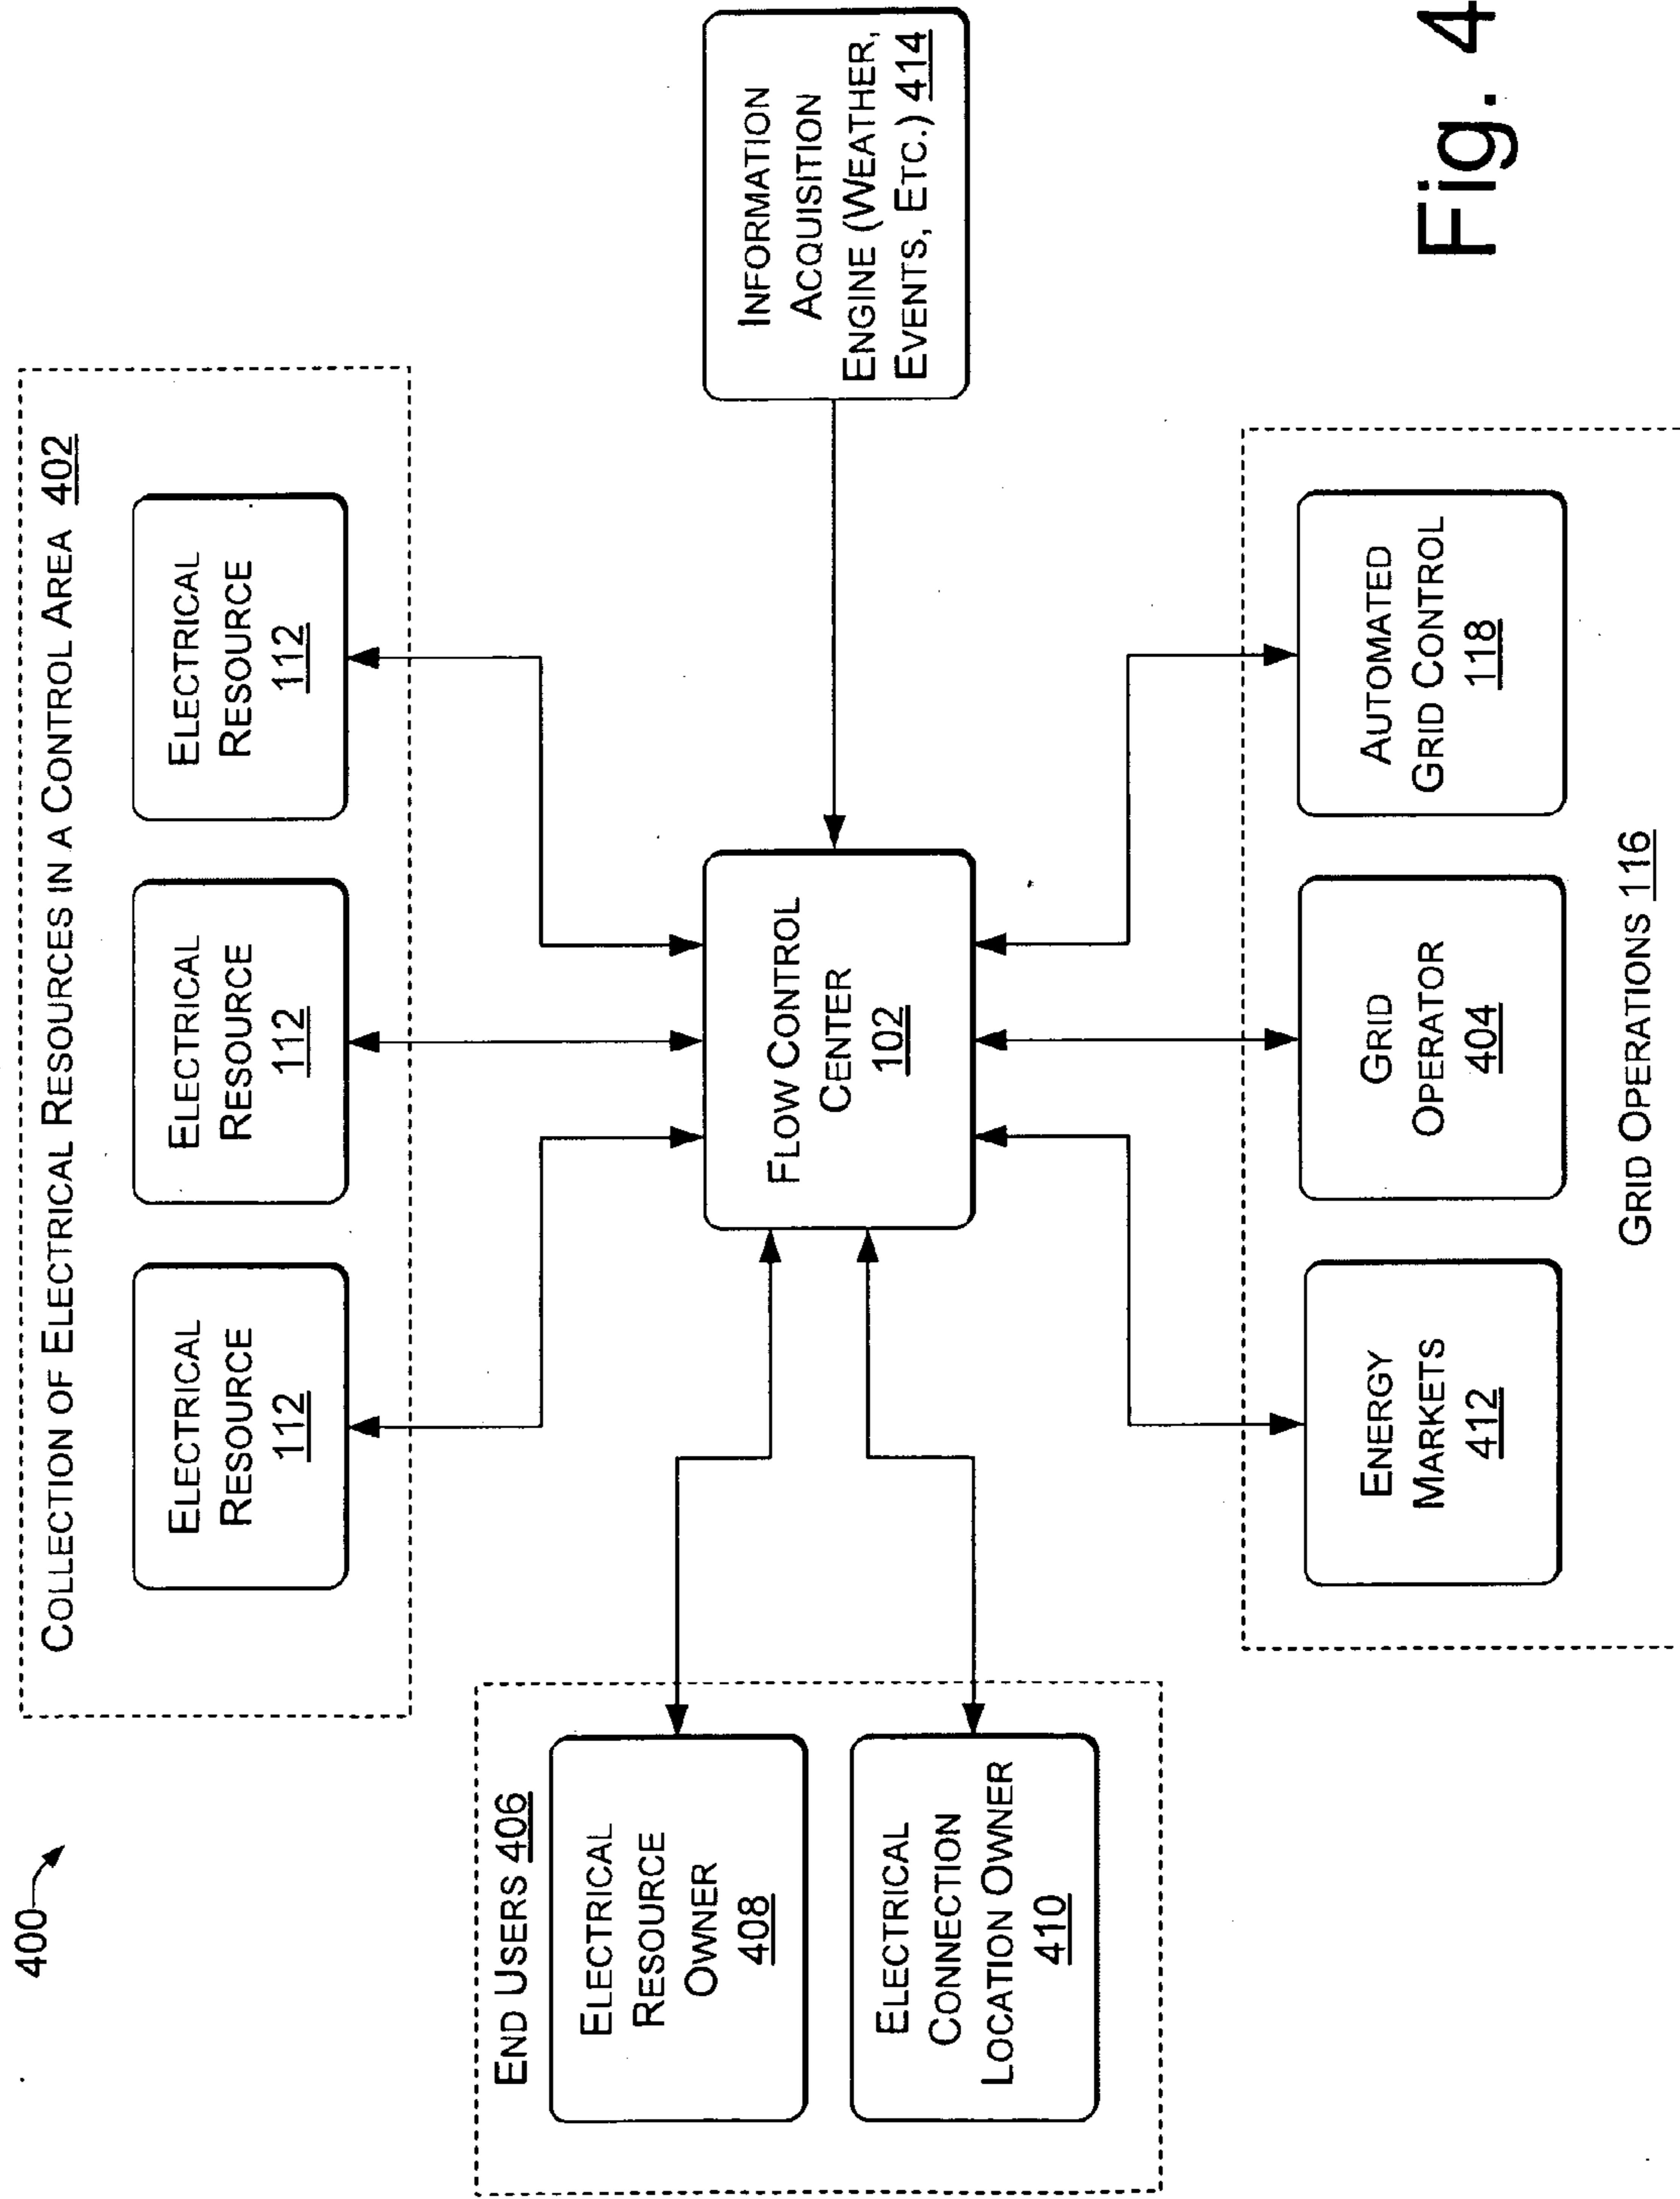


Fig. 4

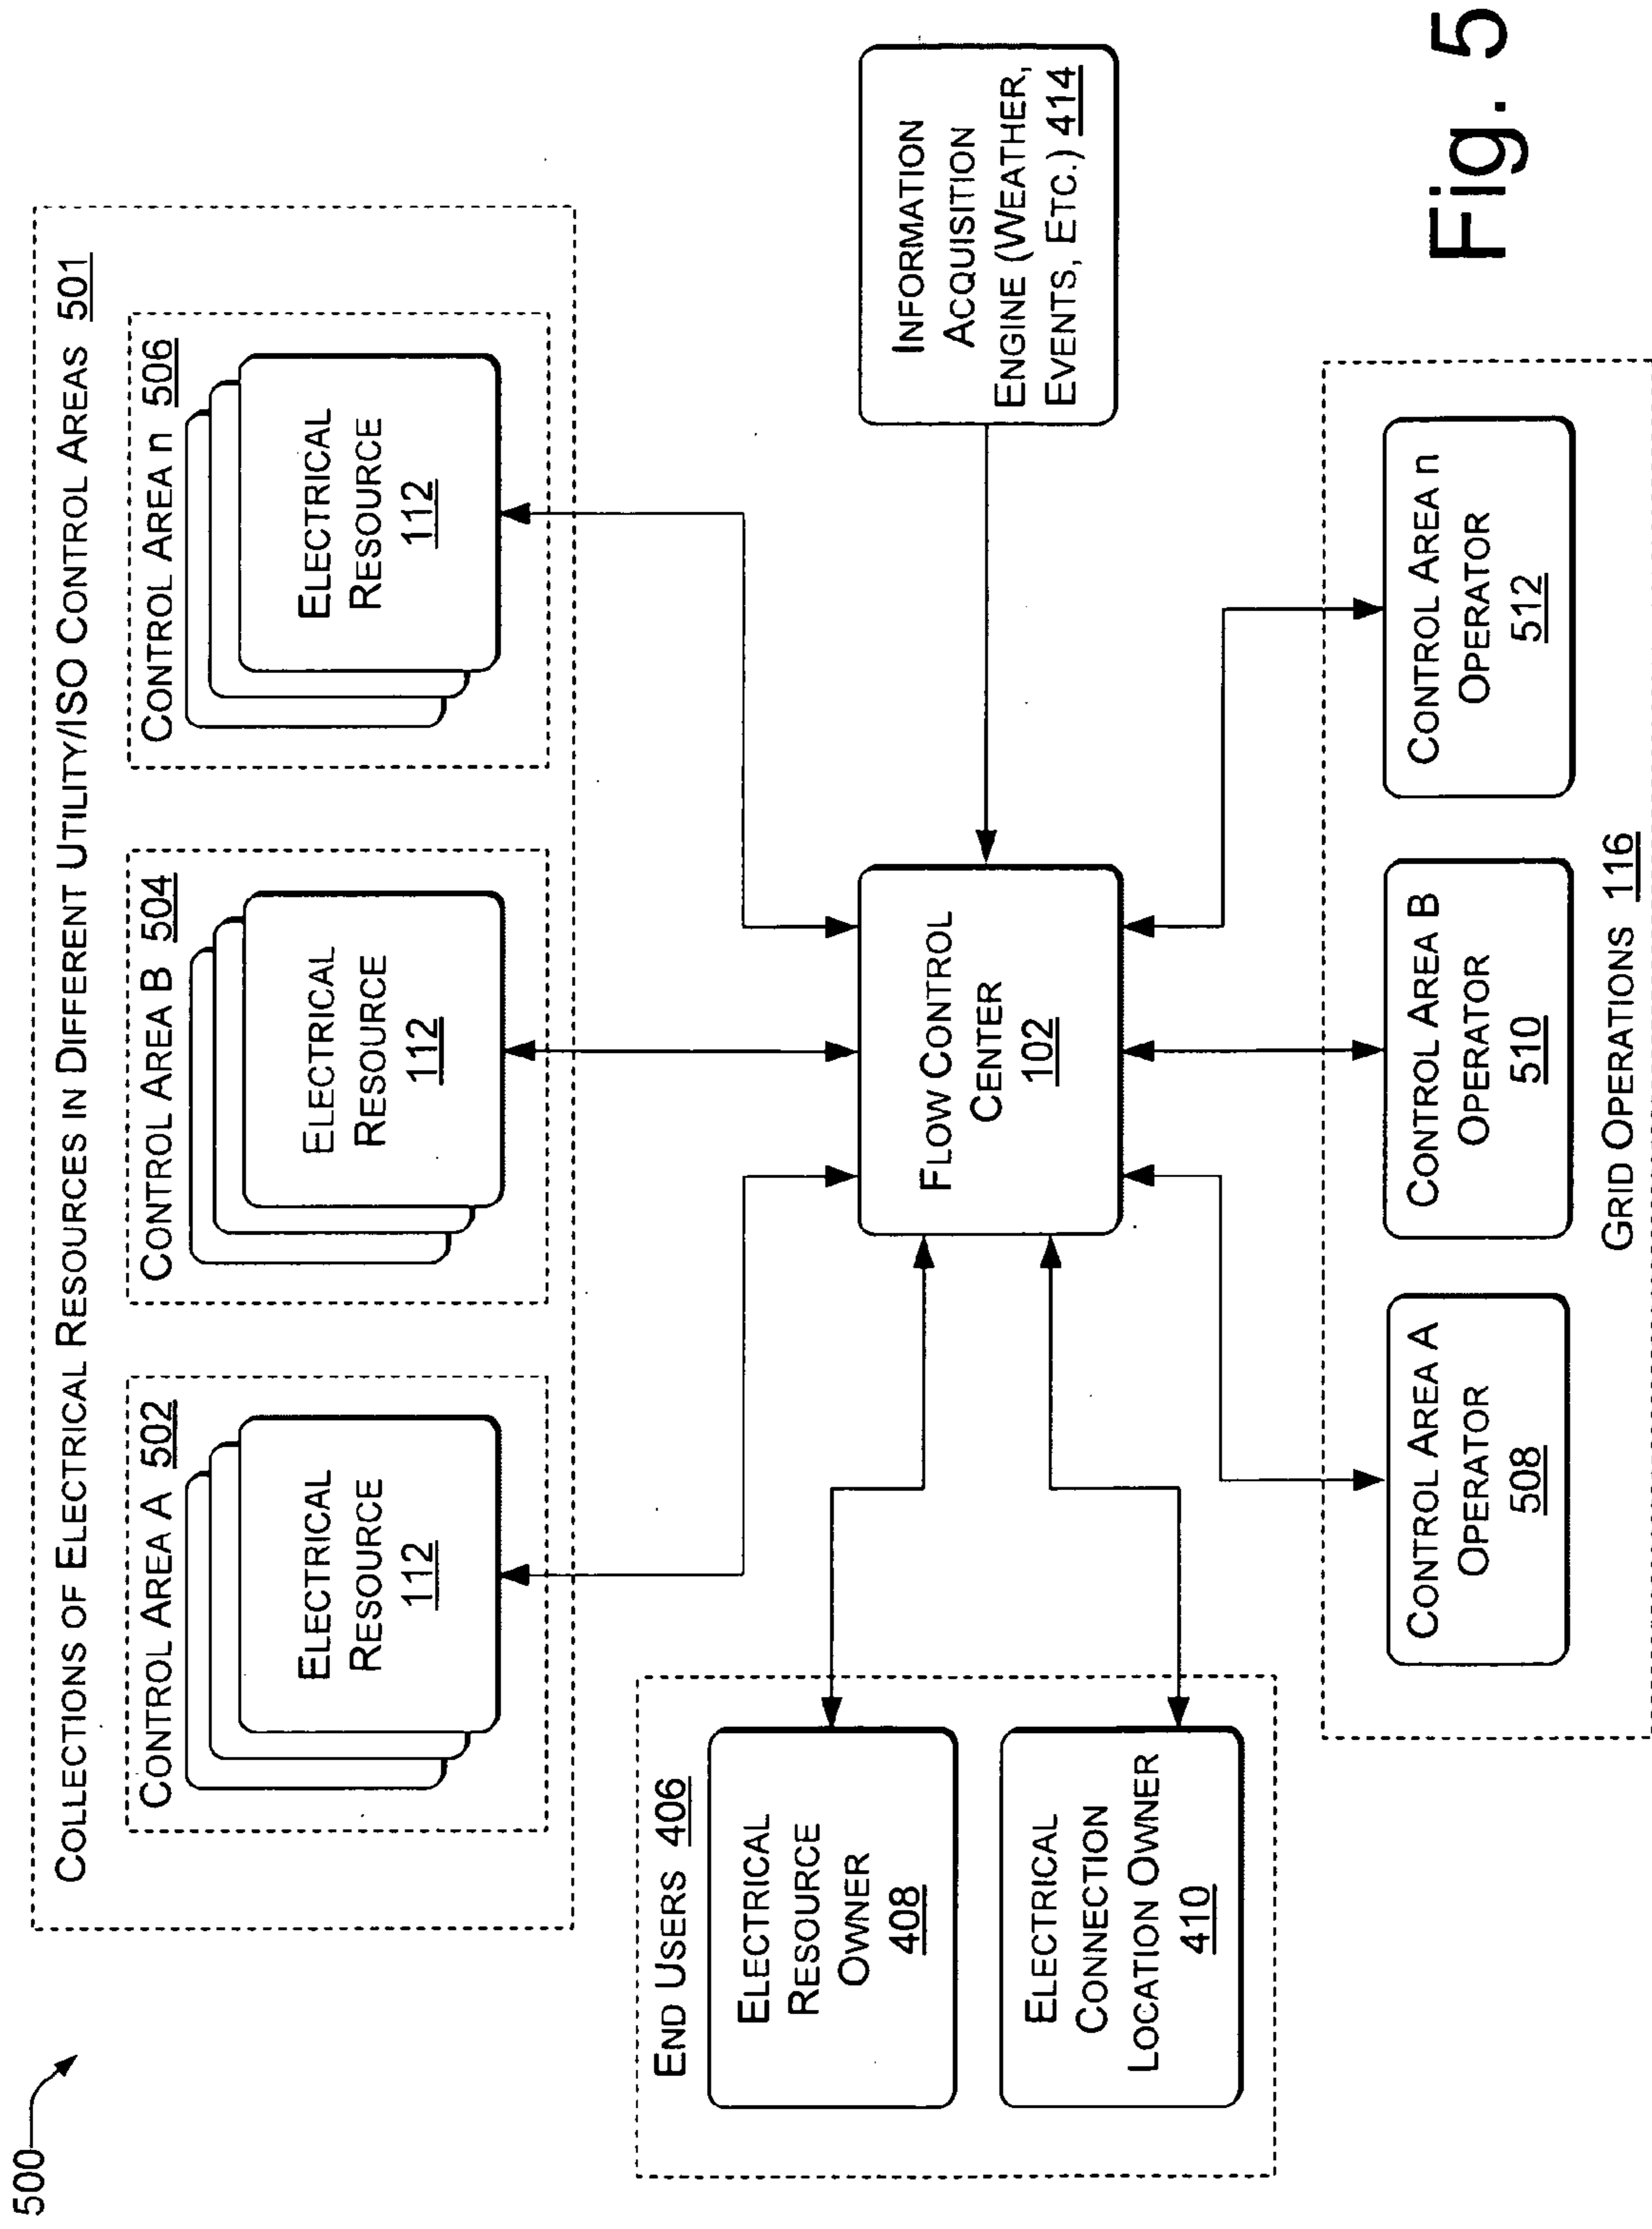


Fig. 5

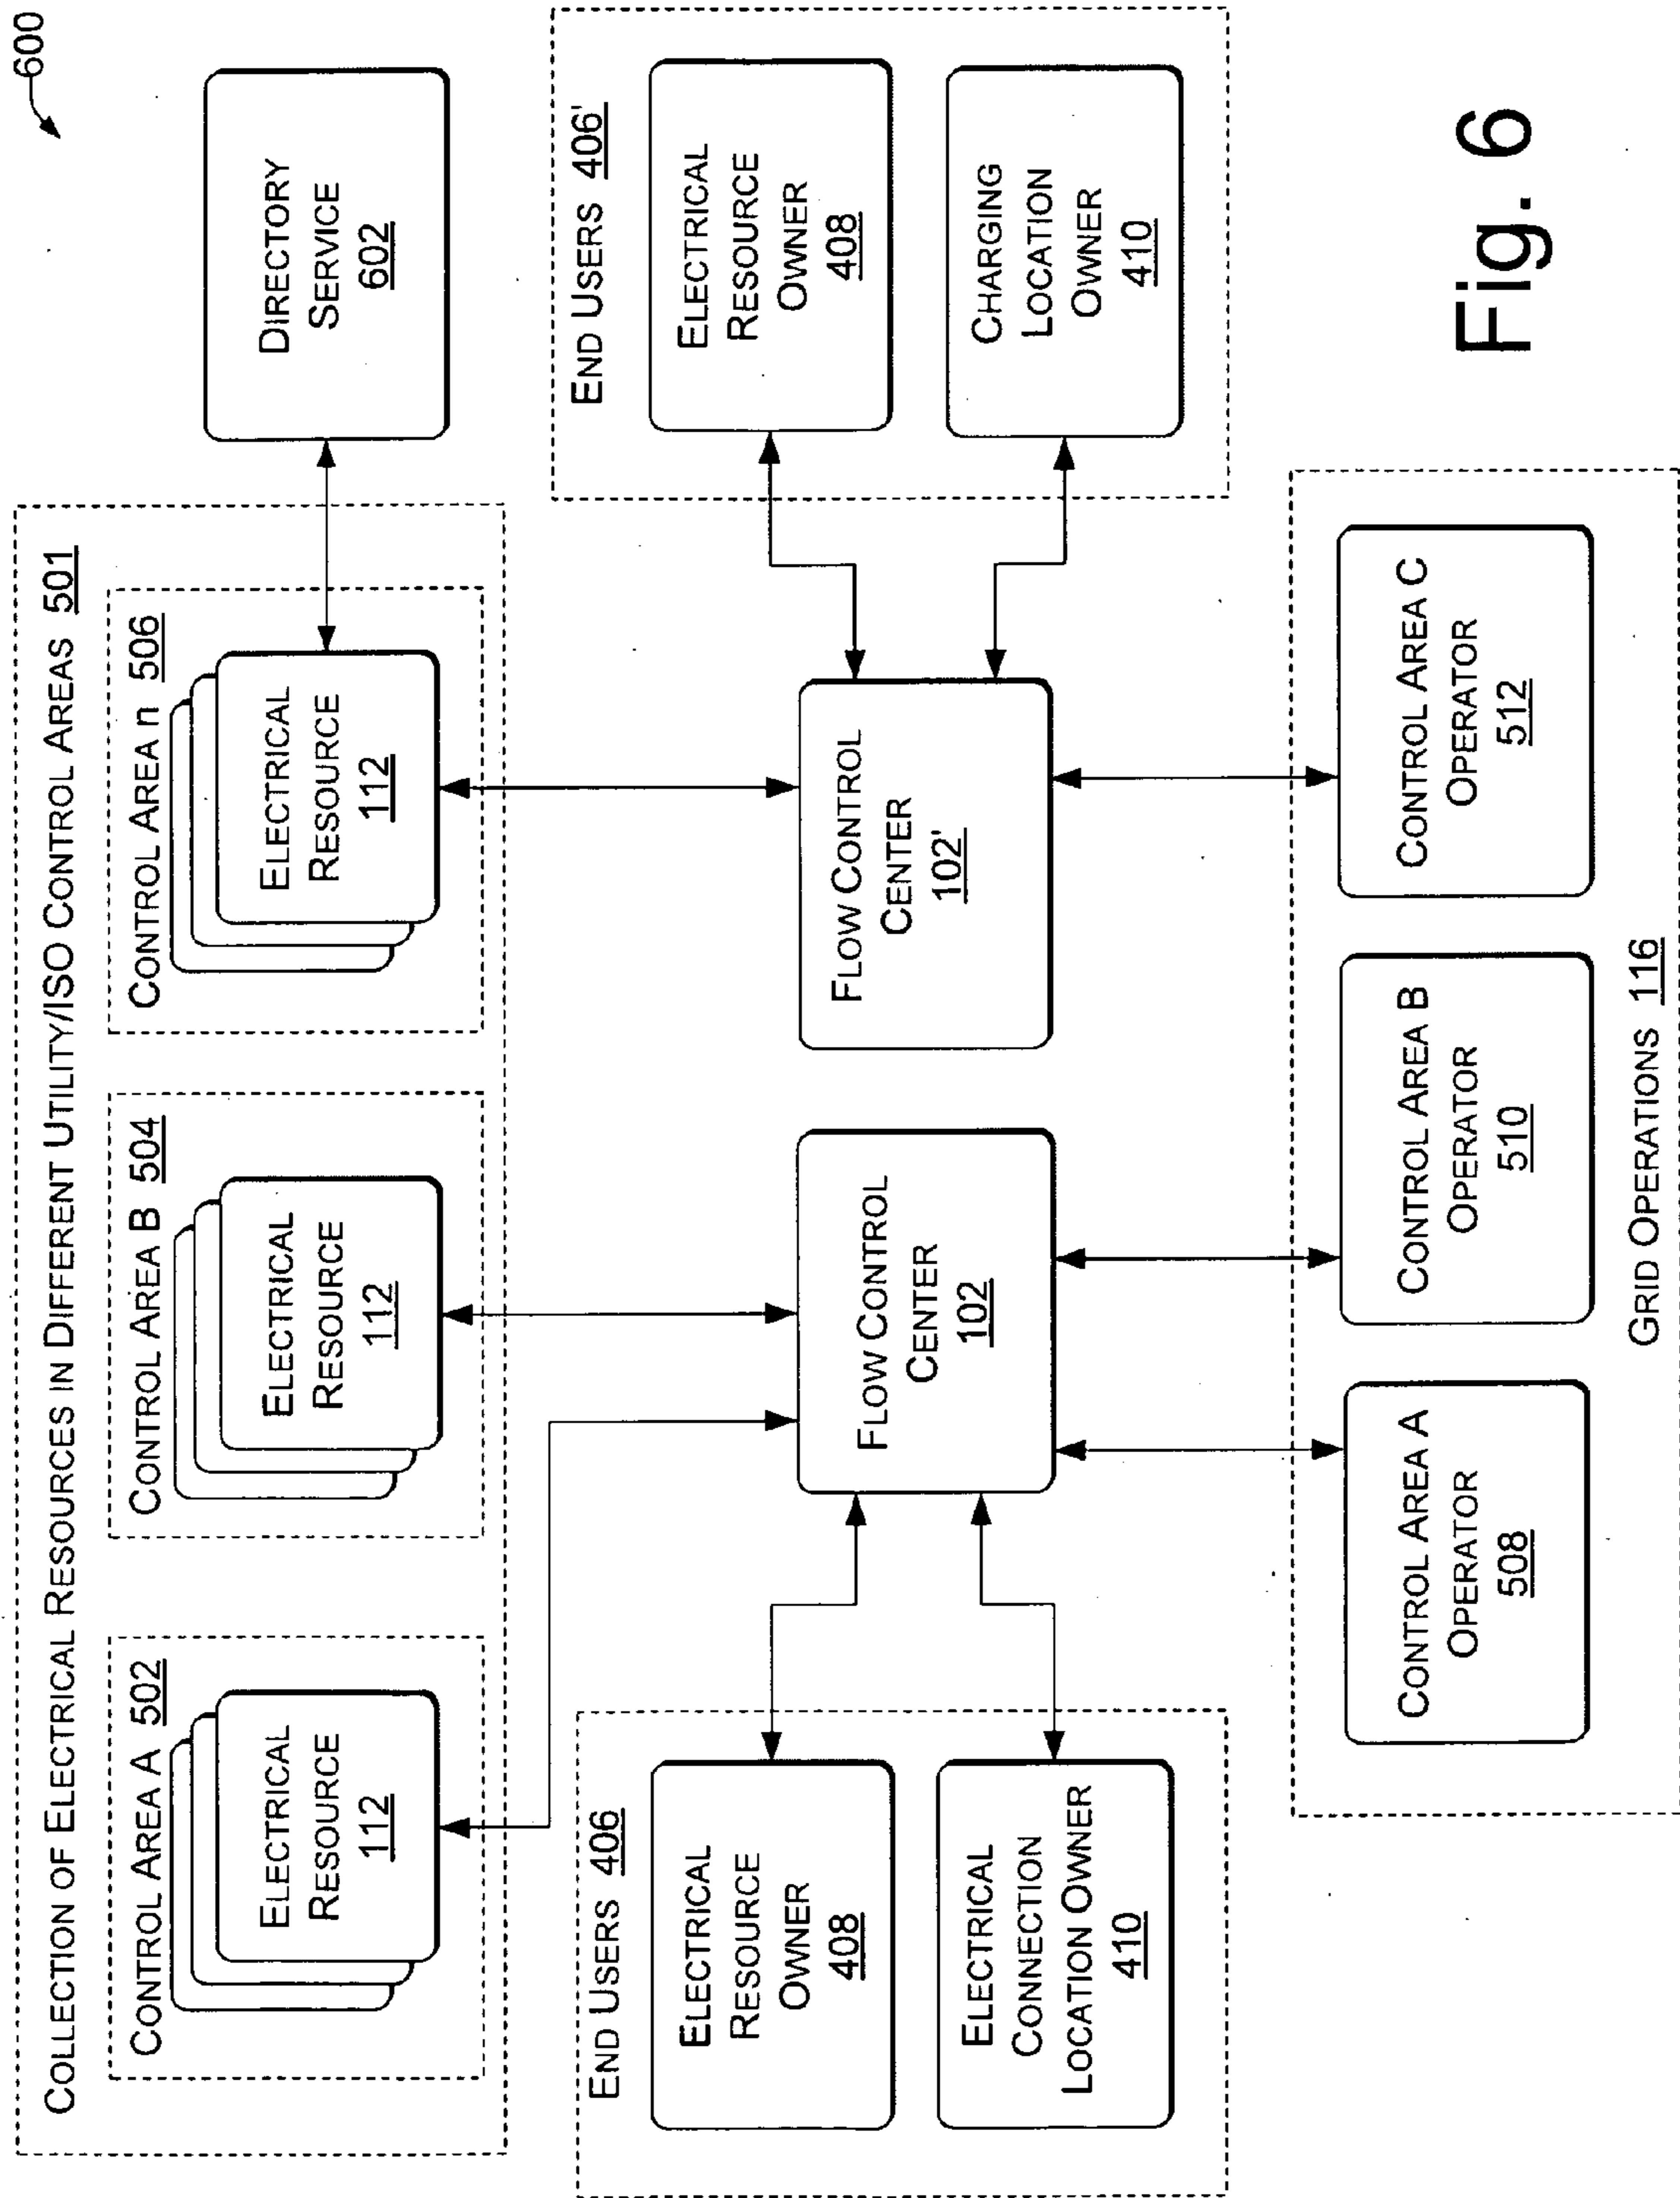


Fig. 6

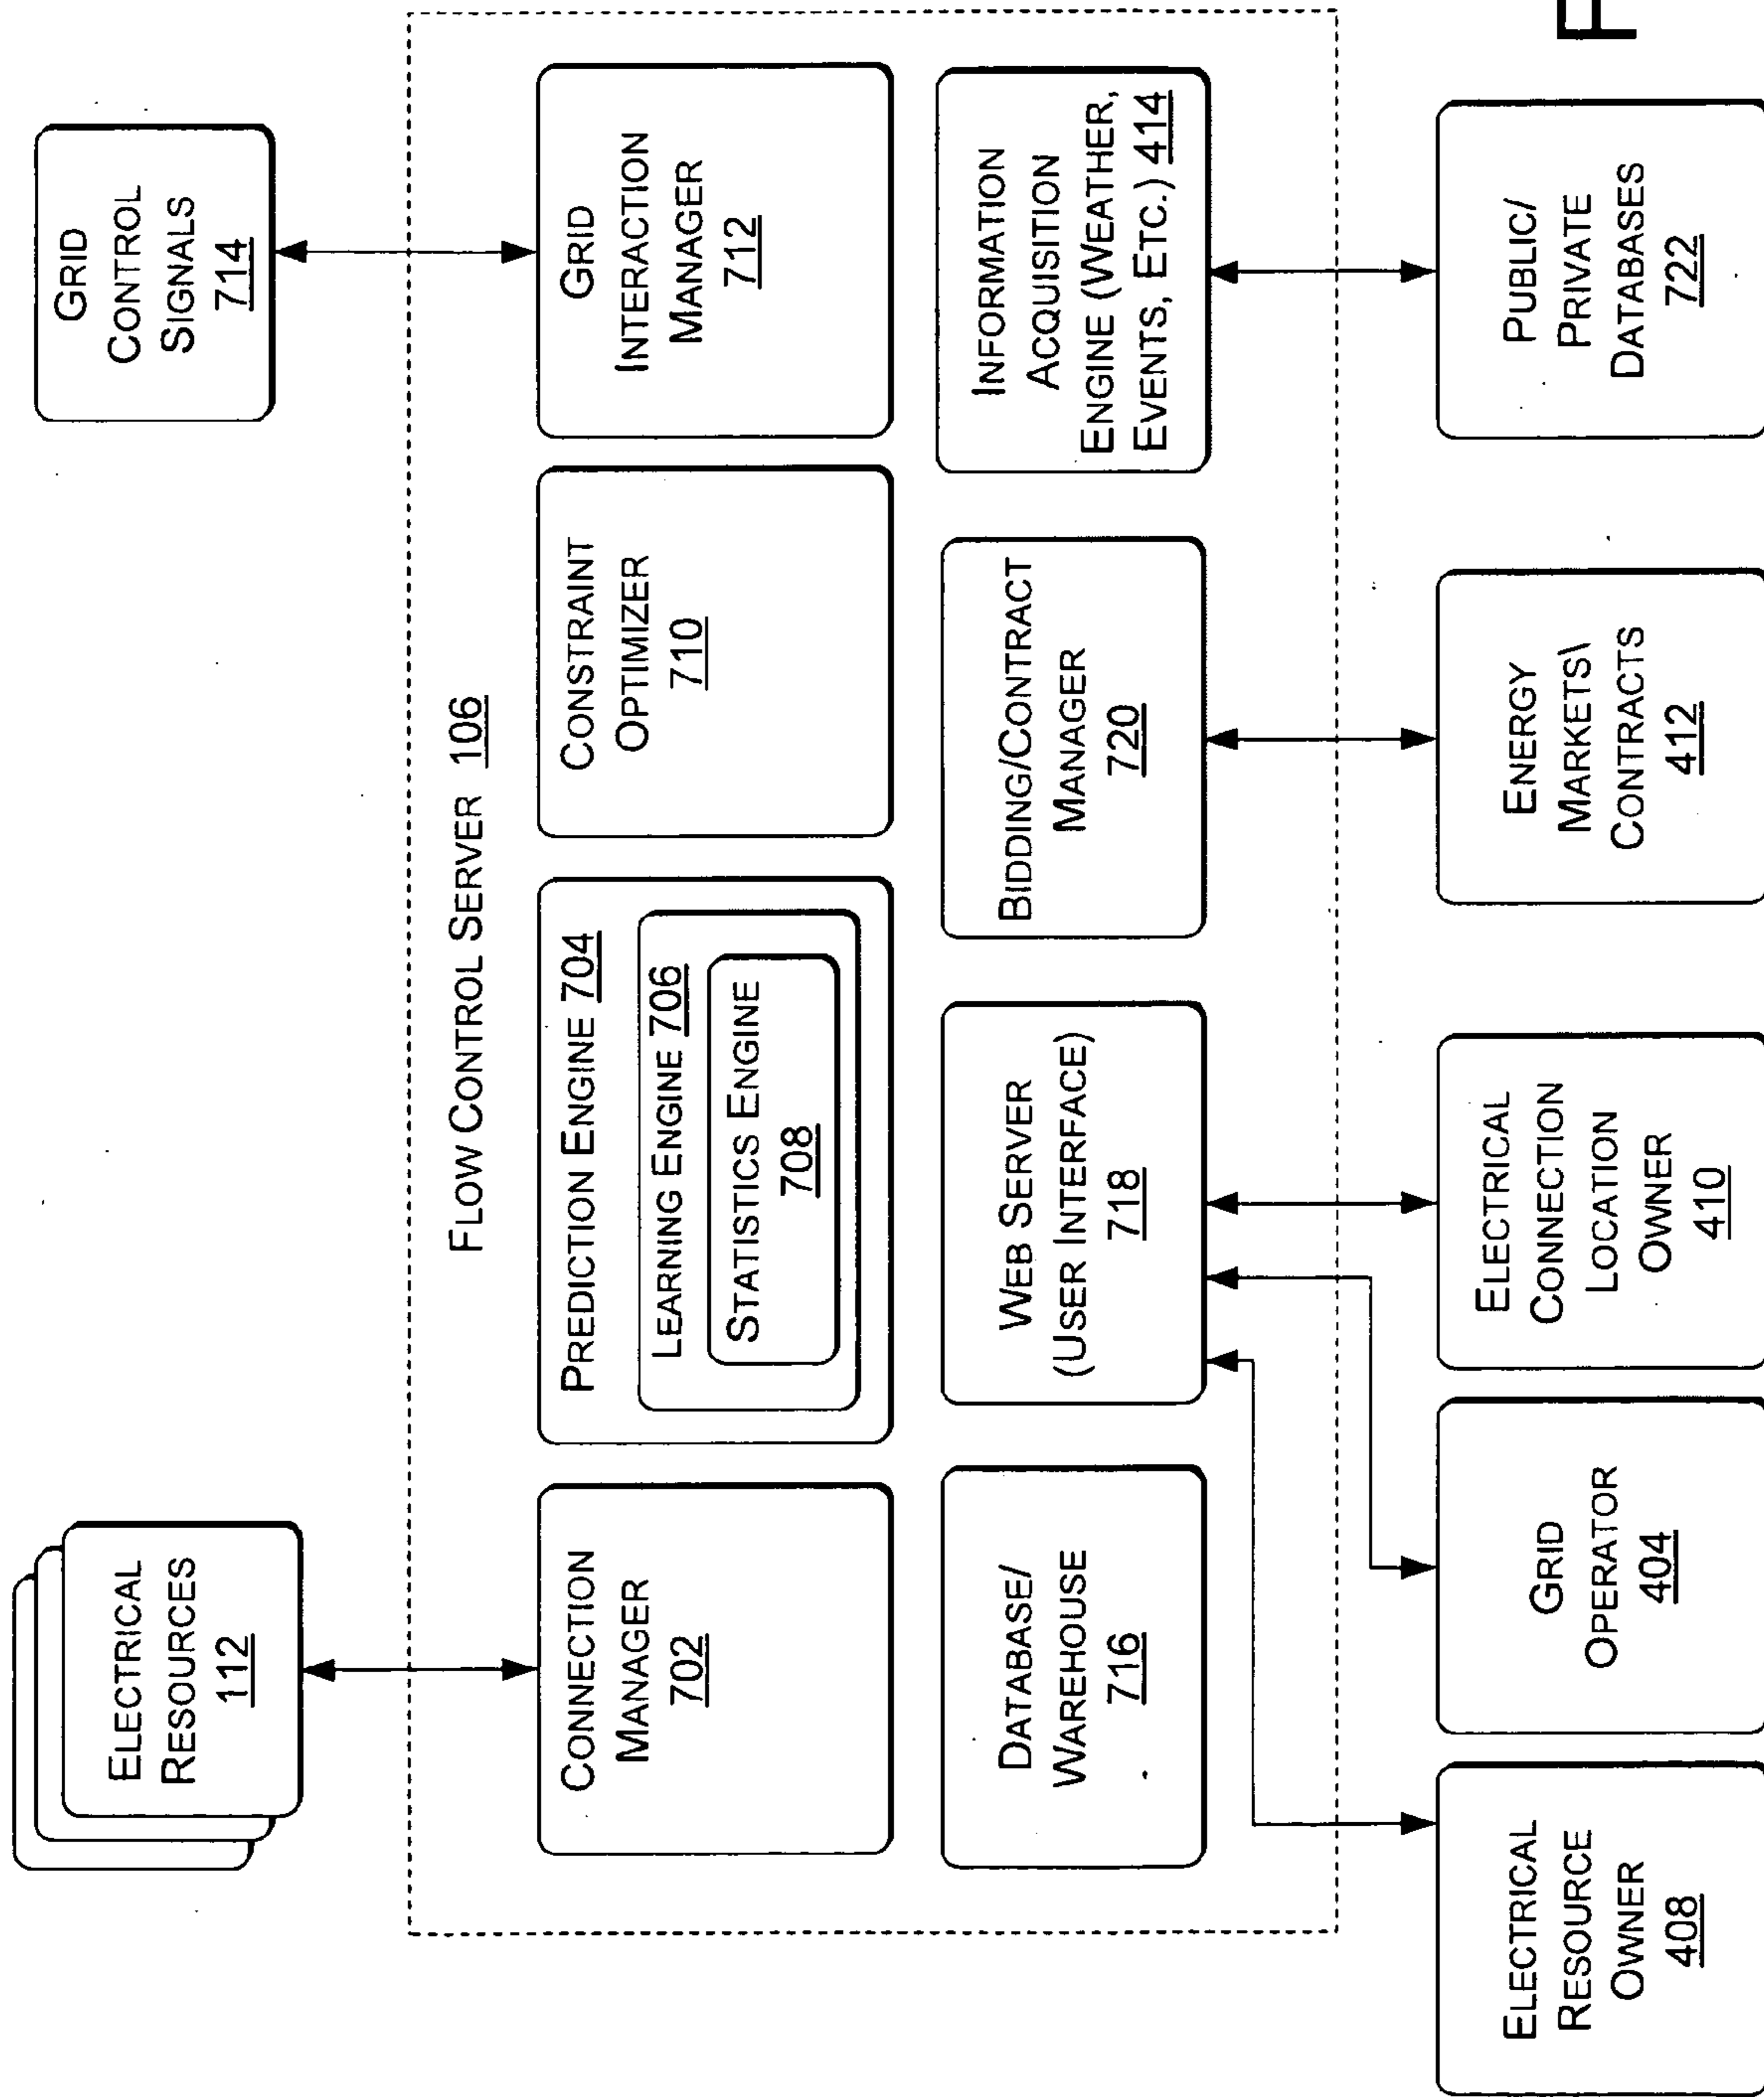


Fig. 7

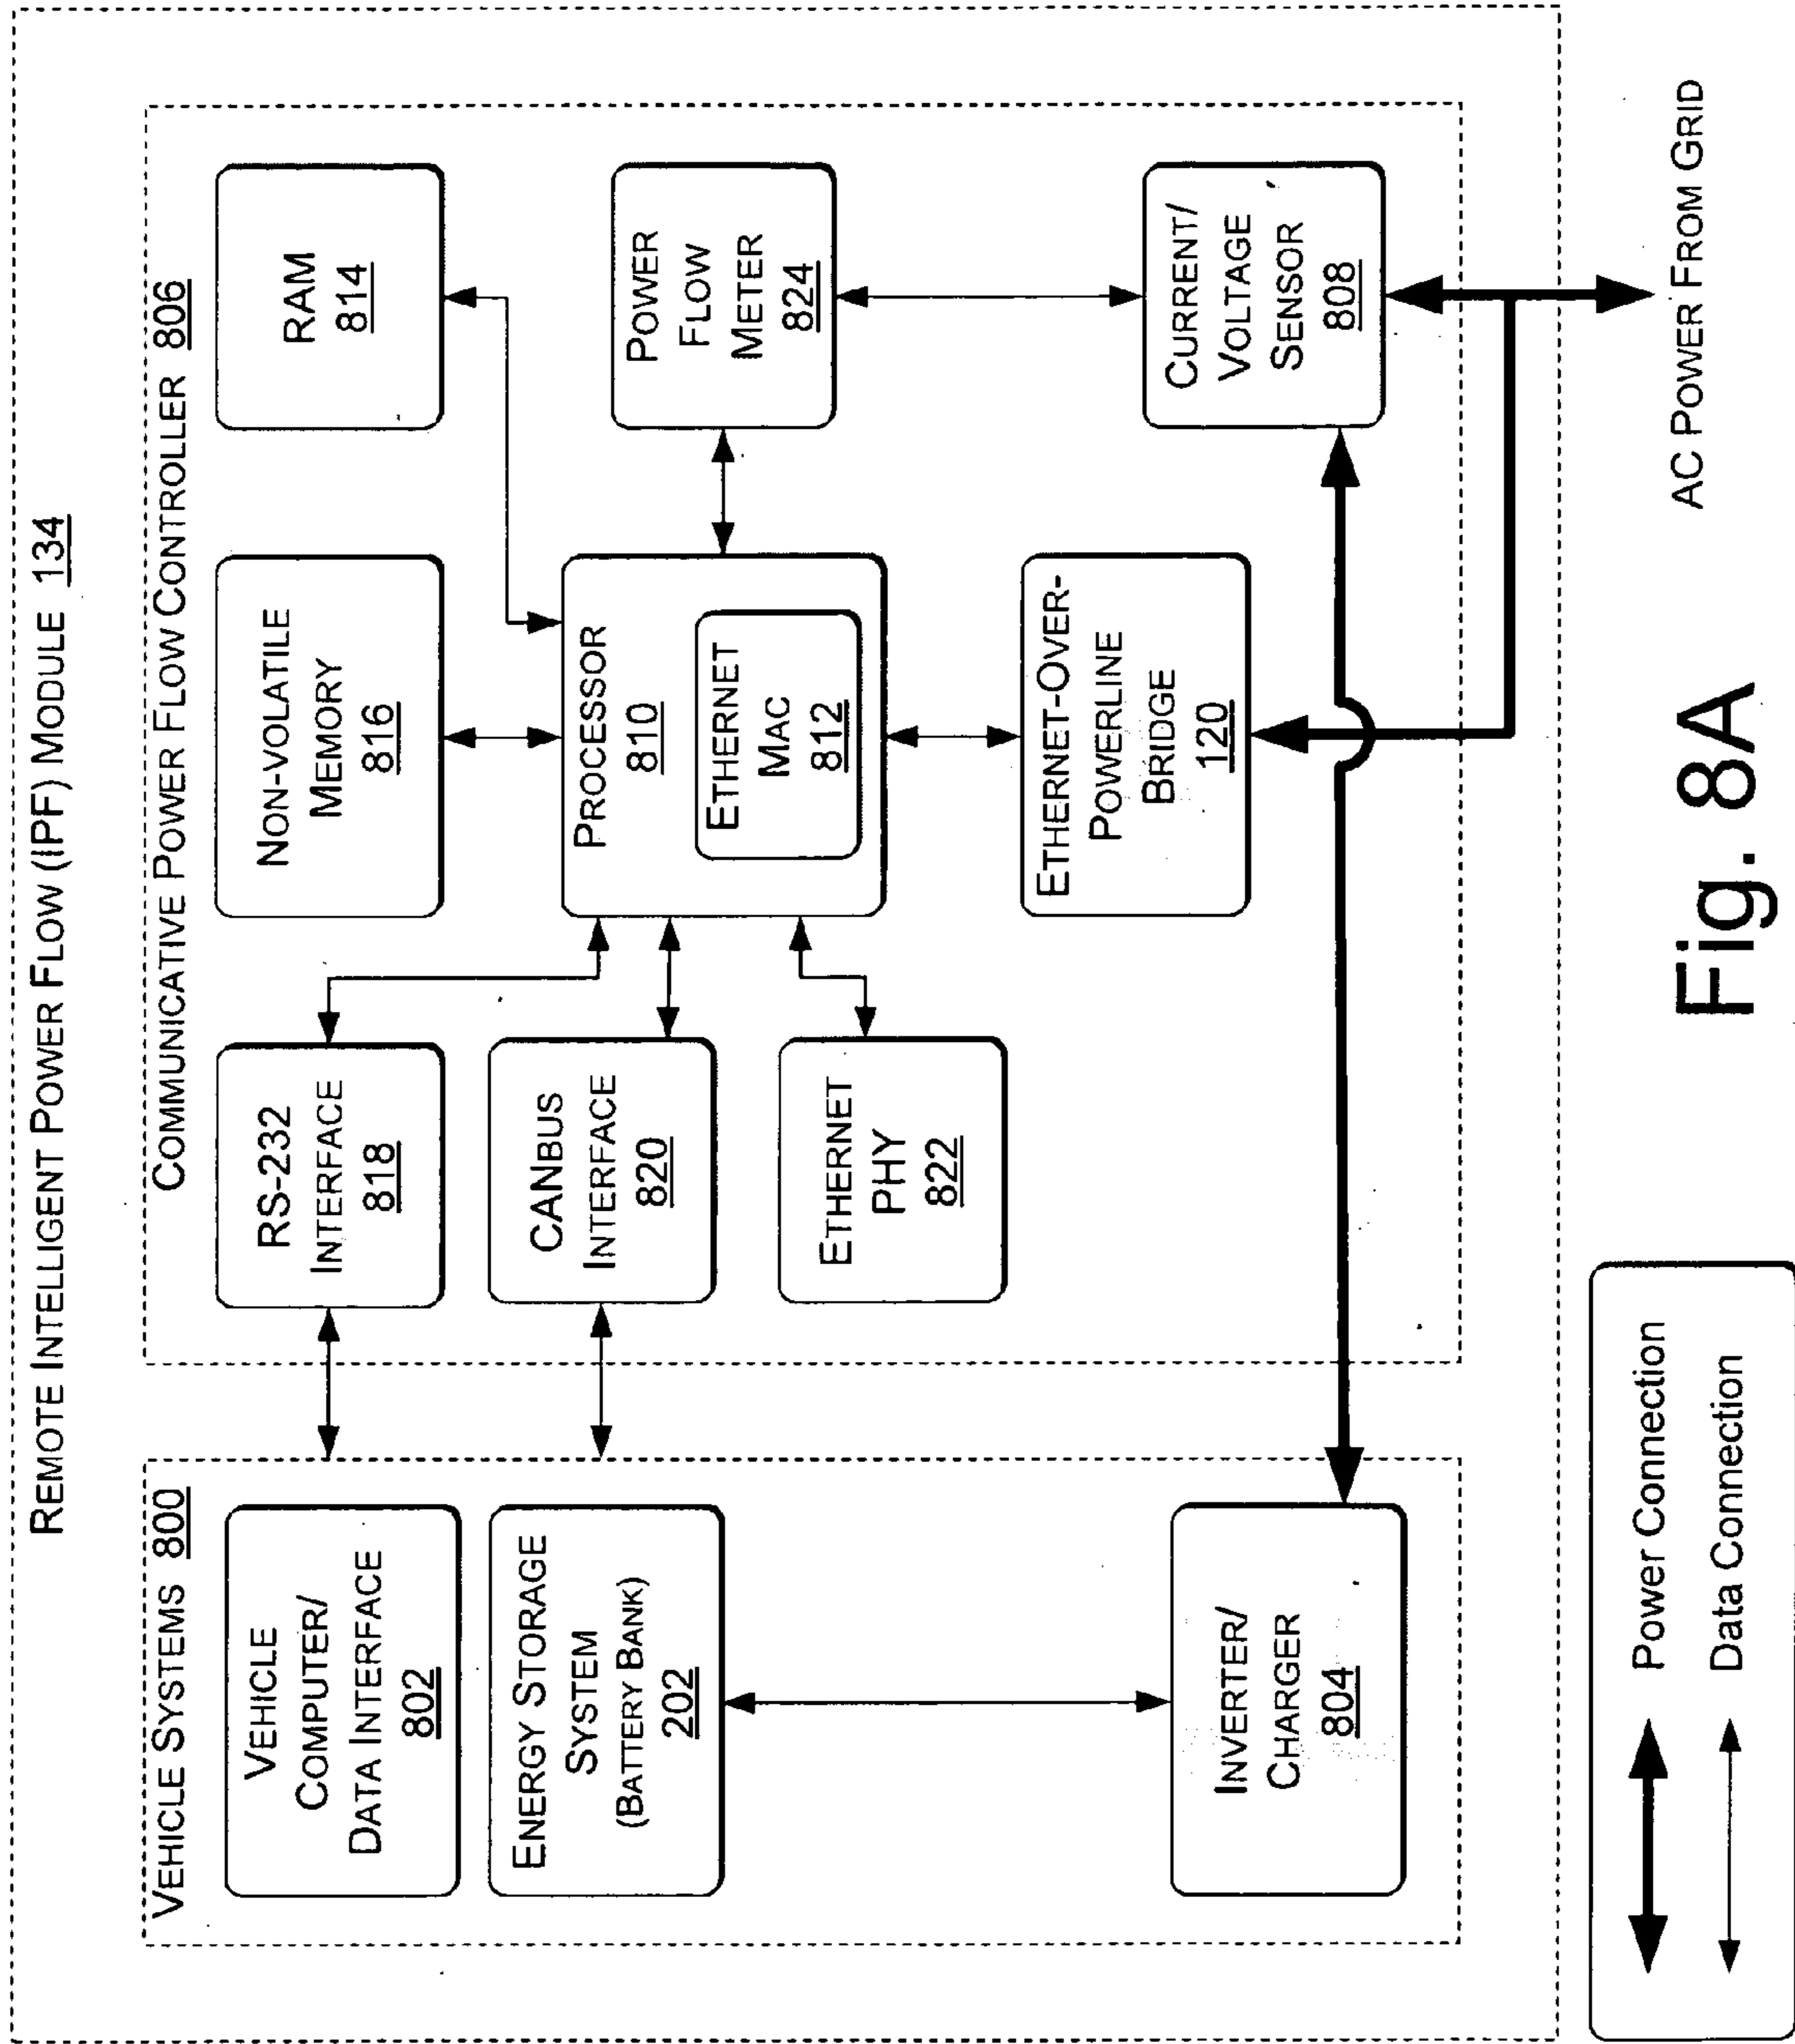


Fig. 8A

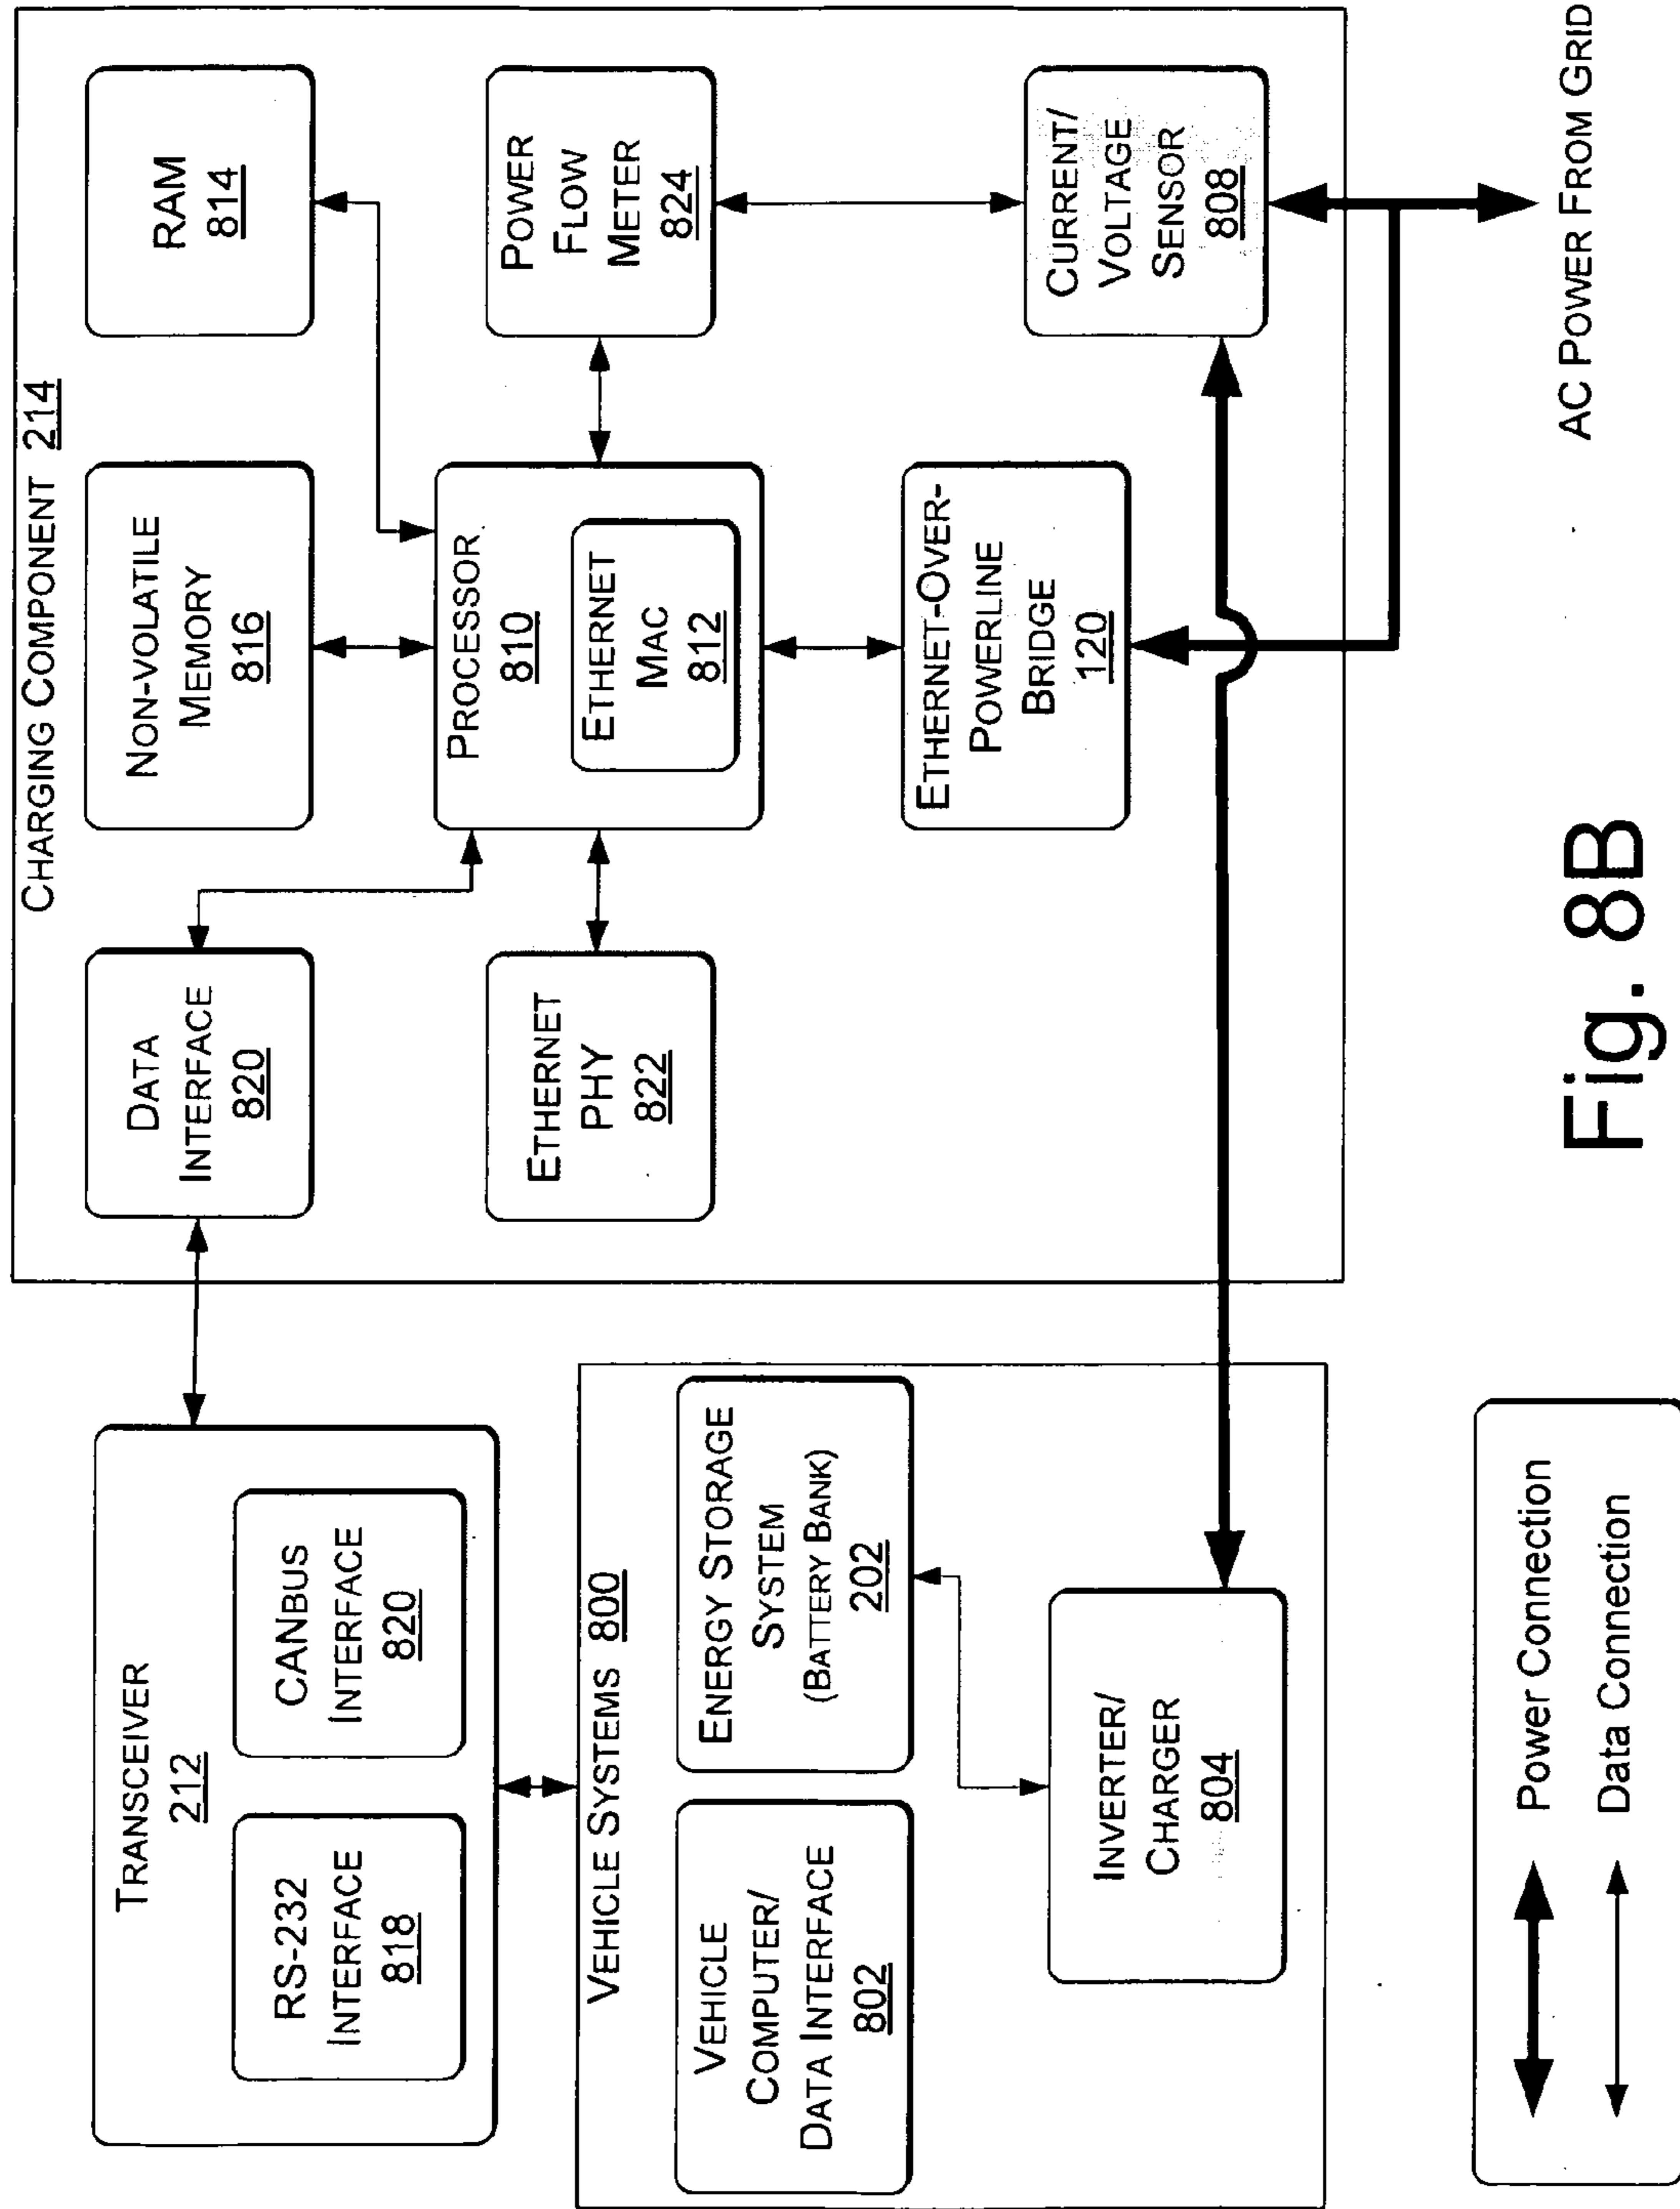


Fig. 8B

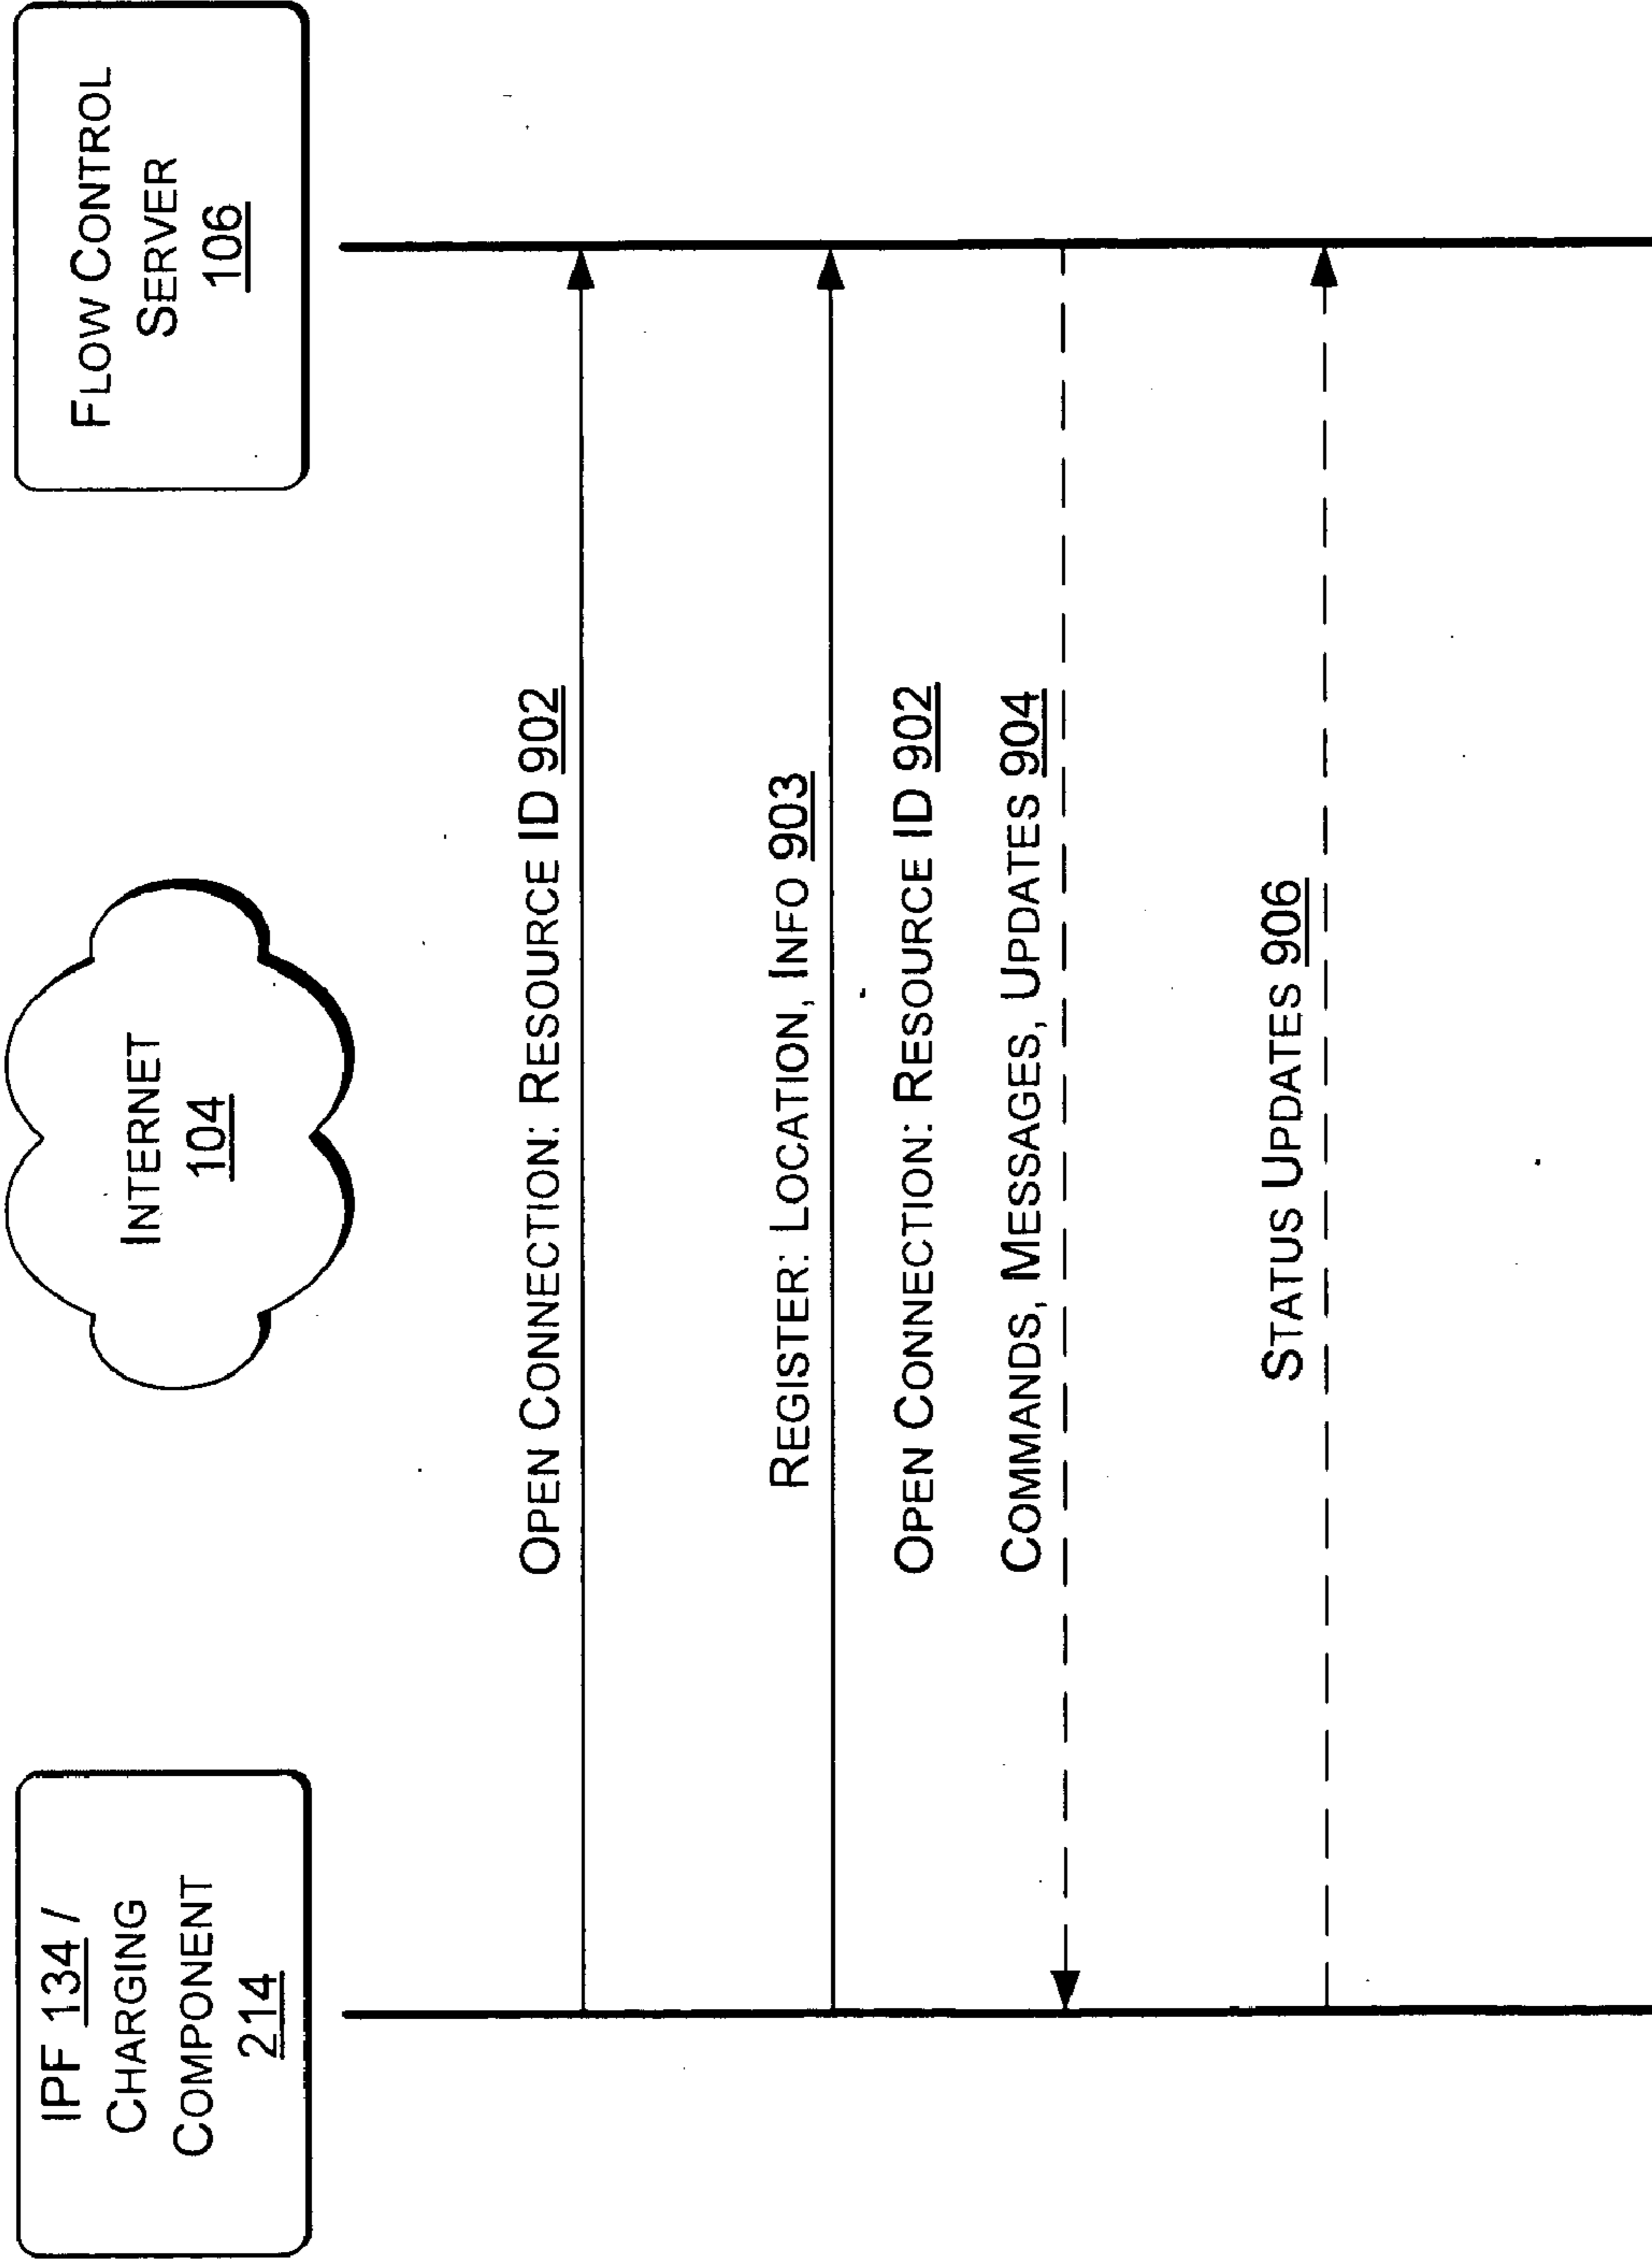


Fig. 9

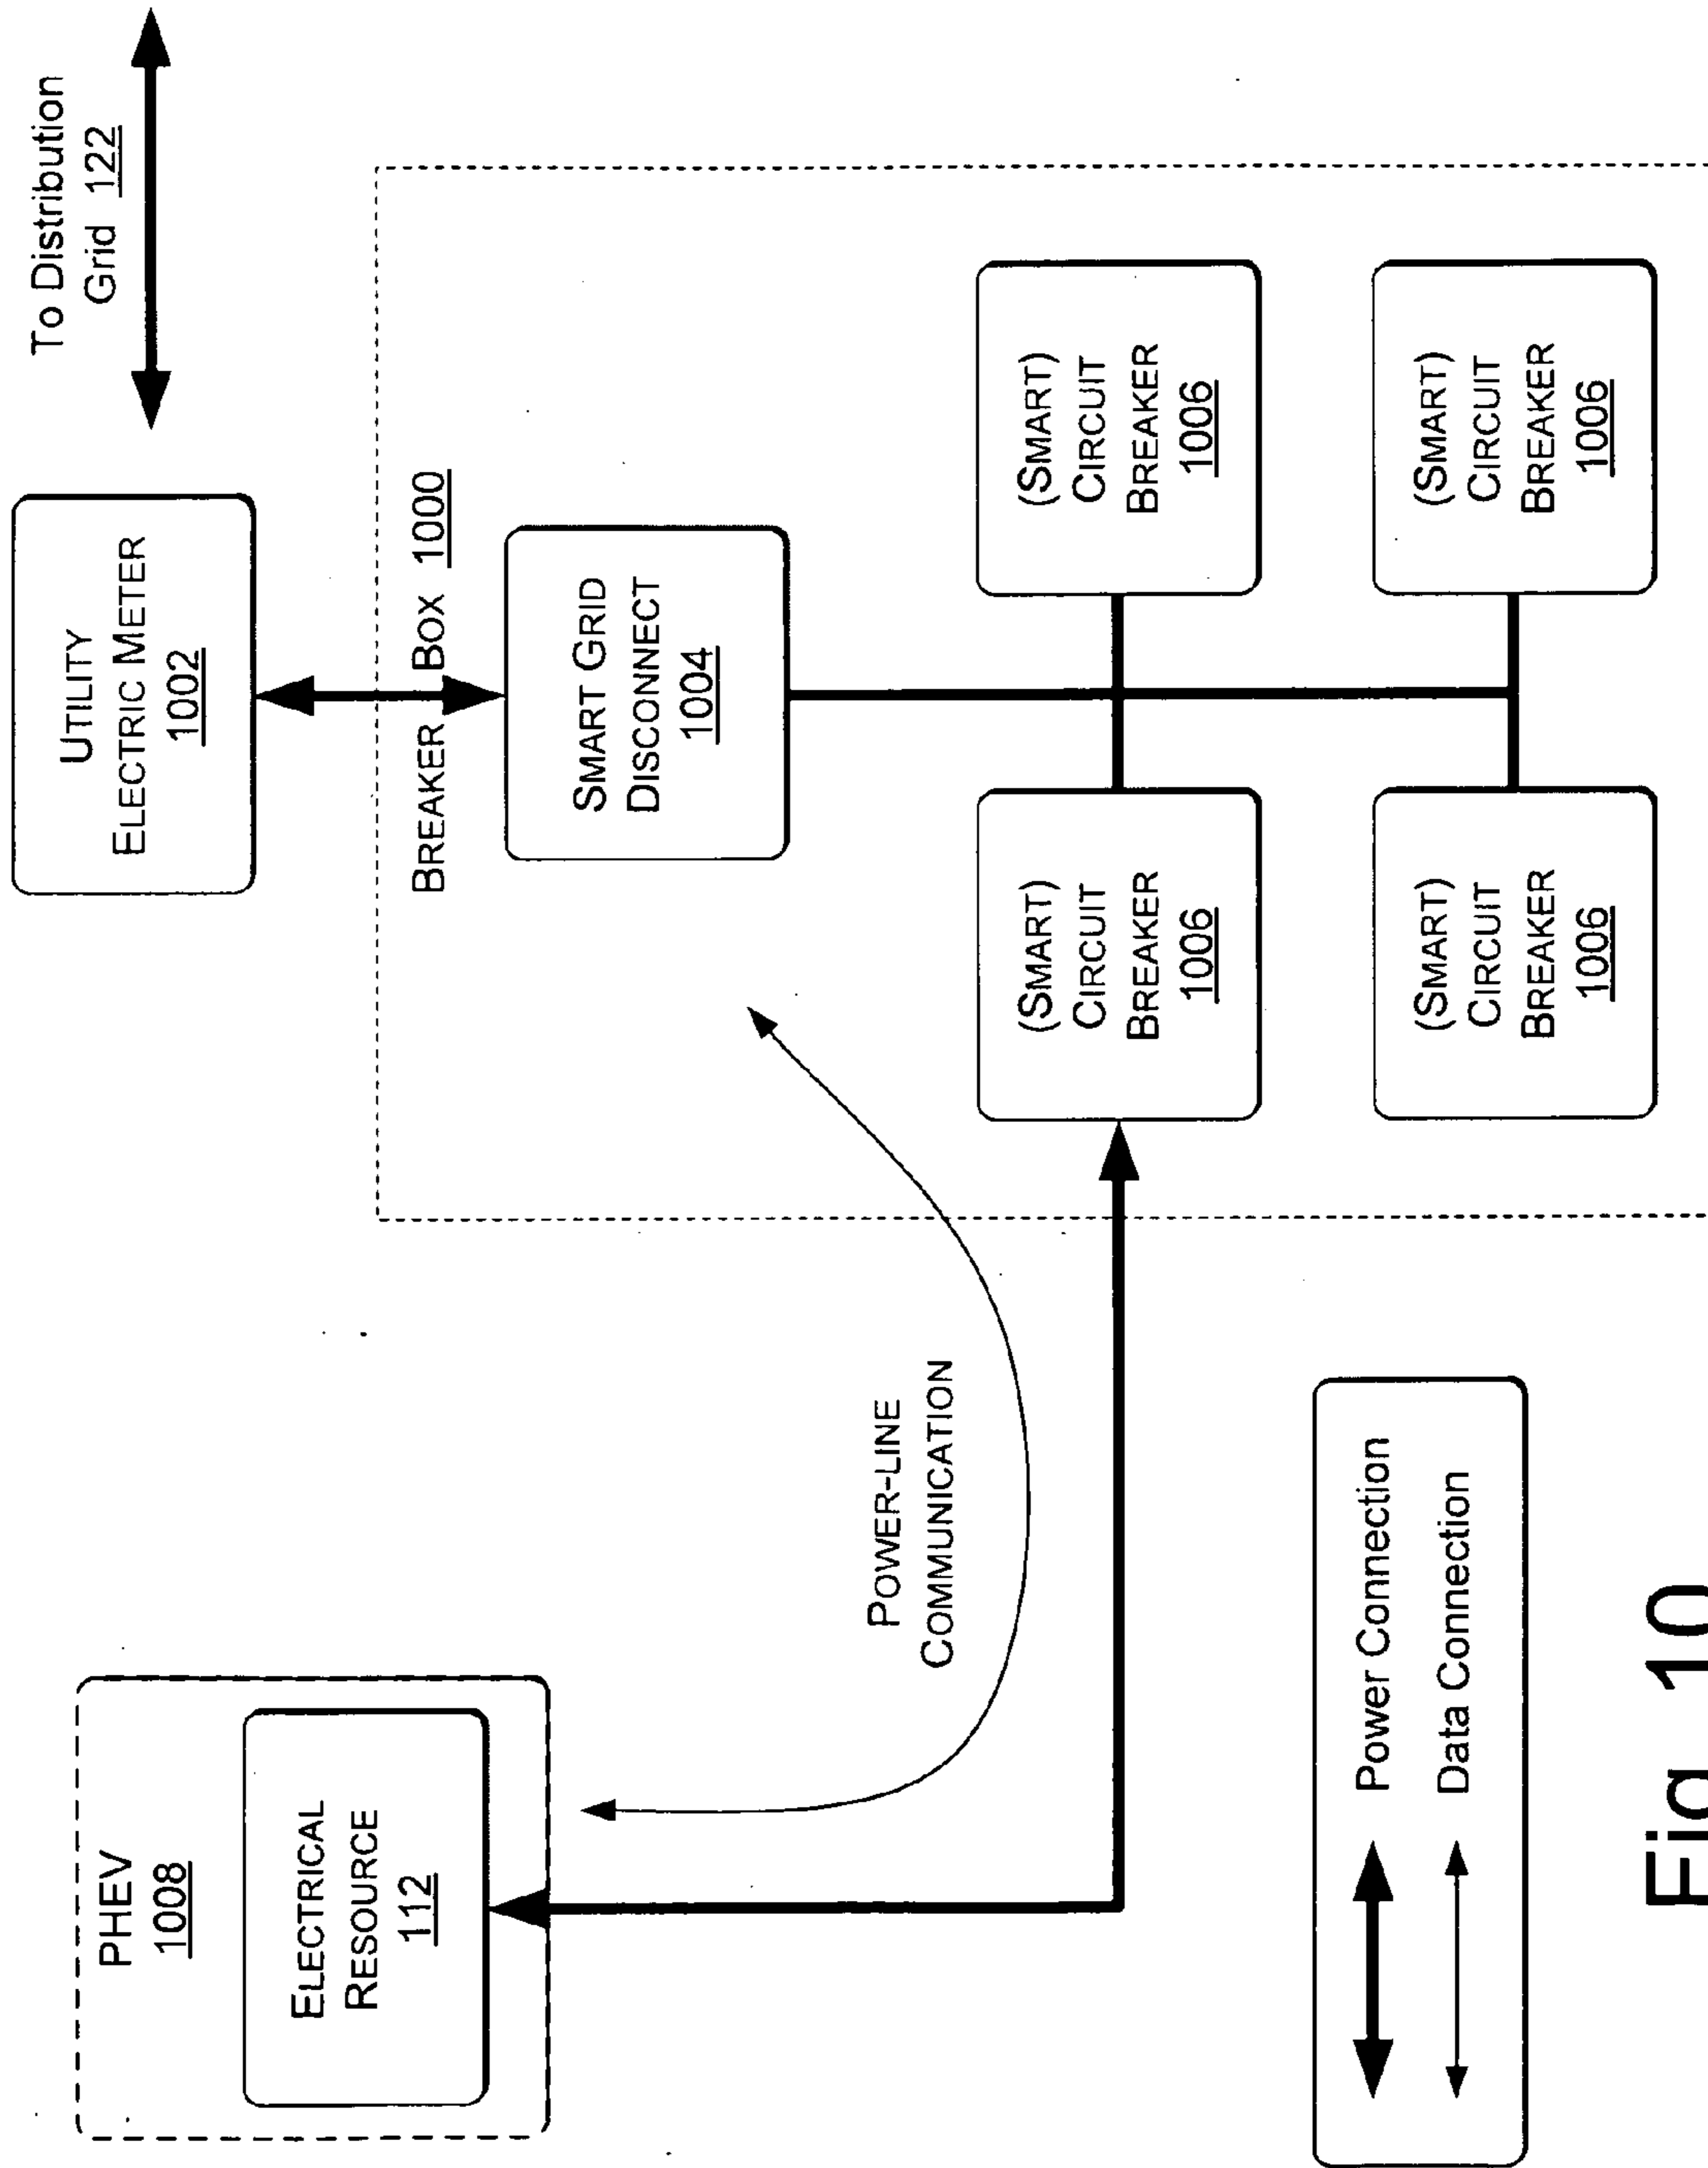


Fig. 10

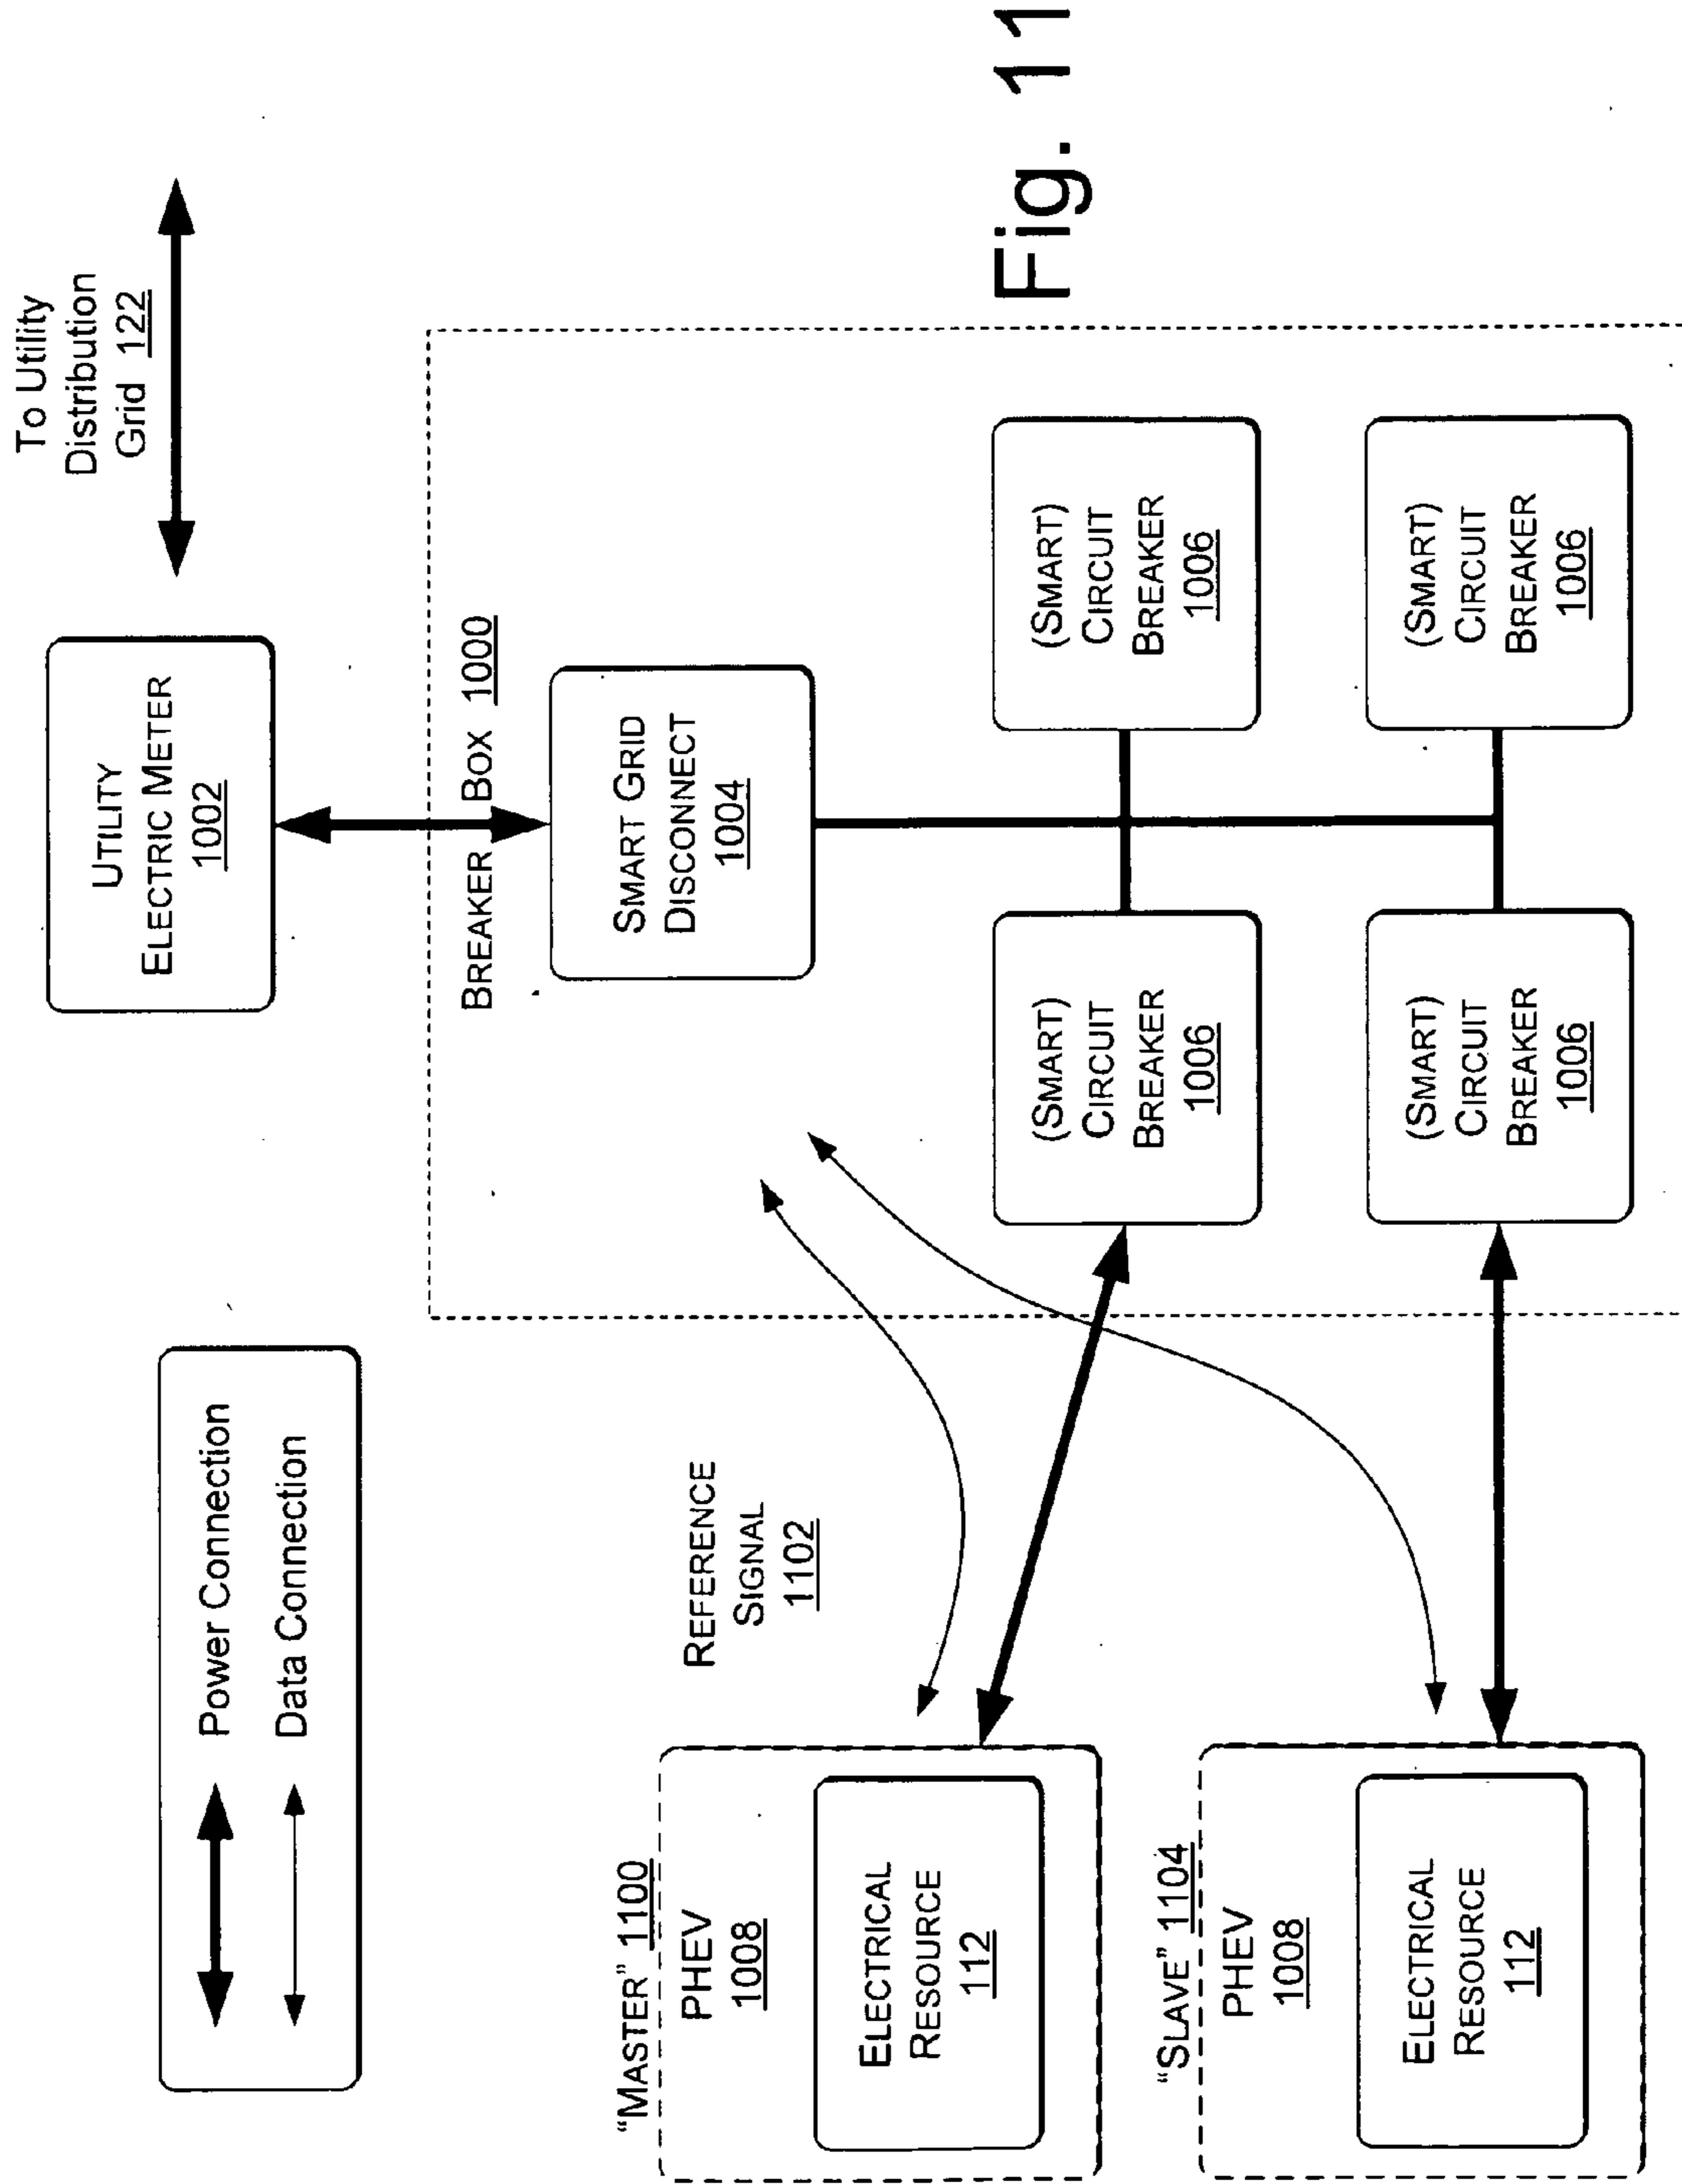


Fig. 11

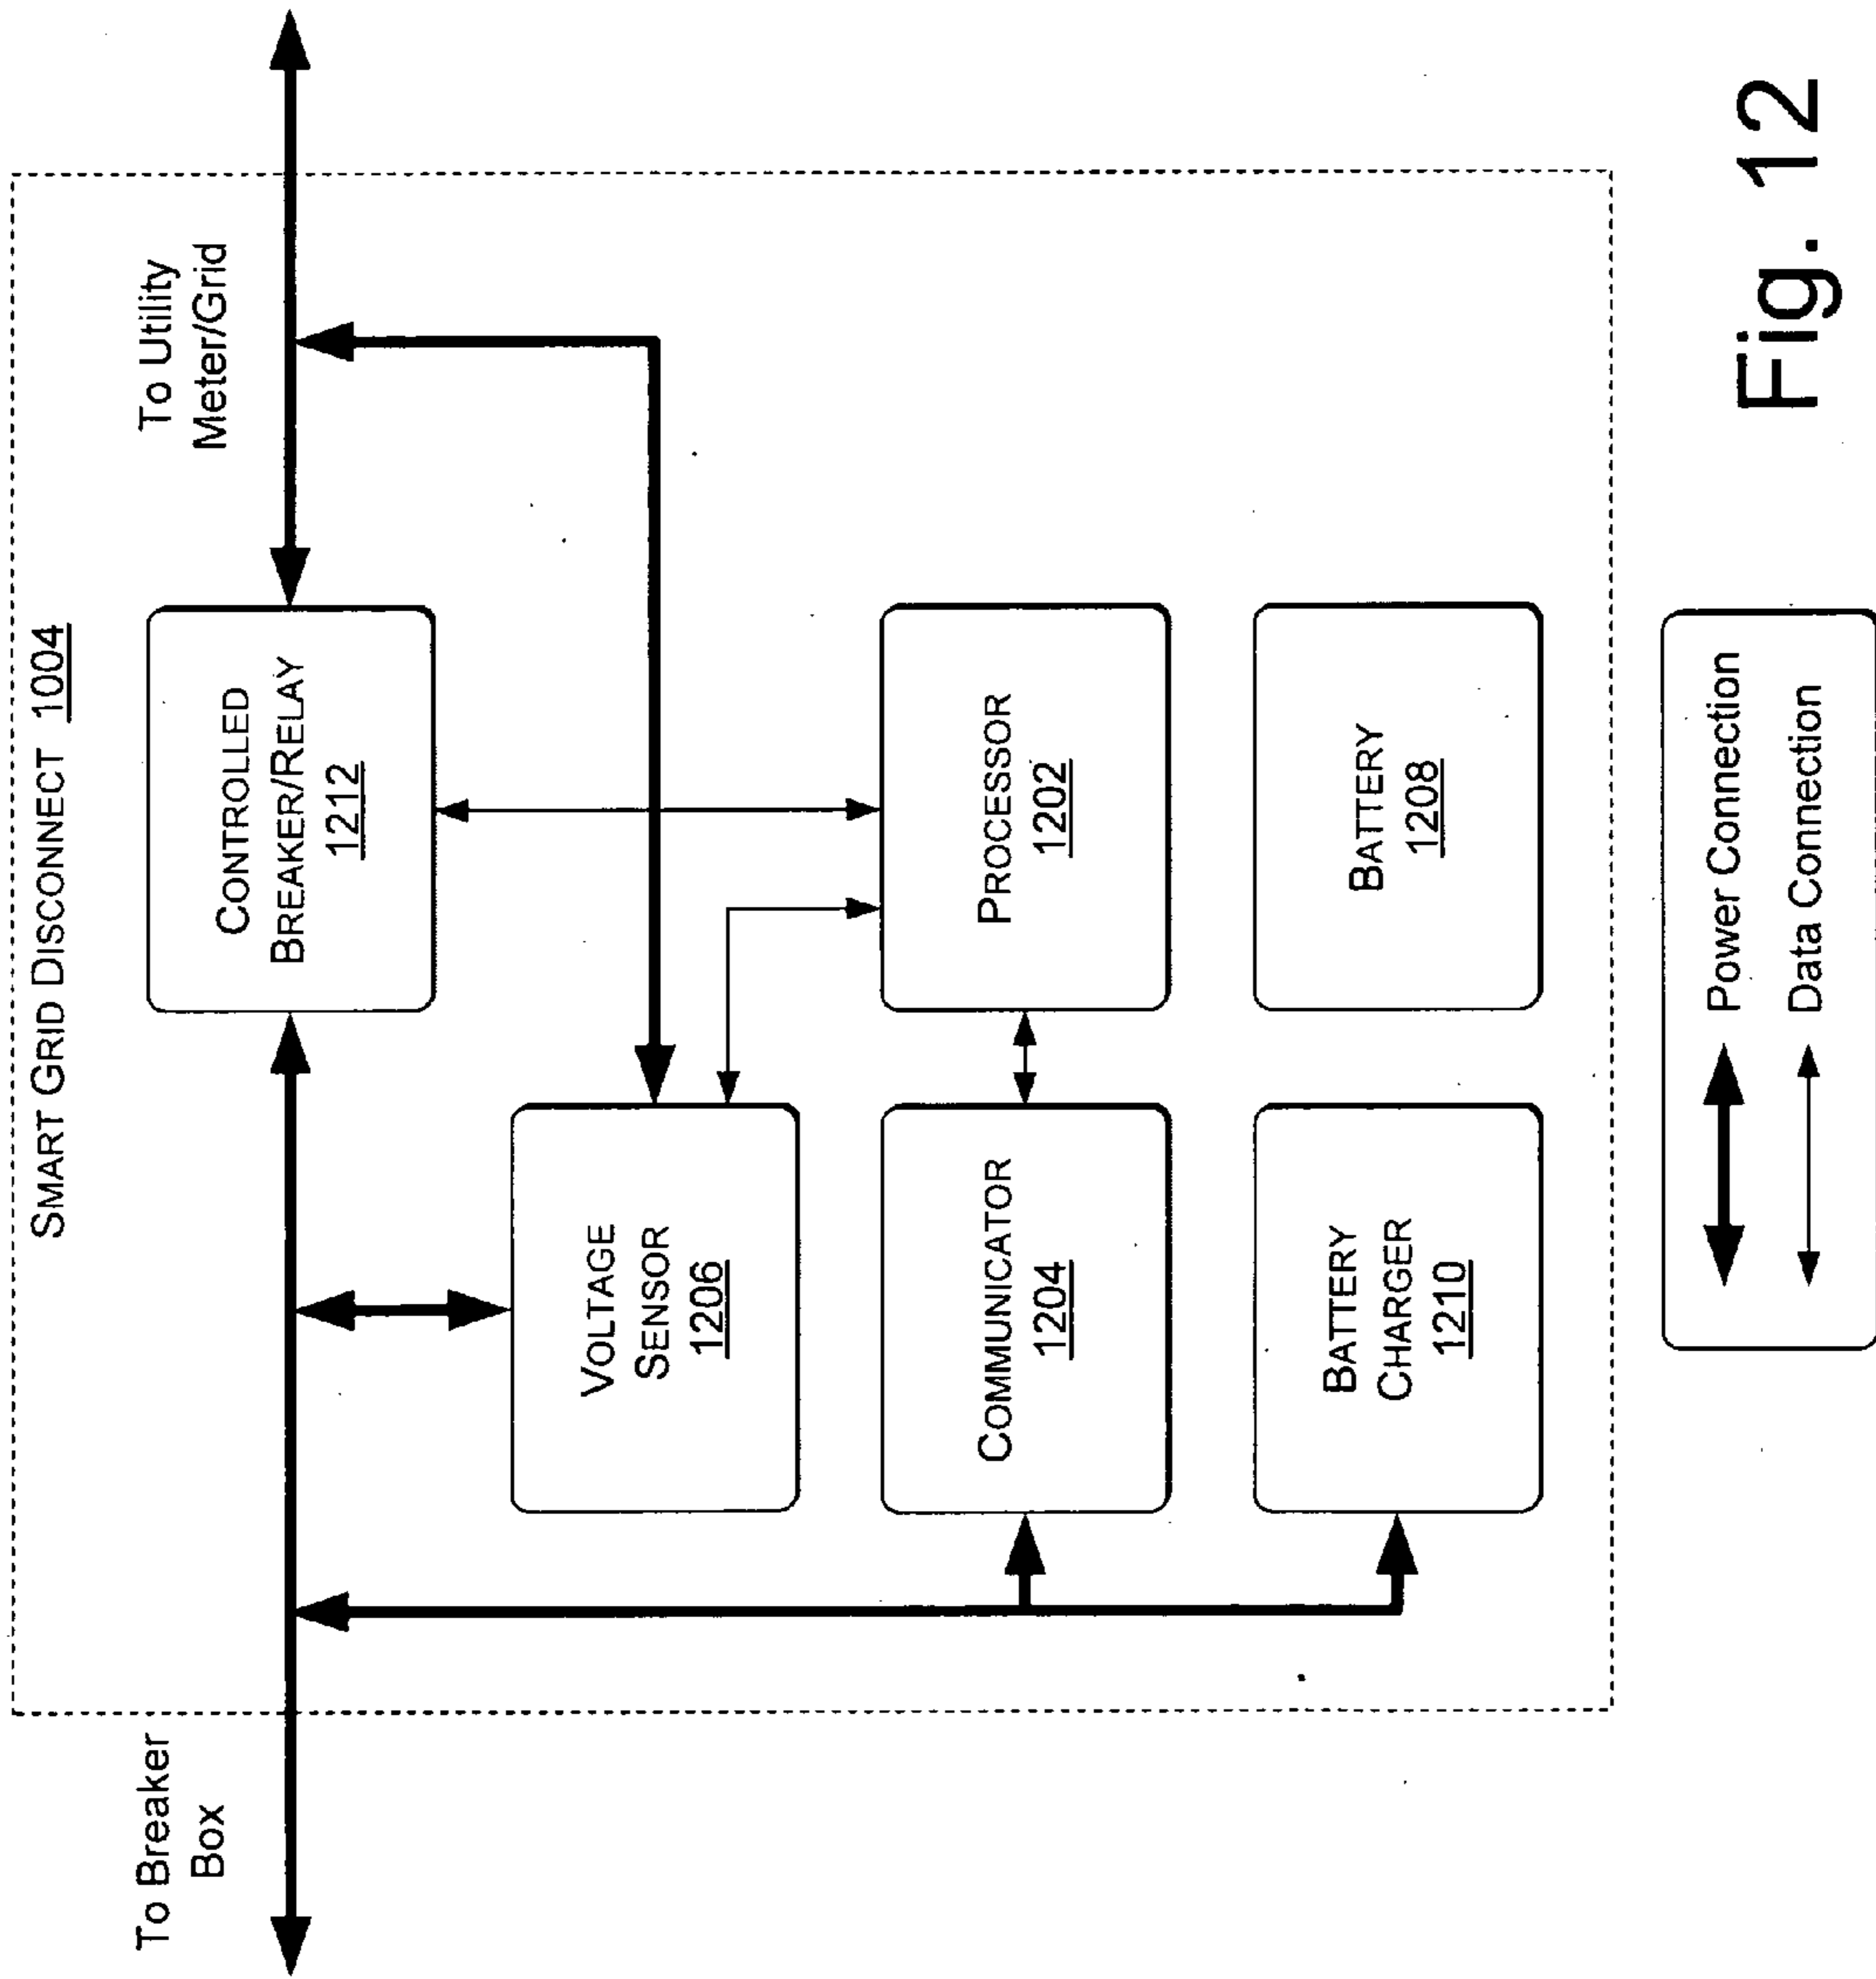


Fig. 12

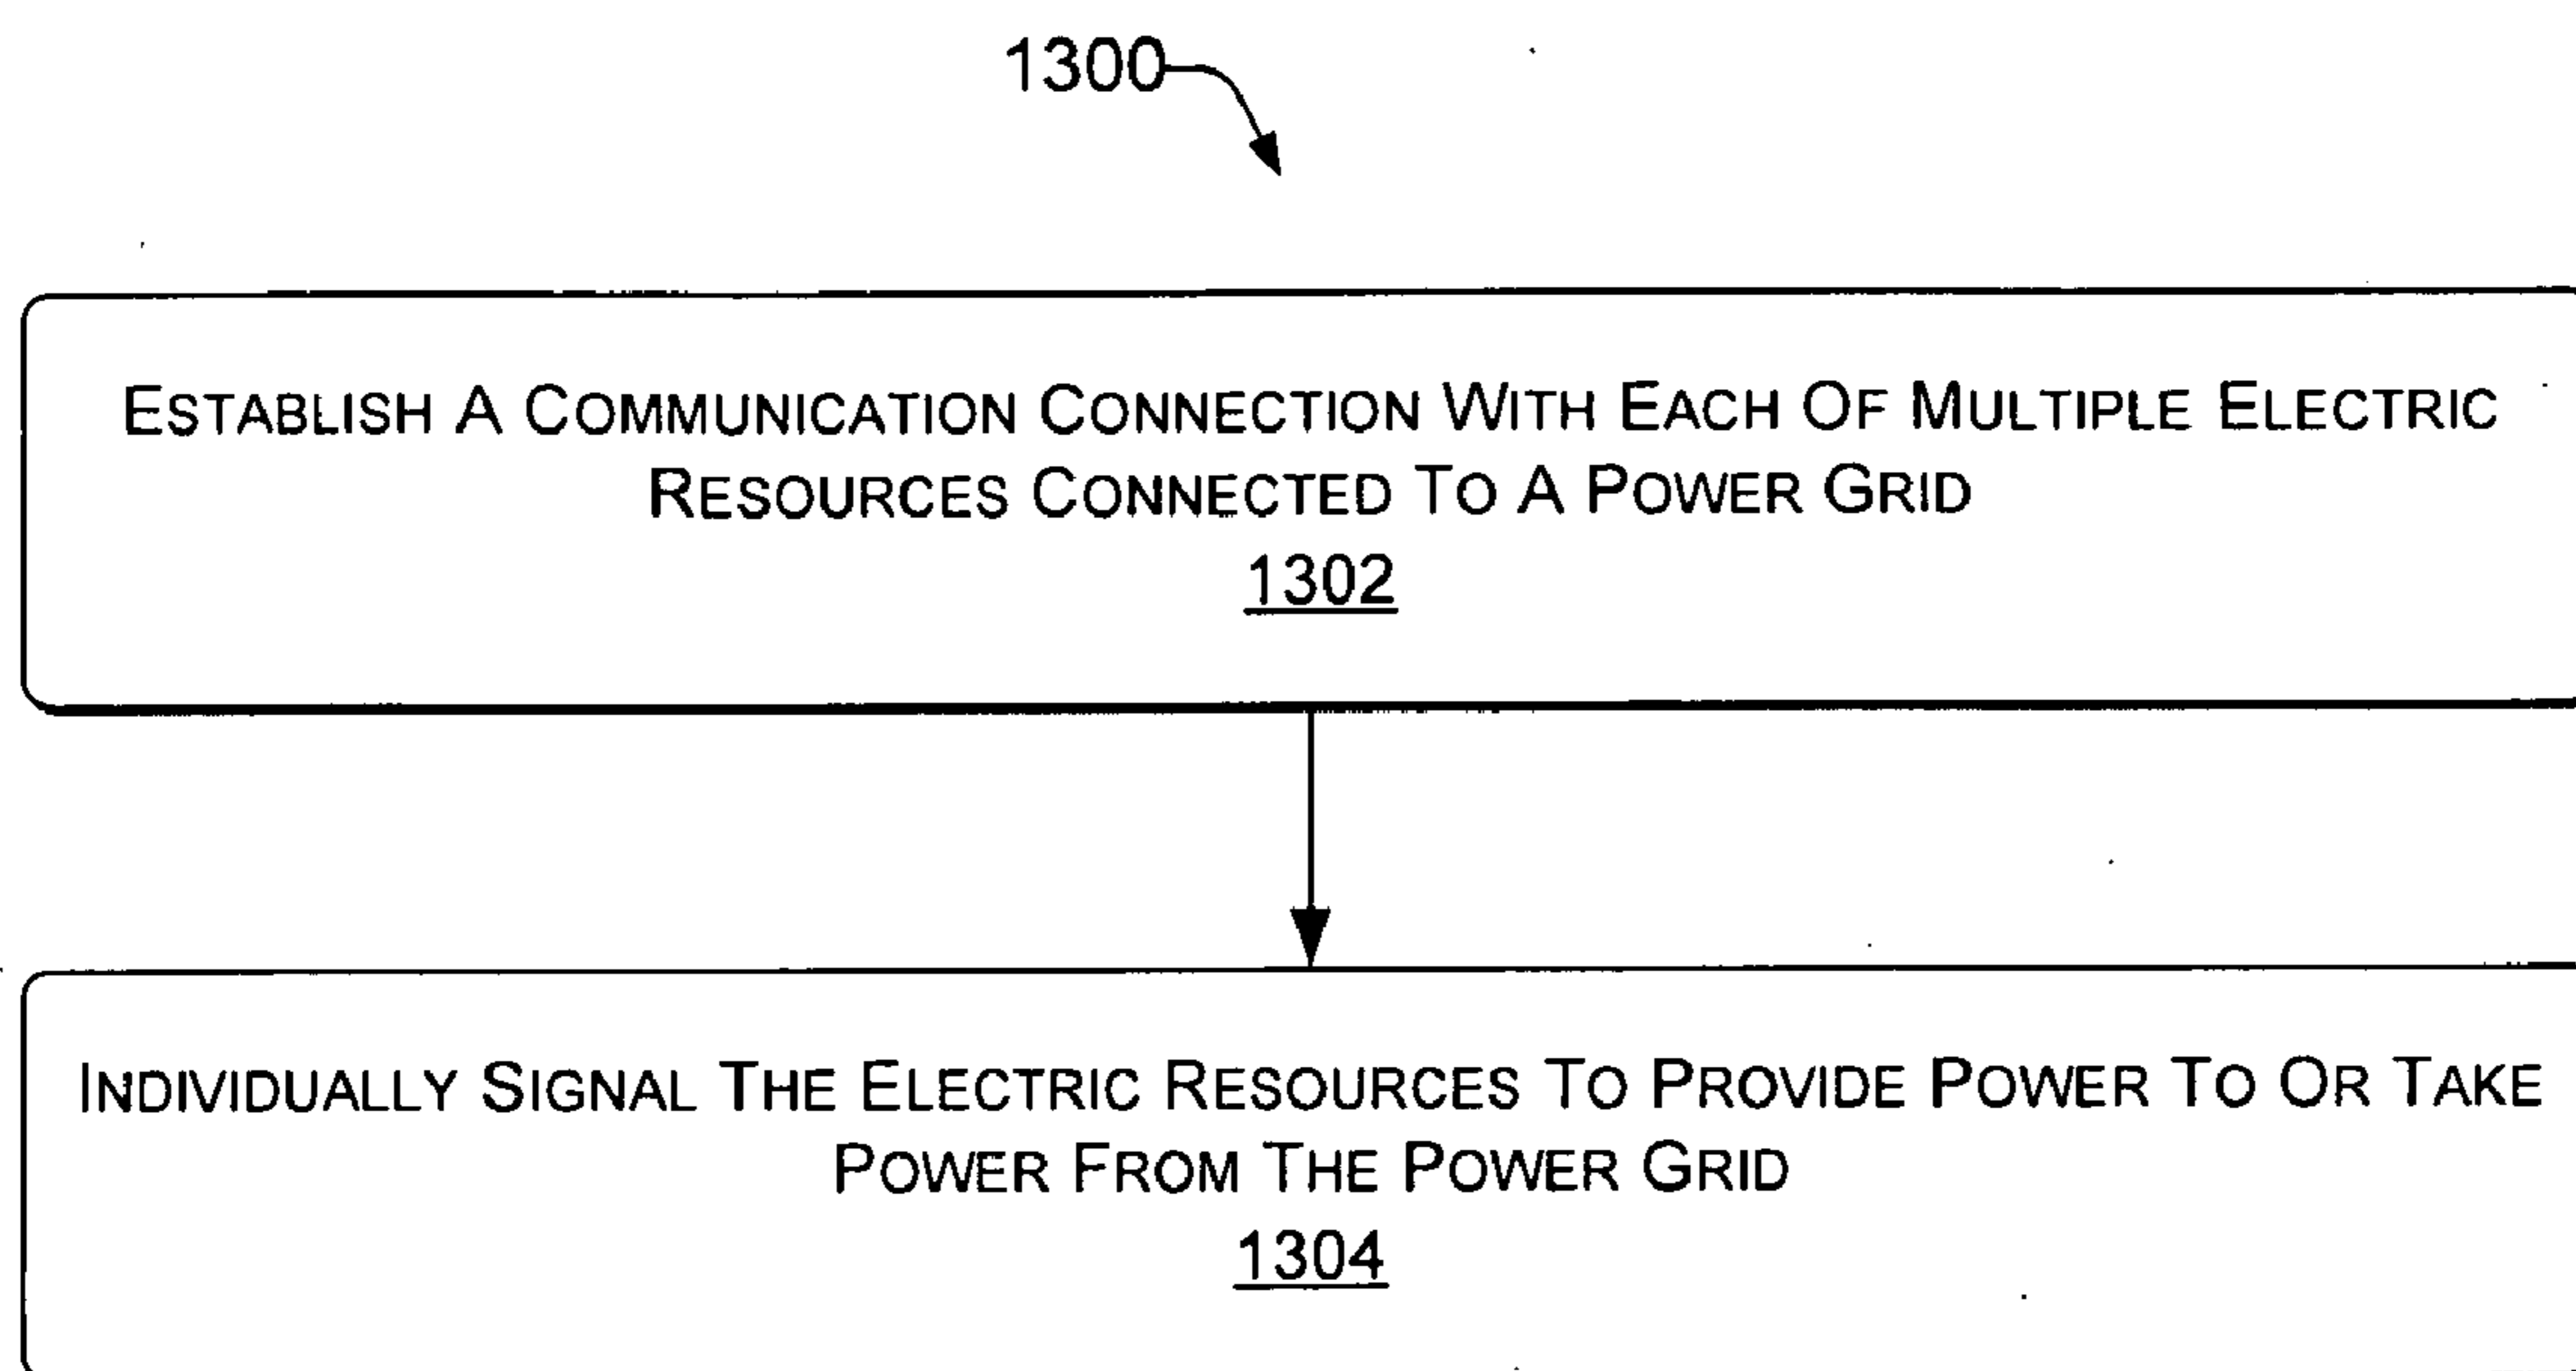


Fig. 13

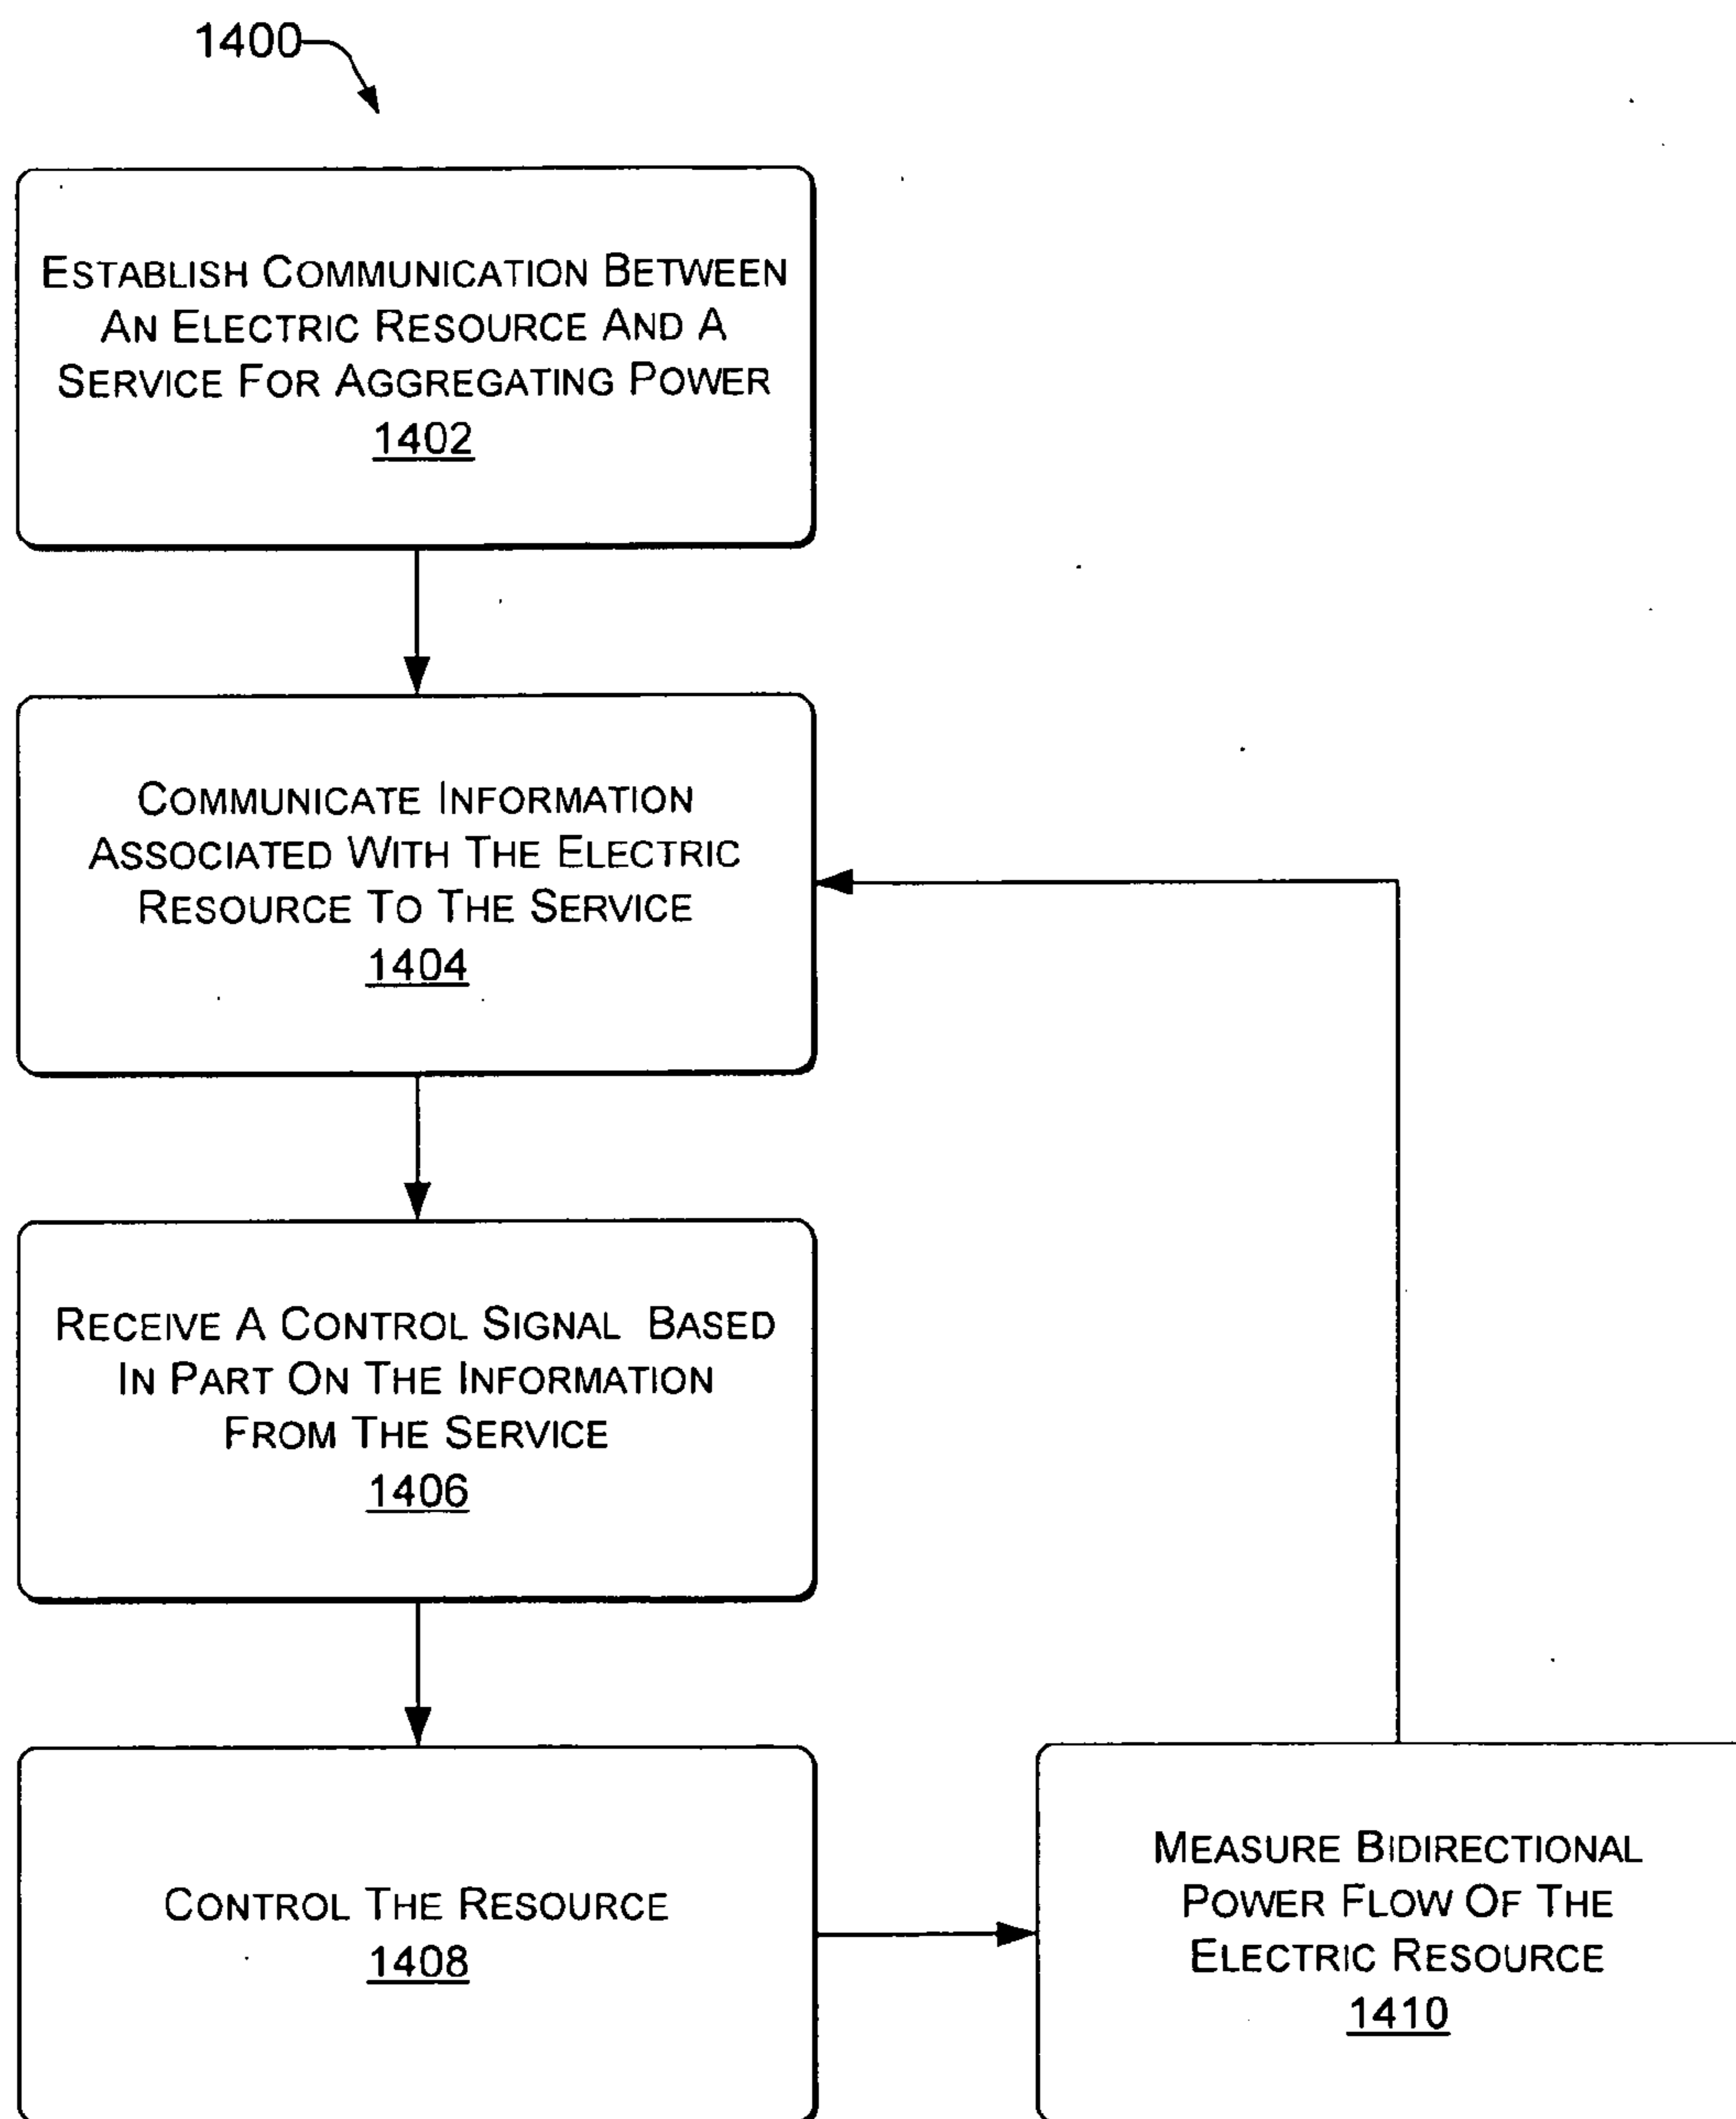


Fig. 14

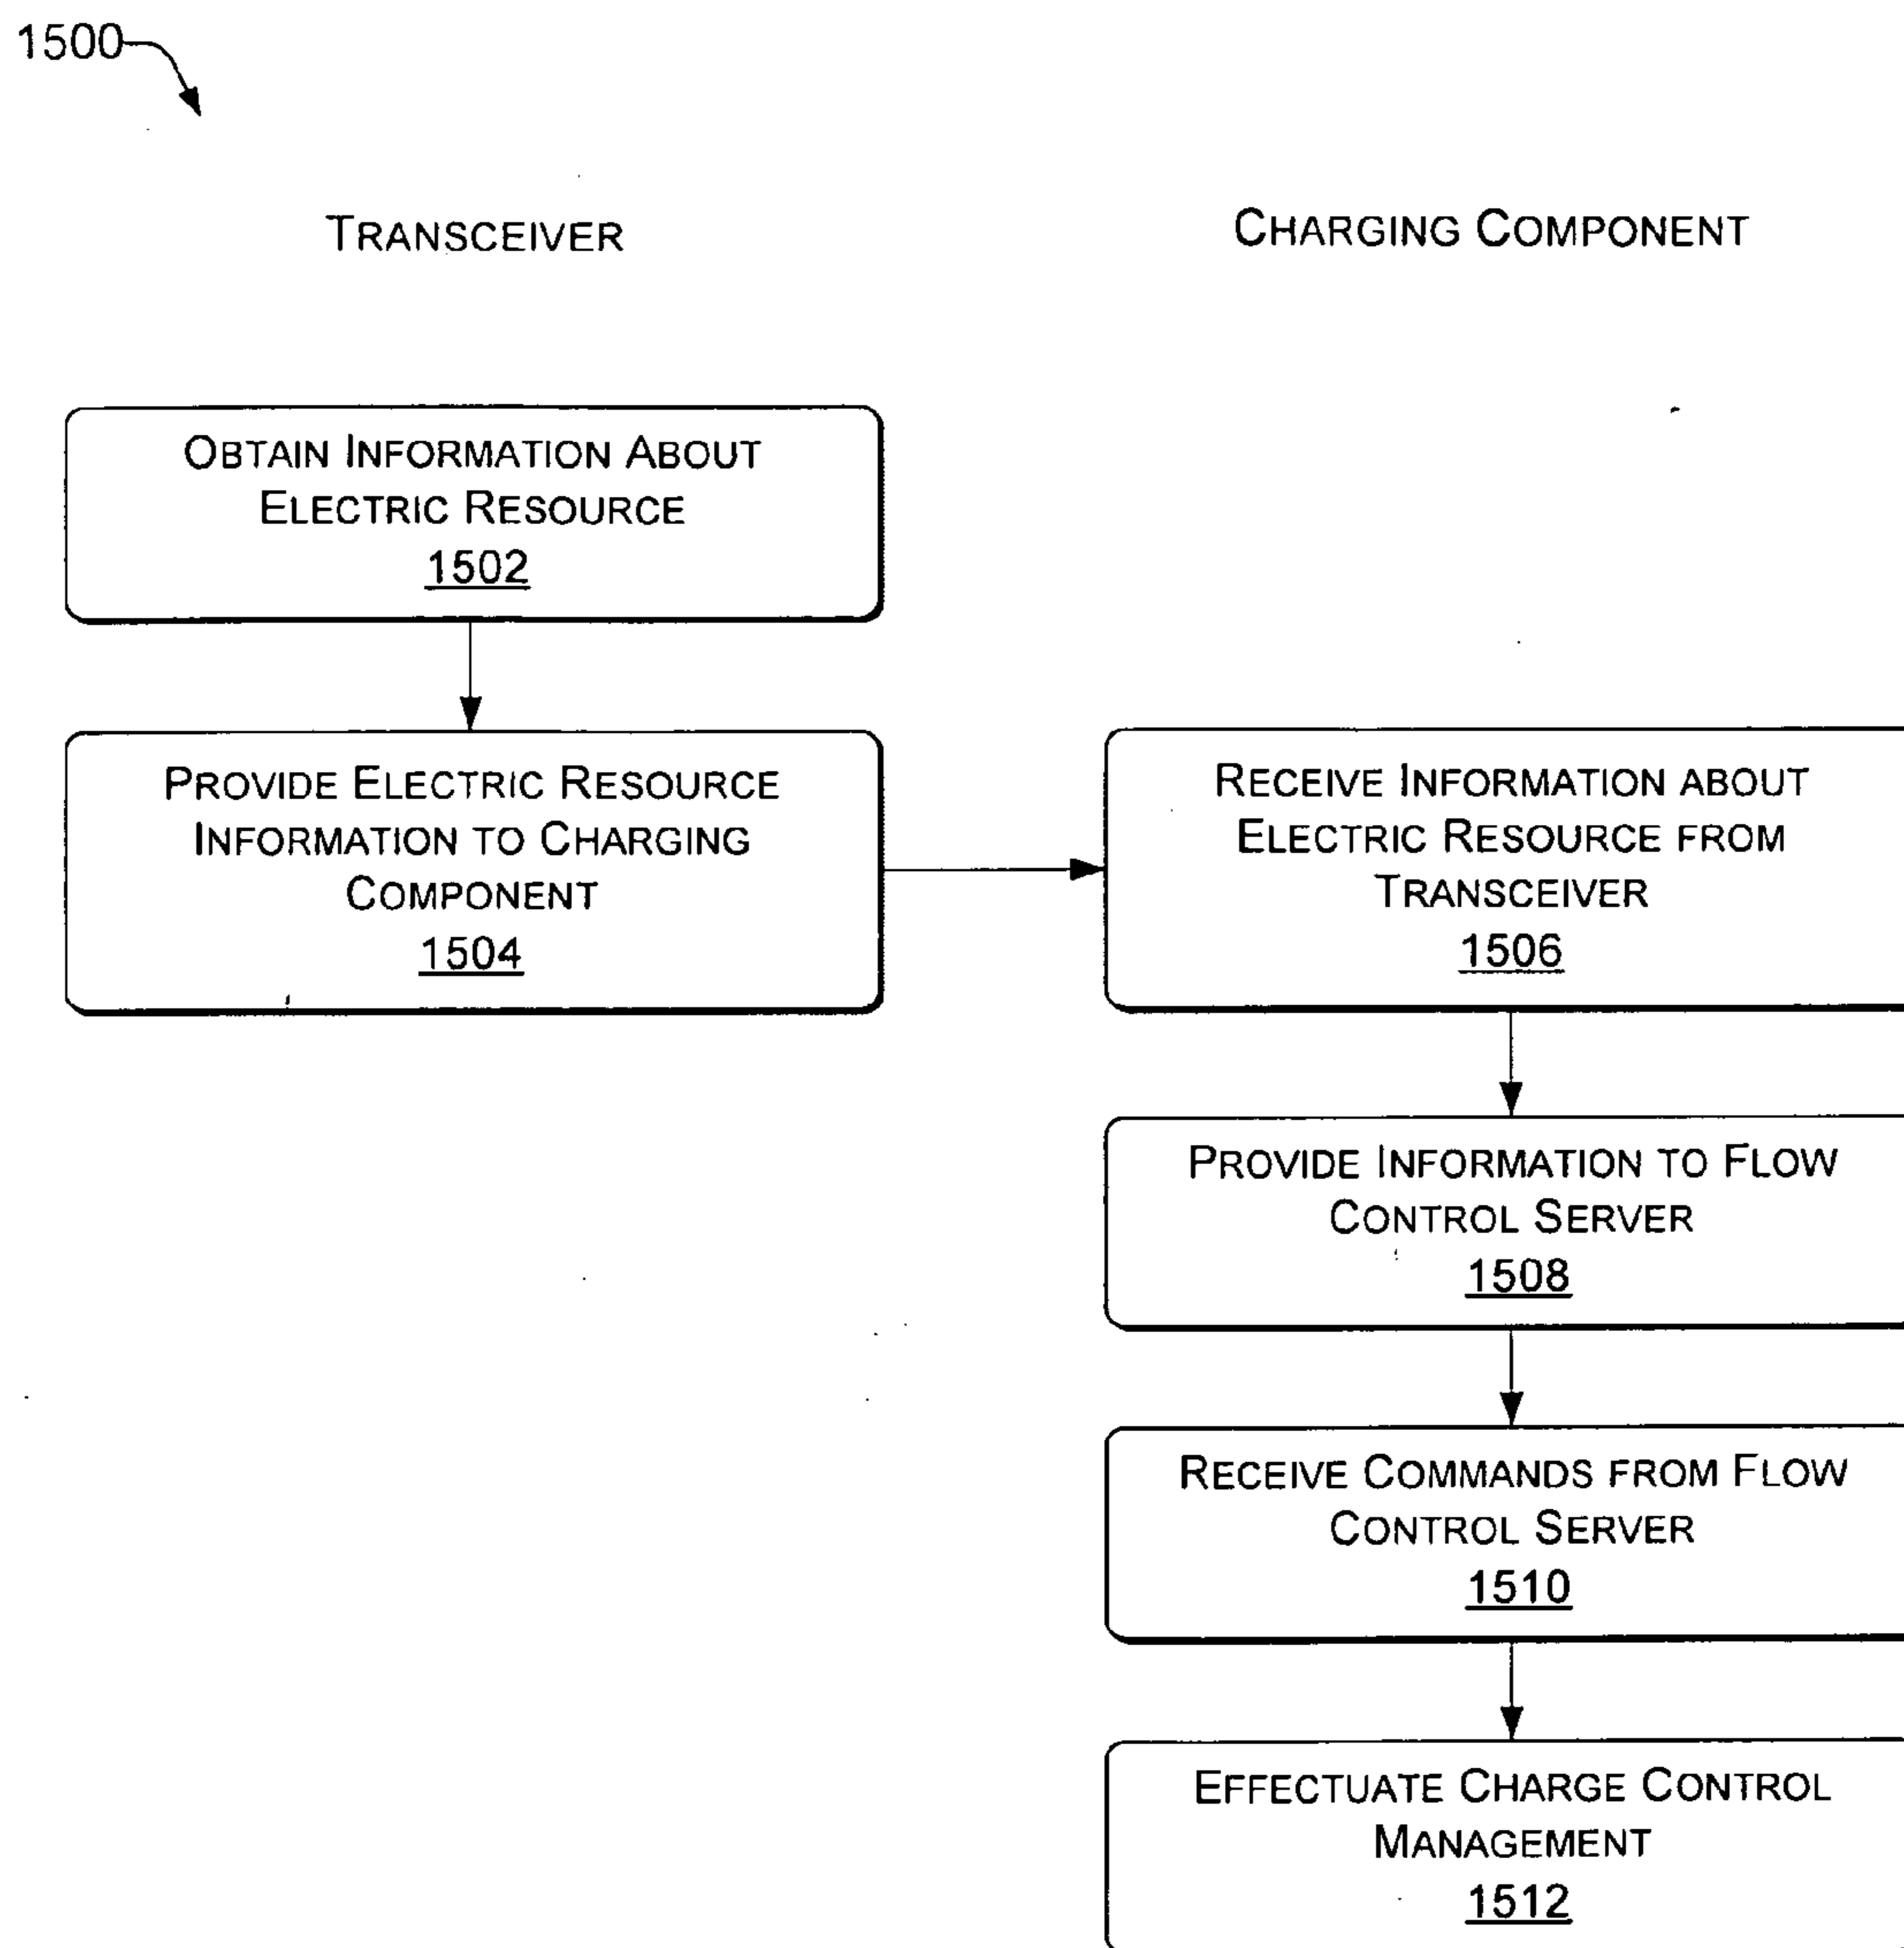


Fig. 15

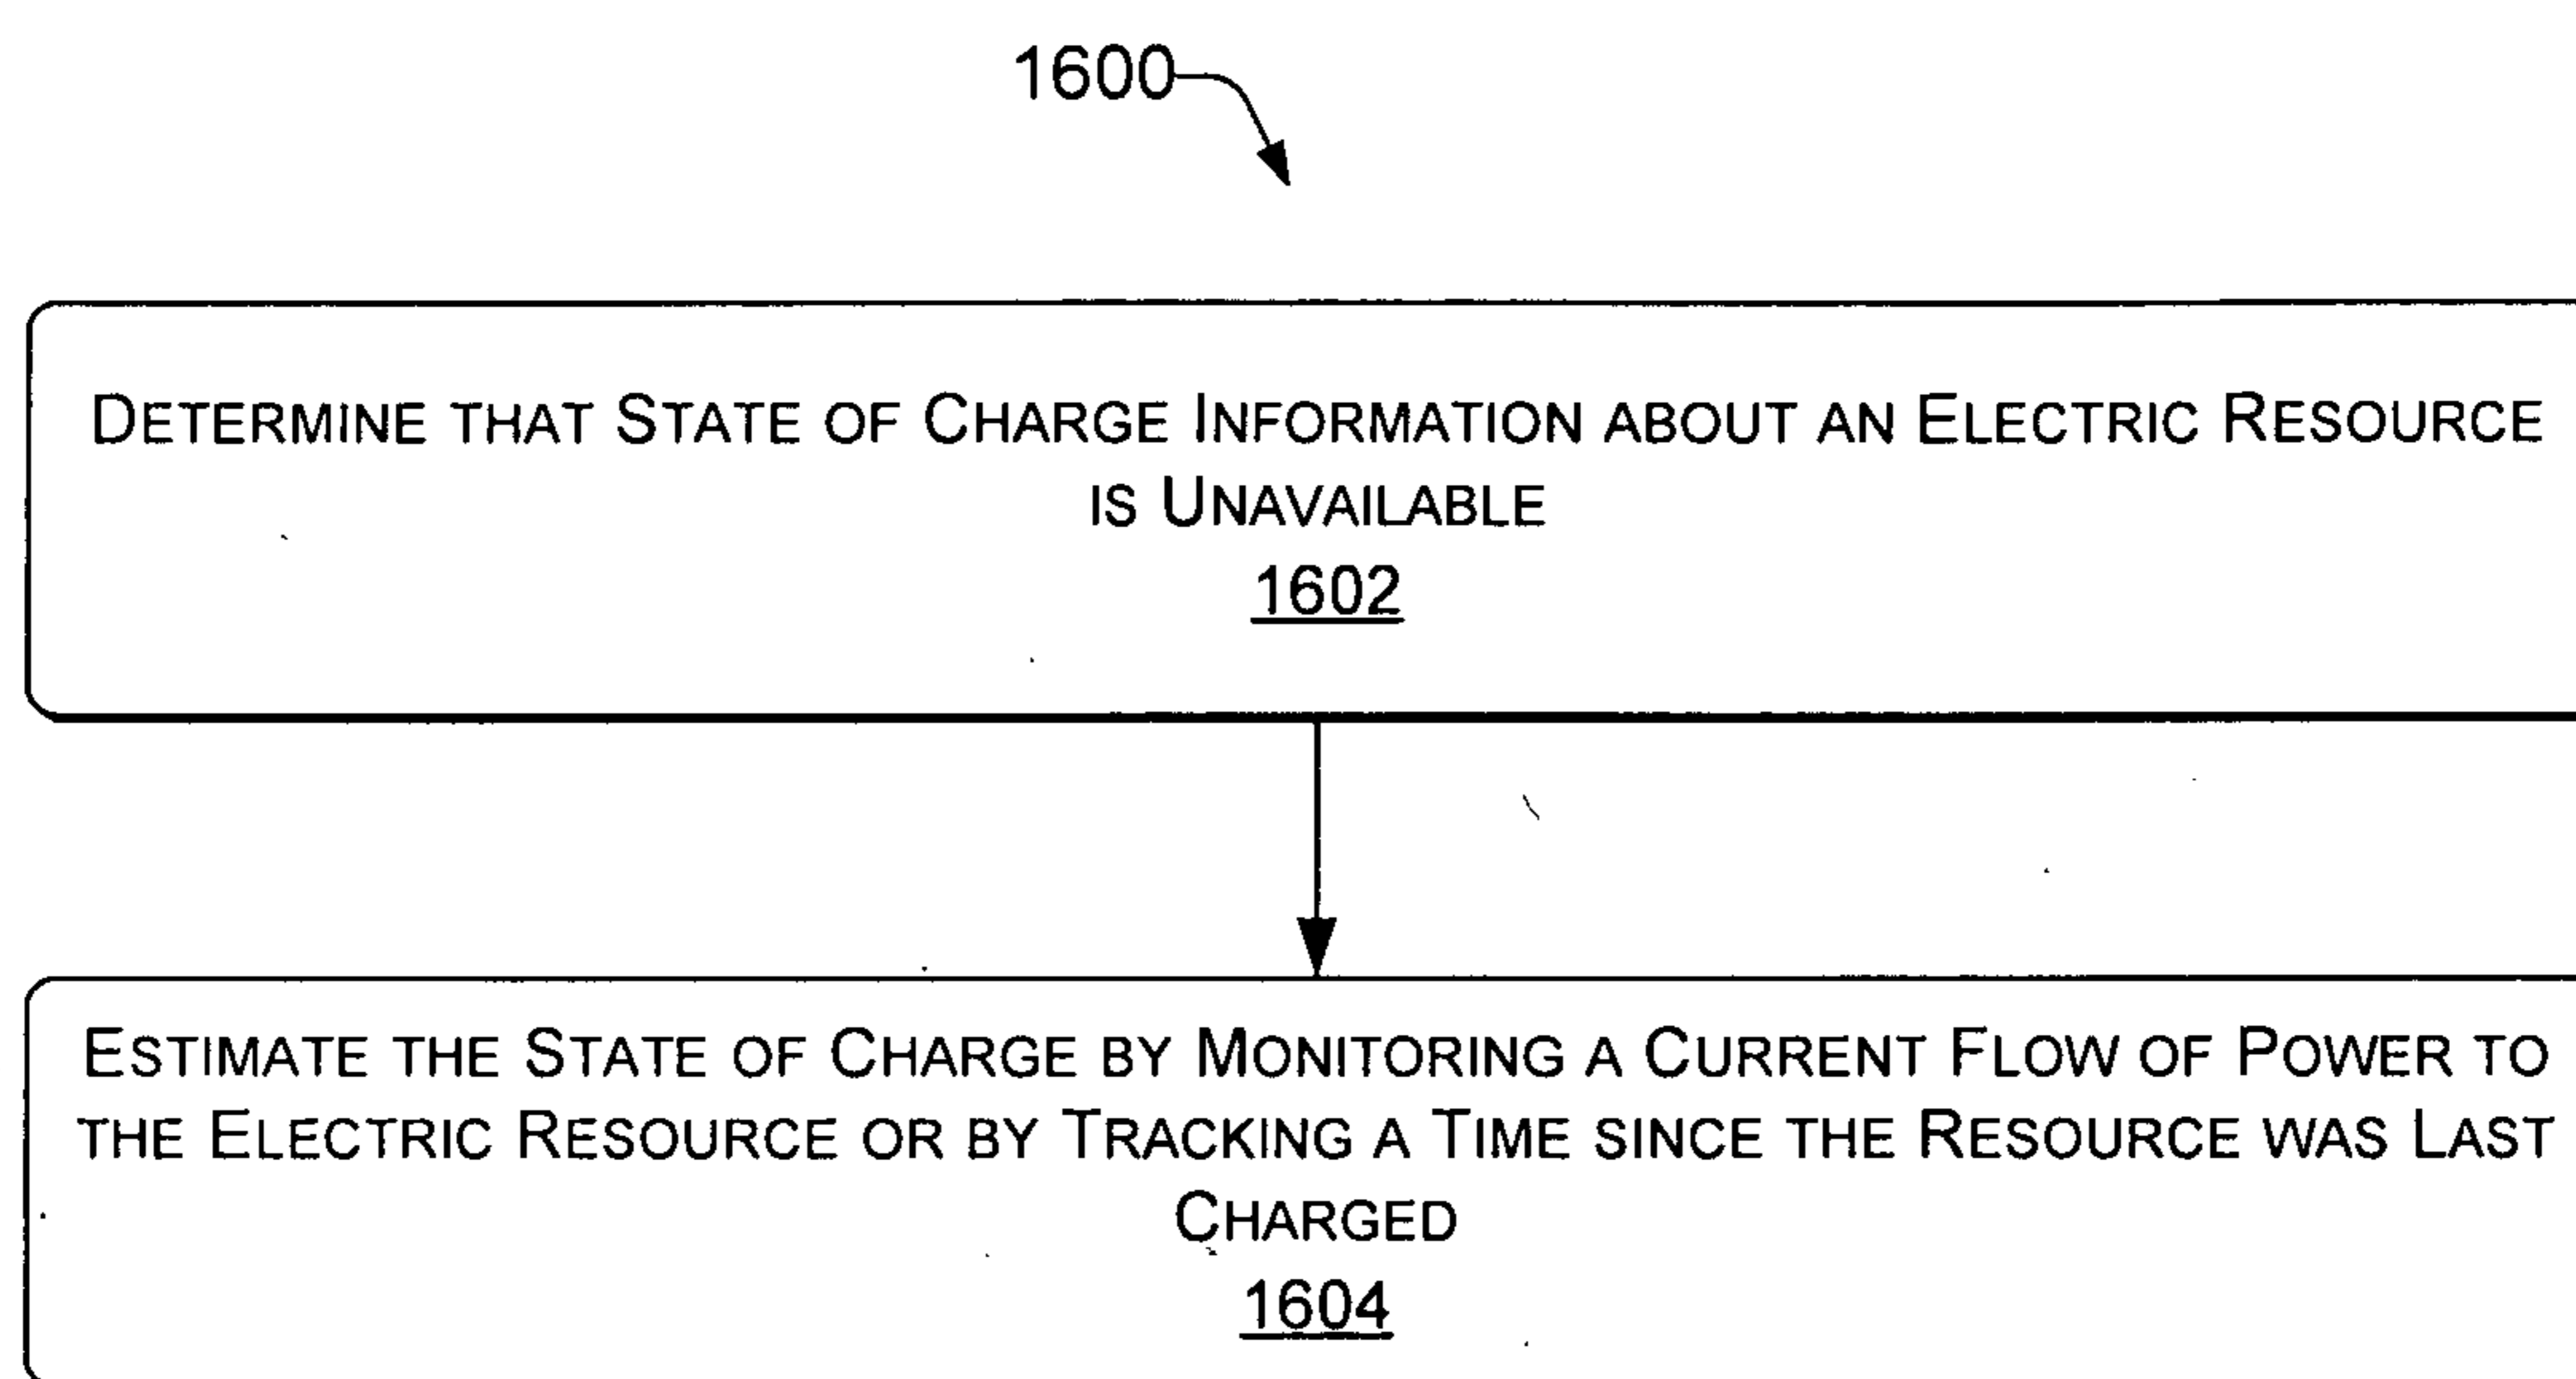


Fig. 16

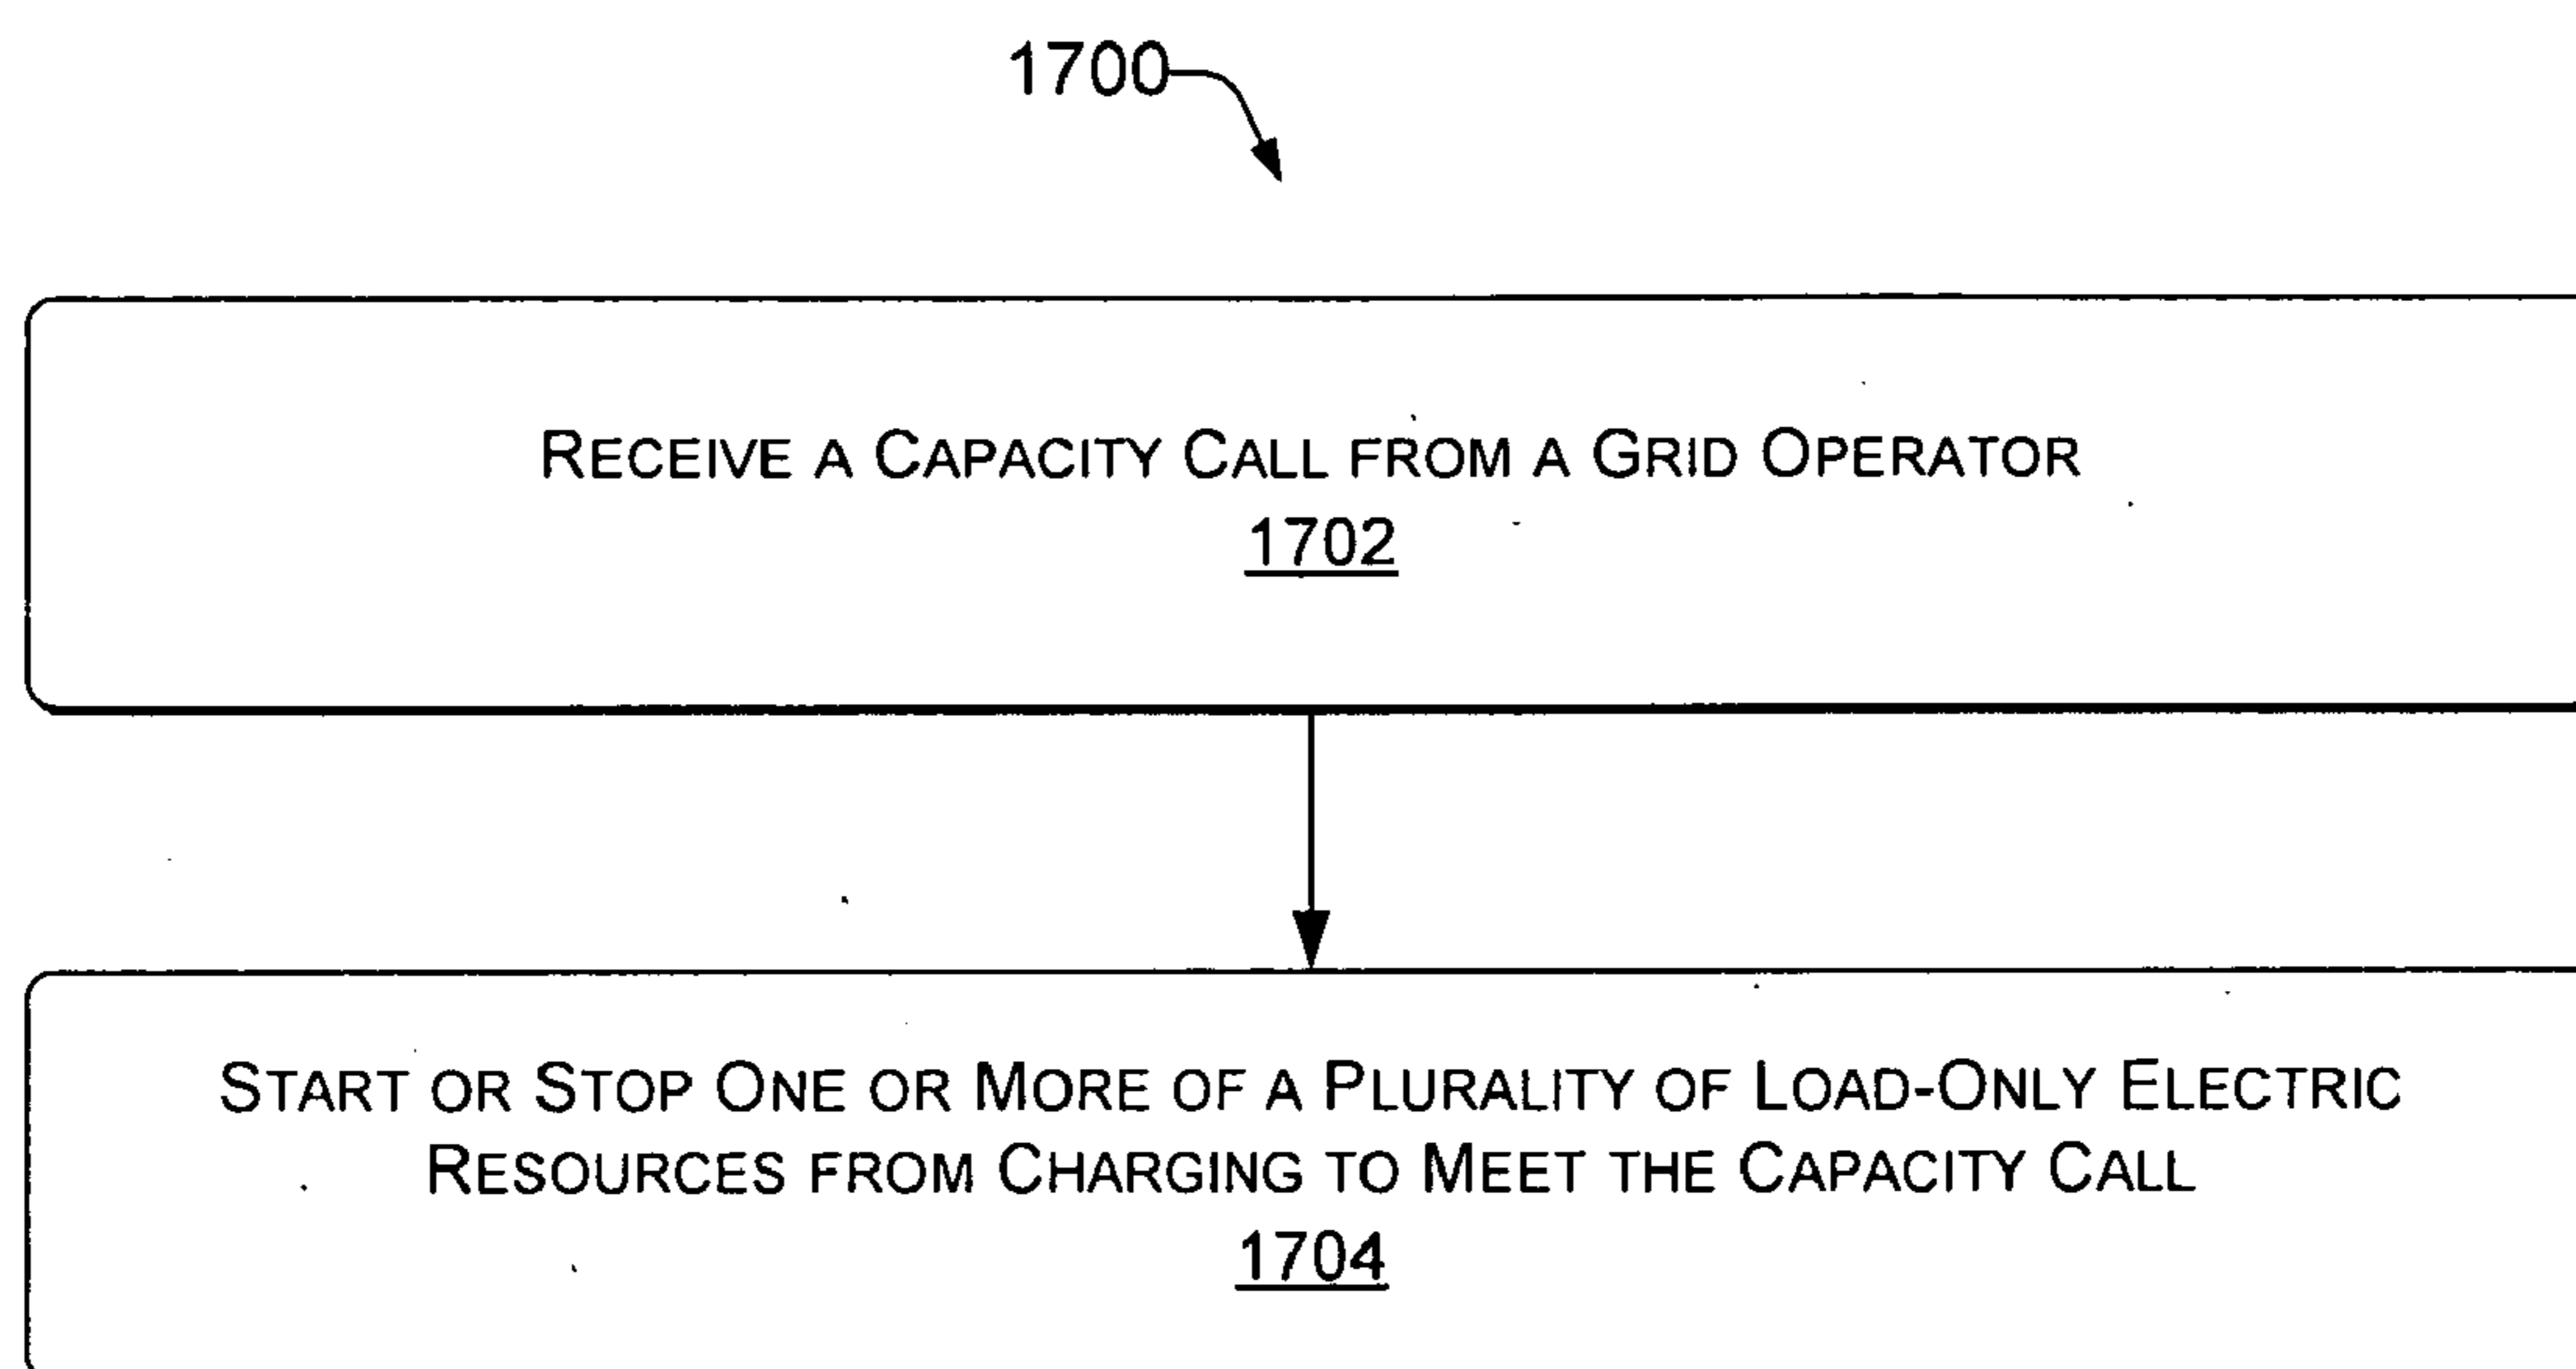


Fig. 17

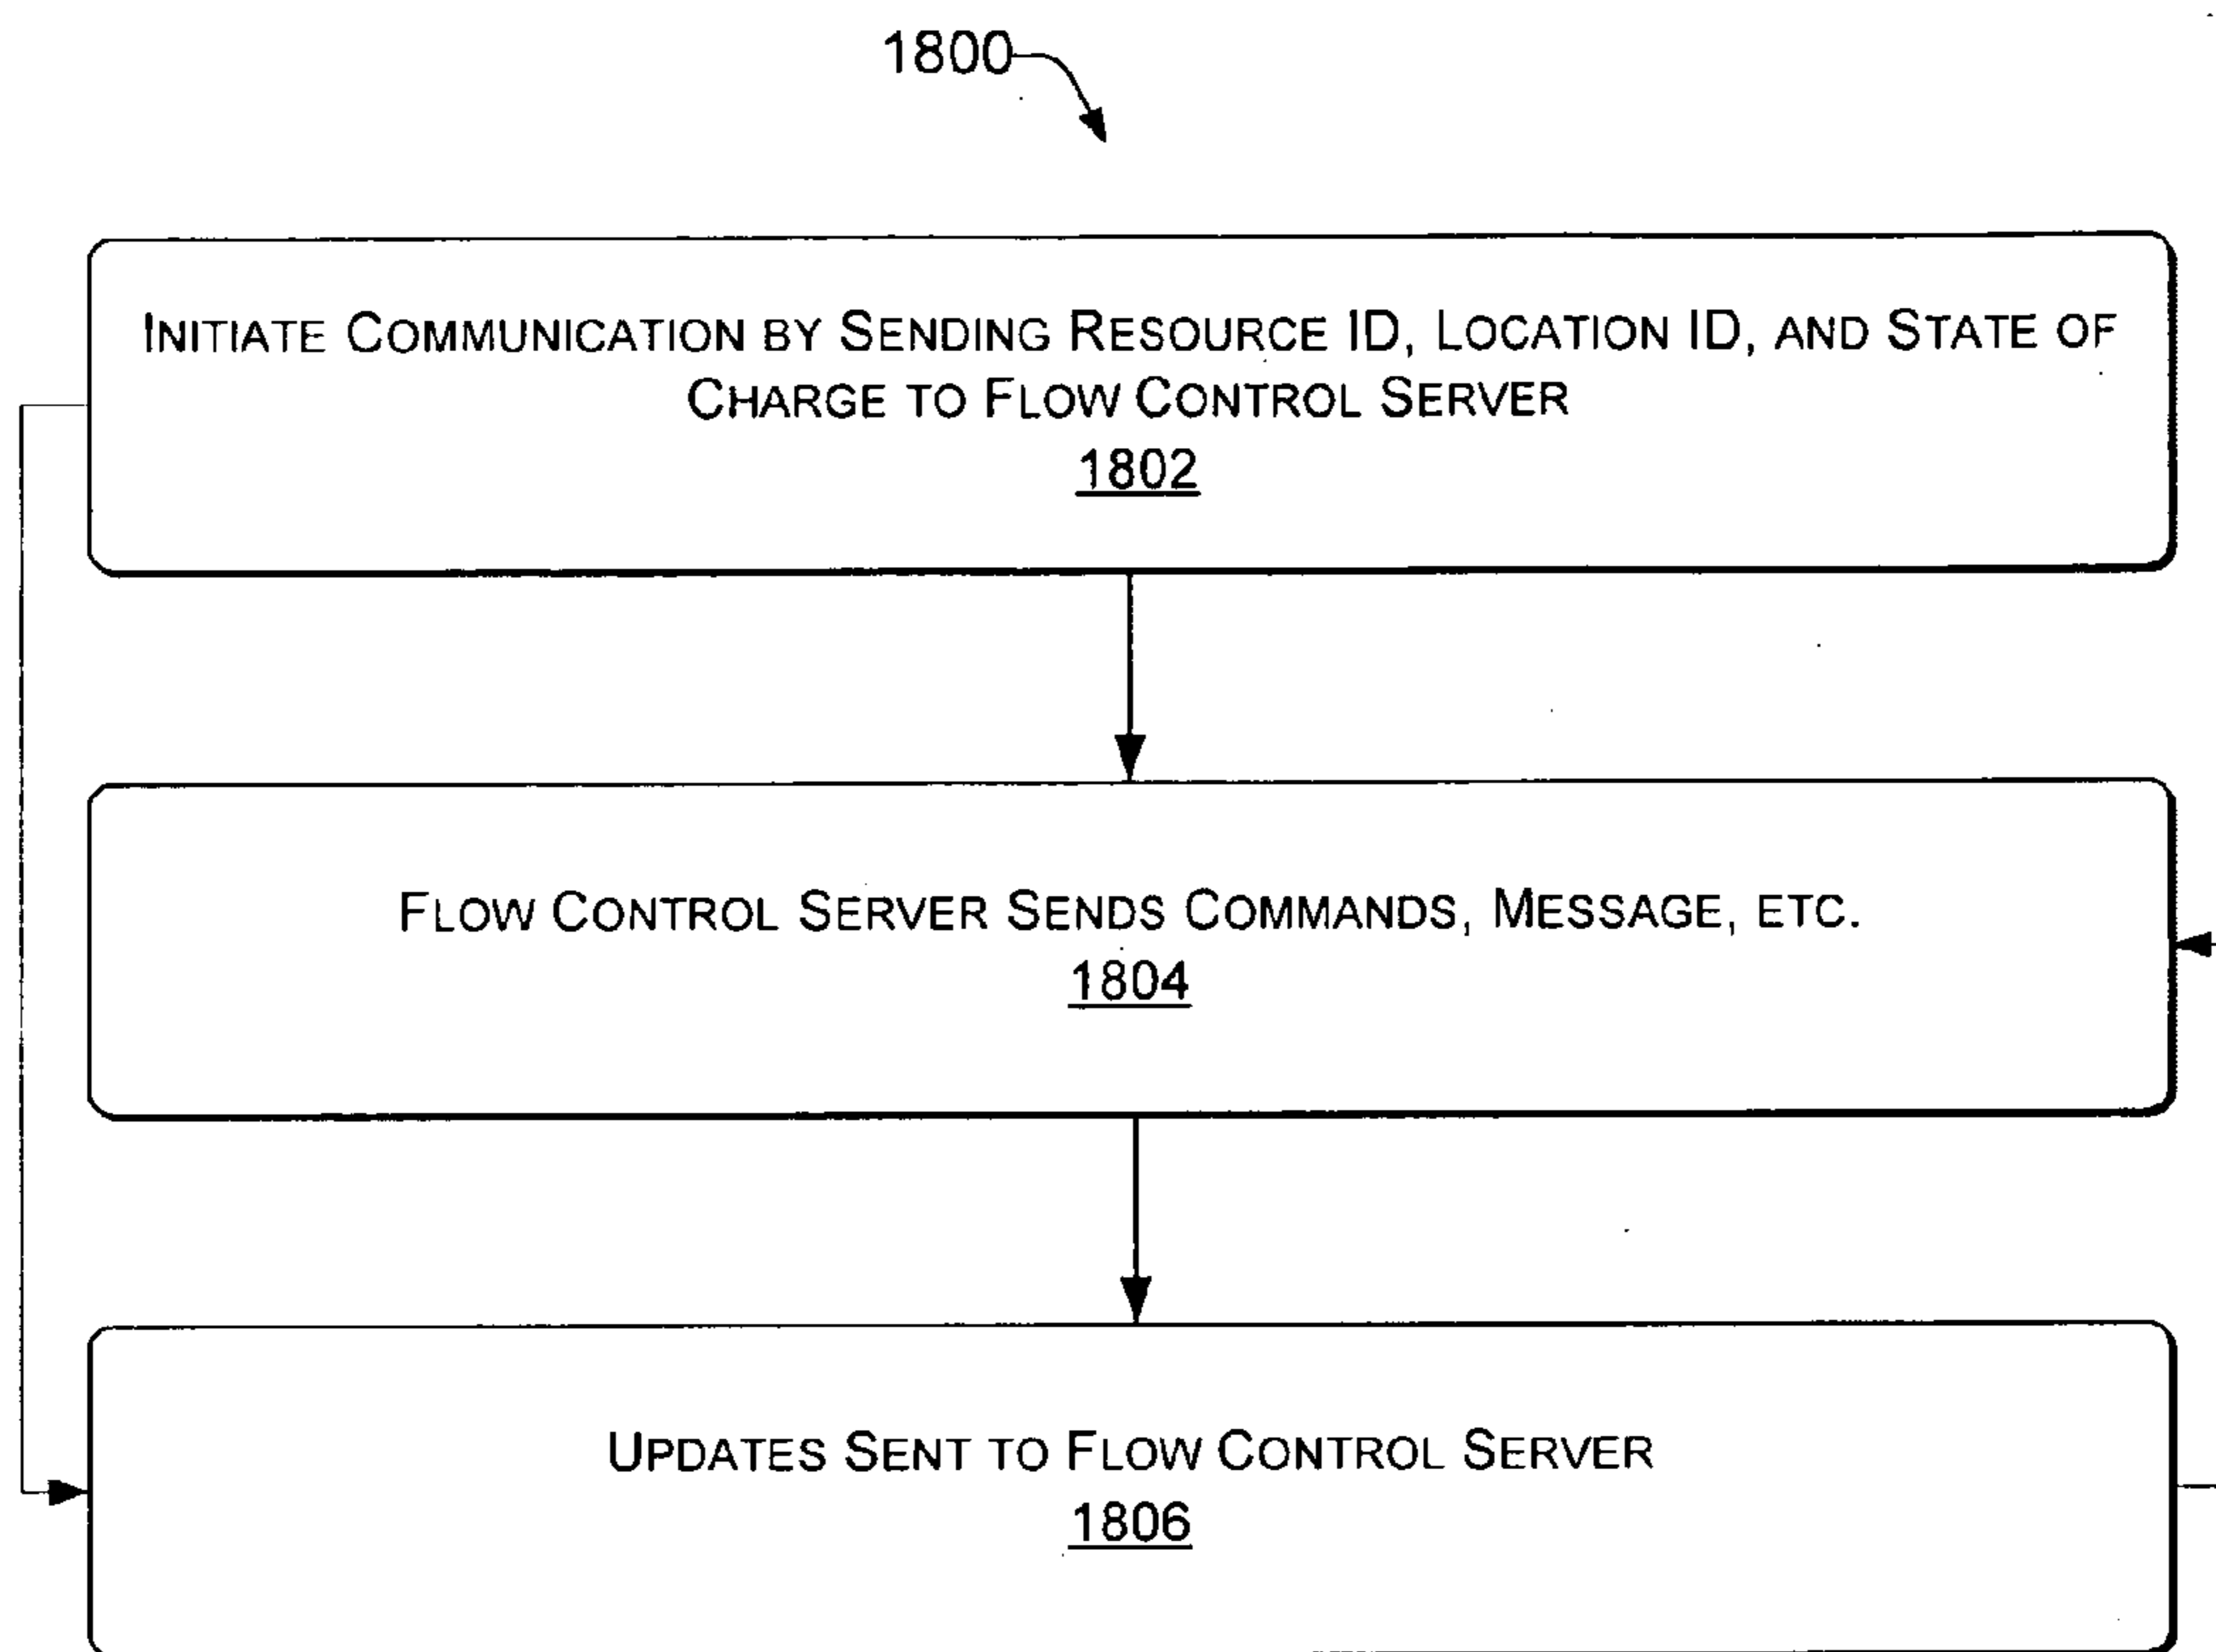


Fig. 18

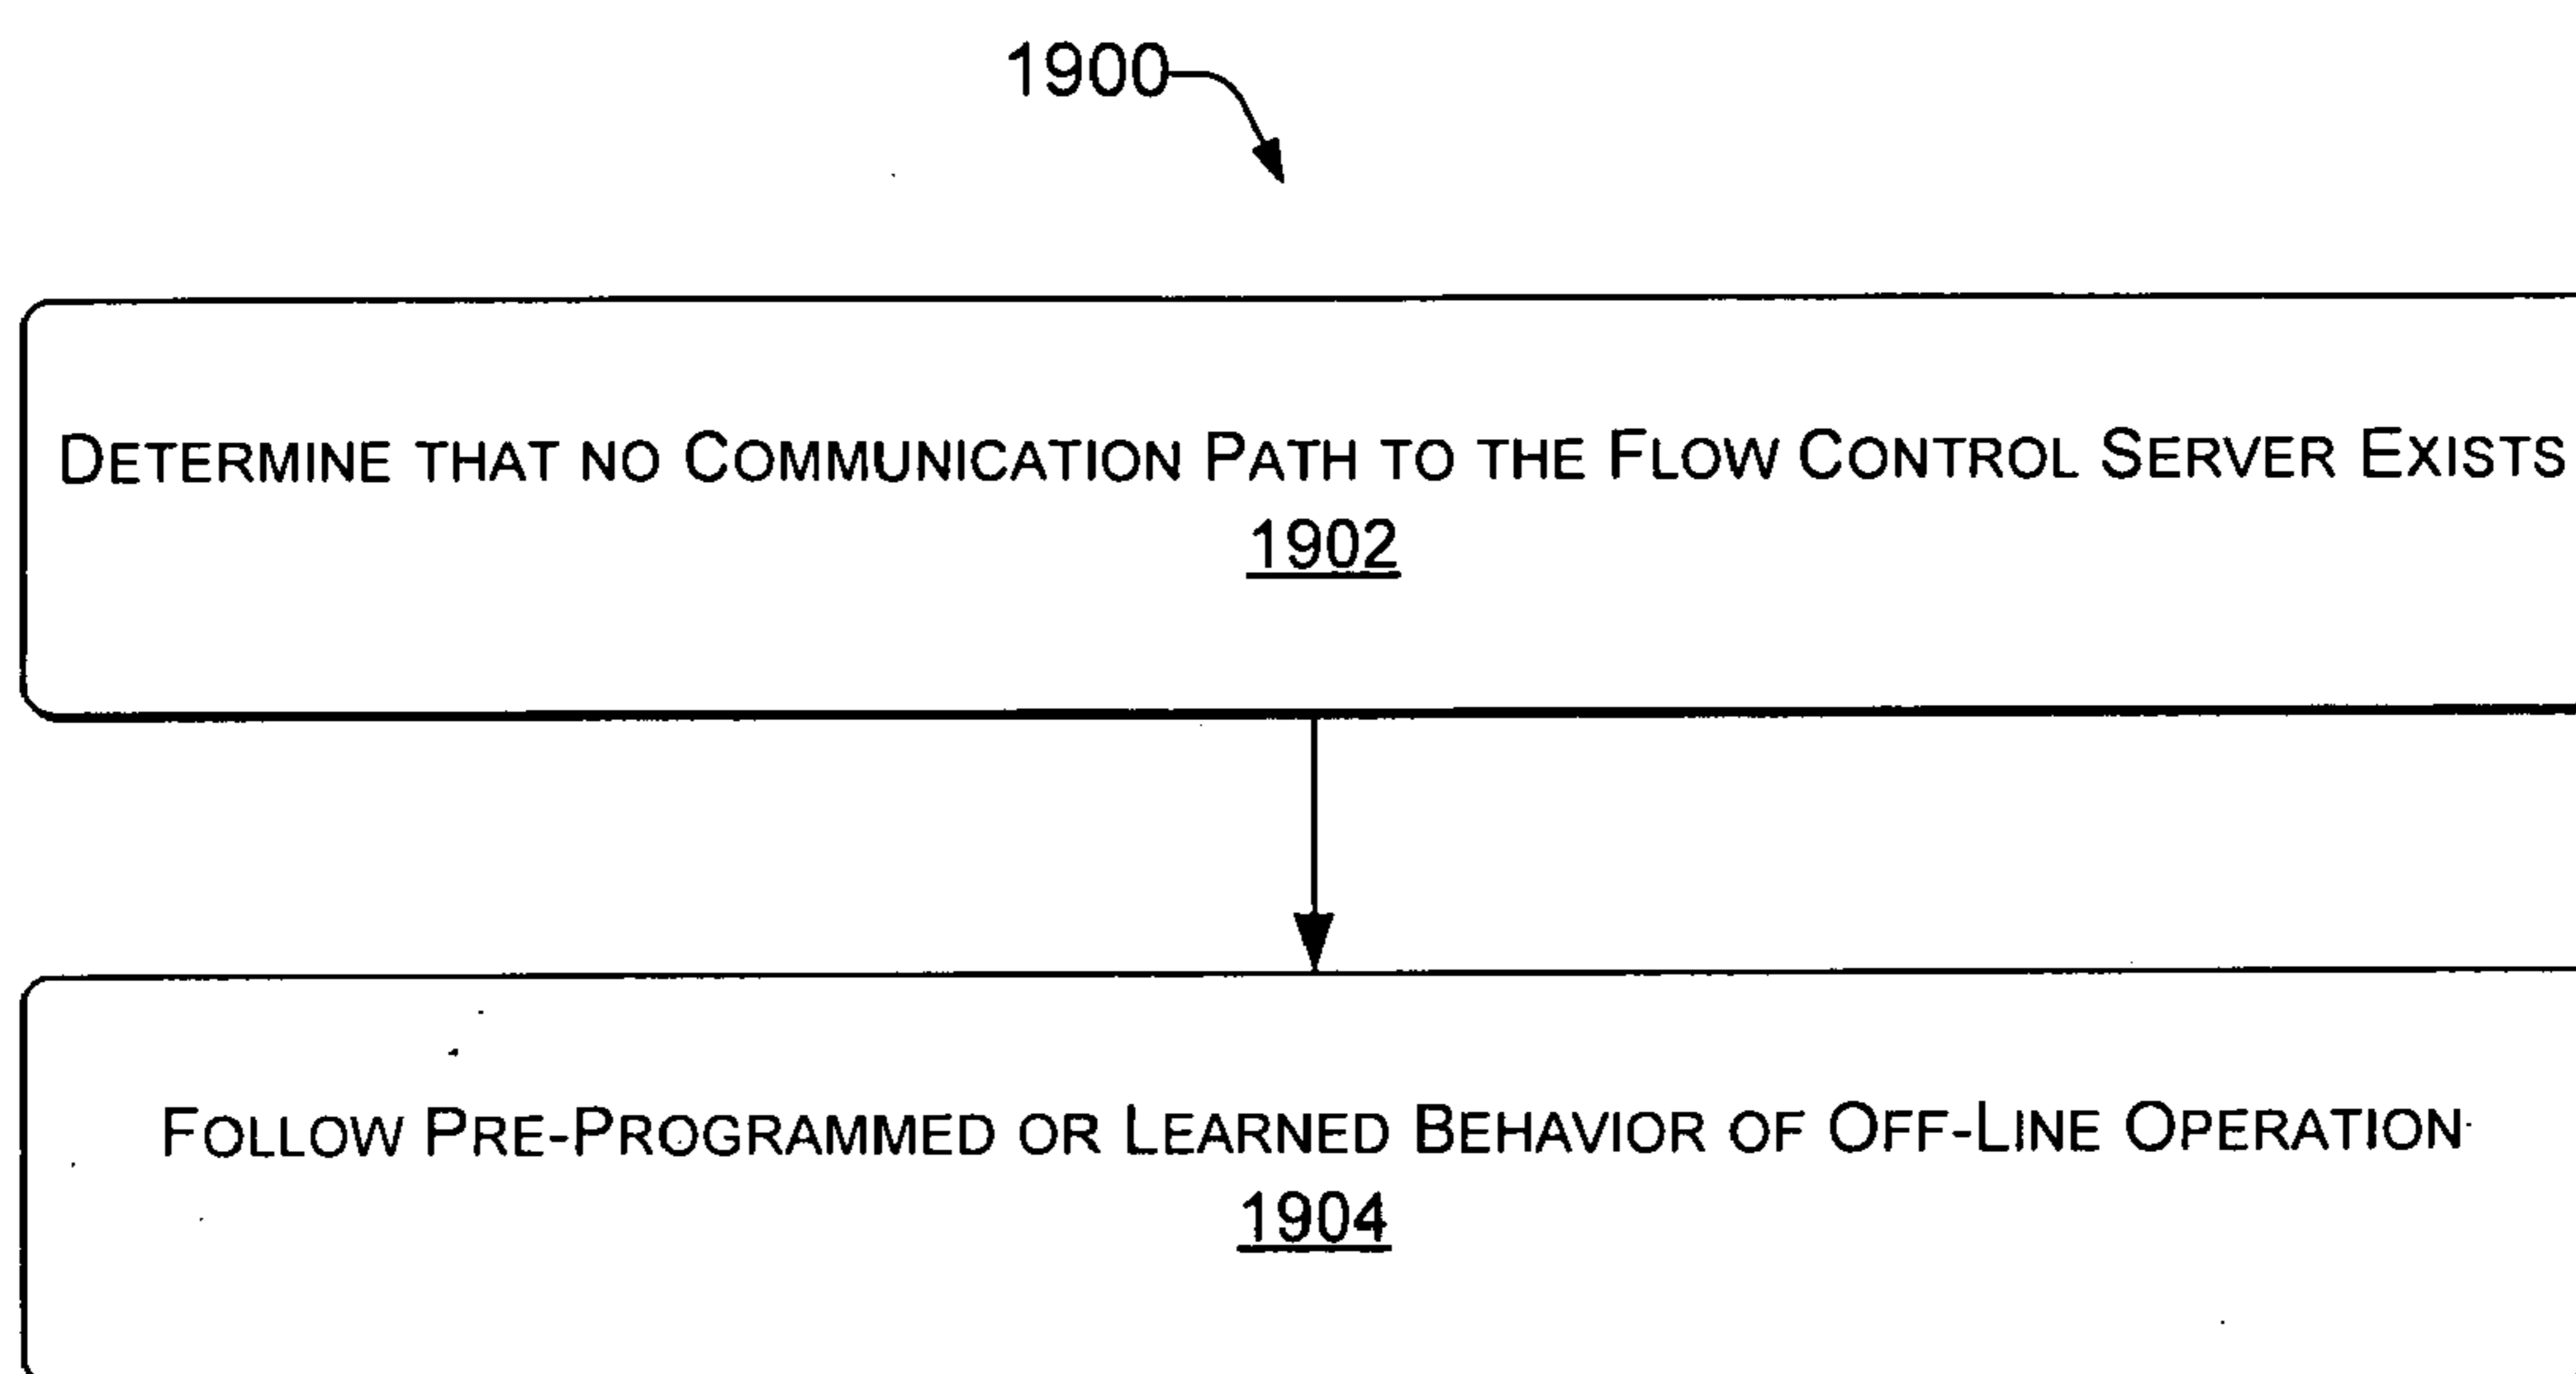


Fig. 19

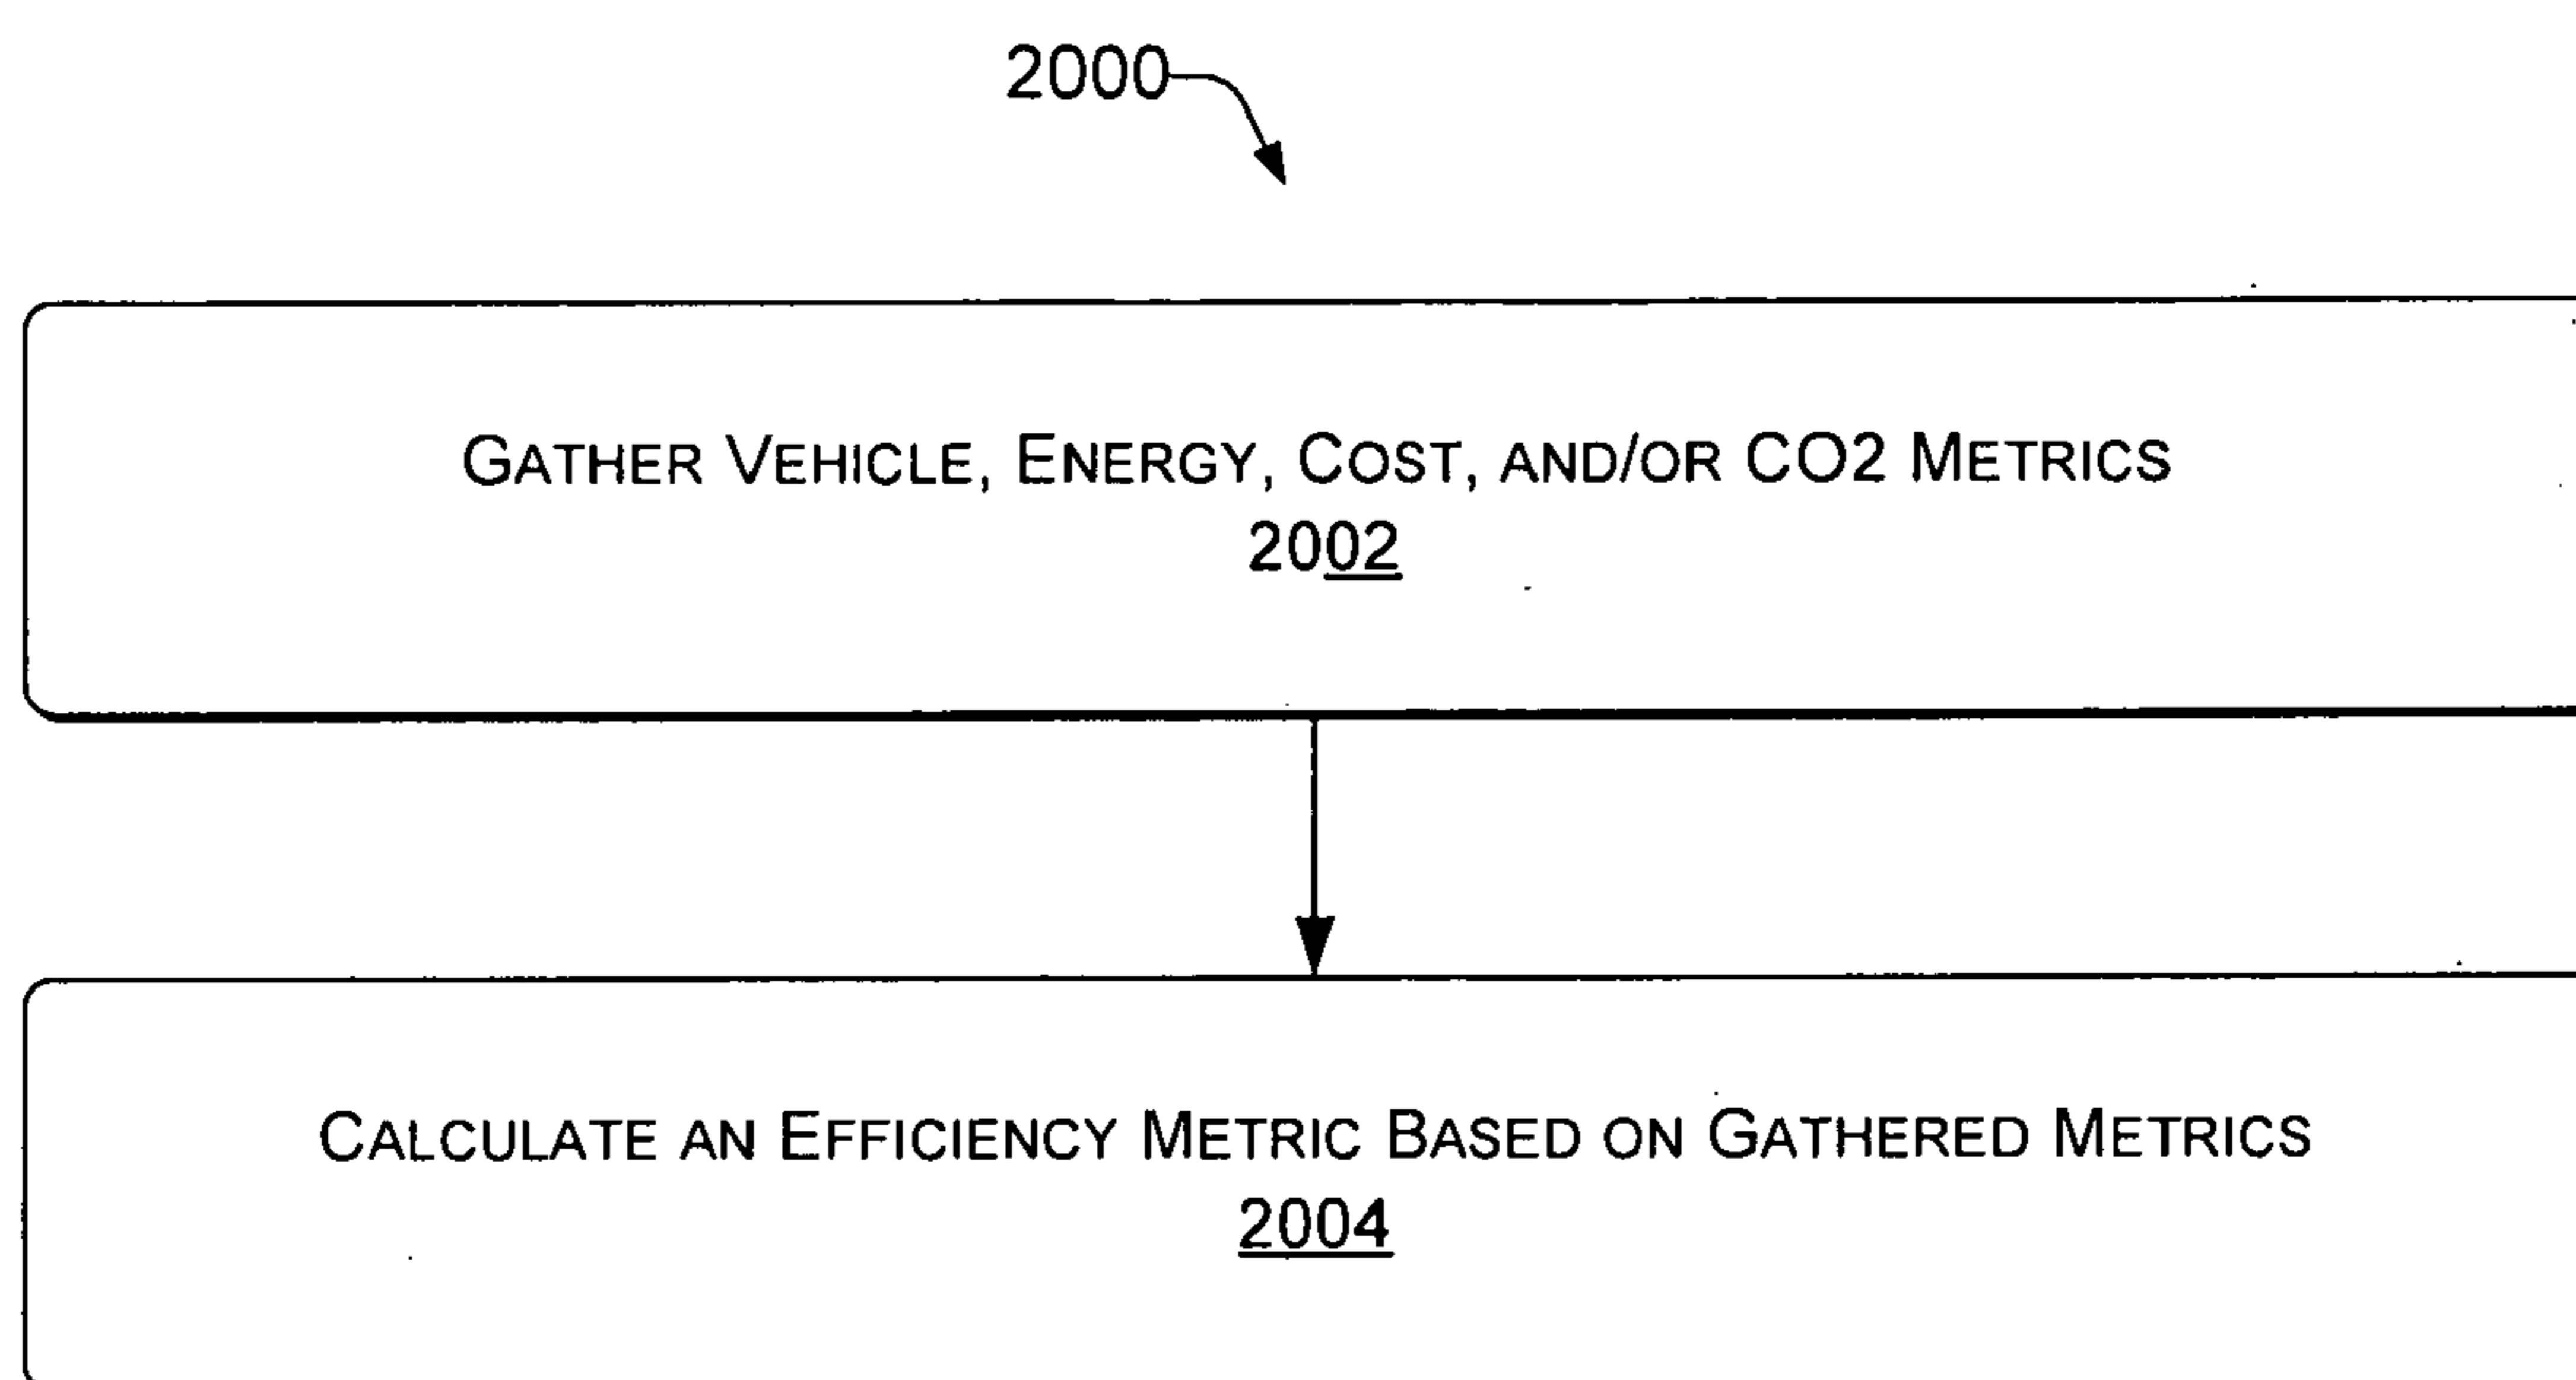


Fig. 20

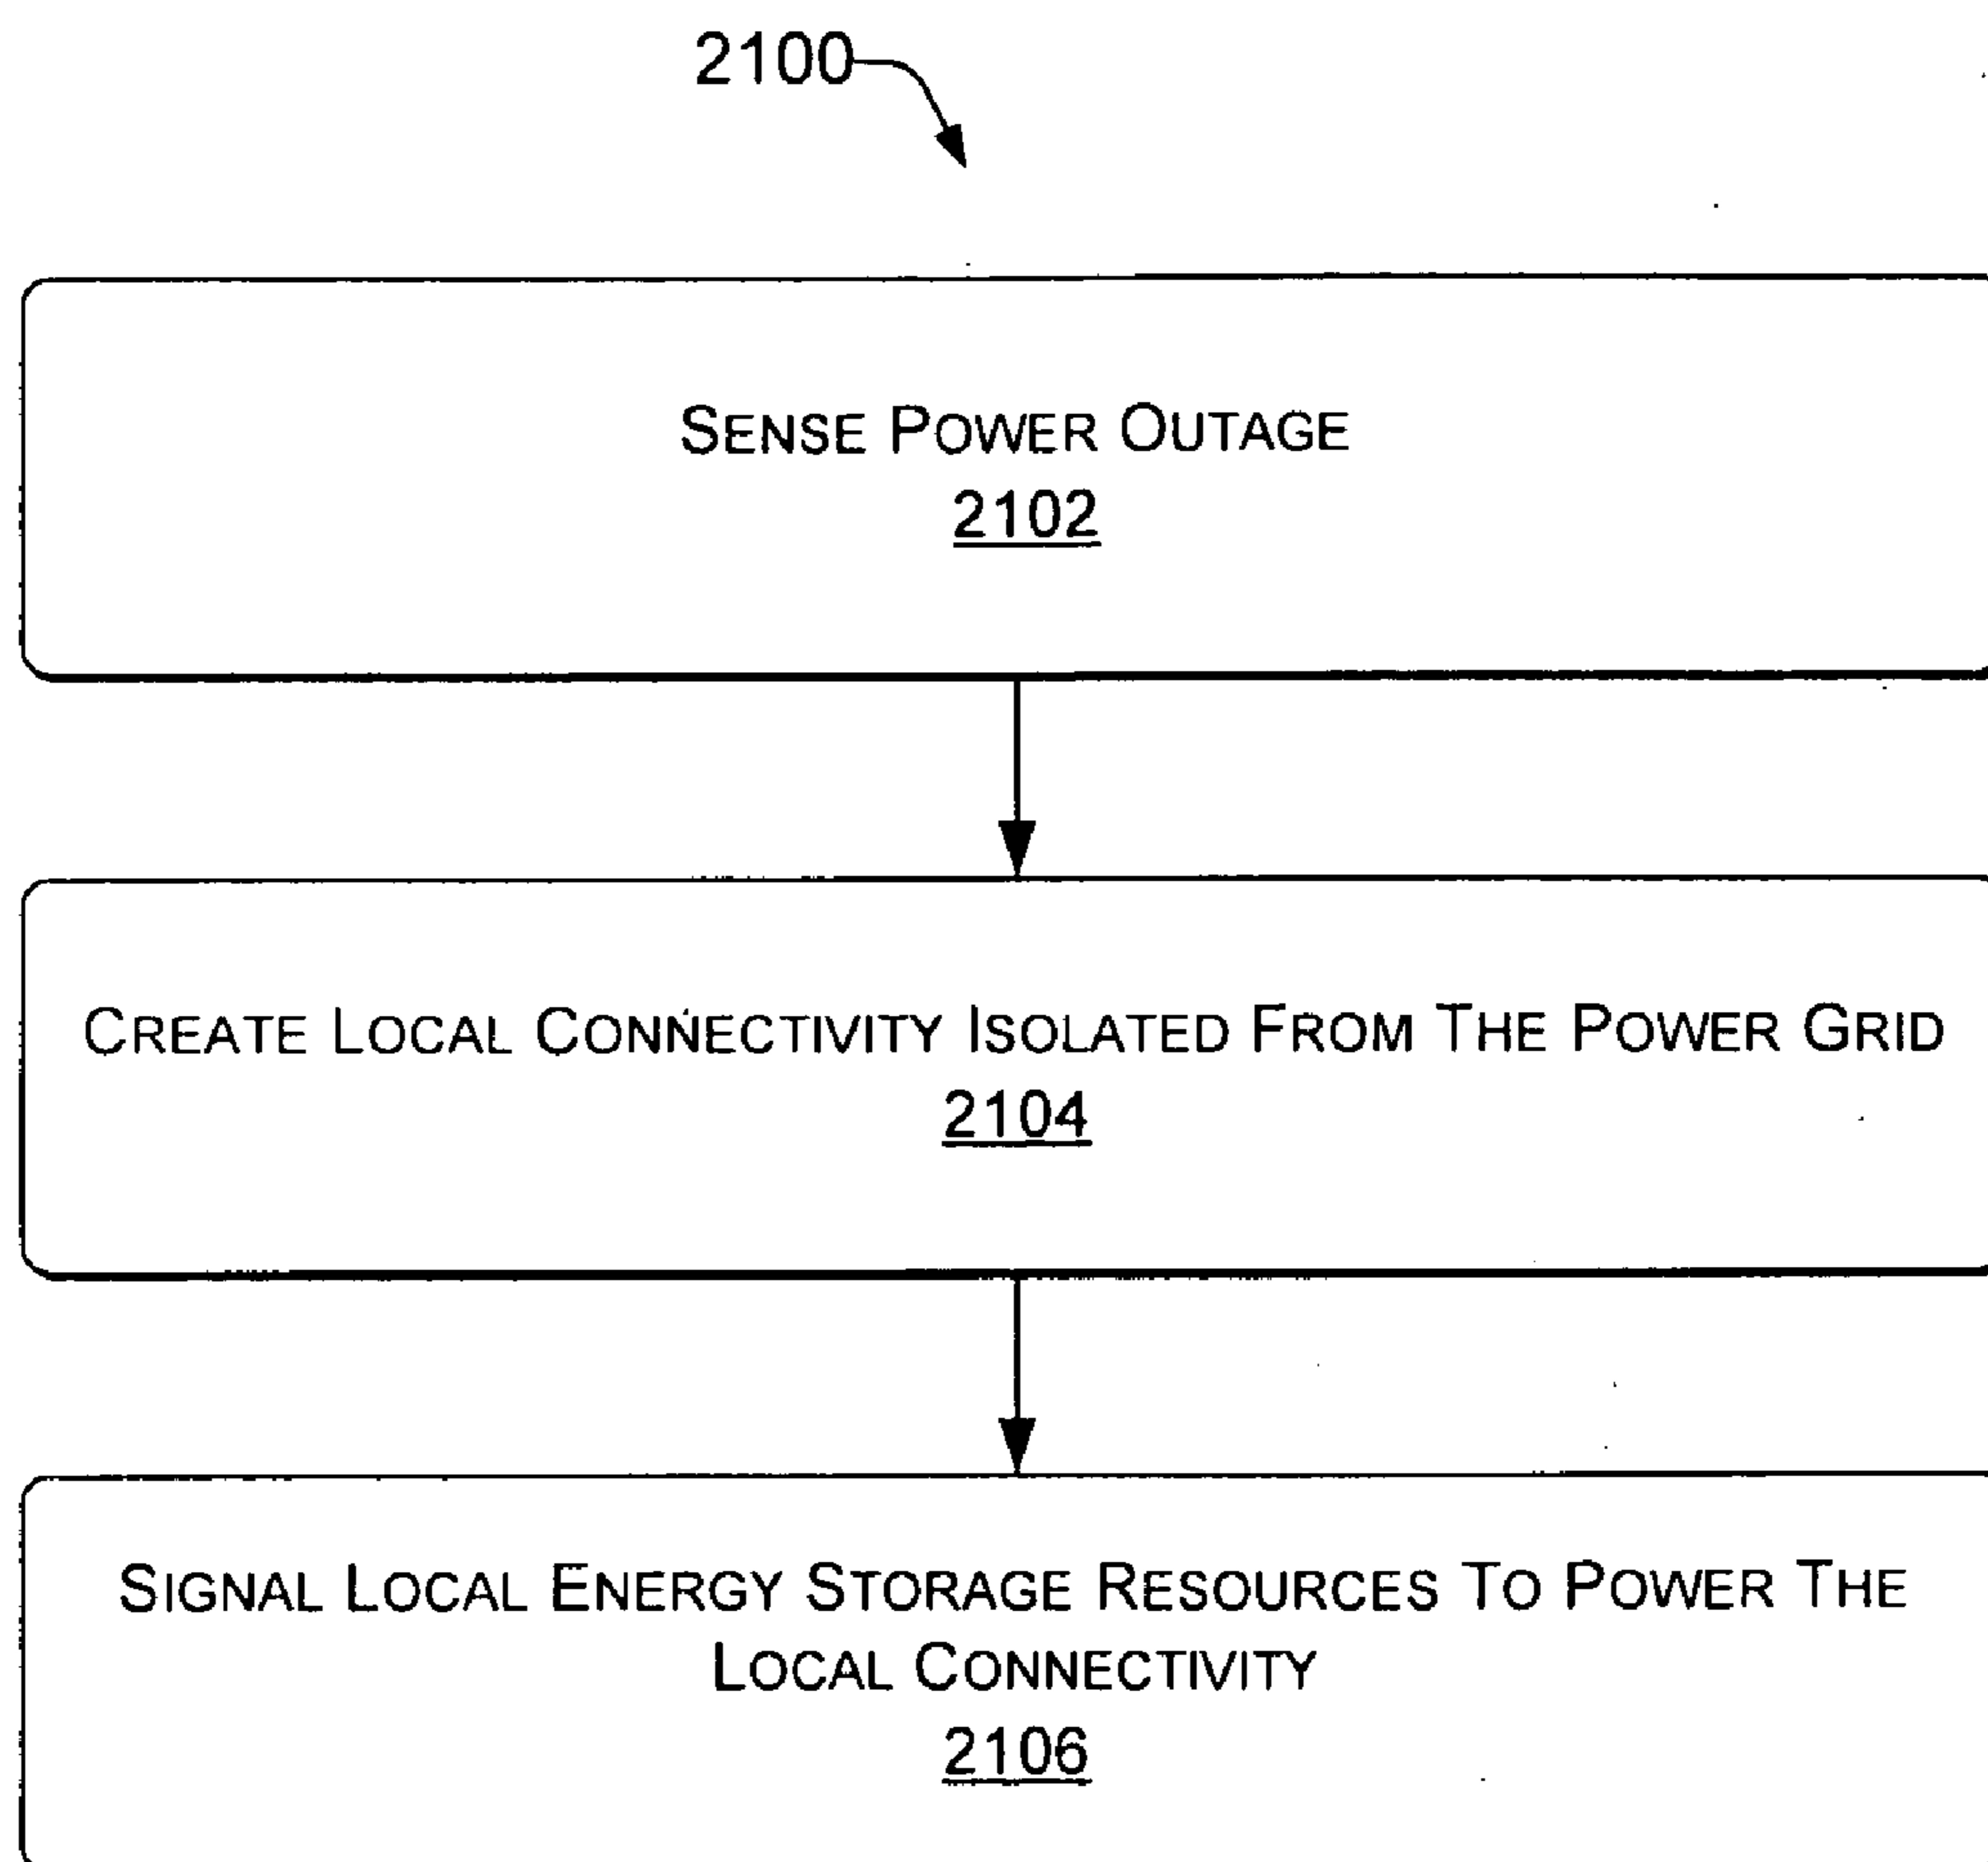


Fig. 21


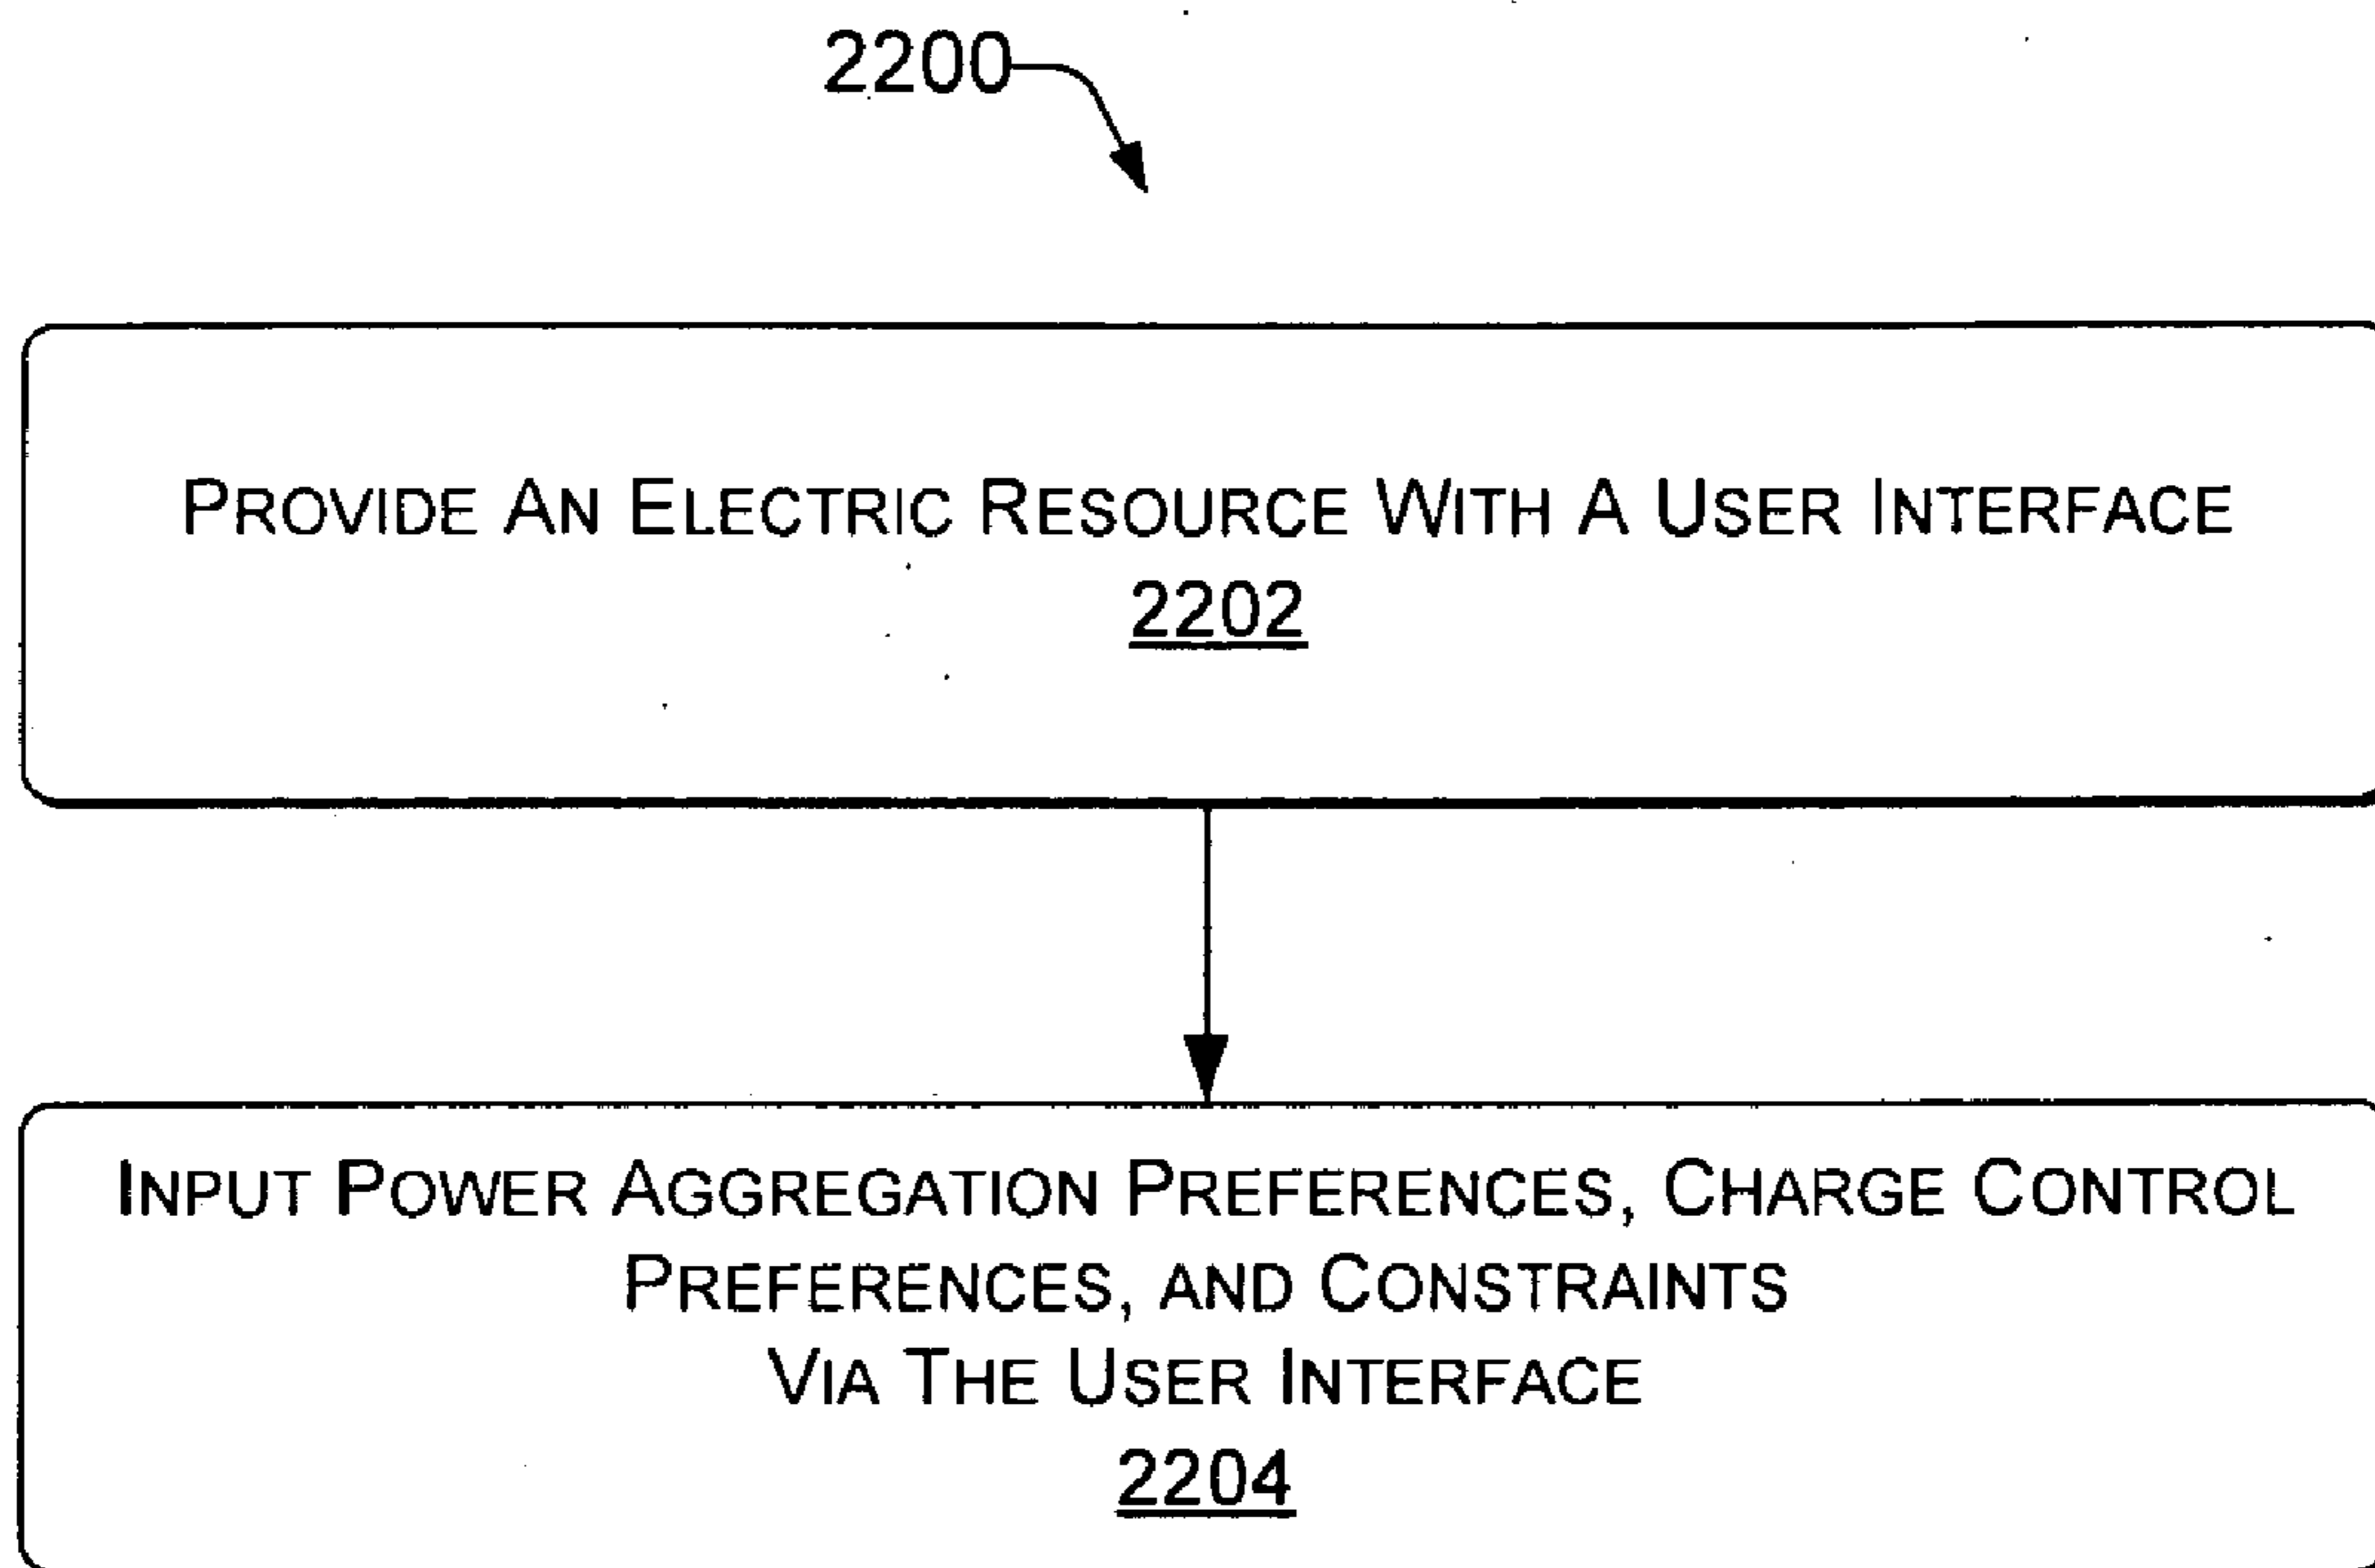


Fig. 22

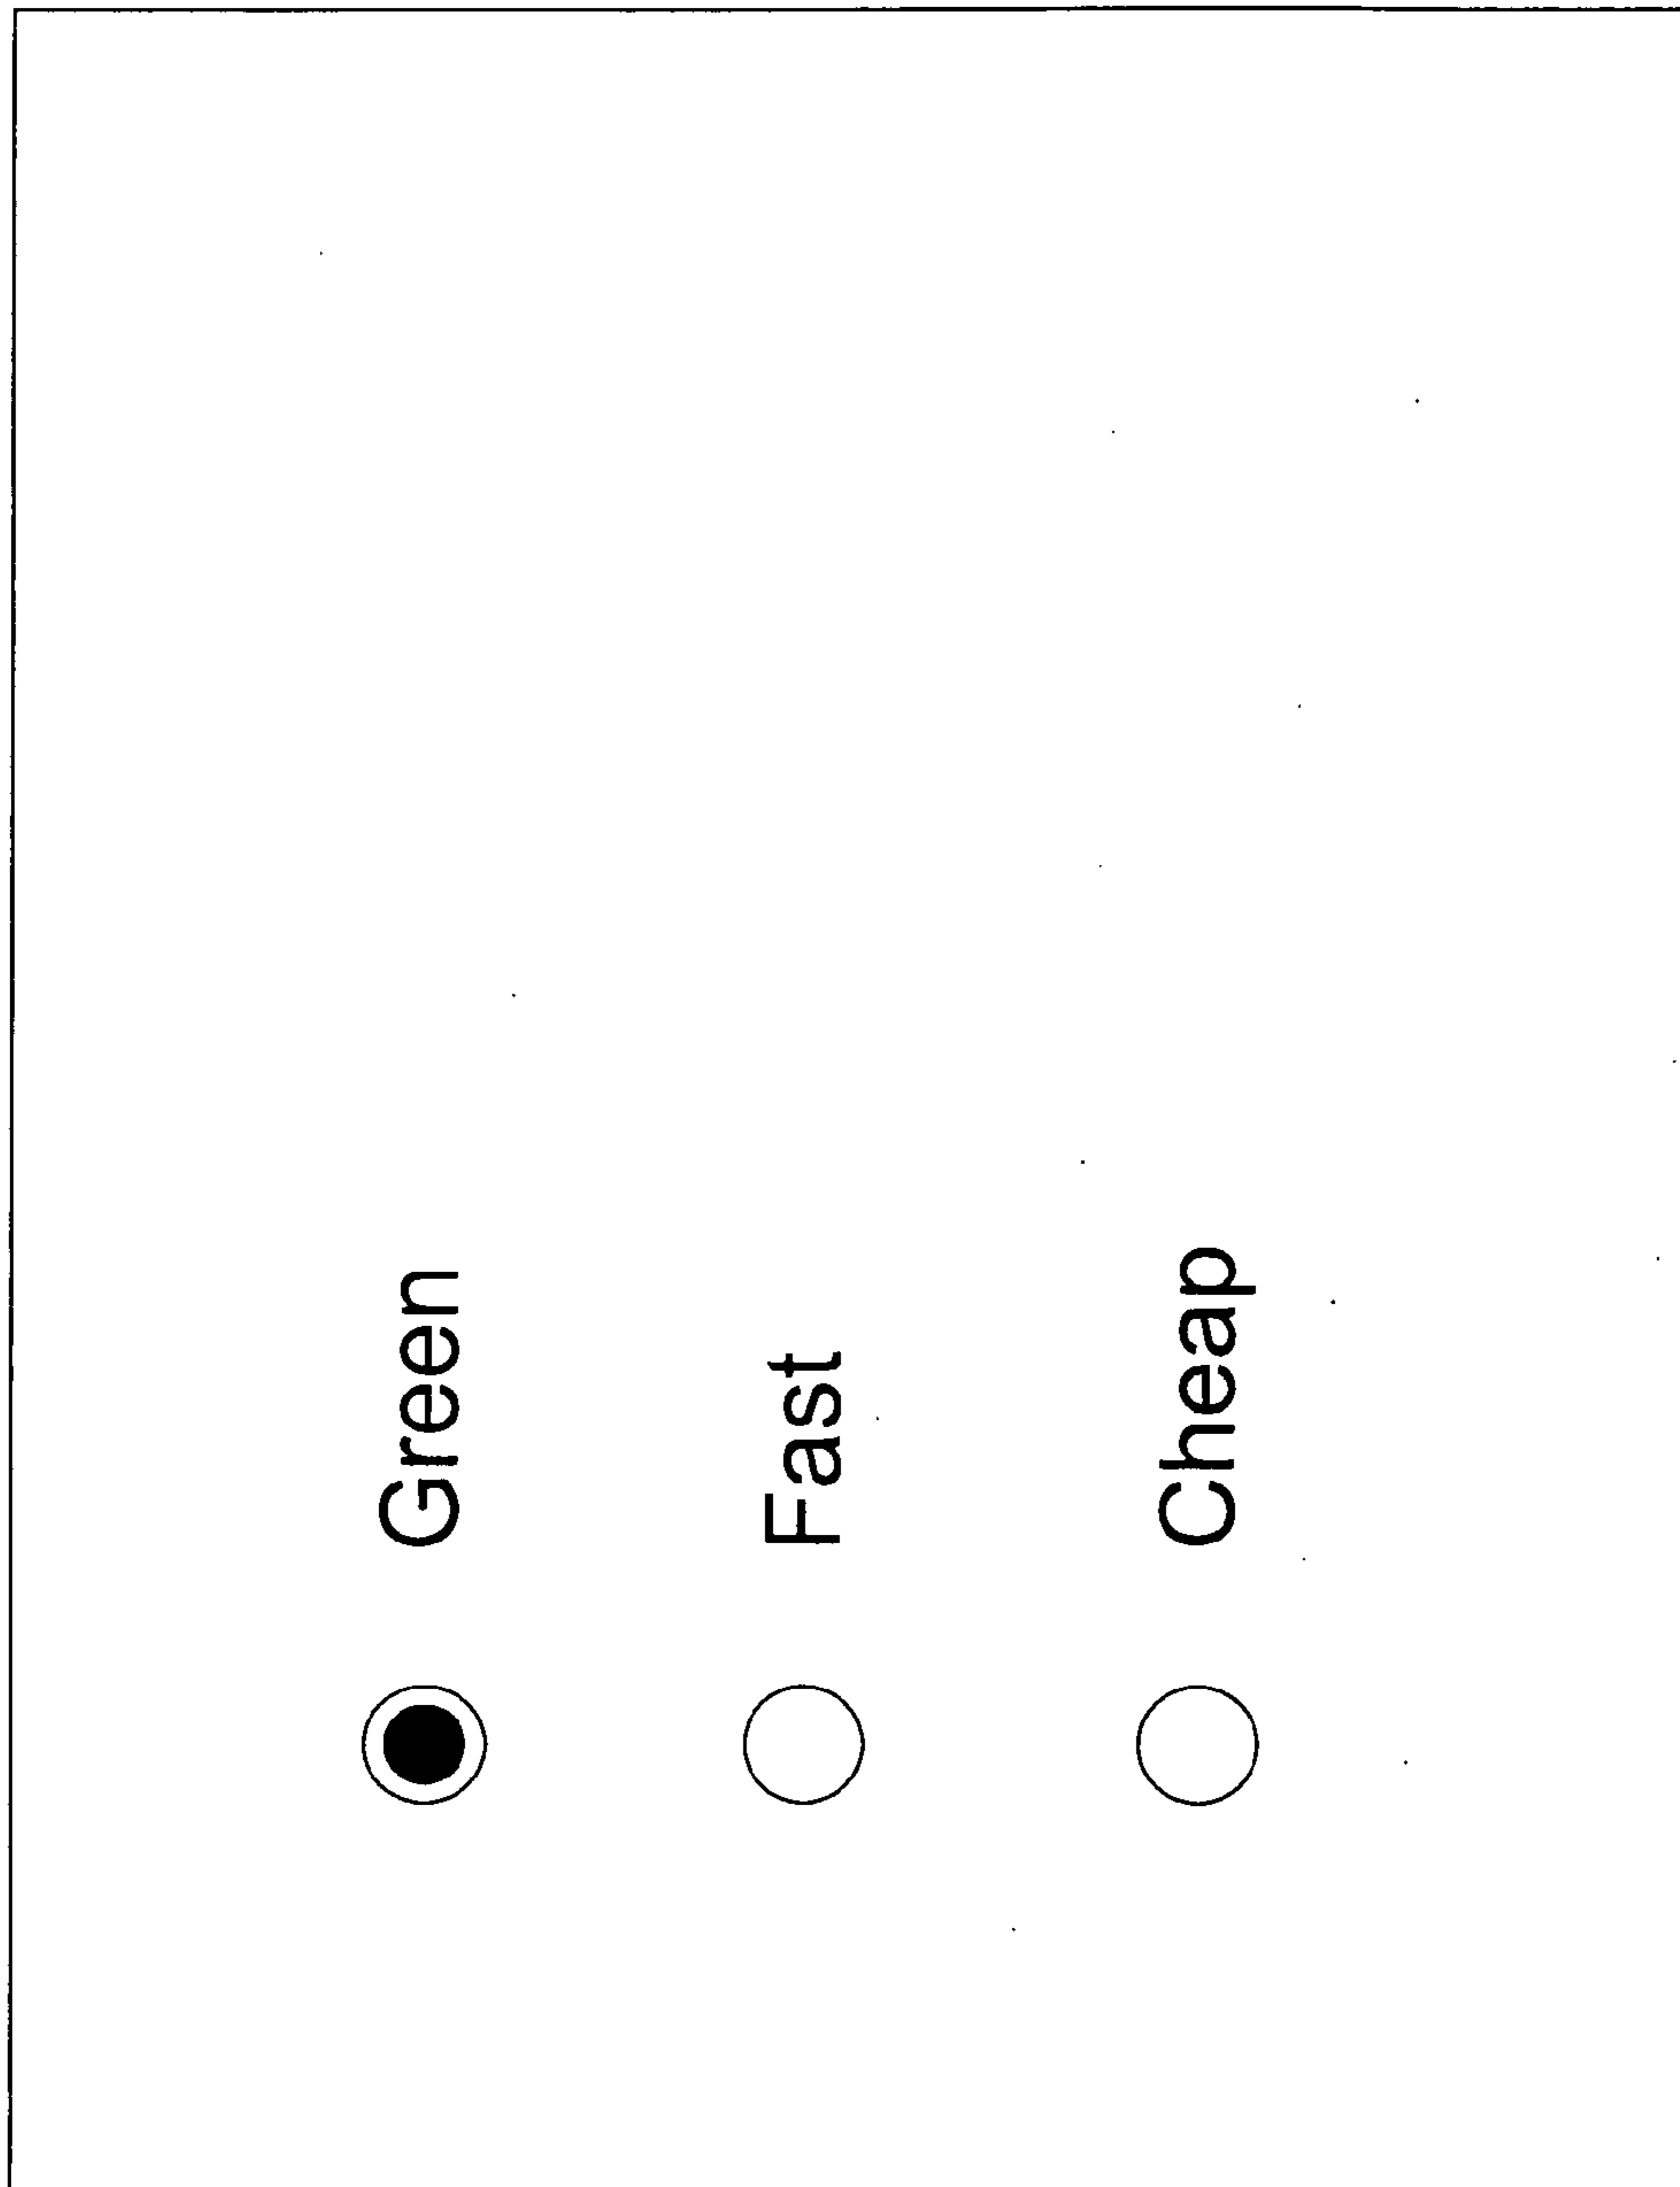

2300

Fig. 23

**TRANSCEIVER AND CHARGING
COMPONENT FOR A POWER
AGGREGATION SYSTEM**

RELATED APPLICATIONS

[0001] This application claims priority to U.S. Provisional Patent Application No. 60/980,663 to Seth Bridges, et al., entitled, "Plug-In-Vehicle Management System," filed Oct. 17, 2007 and incorporated herein by reference.

[0002] This application is also a continuation-in-part of U.S. Non-provisional patent application Ser. No. 11/837,407 to David L. Kaplan, et al., entitled, "Power Aggregation System for Distributed Electric Resources," filed on Aug. 10, 2007 and incorporated herein by reference application Ser. No. 11/837,407 claims priority to U.S. Provisional Patent Application No. 60/822,047 to David L. Kaplan, entitled, "Vehicle-to-Grid Power Flow Management System," filed Aug. 10, 2006 and incorporated herein by reference; U.S. Provisional Patent Application No. 60/869,439 to Seth W. Bridges, David L. Kaplan, and Seth B. Pollack, entitled, "A Distributed Energy Storage Management System," filed Dec. 11, 2006 and incorporated herein by reference; and U.S. Provisional Patent Application No. 60/915,347 to Seth Bridges, Seth Pollack, and David Kaplan, entitled, "Plug-In-Vehicle Management System," filed May 1, 2007 and incorporated herein by reference.

[0003] This application is also related to U.S. patent application Ser. No. 11/836,743, entitled, "Electric Resource Module in a Power Aggregation System for Distributed Electric Resources" by Bridges et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; to U.S. patent application Ser. No. 11/836,745, entitled, "Electric Resource Power Meter in a Power Aggregation System for Distributed Electric Resources" by Bridges et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; to U.S. patent application Ser. No. 11/836,747, entitled, "Connection Locator in a Power Aggregation System for Distributed Electric Resources" by Bridges et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; to U.S. patent application Ser. No. 11/836,749, entitled, "Scheduling and Control in a Power Aggregation System for Distributed Electric Resources" by Pollack et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; to U.S. patent application Ser. No. 11/836,752, entitled, "Smart Islanding and Power Backup in a Power Aggregation System for Distributed Electric Resources" by Bridges et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; to U.S. patent application Ser. No. 11/836,756, entitled, "User Interface and User Control in a Power Aggregation System for Distributed Electric Resources" by Pollack et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference; and to U.S. patent application Ser. No. 11/836,760, entitled, "Business Methods in a Power Aggregation System for Distributed Electric Resources" by Pollack et al., filed concurrently on Aug. 9, 2007, and incorporated herein by reference.

FIELD OF THE INVENTION

[0004] Embodiments of the present invention relate generally to the field of power aggregation and distribution. More

specifically, embodiments of the present invention relate to a service for aggregating power distributed to and from electric resources.

BACKGROUND

[0005] Today's electric power and transportation systems suffer from a number of drawbacks. Pollution, especially greenhouse gas emissions, is prevalent because approximately half of all electric power generated in the United States is produced by burning coal. Virtually all vehicles in the United States are powered by burning petroleum products, such as gasoline or petro-diesel. It is now widely recognized that human consumption of these fossil fuels is the major cause of elevated levels of atmospheric greenhouse gases, especially carbon dioxide (CO₂), which in turn disrupts the global climate, often with destructive side effects. Besides producing greenhouse gases, burning fossil fuels also add substantial amounts of toxic pollutants to the atmosphere and environment. The transportation system, with its high dependence on fossil fuels, is especially carbon-intensive. That is, physical units of work performed in the transportation system typically discharge a significantly larger amount of CO₂ into the atmosphere than the same units of work performed electrically.

[0006] With respect to the electric power grid, expensive peak power—electric power delivered during periods of peak demand—can cost substantially more than off-peak power. The electric power grid itself has become increasingly unreliable and antiquated, as evidenced by frequent large-scale power outages. Grid instability wastes energy, both directly and indirectly (for example, by encouraging power consumers to install inefficient forms of backup generation).

[0007] While clean forms of energy generation, such as wind and solar, can help to address the above problems, they suffer from intermittency. Hence, grid operators are reluctant to rely heavily on these sources, making it difficult to move away from standard, typically carbon-intensive forms of electricity.

[0008] The electric power grid contains limited inherent facility for storing electrical energy. Electricity must be generated constantly to meet uncertain demand, which often results in over-generation (and hence wasted energy) and sometimes results in under-generation (and hence power failures).

[0009] Distributed electric resources, en masse can, in principle, provide a significant resource for addressing the above problems. However, current power services infrastructure lacks provisioning and flexibility that are required for aggregating a large number of small-scale resources (e.g., electric vehicle batteries) to meet medium- and large-scale needs of power services.

[0010] Thus, significant opportunities for improvement exist in the electrical and transportation sectors, and in the way these sectors interact. Fuel-powered vehicles could be replaced with vehicles whose power comes entirely or substantially from electricity. Polluting forms of electric power generation could be replaced with clean ones. Real-time balancing of generation and load can be realized with reduced cost and environmental impact. More economical, reliable electrical power can be provided at times of peak demand. Power services, such as regulation and spinning reserves, can be provided to electricity markets to stabilize the grid and provide a significant economic opportunity. Technologies can

be enabled to provide broader use of intermittent power sources, such as wind and solar.

[0011] Robust, grid-connected electrical storage could store electrical energy during periods of over-production for redelivery to the grid during periods of under-supply. Electric vehicle batteries in vast numbers could participate in this grid-connected storage. However, a single vehicle battery is insignificant when compared with the needs of the power grid.

[0012] Low-level electrical and communication interfaces to enable charging and discharging of electric vehicles with respect to the grid is described in U.S. Pat. No. 5,642,270 to Green et al., entitled, "Battery powered electric vehicle and electrical supply system," incorporated herein by reference. The Green reference describes a bi-directional charging and communication system for grid-connected electric vehicles, but does not address the information processing requirements of dealing with large, mobile populations of electric vehicles, the complexities of billing (or compensating) vehicle owners, nor the complexities of assembling mobile pools of electric vehicles into aggregate power resources based on grid location, the aggregate power resources being robust enough to support firm power service contracts with grid operators.

BRIEF DESCRIPTION OF THE DRAWINGS

[0013] FIG. 1 is a diagram of an exemplary power aggregation system.

[0014] FIGS. 2A-2B are diagrams of exemplary connections between an electric vehicle, the power grid, and the Internet.

[0015] FIG. 3 is a block diagram of exemplary connections between an electric resource and a flow control server of the power aggregation system.

[0016] FIG. 4 is a diagram of an exemplary layout of the power aggregation system.

[0017] FIG. 5 is a diagram of exemplary control areas in the power aggregation system.

[0018] FIG. 6 is a diagram of multiple flow control centers in the power aggregation system and a directory server for determining a flow control center.

[0019] FIG. 7 is a block diagram of an exemplary flow control server.

[0020] FIG. 8A is a block diagram of an exemplary remote intelligent power flow module.

[0021] FIG. 8B is a block diagram of an exemplary transceiver and charging component combination.

[0022] FIG. 9 is a diagram of an exemplary resource communication protocol.

[0023] FIG. 10 is diagram of exemplary safety measures in a vehicle-to-home implementation of the power aggregation system.

[0024] FIG. 11 is a diagram of exemplary safety measures when multiple electric resources flow power to a home in the power aggregation system.

[0025] FIG. 12 is a block diagram of an exemplary smart disconnect of the power aggregation system.

[0026] FIG. 13 is a flow diagram of an exemplary method of power aggregation.

[0027] FIG. 14 is a flow diagram of an exemplary method of communicatively controlling an electric resource for power aggregation.

[0028] FIG. 15 is a flow diagram of an exemplary method of communication between a transceiver and charge component and charge control management by the charge component

[0029] FIG. 16 is a flow diagram of an exemplary method of estimating a state of charge.

[0030] FIG. 17 is a flow diagram of an exemplary method of controlling charging of load-only electric resources.

[0031] FIG. 18 is a flow diagram of an exemplary method for a resource communication protocol.

[0032] FIG. 19 is a flow diagram of an exemplary method of offline behavior for an electric resource.

[0033] FIG. 20 is a flow diagram of an exemplary method of calculating an efficiency metric for an electric resource.

[0034] FIG. 21 is a flow diagram of an exemplary method of smart islanding, including a safety mechanism.

[0035] FIG. 22 is a flow diagram of an exemplary method of extending a user interface for power aggregation.

[0036] FIG. 23 is an illustration of an exemplary simple user interface for facilitating user controlled charging.

DETAILED DESCRIPTION

Overview

[0037] Described herein is a power aggregation system for distributed electric resources, and associated methods. In one implementation, the exemplary system communicates over the Internet and/or some other public or private networks with numerous individual electric resources connected to a power grid (hereinafter, "grid"). By communicating, the exemplary system can dynamically aggregate these electric resources to provide power services to grid operators (e.g. utilities, Independent System Operators (ISO), etc).

[0038] "Power services" as used herein, refers to energy delivery as well as other ancillary services including demand response, regulation, spinning reserves, non-spinning reserves, energy imbalance, reactive power, and similar products.

[0039] "Aggregation" as used herein refers to the ability to control power flows into and out of a set of spatially distributed electric resources with the purpose of providing a power service of larger magnitude.

[0040] "Charge Control Management" as used herein refers to enabling or performing the starting, stopping, or level-setting of a flow of power between a power grid and an electric resource.

[0041] "Power grid operator" as used herein, refers to the entity that is responsible for maintaining the operation and stability of the power grid within or across an electric control area. The power grid operator may constitute some combination of manual/human action/intervention and automated processes controlling generation signals in response to system sensors. A "control area operator" is one example of a power grid operator.

[0042] "Control area" as used herein, refers to a contained portion of the electrical grid with defined input and output ports. The net flow of power into this area must equal (within some error tolerance) the sum of the power consumption within the area and power outflow from the area.

[0043] "Power grid" as used herein means a power distribution system/network that connects producers of power with consumers of power. The network may include generators, transformers, interconnects, switching stations, and safety equipment as part of either/both the transmission system (i.e., bulk power) or the distribution system (i.e. retail power). The exemplary power aggregation system is vertically scalable for use within a neighborhood, a city, a sector, a control area, or (for example) one of the eight large-scale Interconnects in

the North American Electric Reliability Council (NERC). Moreover, the exemplary system is horizontally scalable for use in providing power services to multiple grid areas simultaneously.

[0044] “Grid conditions” as used herein, refers to the need for more or less power flowing in or out of a section of the electric power grid, in response to one of a number of conditions, for example supply changes, demand changes, contingencies and failures, ramping events, etc. These grid conditions typically manifest themselves as power quality events such as under- or over-voltage events or under- or over-frequency events.

[0045] “Power quality events” as used herein typically refers to manifestations of power grid instability including voltage deviations and frequency deviations; additionally, power quality events as used herein also includes other disturbances in the quality of the power delivered by the power grid such as sub-cycle voltage spikes and harmonics.

[0046] “Electric resource” as used herein typically refers to electrical entities that can be commanded to do some or all of these three things: take power (act as load), provide power (act as power generation or source), and store energy. Examples may include battery/charger/inverter systems for electric or hybrid-electric vehicles, repositories of used-but-serviceable electric vehicle batteries, fixed energy storage, fuel cell generators, emergency generators, controllable loads, etc.

[0047] “Electric vehicle” is used broadly herein to refer to pure electric and hybrid electric vehicles, such as plug-in hybrid electric vehicles (PHEVs), especially vehicles that have significant storage battery capacity and that connect to the power grid for recharging the battery. More specifically, electric vehicle means a vehicle that gets some or all of its energy for motion and other purposes from the power grid. Moreover, an electric vehicle has an energy storage system, which may consist of batteries, capacitors, etc., or some combination thereof. An electric vehicle may or may not have the capability to provide power back to the electric grid.

[0048] Electric vehicle “energy storage systems” (batteries, supercapacitors, and/or other energy storage devices) are used herein as a representative example of electric resources intermittently or permanently connected to the grid that can have dynamic input and output of power. Such batteries can function as a power source or a power load. A collection of aggregated electric vehicle batteries can become a statistically stable resource across numerous batteries, despite recognizable tidal connection trends (e.g., an increase in the total number of vehicles connected to the grid at night; a downswing in the collective number of connected batteries as the morning commute begins, etc.) Across vast numbers of electric vehicle batteries, connection trends are predictable and such batteries become a stable and reliable resource to call upon, should the grid or a part of the grid (such as a person’s home in a blackout) experience a need for increased or decreased power. Data collection and storage also enable the power aggregation system to predict connection behavior on a per-user basis.

[0049] Exemplary System

[0050] FIG. 1 shows an exemplary power aggregation system 100. A flow control center 102 is communicatively coupled with a network, such as a public/private mix that includes the Internet 104, and includes one or more servers 106 providing a centralized power aggregation service. “Internet” 104 will be used herein as representative of many

different types of communicative networks and network mixtures (e.g., one or more wide area networks—public or private—and/or one or more local area networks). Via a network, such as the Internet 104, the flow control center 102 maintains communication 108 with operators of power grid (s), and communication 110 with remote resources, i.e., communication with peripheral electric resources 112 (“end” or “terminal” nodes/devices of a power network) that are connected to the power grid 114. In one implementation, powerline communicators (PLCs), such as those that include or consist of Ethernet-over-powerline bridges 120 are implemented at connection locations so that the “last mile” (in this case, last feet—e.g., in a residence 124) of Internet communication with remote resources is implemented over the same wire that connects each electric resource 112 to the power grid 114. Thus, each physical location of each electric resource 112 may be associated with a corresponding Ethernet-over-powerline bridge 120 (hereinafter, “bridge”) at or near the same location as the electric resource 112. Each bridge 120 is typically connected to an Internet access point of a location owner, as will be described in greater detail below. The communication medium from flow control center 102 to the connection location, such as residence 124, can take many forms, such as cable modem, DSL, satellite, fiber, WiMax, etc. In a variation, electric resources 112 may connect with the Internet by a different medium than the same power wire that connects them to the power grid 114. For example, a given electric resource 112 may have its own wireless capability to connect directly with the Internet 104 or an Internet access point and thereby with the flow control center 102.

[0051] Electric resources 112 of the exemplary power aggregation system 100 may include the batteries of electric vehicles connected to the power grid 114 at residences 124, parking lots 126 etc.; batteries in a repository 128, fuel cell generators, private dams, conventional power plants, and other resources that produce electricity and/or store electricity physically or electrically.

[0052] In one implementation, each participating electric resource 112 or group of local resources has a corresponding remote intelligent power flow (IPF) module 134 (hereinafter, “remote IPF module” 134). The centralized flow control center 102 administers the power aggregation system 100 by communicating with the remote IPF modules 134 distributed peripherally among the electric resources 112. The remote IPF modules 134 perform several different functions, including, but not limited to, providing the flow control center 102 with the statuses of remote resources; controlling the amount, direction, and timing of power being transferred into or out of a remote electric resource 112; providing metering of power being transferred into or out of a remote electric resource 112; providing safety measures during power transfer and changes of conditions in the power grid 114; logging activities; and providing self-contained control of power transfer and safety measures when communication with the flow control center 102 is interrupted. The remote IPF modules 134 will be described in greater detail below.

[0053] In another implementation, instead of having an IPF module 134, each electric resource 112 may have a corresponding transceiver (not shown) to communicate with a local charging component (not shown). The transceiver and charging component, in combination, may communicate with flow control center 102 to perform some or all of the above mentioned functions of IPF module 134. An exemplary trans-

ceiver and charging component are shown in FIG. 2B and are described in greater detail herein.

[0054] FIG. 2A shows another view of exemplary electrical and communicative connections to an electric resource 112. In this example, an electric vehicle 200 includes a battery bank 202 and an exemplary remote IPF module 134. The electric vehicle 200 may connect to a conventional wall receptacle (wall outlet) 204 of a residence 124, the wall receptacle 204 representing the peripheral edge of the power grid 114 connected via a residential powerline 206.

[0055] In one implementation, the power cord 208 between the electric vehicle 200 and the wall outlet 204 can be composed of only conventional wire and insulation for conducting alternating current (AC) power to and from the electric vehicle 200. In FIG. 2A, a location-specific connection locality module 210 performs the function of network access point—in this case, the Internet access point. A bridge 120 intervenes between the receptacle 204 and the network access point so that the power cord 208 can also carry network communications between the electric vehicle 200 and the receptacle 204. With such a bridge 120 and connection locality module 210 in place in a connection location, no other special wiring or physical medium is needed to communicate with the remote IPF module 134 of the electric vehicle 200 other than a conventional power cord 208 for providing residential line current at any conventional voltage. Upstream of the connection locality module 210, power and communication with the electric vehicle 200 are resolved into the powerline 206 and an Internet cable 104.

[0056] Alternatively, the power cord 208 may include safety features not found in conventional power and extension cords. For example, an electrical plug 212 of the power cord 208 may include electrical and/or mechanical safeguard components to prevent the remote IPF module 134 from electrifying or exposing the male conductors of the power cord 208 when the conductors are exposed to a human user.

[0057] In some embodiments, a radio frequency (RF) bridge (not shown) may assist the remote IPF module 134 in communicating with a foreign system, such as a utility smart meter (not shown) and/or a connection locality module 210. For example, the remote IPF module 134 may be equipped to communicate over power cord 208 or to engage in some form of RF communication, such as Zigbee or Bluetooth™, and the foreign system may be able to engage in a different form of RF communication. In such an implementation, the RF bridge may be equipped to communicate with both the foreign system and remote IPF module 134 and to translate communications from one to a form the other may understand, and to relay those messages. In various embodiments, the RF bridge may be integrated into the remote IPF module 134 or foreign system, or may be external to both. The communicative associations between the RF bridge and remote IPF module 134 and between the RF bridge and foreign system may be via wired or wireless communication.

[0058] FIG. 2B shows a further view of exemplary electrical and communicative connections to an electric resource 112. In this example, the electric vehicle 200 may include a transceiver 212 rather than a remote IPF module 134. The transceiver 212 may be communicatively coupled to a charging component 214 through a connection 216, and the charging component itself may be coupled to a conventional wall receptacle (wall outlet) 204 of a residence 124 and to electric vehicle 200 through a power cord 208. The other components

shown in FIG. 2B may have the couplings and functions discussed with regard to FIG. 2A.

[0059] In various embodiments, transceiver 212 and charging component 214 may, in combination, perform the same functions as the remote IPF module 134. Transceiver 212 may interface with computer systems of electric vehicle 200 and communicate with charging component 214, providing charging component 214 with information about electric vehicle 200, such as its vehicle identifier, a location identifier, and a state of charge. In response, transceiver 212 may receive requests and commands which transceiver 212 may relay to vehicle 200's computer systems.

[0060] Charging component 214, being coupled to both electric vehicle 200 and wall outlet 204, may effectuate charge control of the electric vehicle 200. If the electric vehicle 200 is not capable of charge control management, charging component 214 may directly manage the charging of electric vehicle 200 by stopping and starting a flow of power between the electric vehicle 200 and a power grid 114 in response to commands received from a flow control server 106. If, on the other hand, the electric vehicle 200 is capable of charge control management, charging component 214 may effectuate charge control by sending commands to the electric vehicle 200 through the transceiver 212.

[0061] In some embodiments, the transceiver 212 may be physically coupled to the electric vehicle 200 through a data port, such as an OBD-II connector. In other embodiments, other couplings may be used. The connection 216 between transceiver 212 and charging component 214 may be a wireless signal, such as a radio frequency (RF), such as a Zigbee, or Bluetooth™ signal. And charging component 214 may include a receiver socket to couple with power cord 208 and a plug to couple with wall outlet 204. In one embodiment, charging component 214 may be coupled to connection locality module 210 in either a wired or wireless fashion. For example, charging component 214 might have a data interface for communicating wirelessly with both the transceiver 212 and locality module 210. In such an embodiment, the bridge 120 may not be required.

[0062] Further details about the transceiver 212 and charging component 214 are illustrated by FIG. 8B and described in greater detail herein.

[0063] FIG. 3 shows another implementation of the connection locality module 210 of FIG. 2, in greater detail. In FIG. 3, an electric resource 112 has an associated remote IPF module 134, including a bridge 120. The power cord 208 connects the electric resource 112 to the power grid 114 and also to the connection locality module 210 in order to communicate with the flow control server 106.

[0064] The connection locality module 210 includes another instance of a bridge 120, connected to a network access point 302, which may include such components as a router, switch, and/or modem, to establish a hardwired or wireless connection with, in this case, the Internet 104. In one implementation, the power cord 208 between the two bridges 120 and 120' is replaced by a wireless Internet link, such as a wireless transceiver in the remote IPF module 134 and a wireless router in the connection locality module 210.

[0065] In other embodiments, a transceiver 212 and charging component 214 may be used instead of a remote IPF module 134. In such an embodiment, the charging component 214 may include or be coupled to a bridge 120, and the connection locality module 210 may also include a bridge 120', as shown. In yet other embodiments, not shown, charg-

ing component **214** and connection locality module **210** may communicate in a wired or wireless fashion, as mentioned previously, without bridges **120** and **120'**. The wired or wireless communication may utilize any sort of connection technology known in the art, such as Ethernet or RF communication, such as Zigbee, or Bluetooth™.

[0066] Exemplary System Layouts

[0067] FIG. 4 shows an exemplary layout **400** of the power aggregation system **100**. The flow control center **102** can be connected to many different entities, e.g., via the Internet **104**, for communicating and receiving information. The exemplary layout **400** includes electric resources **112**, such as plug-in electric vehicles **200**, physically connected to the grid within a single control area **402**. The electric resources **112** become an energy resource for grid operators **404** to utilize.

[0068] The exemplary layout **400** also includes end users **406** classified into electric resource owners **408** and electrical connection location owners **410**, who may or may not be one and the same. In fact, the stakeholders in an exemplary power aggregation system **100** include the system operator at the flow control center **102**, the grid operator **404**, the resource owner **408**, and the owner of the location **410** at which the electric resource **112** is connected to the power grid **114**.

[0069] Electrical connection location owners **410** can include:

[0070] Rental car lots—rental car companies often have a large portion of their fleet parked in the lot. They can purchase fleets of electric vehicles **200** and, participating in a power aggregation system **100**, generate revenue from idle fleet vehicles.

[0071] Public parking lots—parking lot owners can participate in the power aggregation system **100** to generate revenue from parked electric vehicles **200**. Vehicle owners can be offered free parking, or additional incentives, in exchange for providing power services.

[0072] Workplace parking—employers can participate in a power aggregation system **100** to generate revenue from parked employee electric vehicles **200**. Employees can be offered incentives in exchange for providing power services.

[0073] Residences—a home garage can merely be equipped with a connection locality module **210** to enable the homeowner to participate in the power aggregation system **100** and generate revenue from a parked car. Also, the vehicle battery **202** and associated power electronics within the vehicle can provide local power backup power during times of peak load or power outages.

[0074] Residential neighborhoods—neighborhoods can participate in a power aggregation system **100** and be equipped with power-delivery devices (deployed, for example, by homeowner cooperative groups) that generate revenue from parked electric vehicles **200**.

[0075] The grid operations **116** of FIG. 4 collectively include interactions with energy markets **412**, the interactions of grid operators **404**, and the interactions of automated grid controllers **118** that perform automatic physical control of the power grid **114**.

[0076] The flow control center **102** may also be coupled with information sources **414** for input of weather reports, events, price feeds, etc. Other data sources **414** include the system stakeholders, public databases, and historical system data, which may be used to optimize system performance and to satisfy constraints on the exemplary power aggregation

system **100**. Thus, an exemplary power aggregation system **100** may consist of components that:

[0077] communicate with the electric resources **112** to gather data and actuate charging/discharging of the electric resources **112**;

[0078] gather real-time energy prices;

[0079] gather real-time resource statistics;

[0080] predict behavior of electric resources **112** (connectedness, location, state (such as battery State-Of-Charge) at a given time of interest, such as a time of connect/disconnect);

[0081] predict behavior of the power grid **114**/load;

[0082] encrypt communications for privacy and data security;

[0083] actuate charging of electric vehicles **200** to optimize some figure(s) of merit;

[0084] offer guidelines or guarantees about load availability for various points in the future, etc.

[0085] These components can be running on a single computing resource (computer, etc.), or on a distributed set of resources (either physically co-located or not).

[0086] Exemplary power aggregation systems **100** in such a layout **400** can provide many benefits: for example, lower-cost ancillary services (i.e., power services), fine-grained (both temporal and spatial) control over resource scheduling, guaranteed reliability and service levels, increased service levels via intelligent resource scheduling, and/or firming of intermittent generation sources such as wind and solar power generation.

[0087] The exemplary power aggregation system **100** enables a grid operator **404** to control the aggregated electric resources **112** connected to the power grid **114**. An electric resource **112** can act as a power source, load, or storage, and the resource **112** may exhibit combinations of these properties. Control of a set of electric resources **112** is the ability to actuate power consumption, generation, or energy storage from an aggregate of these electric resources **112**.

[0088] FIG. 5 shows the role of multiple control areas **402** in the exemplary power aggregation system **100**. Each electric resource **112** can be connected to the power aggregation system **100** within a specific electrical control area. A single instance of the flow control center **102** can administer electric resources **112** from multiple distinct control areas **501** (e.g., control areas **502**, **504**, and **506**). In one implementation, this functionality is achieved by logically partitioning resources within the power aggregation system **100**. For example, when the control areas **402** include an arbitrary number of control areas, control area “A” **502**, control area “B” **504**, . . . , control area “n” **506**, then grid operations **116** can include corresponding control area operators **508**, **510**, . . . , and **512**. Further division into a control hierarchy that includes control division groupings above and below the illustrated control areas **402** allows the power aggregation system **100** to scale to power grids **114** of different magnitudes and/or to varying numbers of electric resources **112** connected with a power grid **114**.

[0089] FIG. 6 shows an exemplary layout **600** of an exemplary power aggregation system **100** that uses multiple centralized flow control centers **102** and **102'** and a directory server **602** for determining a flow control center. Each flow control center **102** and **102'** has its own respective end users **406** and **406'**. Control areas **402** to be administered by each specific instance of a flow control center **102** can be assigned dynamically. For example, a first flow control center **102** may

administer control area A **502** and control area B **504**, while a second flow control center **102'** administers control area n **506**. Likewise, corresponding control area operators (**508**, **510**, and **512**) are served by the same flow control center **102** that serves their respective different control areas.

[0090] In various embodiments, an electric resource may determine which flow control center **102/102'** administers its control area **502/504/506** by communicating with a directory server **602**. The address of the directory server **602** may be known to electric resource **112** or its associated IPF module **134** or charging component **214**. Upon plugging in, the electric resource **112** may communicate with the directory server **602**, providing the directory server **112** with a resource identifier and/or a location identifier. Based on this information, the directory server **602** may respond, identifying which flow control center **102/102'** to use.

[0091] In another embodiment, directory server **602** may be integrated with a flow control server **106** of a flow control center **102/102'**. In such an embodiment, the electric resource **112** may contact the server **106**. In response, the server **106** may either interact with the electric resource **112** itself or forward the connection to another flow control center **102/102'** responsible for the location identifier provided by the electric resource **112**.

[0092] In some embodiments, whether integrated with a flow control server **106** or not, directory server **602** may include a publicly accessible database for mapping locations to flow control centers **102/102'**.

[0093] Exemplary Flow Control Server

[0094] FIG. 7 shows an exemplary server **106** of the flow control center **102**. The illustrated implementation in FIG. 7 is only one example configuration, for descriptive purposes. Many other arrangements of the illustrated components or even different components constituting an exemplary server **106** of the flow control center **102** are possible within the scope of the subject matter. Such an exemplary server **106** and flow control center **102** can be executed in hardware, software, or combinations of hardware, software, firmware, etc.

[0095] The exemplary flow control server **106** includes a connection manager **702** to communicate with electric resources **112**, a prediction engine **704** that may include a learning engine **706** and a statistics engine **708**, a constraint optimizer **710**, and a grid interaction manager **712** to receive grid control signals **714**. Grid control signals **714** are sometimes referred to as generation control signals, such as automated generation control (AGC) signals. The flow control server **106** may further include a database/information warehouse **716**, a web server **718** to present a user interface to electric resource owners **408**, grid operators **404**, and electrical connection location owners **410**; a contract manager **720** to negotiate contract terms with energy markets **412**, and an information acquisition engine **414** to track weather, relevant news events, etc., and download information from public and private databases **722** for predicting behavior of large groups of the electric resources **112**, monitoring energy prices, negotiating contracts, etc.

[0096] Operation of an Exemplary Flow Control Server

[0097] The connection manager **702** maintains a communications channel with each electric resource **112** that is connected to the power aggregation system **100**. That is, the connection manager **702** allows each electric resource **112** to log on and communicate, e.g., using Internet Protocol (IP) if the network is the Internet **104**. In other words, the electric resources **112** call home. That is, in one implementation they

may initiate the connection with the server **106**. This facet enables the exemplary IPF modules **134** to work around problems with firewalls, IP addressing, reliability, etc.

[0098] For example, when an electric resource **112**, such as an electric vehicle **200** plugs in at home **124**, the IPF module **134** can connect to the home's router via the powerline connection. The router will assign the vehicle **200** an address (DHCP), and the vehicle **200** can connect to the server **106** (no holes in the firewall needed from this direction).

[0099] If the connection is terminated for any reason (including the server instance dies), then the IPF module **134** knows to call home again and connect to the next available server resource.

[0100] Also, when a connection is terminated, the connection manager may notify other components of flow control server **106** to adjust an available resources level tracked by the flow control server **106**. Further, if the connection remains terminated for a pre-determined length of time, the connection manager **702** or another component for flow control server **106** may notify an owner/user of the electric resource **112** via, for example, an email, phone call, or text message to alert him/her of the disconnect.

[0101] The grid interaction manager **712** receives and interprets signals from the interface of the automated grid controller **118** of a grid operator **404**. In one implementation, the grid interaction manager **712** also generates signals to send to automated grid controllers **118**. The scope of the signals to be sent depends on agreements or contracts between grid operators **404** and the exemplary power aggregation system **100**. In one scenario the grid interaction manager **712** sends information about the availability of aggregate electric resources **112** to receive power from the grid **114** or supply power to the grid **114**. In another variation, a contract may allow the grid interaction manager **712** to send control signals to the automated grid controller **118**—to control the grid **114**, subject to the built-in constraints of the automated grid controller **118** and subject to the scope of control allowed by the contract.

[0102] The database **716** can store all of the data relevant to the power aggregation system **100** including electric resource logs, e.g., for electric vehicles **200**, electrical connection information, per-vehicle energy metering data, historical usage patterns for future prediction, resource owner preferences, account information, etc.

[0103] The web server **718** provides a user interface to the system stakeholders, as described above. Such a user interface serves primarily as a mechanism for conveying information to the users, but in some cases, the user interface serves to acquire data, such as preferences, from the users. In one implementation, the web server **718** can also initiate contact with participating electric resource owners **408** to advertise offers for exchanging electrical power.

[0104] The bidding/contract manager **720** interacts with the grid operators **404** and their associated energy markets **412** to determine system availability, pricing, service levels, etc.

[0105] The information acquisition engine **414** communicates with public and private databases **722**, as mentioned above, to gather data that is relevant to the operation of the power aggregation system **100**.

[0106] The prediction engine **704** may use data from the data warehouse **716** to make predictions about electric resource behavior, such as when electric resources **112** will connect and disconnect, location-specific electric resource availability, electrical system load, real-time energy prices, etc. The predictions enable the power aggregation system **100**

to utilize more fully the electric resources **112** connected to the power grid **114**. The learning engine **706** may track, record, and process actual electric resource behavior, e.g., by learning behavior of a sample or cross-section of a large population of electric resources **112**. The statistics engine **708** may apply various probabilistic techniques to the resource behavior to note trends and make predictions.

[0107] In one implementation, the prediction engine **704** performs predictions via collaborative filtering. The prediction engine **704** can also perform per-user predictions of one or more parameters, including, for example, connect-time, connect duration, state-of-charge at connect time, and connection location. In order to perform per-user prediction, the prediction engine **704** may draw upon information, such as historical data, connect time (day of week, week of month, month of year, holidays, etc.), state-of-charge at connect, connection location, etc. In one implementation, a time series prediction can be computed via a recurrent neural network, a dynamic Bayesian network, or other directed graphical model.

[0108] In one scenario, for one user disconnected from the grid **114**, the prediction engine **704** can predict the time and/or duration of the next connection, the state-of-charge at connection time, the location of the connection (and may assign it a probability/likelihood). Once the resource **112** has connected, the time-of-connection, state-of-charge at-connection, and connection location become further inputs to refinements of the predictions of the connection duration. These predictions help to guide predictions of total system availability as well as to determine a more accurate cost function for resource allocation.

[0109] Building a parameterized prediction model for each unique user is not always scalable in time or space. Therefore, in one implementation, rather than use one model for each user in the system **100**, the prediction engine **704** builds a reduced set of models where each model in the reduced set is used to predict the behavior of many users. To decide how to group similar users for model creation and assignment, the system **100** can identify features of each user, such as number of unique connections/disconnections per day, typical connection time(s), average connection duration, average state-of-charge at connection time, etc., and can create clusters of users in either a full feature space or in some reduced feature space that is computed via a dimensionality reduction algorithm such as Principal Components Analysis, Random Projection, etc. Once the prediction engine **704** has assigned users to a cluster, the collective data from all of the users in that cluster is used to create a predictive model that will be used for the predictions of each user in the cluster. In one implementation, the cluster assignment procedure is varied to optimize the system **100** for speed (less clusters), for accuracy (more clusters), or some combination of the two.

[0110] Over time, individual users may change their behaviors and may be reassigned to new clusters that fit their behavior better.

[0111] The constraint optimizer **710** combines information from the prediction engine **704**, the data warehouse **716**, and the contract manager **720** to generate resource control signals that will satisfy the system constraints. For example, the constraint optimizer **710** can signal an electric vehicle **200** to charge its battery bank **202** at a certain charging rate and later to discharge the battery bank **202** for uploading power to the power grid **114** at a certain upload rate: the power transfer rates and the timing schedules of the power transfers opti-

mized to fit the tracked individual connect and disconnect behavior of the particular electric vehicle **200** and also optimized to fit a daily power supply and demand “breathing cycle” of the power grid **114**.

[0112] In one implementation, the constraint optimizer **710** plays a key role in converting generation control signals **714** into vehicle control signals, mediated by the connection manager **702**. Mapping generation control signals **714** from a grid operator **404** into control signals that are sent to each unique electrical resource **112** in the system **100** is an example of a specific constraint optimization problem.

[0113] Each resource **112** has associated constraints, either hard or soft. Examples of resource constraints may include: price sensitivity of the owner, vehicle state-of-charge (e.g., if the vehicle **200** is fully charged, it cannot participate in loading the grid **114**), predicted amount of time until the resource **112** disconnects from the system **100**, owner sensitivity to revenue versus state-of-charge, electrical limits of the resource **114**, manual charging overrides by resource owners **408**, etc. The constraints on a particular resource **112** can be used to assign a cost for activating each of the resource’s particular actions. For example, a resource whose storage system **202** has little energy stored in it will have a low cost associated with the charging operation, but a very high cost for the generation operation. A fully charged resource **112** that is predicted to be available for ten hours will have a lower cost generation operation than a fully charged resource **112** that is predicted to be disconnected within the next 15 minutes, representing the negative consequence of delivering a less-than-full resource to its owner.

[0114] The following is one example scenario of converting one generating signal **714** that comprises a system operating level (e.g. -10 megawatts to $+10$ megawatts, where $+$ represents load, $-$ represents generation) to a vehicle control signal. It is worth noting that because the system **100** can meter the actual power flows in each resource **112**, the actual system operating level is known at all times.

[0115] In this example, assume the initial system operating level is 0 megawatts, no resources are active (taking or delivering power from the grid), and the negotiated aggregation service contract level for the next hour is ± 5 megawatts.

[0116] In this implementation, the exemplary power aggregation system **100** maintains three lists of available resources **112**. The first list contains resources **112** that can be activated for charging (load) in priority order. There is a second list of the resources **112** ordered by priority for discharging (generation). Each of the resources **112** in these lists (e.g., all resources **112** can have a position in both lists) have an associated cost. The priority order of the lists is directly related to the cost (i.e., the lists are sorted from lowest cost to highest cost). Assigning cost values to each resource **112** is important because it enables the comparison of two operations that achieve similar results with respect to system operation. For example, adding one unit of charging (load, taking power from the grid) to the system is equivalent to removing one unit of generation. To perform any operation that increases or decreases the system output, there may be multiple action choices and in one implementation the system **100** selects the lowest cost operation. The third list of resources **112** contains resources with hard constraints. For example, resources whose owner’s **408** have overridden the system **100** to force charging will be placed on the third list of static resources.

[0117] At time “1,” the grid-operator-requested operating level changes to $+2$ megawatts. The system activates charging

the first ‘n’ resources from the list, where ‘n’ is the number of resources whose additive load is predicted to equal 2 megawatts. After the resources are activated, the results of the activations are monitored to determine the actual result of the action. If more than 2 megawatts of load is active, the system will disable charging in reverse priority order to maintain system operation within the error tolerance specified by the contract.

[0118] From time “1” until time “2,” the requested operating level remains constant at 2 megawatts. However, the behavior of some of the electrical resources may not be static. For example, some vehicles **200** that are part of the 2 megawatts system operation may become full (state-of-charge=100%) or may disconnect from the system **100**. Other vehicles **200** may connect to the system **100** and demand immediate charging. All of these actions will cause a change in the operating level of the power aggregation system **100**. Therefore, the system **100** continuously monitors the system operating level and activates or deactivates resources **112** to maintain the operating level within the error tolerance specified by the contract.

[0119] At time “2,” the grid-operator-requested operating level decreases to –1 megawatts. The system consults the lists of available resources and chooses the lowest cost set of resources to achieve a system operating level of –1 megawatts. Specifically, the system moves sequentially through the priority lists, comparing the cost of enabling generation versus disabling charging, and activating the lowest cost resource at each time step. Once the operating level reaches –1 megawatts, the system **100** continues to monitor the actual operating level, looking for deviations that would require the activation of an additional resource **112** to maintain the operating level within the error tolerance specified by the contract.

[0120] In one implementation, an exemplary costing mechanism is fed information on the real-time grid generation mix to determine the marginal consequences of charging or generation (vehicle **200** to grid **114**) on a “carbon footprint,” the impact on fossil fuel resources and the environment in general. The exemplary system **100** also enables optimizing for any cost metric, or a weighted combination of several. The system **100** can optimize figures of merit that may include, for example, a combination of maximizing economic value and minimizing environmental impact, etc.

[0121] In one implementation, the system **100** also uses cost as a temporal variable. For example, if the system **100** schedules a discharged pack to charge during an upcoming time window, the system **100** can predict its look-ahead cost profile as it charges, allowing the system **100** to further optimize, adaptively. That is, in some circumstances the system **100** knows that it will have a high-capacity generation resource by a certain future time.

[0122] Multiple components of the flow control server **106** constitute a scheduling system that has multiple functions and components:

[0123] data collection (gathers real-time data and stores historical data);

[0124] projections via the prediction engine **704**, which inputs real-time data, historical data, etc.; and outputs resource availability forecasts;

[0125] optimizations built on resource availability forecasts, constraints, such as command signals from grid operators **404**, user preferences, weather conditions, etc. The optimizations can take the form of resource control plans that optimize a desired metric.

[0126] The scheduling function can enable a number of useful energy services, including:

[0127] ancillary services, such as rapid response services and fast regulation;

[0128] energy to compensate for sudden, foreseeable, or unexpected grid imbalances;

[0129] response to routine and unstable demands;

[0130] firming of renewable energy sources (e.g. complementing wind-generated power).

[0131] Exemplary Remote IPF Module

[0132] FIG. 8A shows the remote IPF module **134** of FIGS. 1 and 2 in greater detail. The illustrated remote IPF module **134** is only one example configuration, for descriptive purposes. Many other arrangements of the illustrated components or even different components constituting an exemplary remote IPF module **134** are possible within the scope of the subject matter. Such an exemplary remote IPF module **134** has some hardware components and some components that can be executed in hardware, software, or combinations of hardware, software, firmware, etc. In other embodiments, executable instructions configured to perform some or all of the operations of remote IPF module **134** may be added to hardware of an electric resource **112** such as an electric vehicle that, when combined with the executable instructions, provides equivalent functionality to remote IPF module **134**. References to remote IPF module **134** as used herein include such executable instructions.

[0133] The illustrated example of a remote IPF module **134** is represented by an implementation suited for an electric vehicle **200**. Thus, some vehicle systems **800** are included as part of the exemplary remote IPF module **134** for the sake of description. However, in other implementations, the remote IPF module **134** may exclude some or all of the vehicle systems **800** from being counted as components of the remote IPF module **134**.

[0134] The depicted vehicle systems **800** include a vehicle computer and data interface **802**, an energy storage system, such as a battery bank **202**, and an inverter/charger **804**. Besides vehicle systems **800**, the remote IPF module **134** also includes a communicative power flow controller **806**. The communicative power flow controller **806** in turn includes some components that interface with AC power from the grid **114**, such as a powerline communicator, for example an Ethernet-over-powerline bridge **120**, and a current or current/voltage (power) sensor **808**, such as a current sensing transformer.

[0135] The communicative power flow controller **806** also includes Ethernet and information processing components, such as a processor **810** or microcontroller and an associated Ethernet media access control (MAC) address **812**; volatile random access memory **814**, nonvolatile memory **816** or data storage, an interface such as an RS-232 interface **818** or a CANbus interface **820**; an Ethernet physical layer interface **822**, which enables wiring and signaling according to Ethernet standards for the physical layer through means of network access at the MAC/Data Link Layer and a common addressing format. The Ethernet physical layer interface **822** provides electrical, mechanical, and procedural interface to the transmission medium—i.e., in one implementation, using the Ethernet-over-powerline bridge **120**. In a variation, wireless or other communication channels with the Internet **104** are used in place of the Ethernet-over-powerline bridge **120**.

[0136] The communicative power flow controller **806** also includes a bidirectional power flow meter **824** that tracks

power transfer to and from each electric resource **112**, in this case the battery bank **202** of an electric vehicle **200**.

[0137] The communicative power flow controller **806** operates either within, or connected to an electric vehicle **200** or other electric resource **112** to enable the aggregation of electric resources **112** introduced above (e.g., via a wired or wireless communication interface). These above-listed components may vary among different implementations of the communicative power flow controller **806**, but implementations typically include:

- [0138] an intra-vehicle communications mechanism that enables communication with other vehicle components;
- [0139] a mechanism to communicate with the flow control center **102**;
- [0140] a processing element;
- [0141] a data storage element;
- [0142] a power meter; and
- [0143] optionally, a user interface.

[0144] Implementations of the communicative power flow controller **806** can enable functionality including:

- [0145] executing pre-programmed or learned behaviors when the electric resource **112** is offline (not connected to Internet **104**, or service is unavailable);
- [0146] storing locally-cached behavior profiles for “roaming” connectivity (what to do when charging on a foreign system, i.e., when charging in the same utility territory on a foreign meter or in a separate utility territory, or in disconnected operation, i.e., when there is no network connectivity);
- [0147] allowing the user to override current system behavior; and
- [0148] metering power-flow information and caching meter data during offline operation for later transaction.

[0149] Thus, the communicative power flow controller **806** includes a central processor **810**, interfaces **818** and **820** for communication within the electric vehicle **200**, a powerline communicator, such as an Ethernet-over-powerline bridge **120** for communication external to the electric vehicle **200**, and a power flow meter **824** for measuring energy flow to and from the electric vehicle **200** via a connected AC powerline **208**.

[0150] Operation of the Exemplary Remote IPF Module

[0151] Continuing with electric vehicles **200** as representative of electric resources **112**, during periods when such an electric vehicle **200** is parked and connected to the grid **114**, the remote IPF module **134** initiates a connection to the flow control server **106**, registers itself, and waits for signals from the flow control server **106** that direct the remote IPF module **134** to adjust the flow of power into or out of the electric vehicle **200**. These signals are communicated to the vehicle computer **802** via the data interface, which may be any suitable interface including the RS-232 interface **818** or the CANbus interface **820**. The vehicle computer **802**, following the signals received from the flow control server **106**, controls the inverter/charger **804** to charge the vehicle’s battery bank **202** or to discharge the battery bank **202** in upload to the grid **114**.

[0152] Periodically, the remote IPF module **134** transmits information regarding energy flows to the flow control server **106**. If, when the electric vehicle **200** is connected to the grid **114**, there is no communications path to the flow control server **106** (i.e., the location is not equipped properly, or there is a network failure), the electric vehicle **200** can follow a preprogrammed or learned behavior of off-line operation,

e.g., stored as a set of instructions in the nonvolatile memory **816**. For example, the instructions may enable a standard charging mode (i.e., charging without charge control management), charging when time-of-use rates are low (in which case remote IPF module **134** may store a listing of such times), and/or charging based on preferences set up by a user of the vehicle. Also, energy transactions can also be cached in nonvolatile memory **816** for later transmission to the flow control server **106**.

[0153] During periods when the electric vehicle **200** is in operation as transportation, the remote IPF module **134** listens passively, logging select vehicle operation data for later analysis and consumption. The remote IPF module **134** can transmit this data to the flow control server **106** when a communications channel becomes available.

[0154] Exemplary Power Flow Meter

[0155] Power is the rate of energy consumption per interval of time. Power indicates the quantity of energy transferred during a certain period of time, thus the units of power are quantities of energy per unit of time. The exemplary power flow meter **824** measures power for a given electric resource **112** across a bi-directional flow—e.g., power from grid **114** to electric vehicle **200** or from electric vehicle **200** to the grid **114**. In one implementation, the remote IPF module **134** can locally cache readings from the power flow meter **824** to ensure accurate transactions with the central flow control server **106**, even if the connection to the server is down temporarily, or if the server itself is unavailable.

[0156] Mobile Resource Locator

[0157] The exemplary power aggregation system **100** also includes various techniques for determining the electrical network location of a mobile electric resource **112**, such as a plug-in electric vehicle **200**. Electric vehicles **200** can connect to the grid **114** in numerous locations and accurate control and transaction of energy exchange can be enabled by specific knowledge of the charging location. Some of the exemplary techniques for determining electric vehicle charging locations include:

[0158] querying a unique identifier for the location (via wired, wireless, etc.), which can be:

[0159] the unique ID of the network hardware at the charging site;

[0160] the unique ID of the locally installed smart meter, by communicating with the meter;

[0161] a unique ID installed specifically for this purpose at a site; and

[0162] using GPS or other signal sources (cell, WiMAX, etc.) to establish a “soft” (estimated geographic) location, which is then refined based on user preferences and historical data (e.g., vehicles tend to be plugged-in at the owner’s residence **124**, not a neighbor’s residence).

Exemplary Transceiver and Charging Component

[0163] FIG. 8B shows the transceiver **212** and charging component **214** of FIG. 2B in greater detail. The illustrated transceiver **212** and charging component **214** is only one example configuration, for descriptive purposes. Many other arrangements of the illustrated components or even different components constituting the transceiver **212** and charging component **214** are possible within the scope of the subject matter. Such a transceiver **212** and charging component **214** have some hardware components and some components that can be executed in hardware, software, or combinations of hardware, software, firmware, etc.

[0164] The illustrated example of the transceiver 212 and charging component 214 is represented by an implementation suited for an electric vehicle 200. Thus, some vehicle systems 800 are illustrated to provide context to the transceiver 212 and charging component 214 components.

[0165] The depicted vehicle systems 800 include a vehicle computer and data interface 802, an energy storage system, such as a battery bank 202, and an inverter/charger 804. In some embodiments, vehicle systems 800 may include a data port, such as an OBD-II port, that is capable of physically coupling with the transceiver 212. The transceiver 212 may then communicate with the vehicle computer and data interface 802 through the data port, receiving information from electric resource 112 comprised by vehicle systems 800 and, in some embodiments, providing commands to the vehicle computer and data interface 802. In one implementation, the vehicle computer and data interface 802 may be capable of charge control management. In such an embodiment, the vehicle computer and data interface 802 may perform some or all of the charging component 214 operations discussed below. In other embodiments, executable instructions configured to perform some or all of the operations of the vehicle computer and data interface 802 may be added to hardware of an electric resource 112 such as an electric vehicle that, when combined with the executable instructions, provides equivalent functionality to the vehicle computer and data interface 802. References to the vehicle computer and data interface 802 as used herein include such executable instructions.

[0166] In various embodiments, the transceiver 212 may have a physical form that is capable of coupling to a data port of vehicle systems 800. Such a transceiver 212 may also include a plurality of interfaces, such as an RS-232 interface 818 and/or a CANBus interface 820. In various embodiments, the RS-232 interface 818 or CANBus interface 820 may enable the transceiver 212 to communicate with the vehicle computer and data interface 802 through the data port. Also, the transceiver may be or comprise an additional interface (not shown) capable of engaging in wireless communication with a data interface 820 of the charging component 214. The wireless communication may be of any form known in the art, such as radio frequency (RF) communication (e.g., Zigbee, and/or Bluetooth™ communication). In other embodiments, the transceiver may comprise a separate conductor or may be configured to utilize a powerline 208 to communicate with charging component 214. In yet other embodiments, not shown, transceiver 212 may simply be a radio frequency identification (RFID) tag capable of storing minimal information about the electric resource 112, such as a resource identifier, and of being read by a corresponding RFID reader of charging component 214. In such other embodiments, the RFID tag might not couple with a data port or communicate with the vehicle computer and data interface 802.

[0167] As shown, the charging component 214 may be an intelligent plug device that is physically connected to a charging medium, such as a powerline 208 (the charging medium coupling the charging component 214 to the electric resource 112) and an outlet of a power grid (such as the wall outlet 204 shown in FIG. 2B). In other embodiments charging component 214 may be a charging station or some other external control. In some embodiments, the charging component 214 may be portable.

[0168] In various embodiments, the charging component 214 may include components that interface with AC power from the grid 114, such as a powerline communicator, for

example an Ethernet-over-powerline bridge 120, and a current or current/voltage (power) sensor 808, such as a current sensing transformer.

[0169] In other embodiments, the charging component 214 may include a further Ethernet plug or wireless interface in place of bridge 120. In such an embodiment, data-over-powerline communication is not necessary, eliminating the need for a bridge 120. The Ethernet plug or wireless interface may communicate with a local access point, and through that access point to flow control server 106.

[0170] The charging component 214 may also include Ethernet and information processing components, such as a processor 810 or microcontroller and an associated Ethernet media access control (MAC) address 812; volatile random access memory 814, nonvolatile memory 816 or data storage, a data interface 826 for communicating with the transceiver 212, and an Ethernet physical layer interface 822, which enables wiring and signaling according to Ethernet standards for the physical layer through means of network access at the MAC/Data Link Layer and a common addressing format. The Ethernet physical layer interface 822 provides electrical, mechanical, and procedural interface to the transmission medium—i.e., in one implementation, using the Ethernet-over-powerline bridge 120. In a variation, wireless or other communication channels with the Internet 104 are used in place of the Ethernet-over-powerline bridge 120.

[0171] The charging component 214 may also include a bi-directional power flow meter 824 that tracks power transfer to and from each electric resource 112, in this case the battery bank 202 of an electric vehicle 200.

[0172] Further, in some embodiments, the charging component 214 may comprise an RFID reader to read the electric resource information from transceiver 212 when transceiver 212 is an RFID tag.

[0173] Also, in various embodiments, the charging component 214 may include a credit card reader to enable a user to identify the electric resource 112 by providing credit card information. In such an embodiment, a transceiver 212 may not be necessary.

[0174] Additionally, in one embodiment, the charging component 214 may include a user interface, such as one of the user interfaces described in greater detail below.

[0175] Implementations of the charging component 214 can enable functionality including:

[0176] executing pre-programmed or learned behaviors when the electric resource 112 is offline (not connected to Internet 104, or service is unavailable);

[0177] storing locally-cached behavior profiles for “roaming” connectivity (what to do when charging on a foreign system or in disconnected operation, i.e., when there is no network connectivity);

[0178] allowing the user to override current system behavior; and

[0179] metering power-flow information and caching meter data during offline operation for later transaction.

[0180] Operation of the Exemplary Transceiver and Charging Component

[0181] In various embodiments, a transceiver such as the transceiver 212 shown in FIG. 8B may obtain information about an electric resource through, for example, the data port described above. In some embodiments, the transceiver 212 may obtain the information when the electric resource 212 is plugged in, started, and/or operated. The transceiver 212 may then periodically obtain the information at various or pre-

determined points of time thereafter. In some embodiments, the information may include at least one of an electric resource identifier, a state of charge of the electric resource, and/or a time since a last charge.

[0182] Upon obtaining the information or at a later time, the transceiver 212 may provide the information to the charging component 214 through, for example, the communicative coupling described above. In some embodiments, where the transceiver 212 may provide information to any of a number of geographically dispersed charging components 214, transceiver 212 may provide the information to the charging component 214 to which the electric resource 112 is coupled or to the charging component 214 that has the strongest communication signal. In other embodiments, the transceiver 212 may be specifically coupled to a single charging component 214 and may only provide information to that specific component 214. In any embodiments, the transceiver 212 and charging component 214 may utilize a form of encryption, such as key-based encryption, to communicate.

[0183] In some embodiments, where the electric resource 112 is capable of charge control management, the transceiver may receive one or more charge control commands from the charging component 214 and may provide the commands to the vehicle computer and data interface 802 to enable the electric resource to perform charge control management, such as starting or stopping a flow of power between the electric resource 112 and the grid 114.

[0184] In various embodiments, the charging component 214 may receive information about an electric resource 112 to which the charging component 214 is coupled via a charging medium. In some embodiments, the information may be received by the transceiver 212, as discussed above. In other embodiment, the information may be obtained in any number of other ways. For example, the information may be obtained from a user directly entering the information through, for instance, a user interface, from a credit card reader if a user swipes a credit card through the reader, or from an RFID reader if the electric resource 112 has an RFID tag. If a credit card reader is used, the information obtained from the user may be sent to a flow control server 106, or some other server, to obtain information about the electric resource 112 that is linked with the credit card information by, for example, a common owner/user.

[0185] Upon receiving information about an electric resource 112, the charging component 214 may, for example, provide the information to a flow control server 106 and receive, in response, one or more commands to cause the charging component 214 to effectuate charge control management. In some embodiments, in addition to providing the received information, charging component 214 may provide other information, such as an identification of who owns the meter account, what tariff the account is on, if resource 112 to grid 114 power flows are supported, a power rating of the charging connection, type description of the electric resource 112 (such as a make/model), and/or a description of the energy storage system 202 (e.g., battery size, power rating, etc.). In other embodiments, charging component 214 may possess instructions enabling it to effectuate charge control management itself, without communicating with a flow control server 106. In various embodiments, the charging component 214 may effectuate charge control management by starting or stopping a flow of power between the electric resource 112 and grid 114 or by providing the commands to electric resource 112 through transceiver 212. The charging

component 214 may provide the commands if, for example, the electric resource 112 is capable of performing charge control management itself. In some embodiments, the information provided by transceiver 212 may include an indication of whether the electric resource 112 is capable of charge control management.

[0186] In various embodiments, when state of charge information about an electric resource 112 is unavailable, the charging component 214 may estimate the state of charge. For example, the charging component 214 may determine that the electric resource 112 is at or near full charge when a current flow of power to the electric resource 112 begins to slow or taper off. In other embodiments, the charging component 214 may estimate the state of charge by tracking how long it has been since the electric resource 112 was last charged. In yet other embodiments, other estimating techniques may be used.

[0187] If, when the electric resource 112 is connected to the grid 114, there is no communications path to the flow control server 106 (i.e., the location is not equipped properly, or there is a network failure), the charging component 214 can follow a preprogrammed or learned behavior of off-line operation, e.g., stored as a set of instructions in the nonvolatile memory 816. For example, the instructions may enable a standard charging mode (i.e., charging without charge control management), charging when time-of-use rates are low (in which case the charging component 214 may store a listing of such times), and/or charging based on preferences set up by a user of the vehicle. Also, energy transactions can also be cached in nonvolatile memory 816 for later transmission to the flow control server 106.

[0188] In some embodiments, power flow meter 824 may perform as described above with regard to FIG. 2A, and charging component 214 may determine a charging location in the same manner described above for the remote IPF module 134.

Exemplary Transaction Methods

[0189] The exemplary power aggregation system 100 supports the following functions and interactions:

[0190] Setup. The power aggregation system 100 creates contracts outside the system and/or bids into open markets to procure contracts for power services via the web server 718 and contract manager 720. The system 100 then resolves these requests into specific power requirements upon dispatch from the grid operator 404, and communicates these requirements to vehicle owners 408 by one of several communication techniques.

[0191] Delivery. The grid interaction manager 712 accepts real-time grid control signals 714 from grid operators 404 through a power-delivery device, and responds to these signals 714 by delivering power services from connected electric vehicles 200 to the grid 114.

[0192] Reporting. After a power delivery event is complete, a transaction manager can report power services transactions stored in the database 716. A billing manager resolves these requests into specific credit or debit billing transactions. These transactions may be communicated to a grid operator's or utility's billing system for account reconciliation. The transactions may also be used to make payments directly to resource owners 408.

[0193] Matching Load to Generation. It is possible to match energy generation and load by either increasing/decreasing generation to match the load, or by increasing/decreasing the load to match the generation. Electric resources 112, such as

electric vehicles, may present a large, flexible load to the grid **114** when they are charging. The load may be flexible because there may be little penalty for interrupting the charging of a resource **112**, the charging interruption can be executed almost instantaneously, and because the resources **112** are typically plugged in for much more time than it takes to charge them. To utilize the possibility of a flexible load, flow control servers **106** may control the charging behavior of a plurality of electric resources **112**. By increasing the number of electric resources **112** that are charging, the flow control servers **106** can increase the amount of load on the system, and by decreasing the number of electric resources **112** that are charging, the flow control servers **106** can decrease the amount of load on the system.

[0194] Up or Down Regulation on Load-Only Resources. In various embodiments, power aggregation system **100** may aggregate the electric power capacity of one or more distributed, electric load and storage resources, such as electric vehicles, into an amount sufficient to supply ancillary services, such as system regulation or spinning reserves, to a power grid **114** operator. Such a service can be supplied based upon electric resources **112** that are capable of bi-directional power flows, or based even solely upon load-only electric resources **112** (i.e., resources that are only capable of consuming and/or storing power, not providing it).

[0195] In various embodiments, a flow control center **102** may fulfill a capacity call from a grid operator based on a current load set-point of one or more electric resources **112** and on upper and lower rails of the one or more electric resources. The upper rail may be a maximum amount of charge the one or more electric resources **112** can consume. This amount may be the maximum capacity of the electric resources **112** or some lower value based on cost, environmental, and/or user-preference considerations. The lower rail—for load-only resources—may be a minimum amount that the electric resources may consume. This minimum amount may be a minimum capacity—such as consuming no power at all—or some higher value based on cost, environmental, and/or user-preference considerations.

[0196] For example, if a group of ten resources **112** are each consuming 5 kW (i.e., 50 kW total), and each has a maximum capacity of 10 kW and a minimum capacity of 0 kW, the flow control center **102** may answer capacity calls for up-regulation by bidding to take up to 50 kW less or capacity calls for down-regulation by bidding to take up to 50 kW more. The amount bid (i.e., answer to capacity call) may be determined by a variety of cost, environmental, and/or user preference factors, in some embodiments.

[0197] If the flow control center **102** bids to take 30 kW less, then the flow control center **102** may reduce the charge taken by each of the ten electric resources **112** by 3 kW, or may stop six of the electric resources **112** from charging altogether. In other embodiments, other combinations of reducing the power taken and/or stopping charging may be utilized based on cost, environmental, and/or user-preference factors.

[0198] If the flow control center **102** bids to take 30 kW more, then the flow control center **102** may increase the charge taken by each of the ten electric resources **112** by 3 kW, or may increase the power consumed by six of the electric resources **112** to their maximum capacity. In other embodiments, other combinations of increasing the power taken by some or all of the electric resources **112** may be utilized based on cost, environmental, and/or user-preference factors.

[0199] In yet another example, all electric resources **112** may be offered to the grid operator as regulation-down capacity, charged to the greatest degree possible by satisfying grid operator capacity calls, and then incrementally charged only to the minimum degree necessary using normally purchased electricity.

[0200] Charge Control Management Based on Price Fluctuations. In some embodiments, utilities such as grid **114** may offer tariffs where the energy prices vary over time, such as time of use (TOU), critical peak pricing (CPP), and real time pricing (RTP). Flow control servers **106** may learn of this information from the utilities during negotiations for buying or selling power (described above) or at a later time or times. Based on the information, the flow control servers **106** may automatically control when the electric resources **112** recharge to ensure that the resources **112** are charging when it is cheaper to do so. Besides the rate structure and prices obtained from the utility, the flow control servers **106** may also take into account the type of the electric resource **112**, its state of charge, as well as user needs/preferences (i.e., when the user will need to use the resource **112** again, how tolerant the user is of the resource **112** not being fully charged, etc.). This additional information can be provided by the user or estimated based on historical data associated with resource **112** or with resources **112** of other similar users.

[0201] Green Charging. In various embodiments, the power aggregation system **100** may offer users of electric resources **112** metrics of the amount of clean energy used and mechanisms for charging only with clean energy.

[0202] The power aggregation system **100** can meter the amount of net energy put into an electric resource **112**, such as an electric vehicle **200**, from the grid **114** and then offer the resource owner the option of “greening” that power, meaning using clean, renewable energy. In one embodiment, this could be accomplished by buying RECs (renewable energy credits) to match the amount of energy used.

[0203] While there are services, such as websites, where users can self report their energy usage, there is often no way to know how much electrical energy has been used with Plug-in Hybrid Electric Vehicles (PHEVs) **200** and Electric Vehicles (EVs) **200**. This may be particularly hard with PHEVs **200** because of the mixed energy source approach (e.g., fuel plus electricity). By metering exactly the power into the electric resource **112**, including in scenarios where the resource **112** may recharge at any number of different locations, potentially from different utility accounts, the power aggregation system **100** can give the user a guarantee that he or she is using only clean electricity. In some embodiments, this may be accomplished by associating a resource identifier with a clean charging setting. When the resource identifier is presented to the flow control server **106**, the server **106** may, for example only charge if clean energy is available. Or if energy may be obtained from different sources (e.g., coal, wind) associated with different prices, flow control server **106** may elect to use the clean energy (subject perhaps to additional prices constraints provided by the user, etc.).

[0204] In some embodiments, the power aggregation system **100** may enable electric resources **112** to charge only when they are being used to firm renewable resources such as wind generation. Also, in another implementation, the power aggregation system **100** may enable resources **112** to charge only when the grid-mix is more environmentally friendly. In such an implementation, the flow control servers **106** may

create grid-mix predictions and use those predictions to charge the resources **112** in a more environmentally aware manner.

[0205] Efficiency Metrics. In various embodiments, the power aggregation system may provide users of electric resources **112**, such as electric vehicles **200**, with various efficiency metrics. In some embodiments, one or more of the efficiency metrics may be used as a replacement for or supplement to the miles per gallon metric typically used for cars. Since that metric divides total miles driven by fuel used, it may be misleading for PHEVs, which run off both fuel and electricity. In various embodiments, metrics determined by the power aggregation system **100** might include an energy/distance metric (measured, for example, in Joules per mile), a cost/distance metric (measured, for example, in dollars spent of energy per mile), and/or a CO₂-equivalent greenhouse gas emissions/distance metric.

[0206] In some embodiments, efficiency metrics may be calculated by a remote IPF module **134** or a charging component **214**, or calculated by a flow control server **106** and provided to the remote IPF module **134** or charging component **214**. To calculate the efficiency metrics, a number of other metrics may be obtained. For example, a distance driven may be obtained from an electric vehicle's odometer. Energy metrics may be obtained from a power flow meter **824** and/or from a vehicle **200** gas gauge or fuel flow meter. Cost metrics may be obtained directly from a self reporting user, from electric bill data tracked by the remote IPF module **134**, charging component **214**, or flow control server **106**, from credit card data, and/or from average user price information. CO₂ metrics may be obtained from a self-reporting user, from grid **114** mix data, from RECs, from power flow meters **824**, and/or from CO₂ use averages. Once the efficiency metrics are calculated, they may be displayed to a user in the vehicle **200**, on a remote IPF module **134** or charging component **214**, via the website of a flow control center **102**, and/or via other data access means. In some embodiments, this may involve generating a graph or some other chart.

[0207] In some embodiments, to achieve accurate measurements for the efficiency metrics, features may be added to vehicles **200**. For example, vehicles **200** may include lifetime and trip counters for gallons of fuel used and lifetime and trip counters for kWh of electricity used, captured by power flow meter **824** (accounting for regenerative braking, the fuel engine recharging batteries, etc.—the power aggregation system **100** may need to meter various battery inputs and outputs and do some accounting).

[0208] In various embodiments, if a charging component **214** is used, the component **214** or flow control server **106** could back-calculate the amount of fuel used given a user's self-reported miles driven per year. From this, with gas and electricity cost and CO₂ info for the user's area (average), the charging component **214** or flow control server **106** could calculate efficiency metrics. In other embodiments, rather than requiring self-reporting, the charging component **214** or flow control server **106** could utilize a user's electric bill, local rate structure, grid mix, and/or greening preferences.

[0209] Low Carbon Fuel Standard (LCFS) Tracking. In some embodiments, the power aggregation system **100** may utilize the CO₂ efficiency metrics described above to determine whether low carbon fuel standards are being met. Various governmental entities may increasingly impose such standards on users and vehicle **200** manufactures. By calculating CO₂ efficiency metrics for individual users, system **100**

might also collectivize the metrics based on a vehicle **200** type, such as a make and/or model, and report the metrics to governmental entities, electric utilities, vehicle owners/drivers, and/or manufacturers.

Exemplary User Interfaces (UI)

[0210] Charging Station UI. An electrical charging station, whether free or for pay, can be installed with a user interface that presents useful information to the user. Specifically, by collecting information about the grid **114**, the electric resource state, and the preferences of the user, the station can present information such as the current electricity price, the estimated recharge cost, the estimated time until recharge, the estimated payment for uploading power to the grid **114** (either total or per hour), etc. The information acquisition engine **414** communicates with the electric resource **112** and with public and/or private data networks **722** to acquire the data used in calculating this information.

[0211] The types of information gathered from the electric resource **112** could include an electric resource identifier (resource ID) and state information like the state of charge of the electric resource **112**. The resource ID could be used to obtain knowledge of the electric resource type and capabilities, preferences, etc. through lookup with the flow control server **106**.

[0212] In various embodiments, the charging station system including the UI might also gather grid-based information, such as current and future energy costs at the charging station.

[0213] User Charge Control UI Mechanisms. In various embodiments, by default, electric resources **112** may receive charge control management via power aggregation system **100**. In some embodiments, an override control may be provided to override charge control management and charge as soon as possible. The override control may be provided, in various embodiments, as a user interface mechanism of the remote IPF module **134**, the charging component **214**, of the electric resource (for example, if electric resource is a vehicle **200**, the user interface control may be integrated with dash controls of the vehicle **200**) or even via a web page offered by flow control server **106**. The control could be presented, for example, as a button, a touch screen option, a web page, or some other UI mechanism. In one embodiment, the UI may be the UI illustrated by FIG. **23** and discussed in greater detail below. In some embodiments, the override would be a one-time override, only applying to a single plug-in session. Upon disconnecting and reconnecting, the user may again need to interact with the UI mechanism to override the charge control management.

[0214] In some embodiments, the user may pay more to charge with the override on than under charge control management, thus providing an incentive for the user to accept charge control management. Such a cost differential may be displayed or rendered to the user in conjunction with or on the UI mechanism. This differential could take into account time-varying pricing, such as Time of Use (TOU), Critical Peak Pricing (CPP), and Real-Time Pricing (RTP) schemes, as discussed above, as well as any other incentives, discounts, or payments that might be forgone by not accepting charge control management.

[0215] UI Mechanism for Management Preferences. In various embodiments, a user interface mechanism of the remote IPF module **134**, the charging component **214**, of the electric resource (for example, if electric resource is a vehicle

200, the user interface control may be integrated with dash controls of the vehicle **200**) or even via a web page offered by flow control server **106** may enable a user to enter and/or edit management preferences to affect charge control management of the user's electric resource **112**. In some embodiments, the UI mechanism may allow the user to enter/edit general preferences, such as whether charge control management is enabled, whether vehicle-to-grid power flow is enabled or whether the electric resource **112** should only be charged with clean/green power. Also, in various embodiments, the UI mechanism may enable a user to prioritize relative desires for minimizing costs, maximizing payments (i.e., fewer charge periods for higher amounts), achieving a full state-of-charge for the electric resource **112**, charging as rapidly as possible, and/or charging in as environmentally-friendly a way as possible. Additionally, the UI mechanism may enable a user to provide a default schedule for when the electric resource will be used (for example, if resource **112** is a vehicle **200**, the schedule would be for when the vehicle **200** should be ready to drive). Further, the UI mechanism may enable the user to add or select special rules, such as a rule not to charge if a price threshold is exceeded or a rule to only use charge control management if it will earn the user at least a specified threshold of output. Charge control management may then be effectuated based on any part or all of these user entered preferences.

[0216] Simple User Interface. FIG. 23 illustrates a simple user interface (UI) which enables a user to control charging based on selecting among a limited number of high level preferences. For example, UI **2300** includes the categories "green", "fast", and "cheap" (with what is considered "green", "fast", and "cheap" varying from embodiment to embodiment). The categories shown in UI **2300** are selected only for the sake of illustration and may instead include these and/or any other categories applicable to electric resource **112** charging known in the art. As shown, the UI **2300** may be very basic, using well known form controls such as radio buttons. In other embodiments, other graphic controls known in the art may be used. The general categories may be mapped to specific charging behaviors, such as those discussed above, by a flow control server **106**.

Electric Resource Communication Protocol

[0217] FIG. 9 illustrates an exemplary resource communication protocol. As shown, a remote IPF module **134** or charging component **214** may be in communication with a flow control server **106** over the Internet **104** or another networking fabric or combination of networking fabrics. In various embodiments, a protocol specifying an order of messages and/or a format for messages may be used to govern the communications between the remote IPF module **134** or charging component **214** and flow control server **106**.

[0218] In some embodiments, the protocol may include two channels, one for messages initiated by the remote IPF module **134** or charging component **214** and for replies to those messages from the flow control server **106**, and another channel for messages initiated by the flow control server **106** and for replies to those messages from the remote IPF module **134** or charging component **214**. The channels may be asynchronous with respect to each other (that is, initiation of messages on one channel may be entirely independent of initiation of messages on the other channel). However, each channel may itself be synchronous (that is, once a message is

sent on a channel, another message may not be sent until a reply to the first message is received).

[0219] As shown, the remote IPF module **134** or charging component **214** may initiate communication **902** with the flow control server **106**. In some embodiments, communication **902** may be initiated when, for example, an electric resource **112** first plugs in/connects to the power grid **114**. In other embodiments, communication **902** may be initiated at another time or times. The initial message **902** governed by the protocol may require, for example, one or more of an electric resource identifier, such as a MAC address, a protocol version used, and/or a resource identifier type.

[0220] Upon receipt of the initial message by the flow control server **106**, a connection may be established between the remote IPF module **134** or charging component **214** and flow control server **106**. Upon establishing a connection, the remote IPF module **134** or charging component **214** may register with flow control server **106** through a subsequent communication **903**. Communication **903** may include a location identifier scheme, a latitude, a longitude, a max power value that the remote IPF module **134** or charging component **214** can draw, a max power value that the remote IPF module **134** or charging component **214** can provide, a current power value, and/or a current state of charge.

[0221] After the initial message **902**, the protocol may require or allow messages **904** from the flow control server **106** to the remote IPF module **134** or charging component **214** or messages **906** from remote IPF module **134** or charging component **214** to the flow control server **106**. The messages **904** may include, for example, one or more of commands, messages, and/or updates. Such messages **904** may be provided at any time after the initial message **902**. In one embodiment, messages **904** may include a command setting, a power level and/or a ping to determine whether the remote IPF module **134** or charging component **214** is still connected.

[0222] The messages **906** may include, for example, status updates to the information provided in the registration message **903**. Such messages **906** may be provided at any time after the initial message **902**. In one embodiment, the messages **906** may be provided on a pre-determined time interval basis. In various embodiments, messages **906** may even be sent when the remote IPF module **134** or charging component **214** is connected, but not registered. Such messages **906** may include data that is stored by flow control server **106** for later processing. Also, in some embodiments, messages **904** may be provided in response to a message **902** or **906**.

Exemplary Safety and Remote Smart-Islanding

[0223] The exemplary power aggregation system **100** can include methods and components for implementing safety standards and safely actuating energy discharge operations. For example, the exemplary power aggregation system **100** may use in-vehicle line sensors as well as smart-islanding equipment installed at particular locations. Thus, the power aggregation system **100** enables safe vehicle-to-grid operations. Additionally, the power aggregation system **100** enables automatic coordination of resources for backup power scenarios.

[0224] In one implementation, an electric vehicle **200** containing a remote IPF module **134** or transceiver **212** (with a local charging component **214**) stops vehicle-to-grid upload of power if the remote IPF module **134** or charging component **214** senses no line power originating from the grid **114**. This halting of power upload prevents electrifying a cord that

may be unplugged, or electrifying a powerline 206 that is being repaired, etc. However, this does not preclude using the electric vehicle 200 to provide backup power if grid power is down because the safety measures described below may be used to ensure that an island condition is not created.

[0225] Additional smart-islanding equipment installed at a charging location can communicate with the remote IPF module 134 or charging component 214 to coordinate activation of power upload to the grid 114 if grid power drops. One particular implementation of this technology is a vehicle-to-home backup power capability.

[0226] Also, in a further implementation, electric vehicle 200 may be a PHEV (i.e., hybrid vehicle) partially powered by fuel or some other non-electric energy source. In such an implementation, the electric vehicle 200 may be started, subject to safeguards, to provide additional energy to enhance the vehicle-to-home backup power capability.

[0227] FIG. 10 shows exemplary safety measures in a vehicle-to-home scenario, in which an electric resource 112, and potentially a PHEV 1008 comprising the electric resource 112, is used to provide power to a load or set of loads (as in a home). A breaker box 1000 is connected to the utility electric meter 1002. When an electric resource 112/PHEV 1008 is flowing power into the grid (or local loads), an islanding condition should be avoided for safety reasons. The electric resource 112 should not energize a line that would conventionally be considered de-energized in a power outage by line workers.

[0228] A locally installed smart grid disconnect (switch) 1004 senses the utility line in order to detect a power outage condition and coordinates with the electric resource 112 to enable vehicle-to-home power transfer. In the case of a power outage, the smart grid disconnect 1004 disconnects the circuit breakers 1006 from the utility grid 114 and communicates with the electric resource 112/PHEV 1008 to begin power backup services. When the utility services return to operation, the smart grid disconnect 1004 communicates with the electric resource 112/PHEV 1008 to disable the backup services and reconnect the breakers to the utility grid 114.

[0229] In various embodiments, the electric resource 112 may be part of a PHEV 1008. As mentioned above, PHEV 1008 may include not only the electric power source of electric resource 112, but also at least one additional power source, such as a fuel-driven engine. To enhance the backup power provided, the fuel engine and/or other power source of the PHEV 1008 may be started. In some embodiments, the PHEV 1008 may only be manually started by a user in order to reduce the hazards posed by exhaust and/or other potentially dangerous conditions. In other embodiments, PHEV 1008 may be started automatically. For example, a remote IPF module 134 or charging component 214 may receive an instruction from the switch 1004 to turn on the PHEV 1008 to provide additional power. In such other embodiments, the PHEV 1008 may possess additional safeguards, such as a carbon monoxide sensor, safety interlocks to make sure that PHEV 1008 is in park with the break on, and/or a location awareness to determine whether the current location is safe for running PHEV 1008. Also, automatic starting of PHEV 1008 may be conditioned based on user preferences (such as preferences entered through the exemplary user interfaces discussed above). PHEV 1008 may then only run subject to compliance with the safeguards and/or preferences.

[0230] FIG. 11 shows exemplary safety measures when multiple electric resources 112, and potentially PHEVs 1008

comprising the electric resources 112, power a home. In this case, the smart grid disconnect 1004 coordinates with all connected electric resources 112. One electric resource 112 is deemed the “master” 1100 for purposes of generating a reference signal 1102 and the other resources are deemed “slaves” 1104 and follow the reference of the master 1100. In a case in which the master 1100 disappears from the network, the smart grid disconnect 1004 assigns another slave 1104 to be the reference/master 1100.

[0231] FIG. 12 shows the smart grid disconnect 1004 of FIGS. 10 and 11, in greater detail. In one implementation, the smart grid disconnect 1004 includes a processor 1202, a communicator 1204 coupled with connected electric resources 112, a voltages sensor 1206 capable of sensing both the internal and utility-side AC lines, a battery 1208 for operation during power outage conditions, and a battery charger 1210 for maintaining the charge level of the battery 1208. A controlled breaker or relay 1212 switches between grid power and electric resource-provided power when signaled by the processor 1202.

Exemplary Methods

[0232] FIG. 13 shows an exemplary method 1300 of power aggregation. In the flow diagram, the operations are summarized in individual blocks. The exemplary method 1300 may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary power aggregation system 100.

[0233] At block 1302, communication is established with each of multiple electric resources connected to a power grid. For example, a central flow control service can manage numerous intermittent connections with mobile electric vehicles, each of which may connect to the power grid at various locations. An in-vehicle remote agent or local charging component 214 and transceiver 212 connect each vehicle to the Internet when the vehicle connects to the power grid.

[0234] At block 1304, the electric resources are individually signaled to provide power to or take power from the power grid.

[0235] FIG. 14 is a flow diagram of an exemplary method of communicatively controlling an electric resource for power aggregation. In the flow diagram, the operations are summarized in individual blocks. The exemplary method 1400 may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary intelligent power flow (IPF) module 134 or by components of the charging component 214.

[0236] At block 1402, communication is established between an electric resource and a service for aggregating power.

[0237] At block 1404, information associated with the electric resource is communicated to the service.

[0238] At block 1406, a control signal based in part upon the information is received from the service.

[0239] At block 1408, the resource is controlled, e.g., to provide power to the power grid or to take power from the grid, i.e., for storage.

[0240] At block 1410, bidirectional power flow of the electric device is measured, and used as part of the information associated with the electric resource that is communicated to the service at block 1404.

[0241] FIG. 15 is a flow diagram of an exemplary method of communication between a transceiver and charge component and charge control management by the charge component. In

the flow diagram, the operations are summarized in individual blocks. The exemplary method **1500** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary transceiver **212** and charging component **214**.

[0242] At block **1502**, a transceiver **212** may obtain information about an electric resource **112** to which the transceiver is coupled through a data port.

[0243] At block **1504**, the transceiver **212** may provide the obtained electric resource information to a charging component **214**, the charging component **214** being communicatively coupled to the transceiver **212** and physically coupled to the electric resource **212** by a charging medium.

[0244] At block **1506**, the charging component **214** may receive the electric resource information from the transceiver **212**.

[0245] At block **1508**, the charging component **214** may provide the electric resource information to a flow control server **106**.

[0246] At block **1510**, the charging component **214** may receive, in response, one or more commands from the flow control server **106** to cause the charging component **214** to effectuate charge control management.

[0247] At block **1512**, the charging component **214** may effectuate charge control management by starting or stopping a flow of power between the electric resource **112** and a power grid **114** or by providing the commands to the electric resource **112** through the transceiver **212**.

[0248] FIG. **16** is a flow diagram of an exemplary method of estimating a state of charge. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **1600** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary charging component **214**.

[0249] At block **1602**, the charging component **214**, remote IPF module **134**, or flow control server **106** may determine that current state-of-charge information about an electric resource **112** is unavailable.

[0250] At block **1604**, the current state-of-charge may be estimated by monitoring a current flow of power from the grid **114** to the resource **112** or by tracking the time since the resource was last charged.

[0251] FIG. **17** is a flow diagram of an exemplary method of controlling charging of load-only electric resources. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **1700** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary remote IPF module **134** or charging component **214**.

[0252] At block **1702**, a flow control server **106** may receive a capacity call from a grid operator **116** requesting an up or down regulation to take more or less power from the grid **114**.

[0253] At block **1704**, in response to the call, the flow control server **106** may cause one or more of a plurality of load-only electric vehicles **200** to start or stop charging in order to meet the capacity call.

[0254] FIG. **18** is a flow diagram of an exemplary method for a resource communication protocol. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **1800** may be performed by hardware,

software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary power aggregation system **100**.

[0255] At block **1802**, a remote IPF module **134** or charging component **214** may initiate communication with a flow control server **106** through a message required by a resource communication protocol to include one or more of a resource identifier, a location identifier, and/or a state-of-charge of an electric resource **112**.

[0256] At block **1804**, at any point after communication is initiated, the flow control server **106** may send one or more commands, messages, or updates to the remote IPF module **134** or charging component **214**.

[0257] At block **1806**, at any point after communication is initiated, the remote IPF module **134** or charging component **214** may send updated information to the flow control server **106**.

[0258] FIG. **19** is a flow diagram of an exemplary method of offline behavior for an electric resource. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **1900** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary remote IPF module **134** or charging component **214**.

[0259] At block **1902**, a remote IPF module **134** or charging component **214** may determine that no communication path to a flow control server **106** exists.

[0260] At block **1904**, in response to the determination, the remote IPF module **134** or charging component **214** may follow a pre-programmed or learned behavior of offline operation.

[0261] FIG. **20** is a flow diagram of an exemplary method of calculating an efficiency metric for an electric resource. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **2000** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary power aggregation system **100**.

[0262] At block **2002**, a remote IPF module **134**, charging component **214**, or flow control server **106** may gather vehicle, energy, cost, and CO₂ metrics.

[0263] At block **2004**, one or more efficiency metrics may be calculated based on the gathered metrics.

[0264] FIG. **21** is a flow diagram of an exemplary method of smart islanding. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **2100** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary power aggregation system **100**.

[0265] At block **2102**, a power outage is sensed.

[0266] At block **2104**, a local connectivity—a network isolated from the power grid is created.

[0267] At block **2106**, local energy storage resources are signaled to power the local connectivity.

[0268] FIG. **22** is a flow diagram of an exemplary method of extending a user interface for power aggregation. In the flow diagram, the operations are summarized in individual blocks. The exemplary method **2200** may be performed by hardware, software, or combinations of hardware, software, firmware, etc., for example, by components of the exemplary power aggregation system **100**.

[0269] At block **2202**, a user interface is associated with an electric resource. The user interface may be displayed in, on, or near an electric resource, such as an electric vehicle that

includes an energy storage system or a charging station, or the user interface may be displayed on a device associated with the owner of the electric resource, such as a cell phone or portable computer.

[0270] At block 2204, power aggregation preferences, charge control management preferences, and constraints are input via the user interface. In other words, a user may control a degree of participation of the electric resource in a power aggregation scenario via the user interface. Or, the user may control the characteristics of such participation.

CONCLUSION

[0271] Although exemplary systems and methods have been described in language specific to structural features and/or methodological acts, it is to be understood that the subject matter defined in the appended claims is not necessarily limited to the specific features or acts described. Rather, the specific features and acts are disclosed as exemplary forms of implementing the claimed methods, devices, systems, etc.

1. A system, comprising:
 - a transceiver device, physically coupled to an electric resource, to provide information about the electric resource; and
 - a charging component, physically coupled to the electric resource via a charging medium and communicatively coupled to the transceiver device, to receive the information about the electric resource from the transceiver and, in response, effectuate charge control management of the electric resource.
2. The system of claim 1, wherein the transceiver device is a radio frequency identification (RFID) tag containing an electric resource identifier or a device that connects to a data port of the electric resource.
3. The system of claim 1, wherein the charging component is:
 - an intelligent plug device that is physically connected to the charging medium and an outlet of a power grid, a charging station, or
 - another external control system.
4. The system of claim 1, wherein the information about the electric resource includes at least one of an electric resource identifier, a state of charge of the electric resource, and/or a time since a last charge.
5. The system of claim 1, wherein effectuating charge control management comprises starting, stopping, or level-setting, by the charging component, a flow of power between a power grid and the electric resource.
6. The system of claim 1, wherein the electric resource is a mobile electric vehicle that is connectable to a power grid.
7. The system of claim 1, wherein the transceiver device is communicatively coupled to the charging component via the charging medium, a separate conductor, or a wireless connection.
8. A method, comprising:
 - obtaining information about an electric resource via a data port of the electric resource; and
 - providing the information to a charging component that is coupled to the electric resource via a charging medium and to a power grid via an outlet of the power grid and is able effectuate charge control management based at least in part on the provided information.

9. The method of claim 8, wherein the charging component is one of a plurality of geographically dispersed charging components, and the providing includes providing the information to the one of the charging components that the electric resource is coupled to.

10. The method of claim 8, further comprising providing security for the information provided to the charging component, the charging component being specifically paired with the transceiver device.

11. The method of claim 8, further comprising:

- receiving charging commands from the charging component or flow control server; and
- providing the charging commands to the electric resource, the electric resource having charge control management capabilities.

12. The method of claim 8, wherein the electric resource is a mobile electric vehicle that is connectable to a power grid and the data port is an OBD-II connector of the electric vehicle.

13. The method of claim 8, wherein the providing comprises providing the information to the charging component via the charging medium, a separate conductor, or a wireless connection.

14. A charging component, comprising:

- a computer readable medium having a plurality of programming instructions which, when executed, perform operations including
 - receiving information about an electric resource that is connectable to the charging component via a charging medium,
 - providing the information to a flow control server, and
 - in response, receiving one or more commands from the flow control server to cause the charging component to effectuate charge control management of the electric resource.

15. The charging component of claim 14, wherein the instructions, when executed, effectuate charge control management based at least in part on the received commands, and the effectuating includes starting, stopping, or level-setting a flow of power between a power grid and the electric resource.

16. The charging component of claim 14, wherein the charging component is portable and may be physically coupled to any of a plurality of power grid outlets and/or charging stations.

17. The charging component of claim 14, wherein the information is entered by a user associated with the electric resource.

18. The charging component of claim 14, wherein the information is entered by the user via swiping a credit card or other identifier of the user through a reader associated with the charging component.

19. The charging component of claim 14, wherein the instructions, when executed, estimate a state of charge of the electric resource based at least in part on a charging current flowing to the electric resource.

20. The charging component of claim 14, wherein the instructions, when executed, estimate a state of charge of the electric resource based at least in part on a duration of time since the electric resource was last coupled to the charging component via the charging medium.