

United States Patent [19]
Brocklebank et al.

[11] **Patent Number:** **4,557,896**
[45] **Date of Patent:** **Dec. 10, 1985**

[54] **TREATMENT OF AQUEOUS SYSTEMS**

[75] **Inventors:** **Philip Brocklebank, Warrington;**
John J. Bennison, Runcorn, both of
England

[73] **Assignee:** **Dearborn Chemicals Limited,**
Widnes, England

[21] **Appl. No.:** **271,872**

[22] **Filed:** **Jun. 9, 1981**

[30] **Foreign Application Priority Data**

Sep. 25, 1980 [GB] United Kingdom 8030967

[51] **Int. Cl.⁴** **C23F 11/00; C23F 11/08;**
C23F 11/10

[52] **U.S. Cl.** **422/14; 422/15;**
422/17

[58] **Field of Search** **422/15, 17, 14;**
252/389 A, 389 R, 387

[56] **References Cited**

U.S. PATENT DOCUMENTS

Re. 28,553 9/1975 Freyhold 422/15
3,925,245 12/1975 Harris et al. 252/389 A
4,057,511 11/1977 Bohnsack 252/309
4,206,075 6/1980 Boffardi 422/15

4,209,398 6/1980 Ii 210/609
4,209,487 6/1980 Hogue et al. 422/15
4,277,359 4/1981 Lipinski 252/181
4,317,744 3/1982 Levi 422/17

FOREIGN PATENT DOCUMENTS

2032411 5/1980 United Kingdom .

OTHER PUBLICATIONS

Held, Kuhlwasser, Vulkan-Verlag, p. 218, (Essen, 1970).

Marshall, "An Investigation into the Mechanism of Inhibition of a Synergistic Dionodic Corrosion Inhibitor", *Corrosion-NACE*, vol. 37, No. 4, pp. 214-222, (Apr. 1981).

Primary Examiner—William F. Smith
Attorney, Agent, or Firm—Edward J. Cabic

[57] **ABSTRACT**

Composition and method for inhibiting corrosion in aqueous systems using synergistic combination of an inorganic nitrite and a phosphonate, e.g., 10-20 ppm sodium nitrite plus 0.5-5 ppm hydroxyethylidene di-phosphonic acid.

8 Claims, No Drawings

2

5

10

15

35



50

55

60

65

It will be appreciated that other low toxic materials conventionally used in water treatment can be added to

the system and/or the composition including silicates, inorganic phosphates and polyphosphates, lignin derivatives, and the like.

The compositions of the present invention will normally be in the form of an aqueous solution but other possible forms include powders and briquettes.

The following examples further illustrate the present invention. In these examples two different types of tests were employed, namely a circulatory test and a test to simulate intermittent flow operations.

In the circulatory test a laboratory test apparatus was used in which water is circulated by means of a pump from a reservoir maintained at a temperature of 40° C. with a heater and thermostat. The water passes through a glass tube assembly holding the metal test specimens and then is returned to the reservoir entraining air as it does so in order to keep the water saturated with oxygen as it would be in a typical open recirculating cooling system.

Water lost by evaporation is replaced from an elevated tank through a float control to maintain a constant volume in the system.

In each test, treatment is applied at three times normal dose for 24 hours in order to passivate the metals; then the water is diluted to the normal dose for the remainder of the test. Each test is for a minimum of 3 days, the test specimens being cleaned before and after each run to find the weight loss which is then calculated to show the average corrosion rate in mils (0.025) per year.

The water used in the tests was Widnes (England) mains water. The water had a total hardness of 140 mg/l, M.alkalinity of 100 mg/l, and Langelier Index of minus 0.5 which concentrates two times during the test due to evaporation.

The results obtained using HEDPA as the phosphonate and poly methacrylic acid of molecular weight 5000 as polymer and sodium nitrite are given in the following Table I:

(Note, in the tables, 1 mg/liter equals 1 ppm.)

TABLE 1

Example No	Additives mg/liter			Corrosion rate, mils/year		
	Nitrite	Phosphonate	Polymer	Steel	Copper	Aluminum
1	—	—	—	26.6	0.2	2.9
2	20	—	—	12.7	0.1	1.4
3	15	—	—	19.5	0.1	1.4
4	10	—	—	31.9	0.2	2.6
5	—	20	—	13.4	0.1	1.7
6	—	—	20	18.3	0.1	0.9
7	—	10	10	23.3	0.1	1.0
8	15	5	—	4.6	0.4	2.6
9	15	—	5	9.7	0.1	2.7
10	15	2.5	2.5	3.9	0.1	0.8

Examples 1 to 7 show that nitrite alone at 20 to 15 mg/l showed some slight corrosion inhibition to steel while at 10 mg/l was giving increased corrosion. The phosphonate and polymer at 20 mg/l also showed slight inhibition when used alone but almost none when used together at 10 mg/l. Examples 8 to 10 show that combining 15 mg/l nitrite with 5 mg/l of phosphonate gave a marked improvement while with 5 mg/l polymer there was also some improvement. However, there was a greater improvement when using 15 mg/l nitrite with 2.5 mg/l each of polymer and phosphonate.

Further results were obtained as shown in the following table for corrosion of mild steel where the major effect is normally observed.

	Additives Mg/Liter			Corrosion Rate Mild Steel Units per year
	Nitrite	HEDPA	POLYMER ¹	
5	—	—	—	26.6
10	20	—	—	12.7
	—	20	—	13.4
	—	—	20	18.3
	15	—	—	19.5
	15	5	—	4.6
	15	—	5	9.7
15	15	2.5	2.5	3.9
	—	5	—	5.0
	—	—	5	28.0
	—	2.5	2.5	27.4

¹Poly methacrylic acid.

In the test made under intermittent flow conditions the procedure is the same as that in the circulatory test except that the apparatus is connected to the main electricity supply via a time-switch. This is set to allow the rig to operate for 12 hours during the day and is then shut off for 12 hours each night. The only other difference was that a water temperature of 50° C. was used when the rig was running. This would drop to room temperature after shut-off.

The following symbols are used in the following Tables giving the results obtained:

- HEDPA = Hydroxy ethylidene diphosphonic acid
- PMA = Sodium polymethacrylate
- PAA = Sodium polyacrylate
- PBTA = 2-Phosphono-butane-tricarboxylic acid
- DTPPA = Diethylene triamine pentamethylenephosphonic acid


	Additives Mg/liter			Corrosion rate Mild Steel mpy
	Nitrite	Phosphonate	Polymer	
1	—	—	—	32.0
2	30	—	—	42.0
3	—	30 HEDPA	—	17.0
4	—	—	30 PMA	25.5
5	25	5 HEDPA	—	6.0
6	25	—	5 PMA	38.0
7	25	2.5 HEDPA	2.5 PMA	15.5
8	—	—	30 PAA	18.5
9	25	—	5 PAA	19.5
10	25	2.5 HEDPA	2.5 PAA	15.5
11	—	30 PBTA	—	7.0
12	25	5 PBTA	—	21.0
13	25	2.5 PBTA	2.5 PAA	22.5
14	—	30 DTPPA	—	9.5
15	25	5 DTPPA	—	30.5
16	25	2.5 DTPPA	2.5 PAA	14.5

These results show that a blend of nitrite and HEDPA (compare runs 2, 3 and 5) gives better inhibition than either alone at the same dose rate. Polymethacrylate plus nitrite has little effect (run 6), but the triple blend of nitrite, HEDPA and PMA (run 7) is much improved. Again, the use of polymethacrylate gives a comparable result to polyacrylate when used with nitrite and HEDPA (compare runs 8 to 10). Runs 11 to 16, by comparison, show that other types of phosphonate provide little improvement over the use of nitrite alone.

We claim:

1. Method of inhibiting corrosion in aqueous cooling systems comprising adding thereto as the sole corrosion

inhibiting ingredient a mixture consisting of a water soluble inorganic nitrite and a phosphonate of the formula

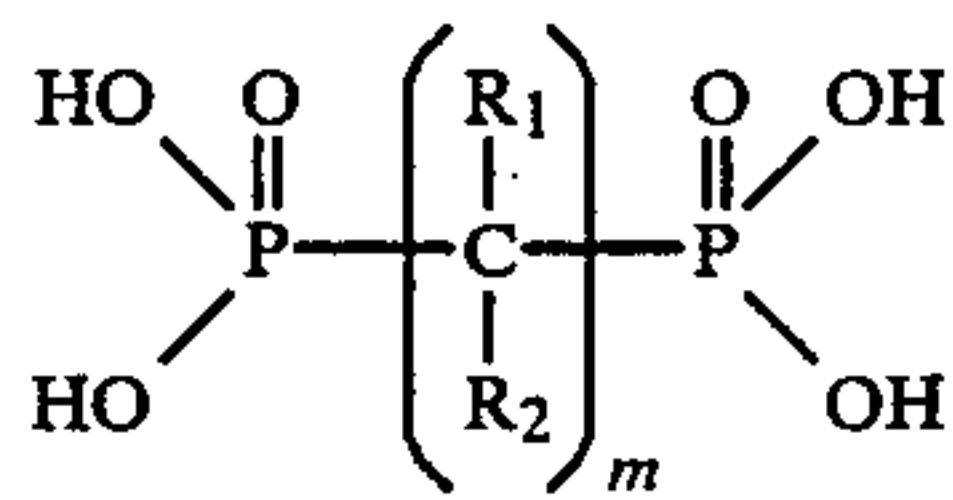

wherein m is an integer from 1 to 10, R₁ is hydrogen or alkyl of 1 to 4 carbon atoms and R₂ is hydroxyl, hydrogen or alkyl of 1 to 4 carbon atoms, said nitrite being present in an amount of 10–35 ppm and said phosphonate being present in an amount of 0.1 to 20 ppm.

2. Method according to claim 1 wherein the nitrite is added at 10–20 ppm and the phosphonate at 0.5–5 ppm.


3. Method according to claim 1 in which the nitrite is sodium nitrite.

4. Method according to claim 1 in which the phosphonate is hydroxyethylidene diphosphonic acid.


5. Method of inhibiting corrosion in aqueous cooling systems comprising adding thereto as the sole corrosion inhibiting ingredient a mixture consisting of

a water soluble inorganic nitrite,

a phosphonate of the formula

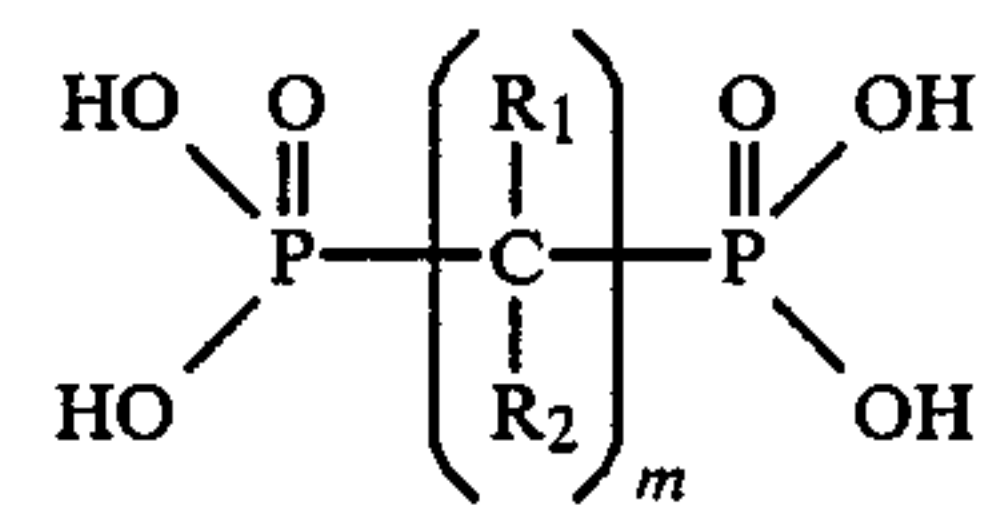

wherein m is an integer from 1 to 10, R₁ is hydrogen or alkyl of 1 to 4 carbon atoms and R₂ is hydroxyl, hydrogen or alkyl of 1 to 4 carbon atoms, and a polymer having a molecular weight of 500–100,000 and possessing recurring units of the general formula:

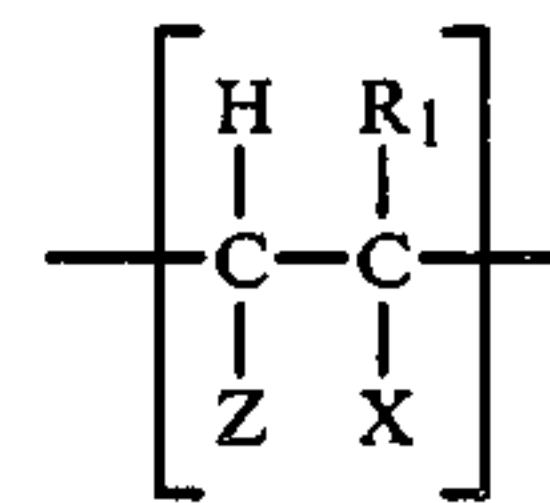

wherein R₁ represents hydrogen or alkyl of 1 to 4 carbon atoms, X represents COOH, and Z represents hydrogen or COOH; or X and Z together represent —CO—O—CO—, said nitrite being present in an amount of 10–35 ppm, said phosphonate being present in an amount of 0.1 to 20 ppm, and said polymer being present in an amount of 0.5 to 50 ppm.

6. Method according to claim 5 in which the polymer is polymethacrylic acid having a molecular weight of about 5000.

7. Method according to claim 5 in which the polymer is polyacrylic acid having a molecular weight of about 1000.

8. Method according to claim 3 in which 2–10 ppm of the polymer is added.

* * * * *