

[54] HOUSING FOR A FIRE AND SMOKE DETECTOR

[75] Inventor: Kenneth R. Fenne, Glen Ellyn, Ill.

[73] Assignee: Pittway Corporation, Northbrook, Ill.

[**] Term: 14 Years

[21] Appl. No.: 309,730

[22] Filed: Oct. 8, 1981

[51] Int. Cl. D10-05

[52] U.S. Cl. D10/106

[58] Field of Search D10/104, 106, 121; 340/540, 541, 542, 545, 546, 547, 552-561, 565, 566, 568, 576-581, 586, 588, 628, 629, 630, 632; 250/381, 383, 382, 384

[56] References Cited

U.S. PATENT DOCUMENTS

D. 242,778 12/1976 Goble et al. D10/106

OTHER PUBLICATIONS

Graviner Fire Protection Systems Brochure, 1978, p. 2, Fixed Temperature Detector.

Pyr-A-Larm Fire & Smoke Detection Systems Catalog, 1971, p. 1, Ionization Fire Detector.

Primary Examiner—Susan J. Lucas

Attorney, Agent, or Firm—Gary, Juettner & Pyle

[57] CLAIM

The ornamental design for a housing for a fire and smoke detector, substantially as shown.

DESCRIPTION

FIG. 1 is a plan view of a housing for a fire and smoke detector, showing my new design;

FIG. 2 is a side elevational view thereof;

FIG. 3 is a cross sectional view taken substantially along the lines 3-3 of FIG. 1; and

FIG. 4 is a partial cross sectional view taken substantially along the lines 4-4 of FIG. 2.

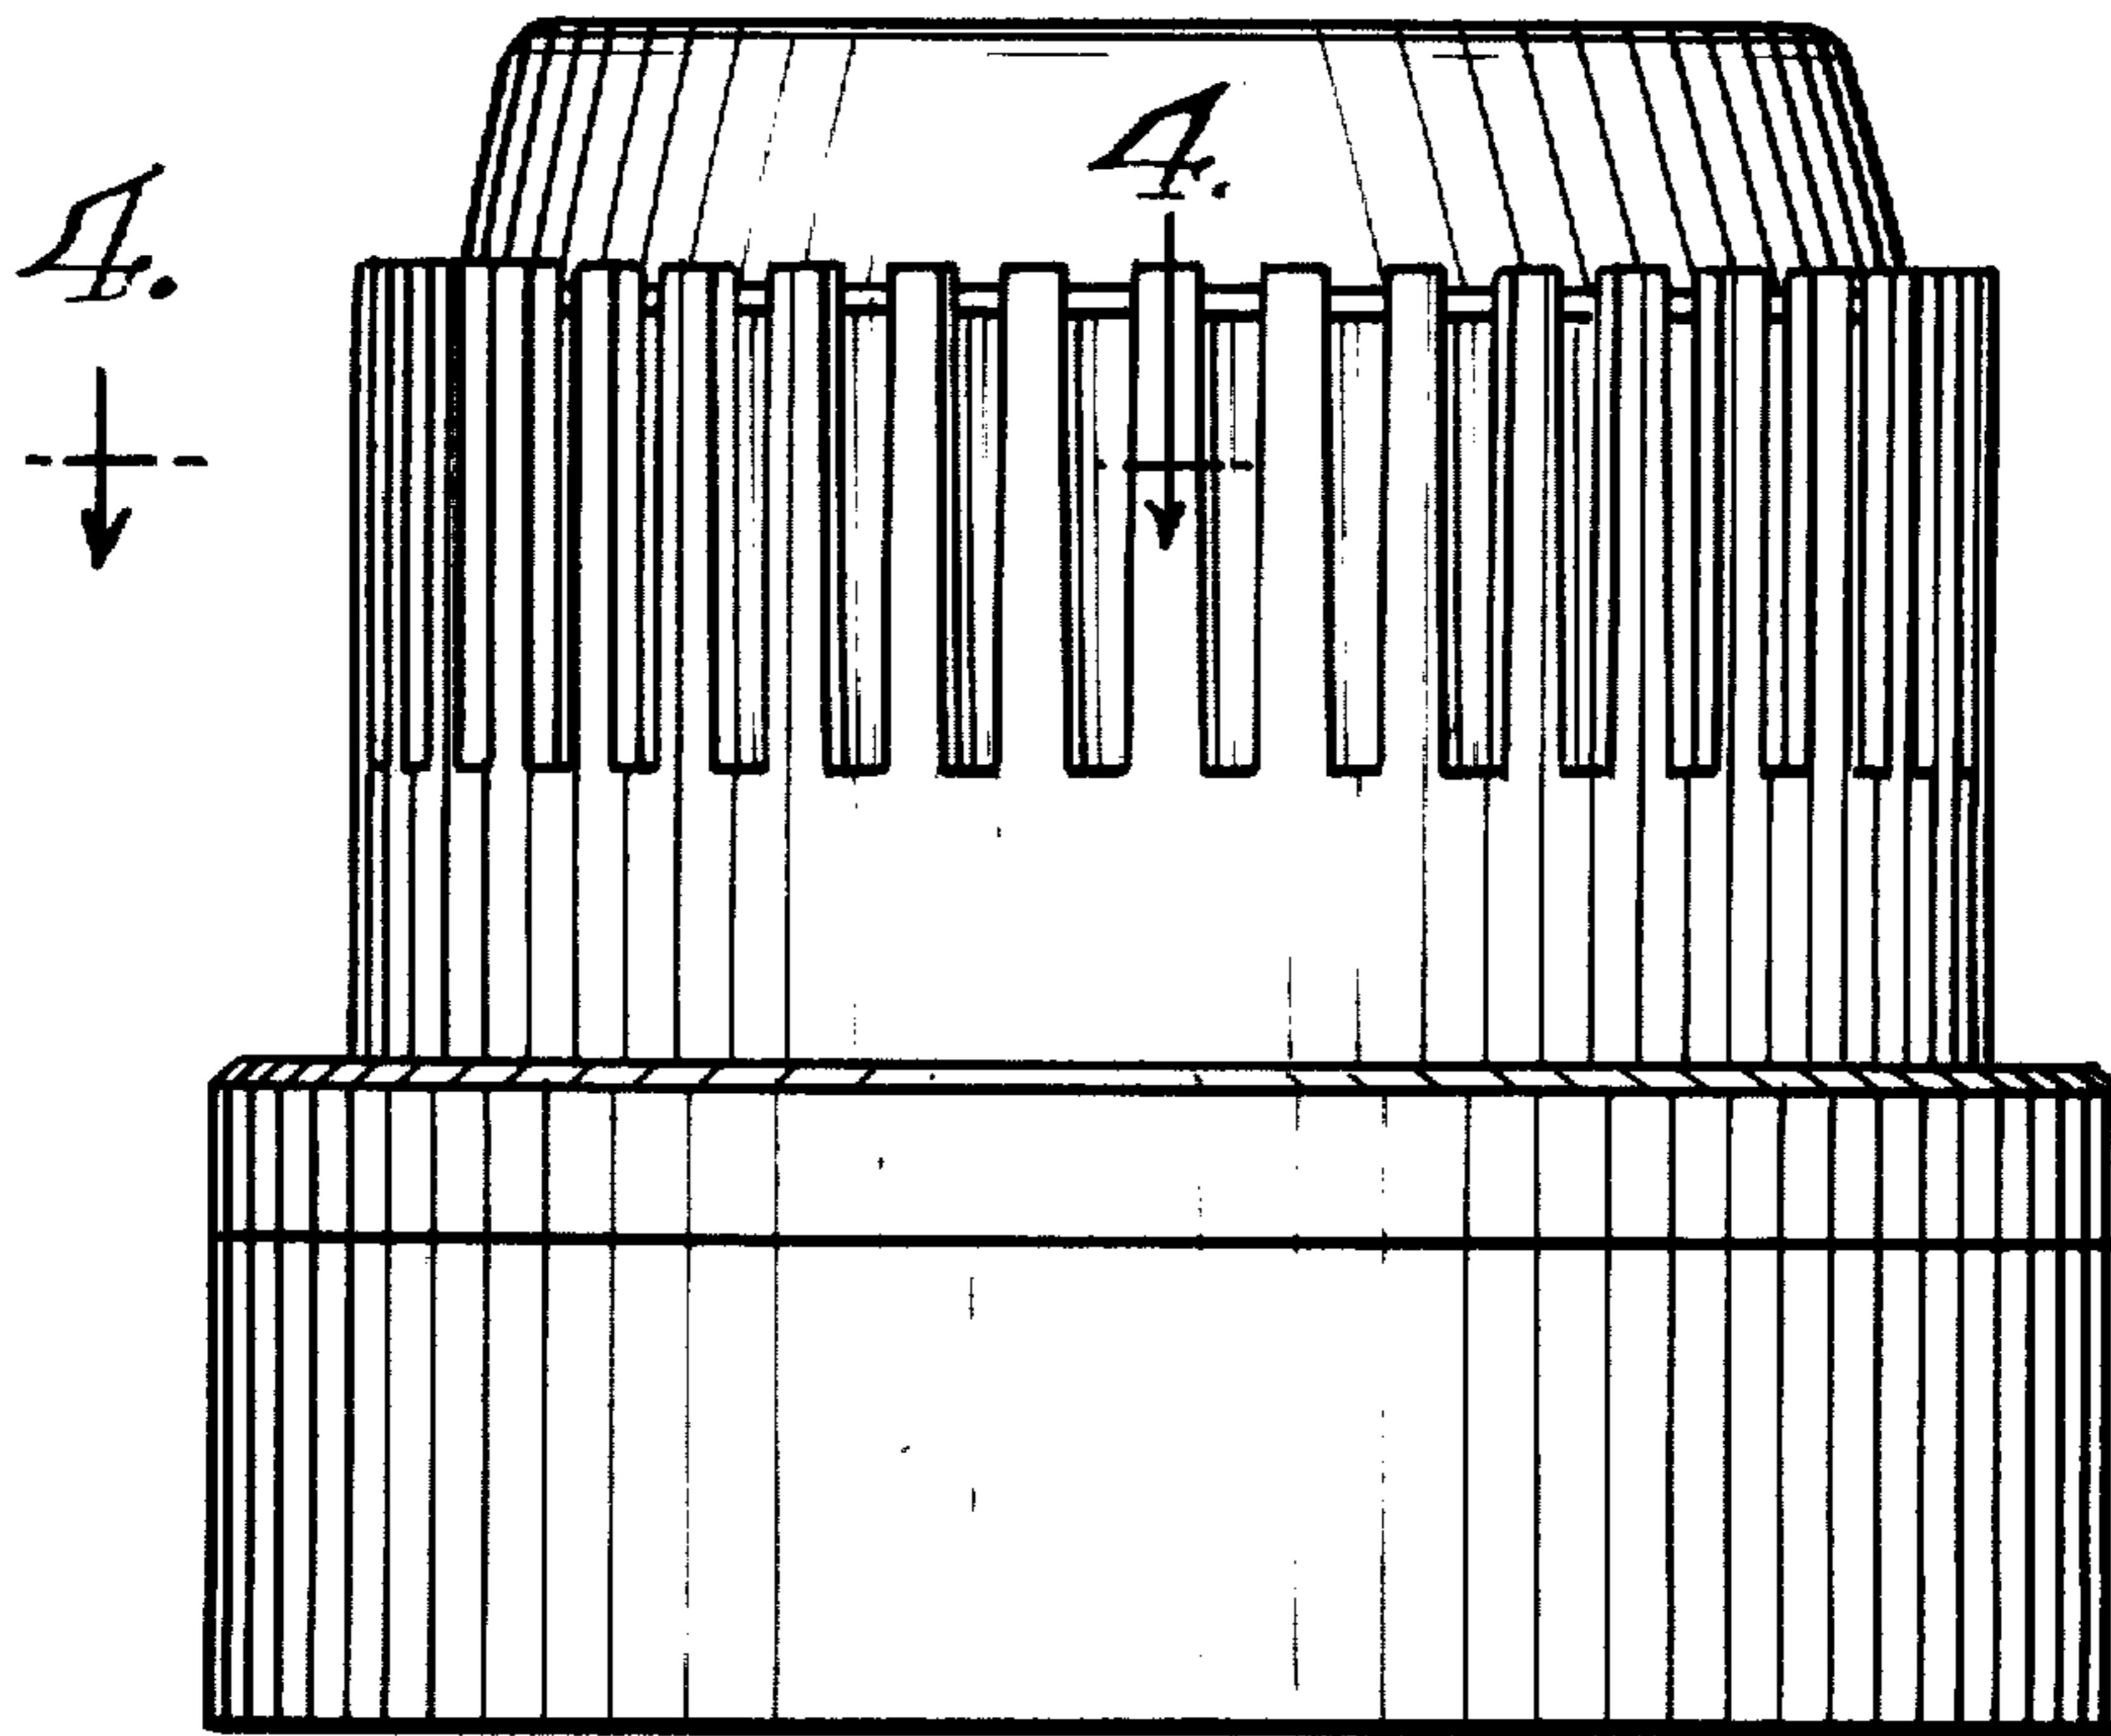


FIG. 1.

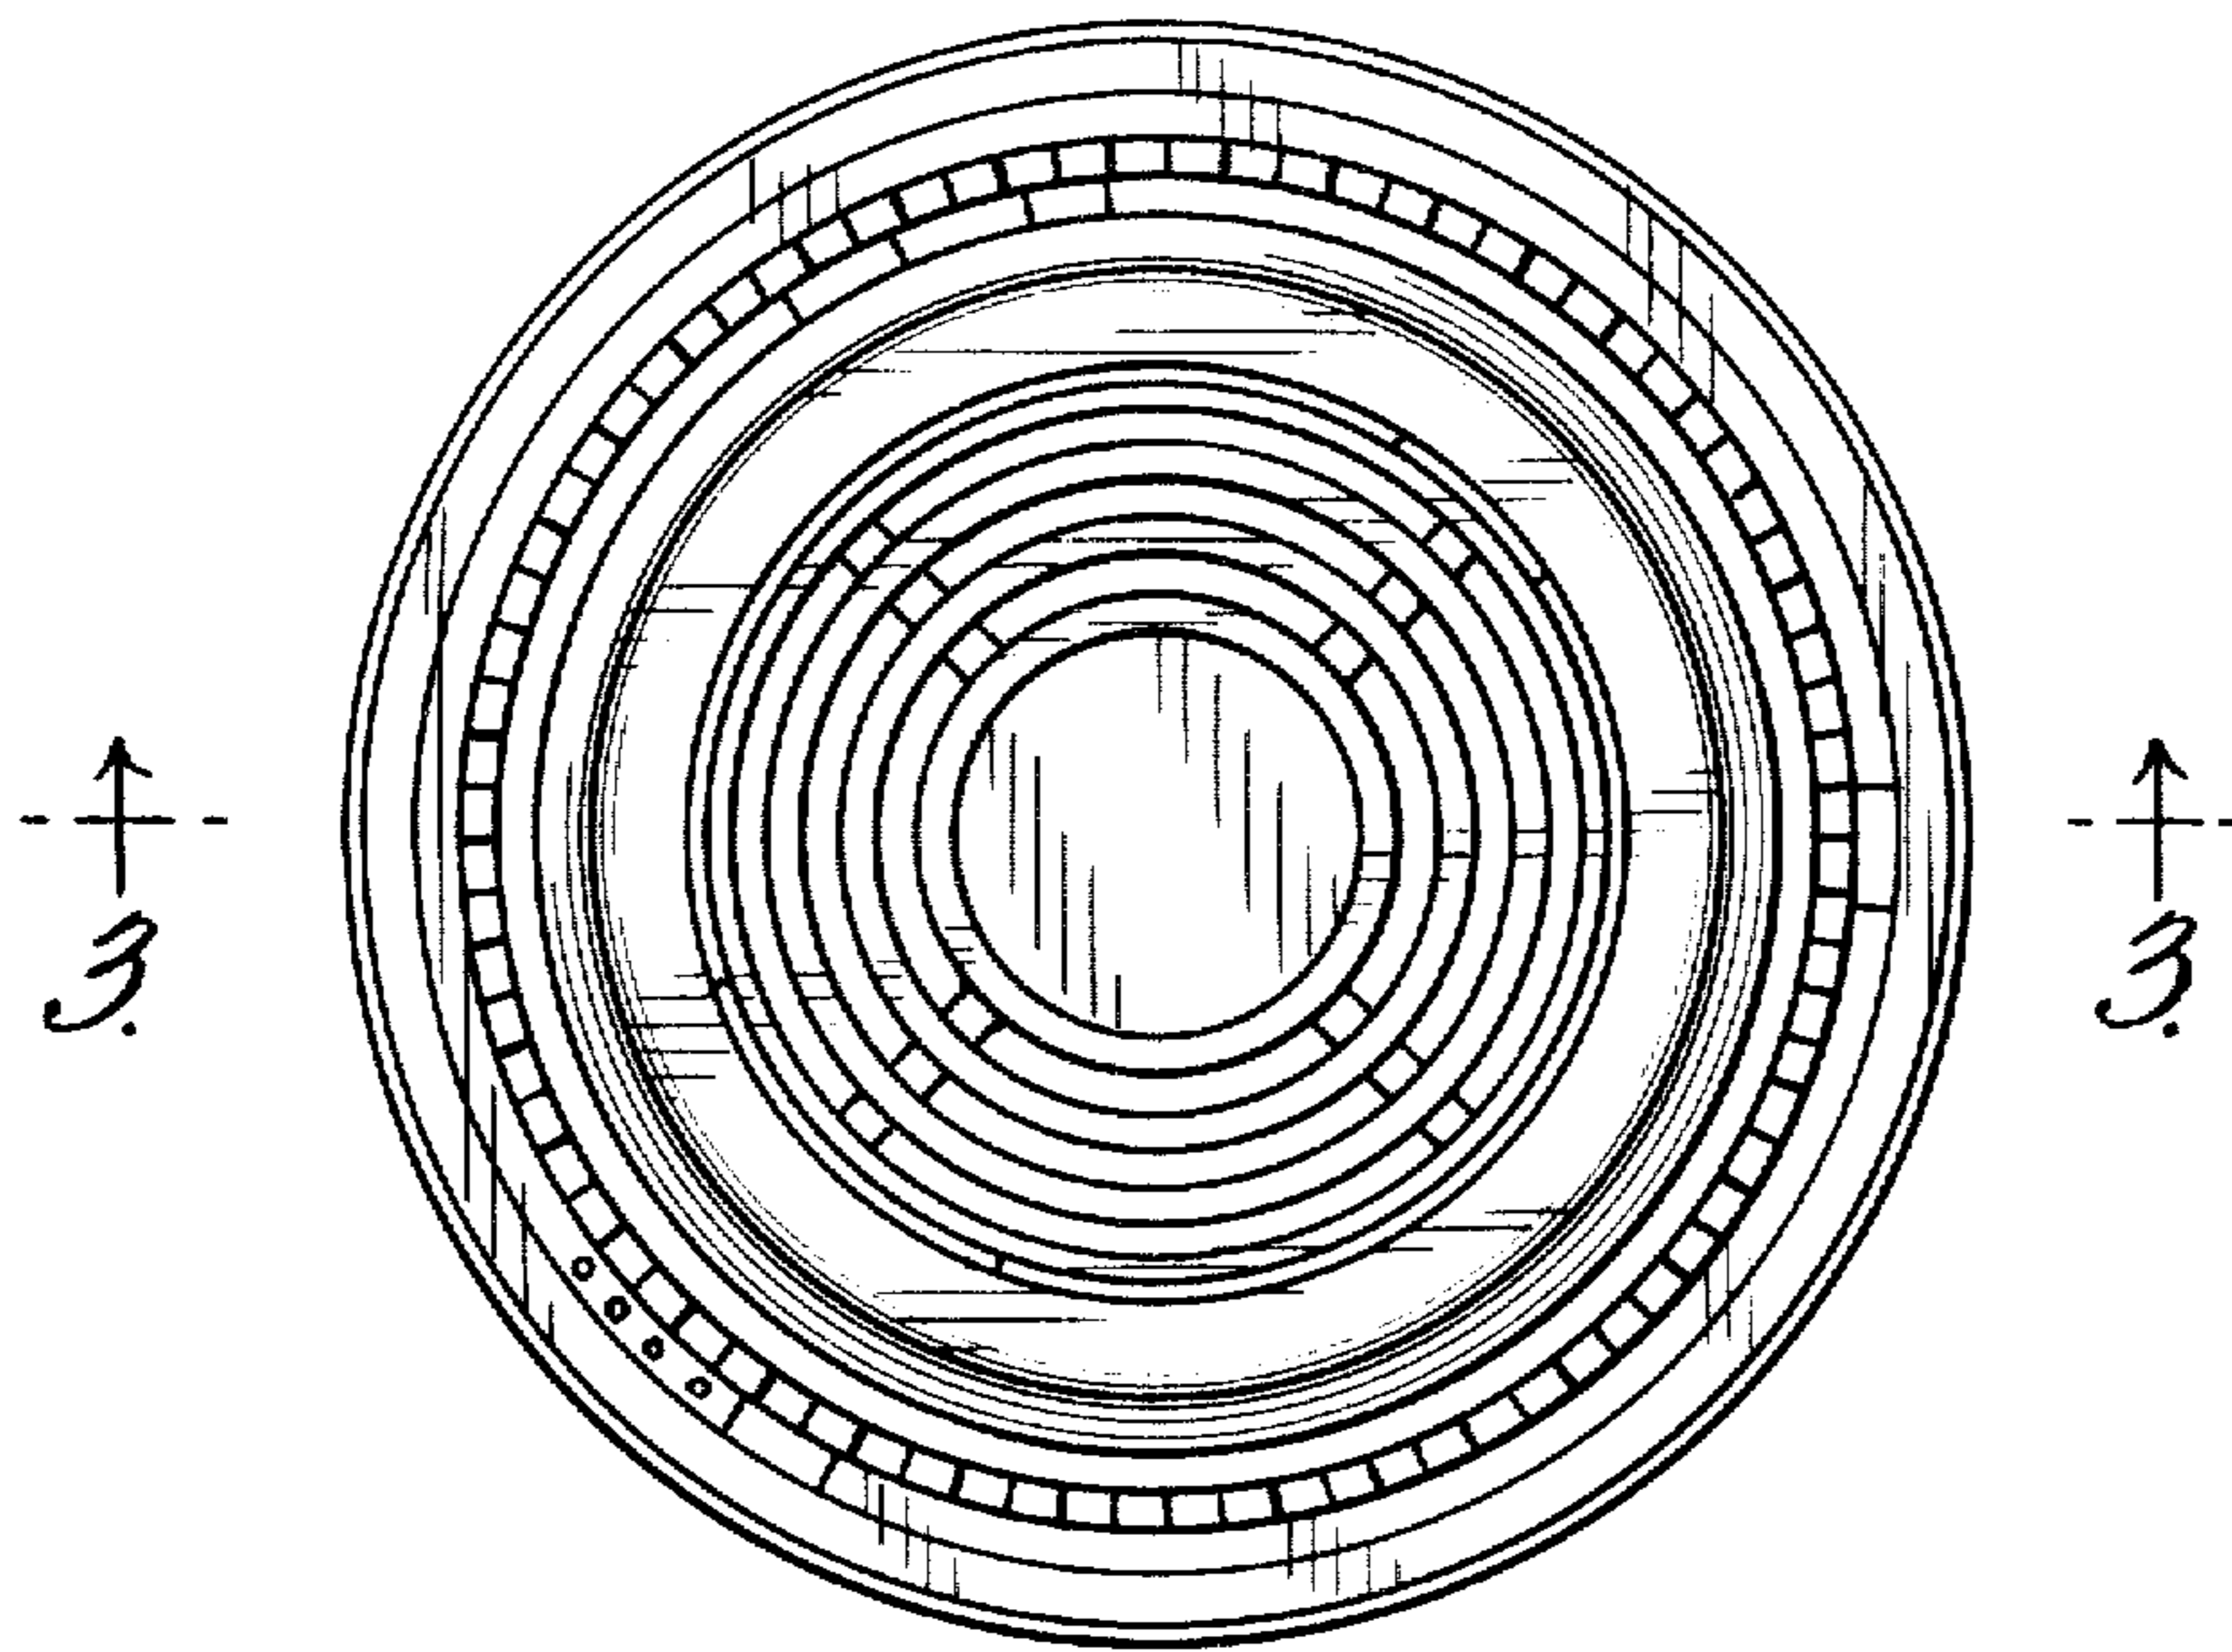


FIG. 2.

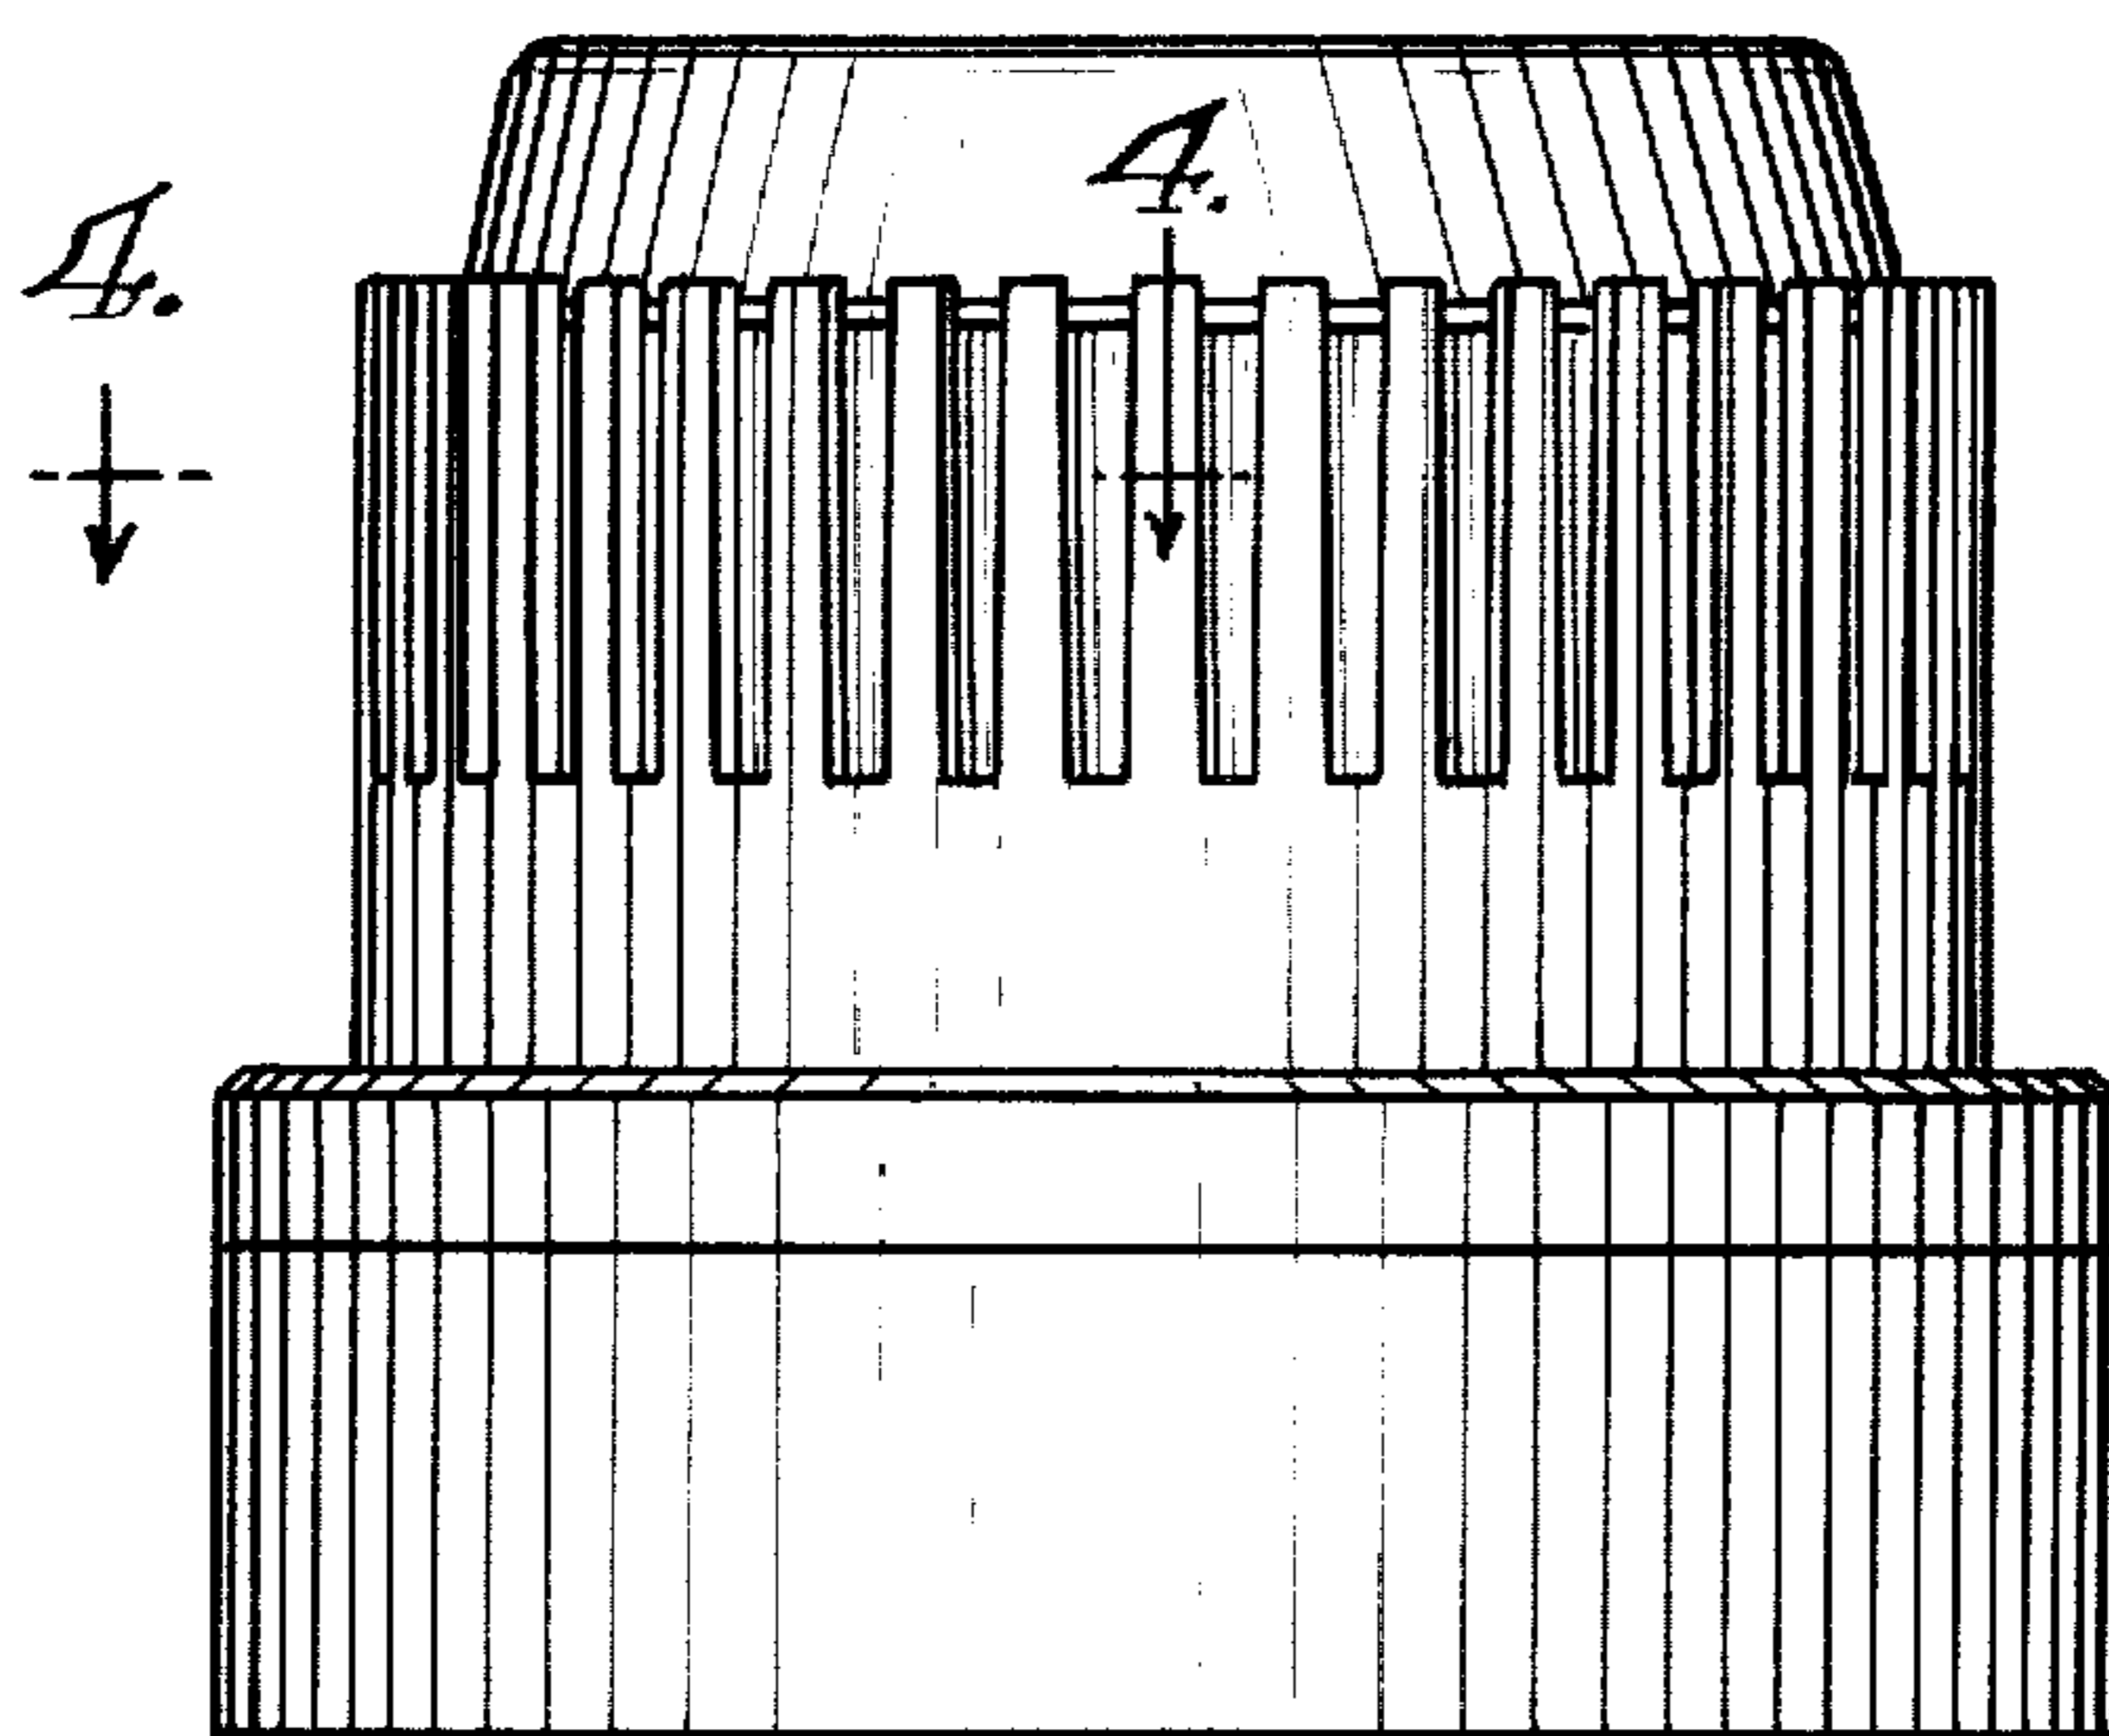


Fig. 3.

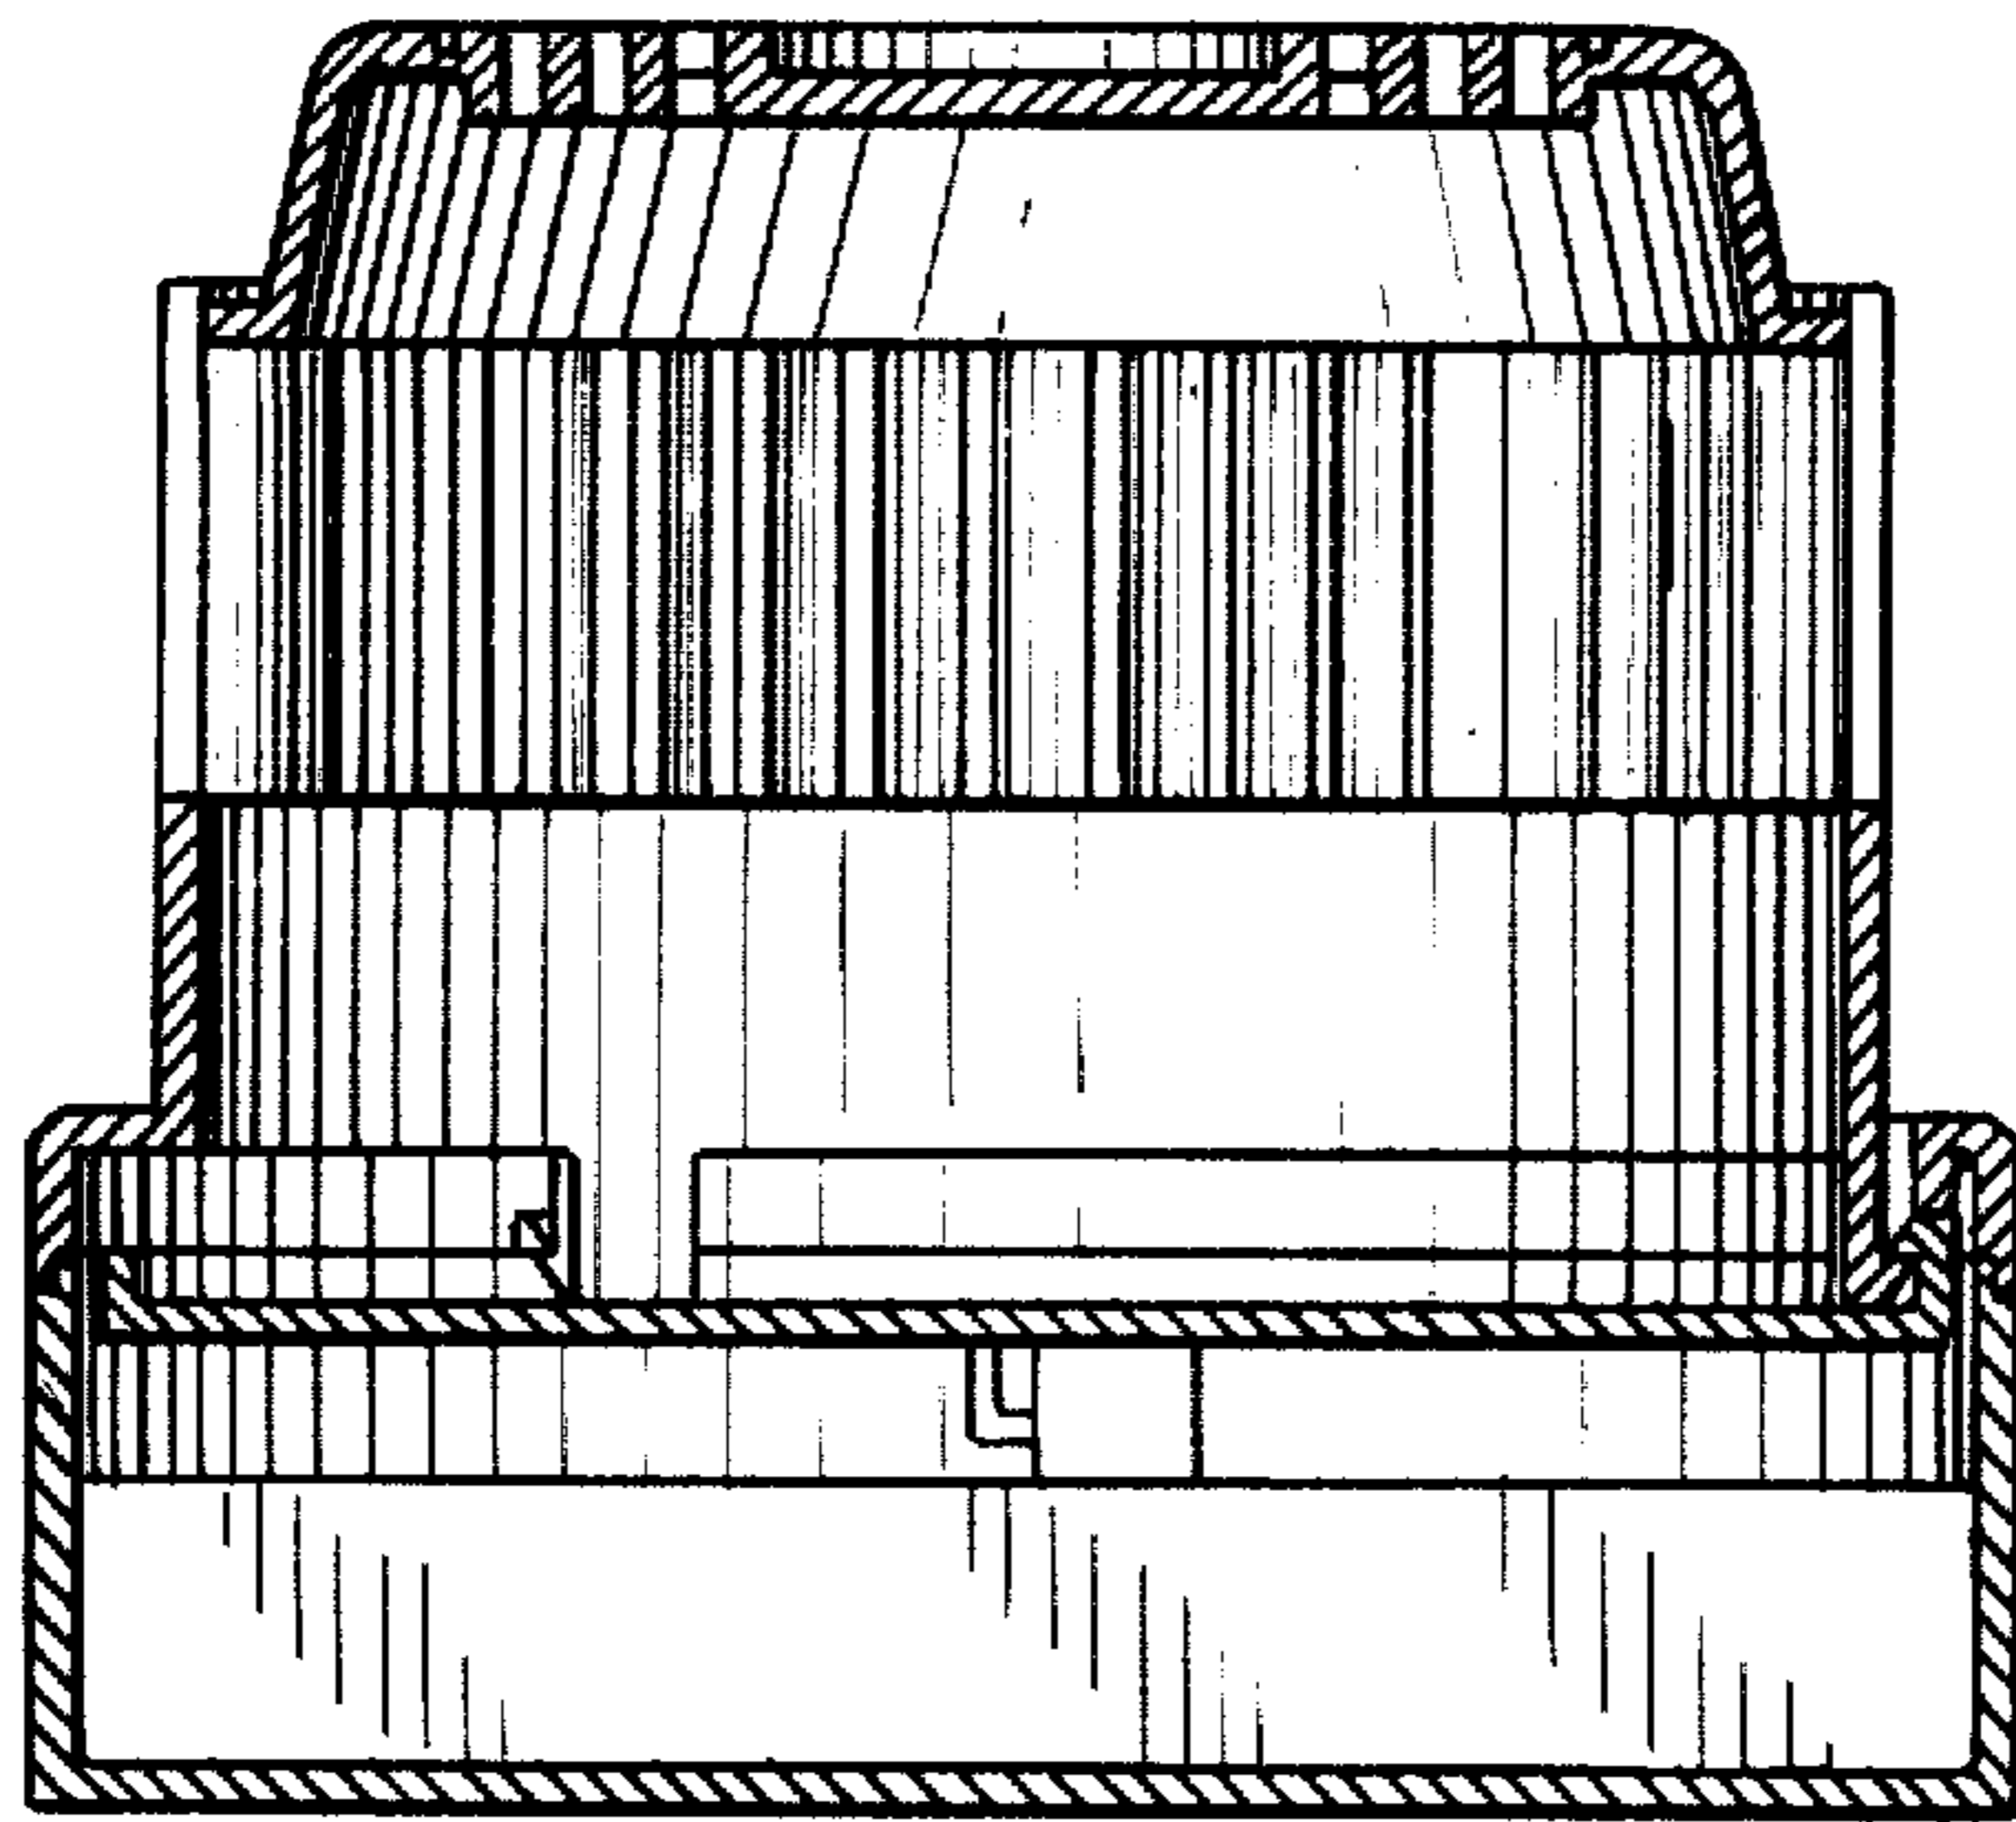


Fig. 4.

