

[54] FIRE AND SMOKE DETECTOR

[75] Inventors: Nobuei Takai; Katsura Yamamoto,
both of Tokyo, Japan

[73] Assignee: Nittan Company, Limited, Tokyo,
Japan

[**] Term: 14 Years

[21] Appl. No.: 276,321

[22] Filed: Jun. 22, 1981

[51] Int. Cl. D10—05
[52] U.S. Cl. D10/106; D10/104
[58] Field of Search D10/104, 106; 340/693,
340/545, 547, 555, 578, 584, 586

[56] References Cited

U.S. PATENT DOCUMENTS

D. 263,381 3/1982 Kelley D10/106
4,257,039 3/1981 Webb et al. 340/693

Primary Examiner—Wallace R. Burke
Assistant Examiner—Suzanne N. Gitlin
Attorney, Agent, or Firm—Ladas & Parry

[57] CLAIM

The ornamental design for a fire and smoke detector, as shown.

DESCRIPTION

FIG. 1 is a top plan view of a fire and smoke detector showing our new design;
FIG. 2 is a side elevational view thereof;
FIG. 3 is a cross-sectional elevational view, taken on line 3—3 of FIG. 1;
FIG. 4 is a bottom plan view thereof;
FIG. 5 is a perspective view thereof.

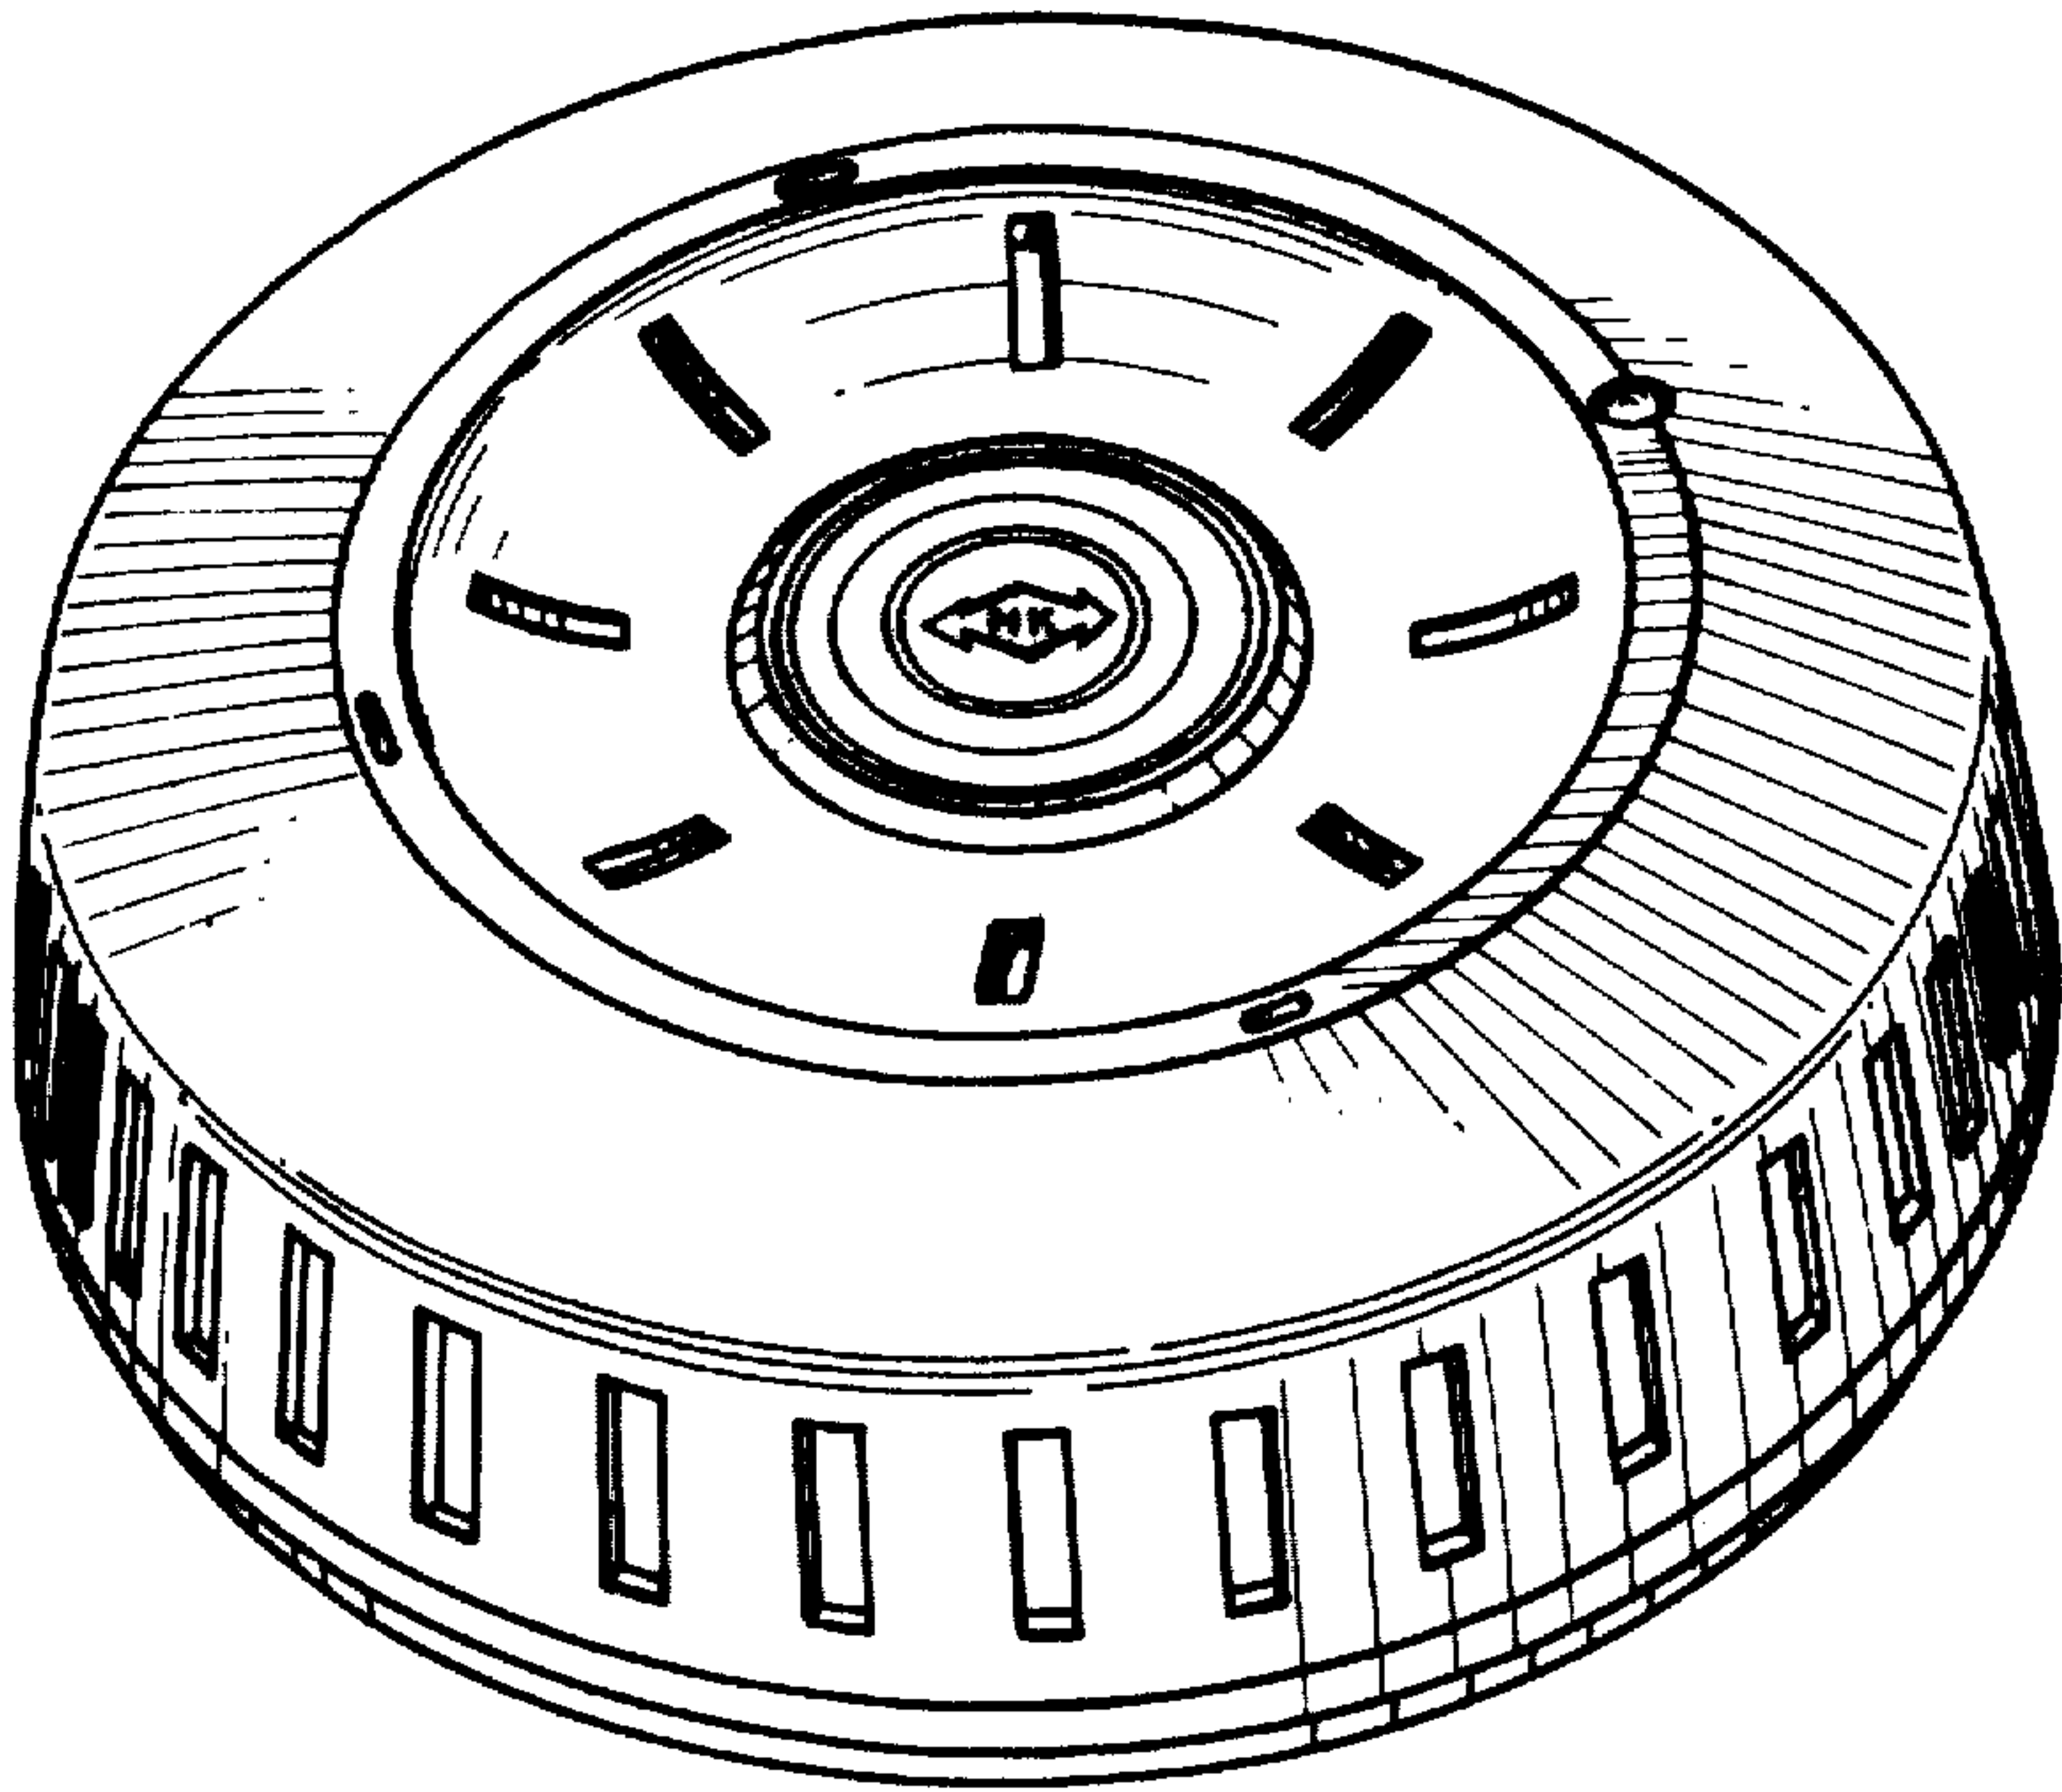


Fig. 1

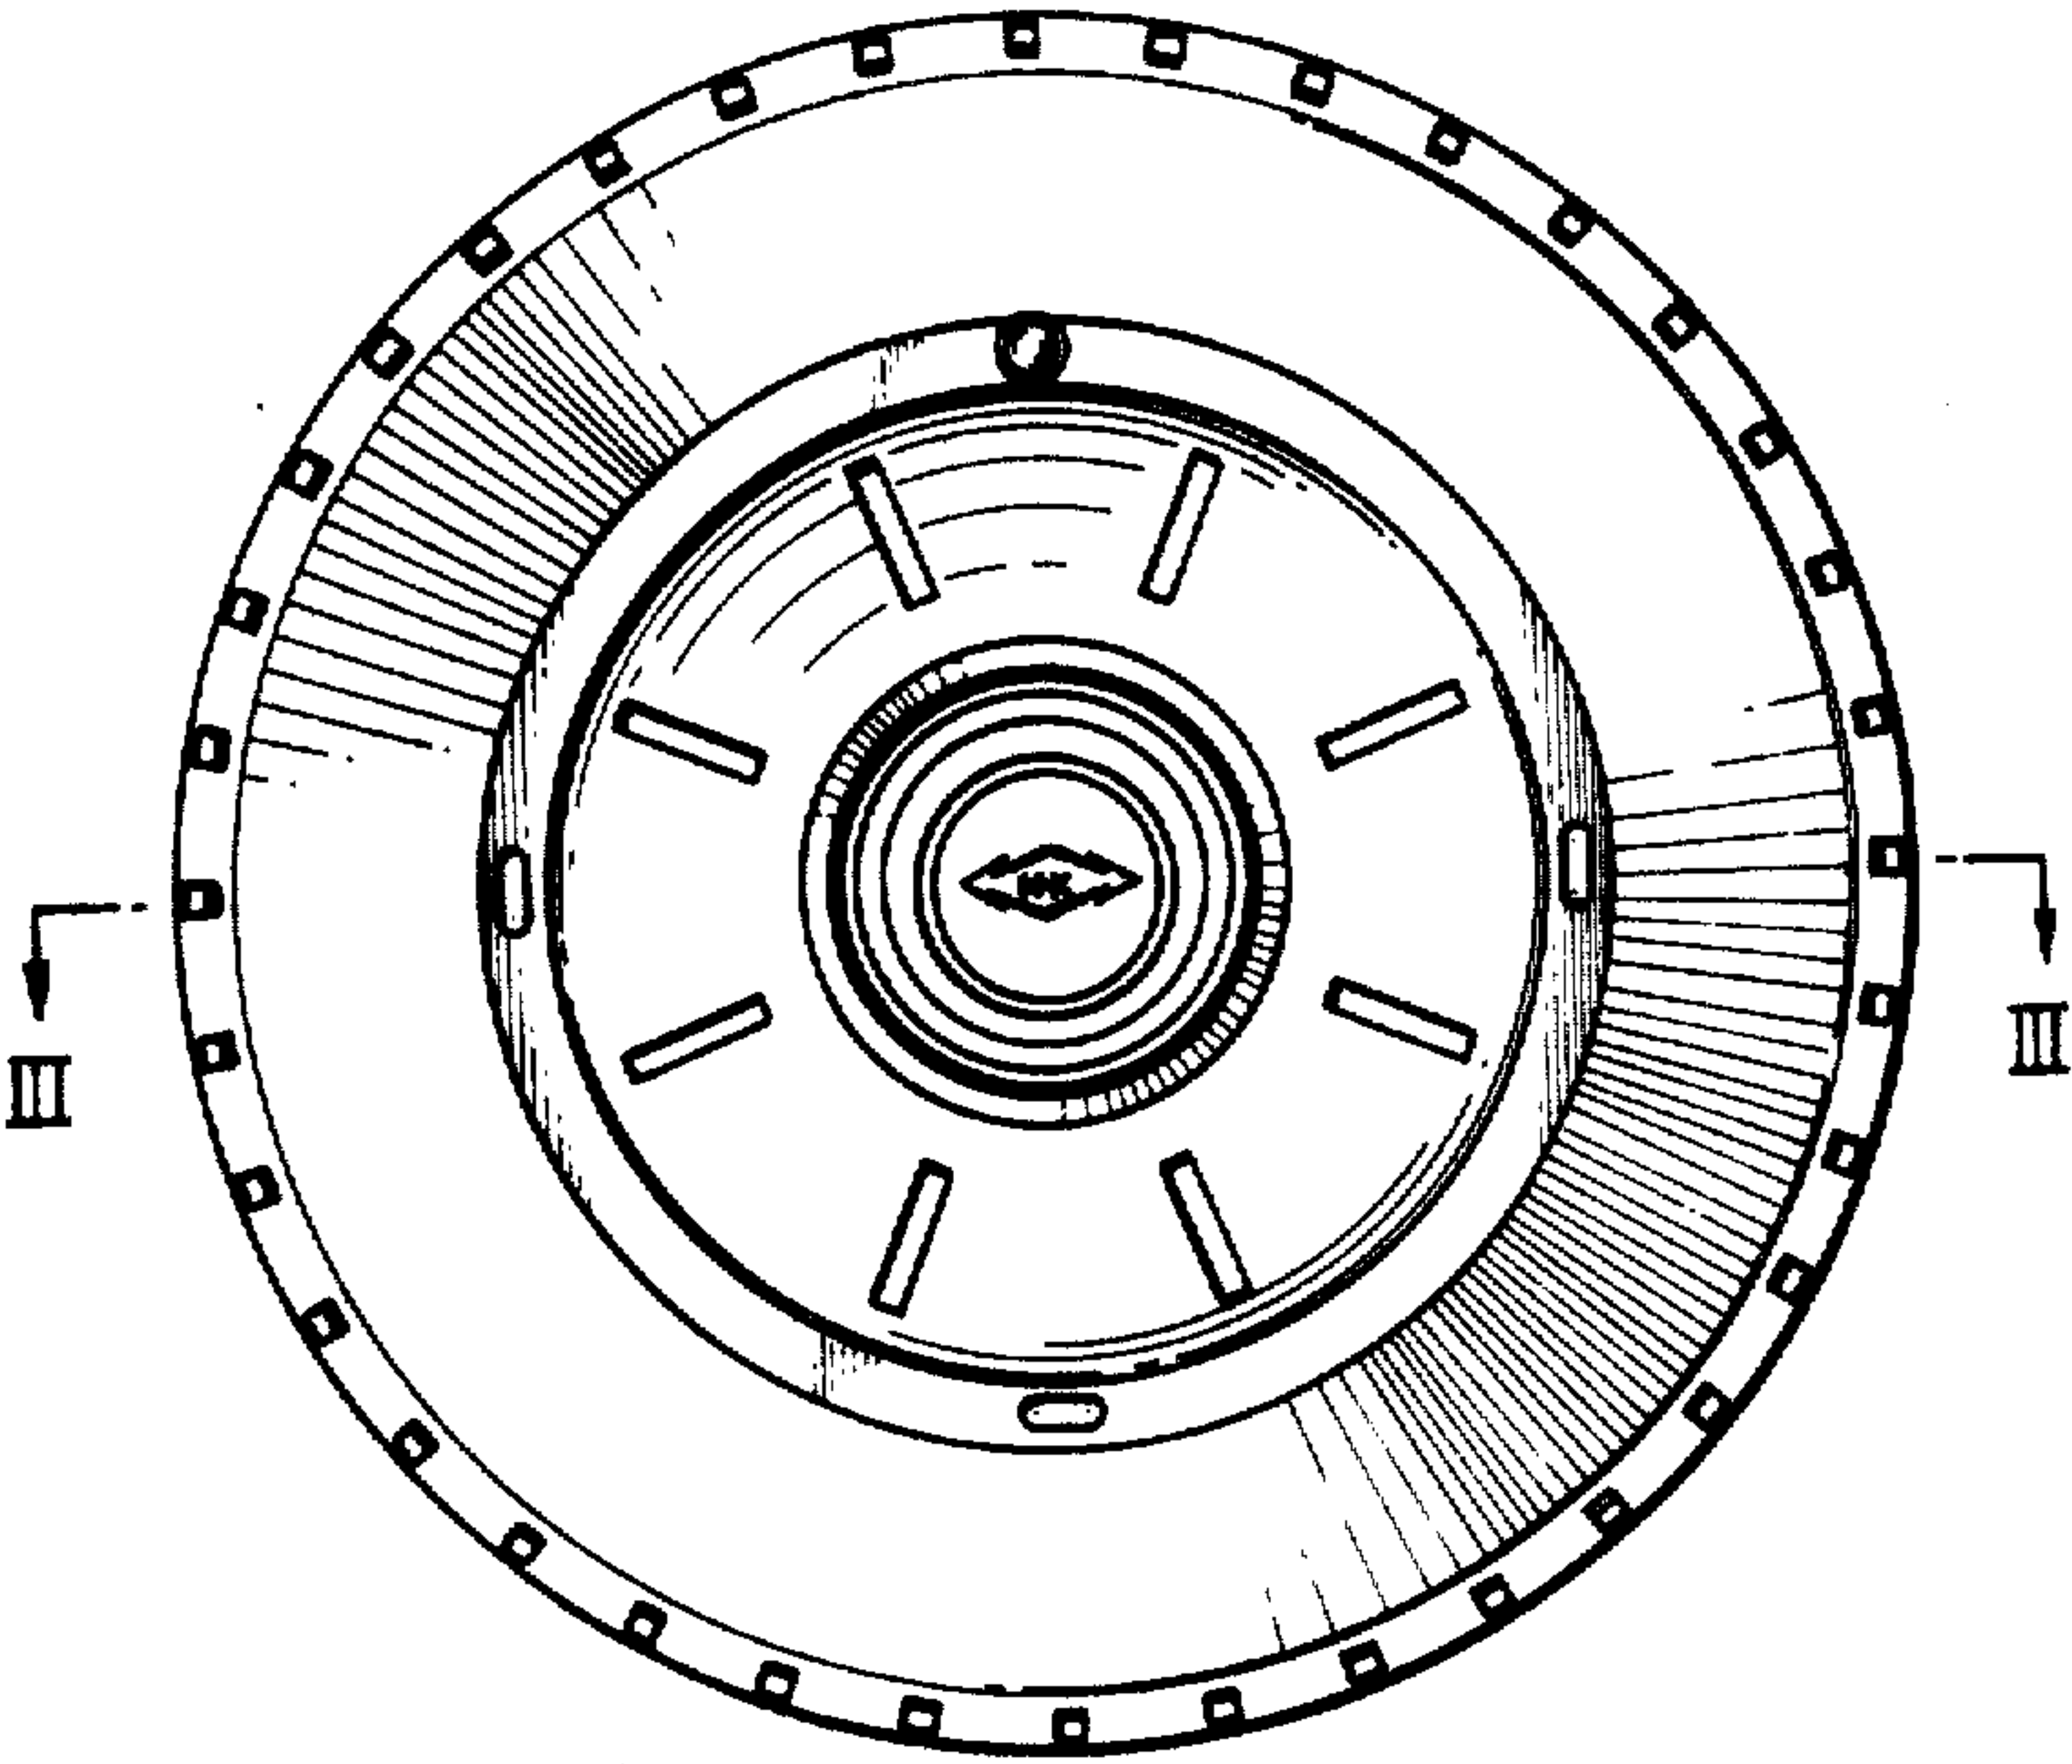


Fig. 2

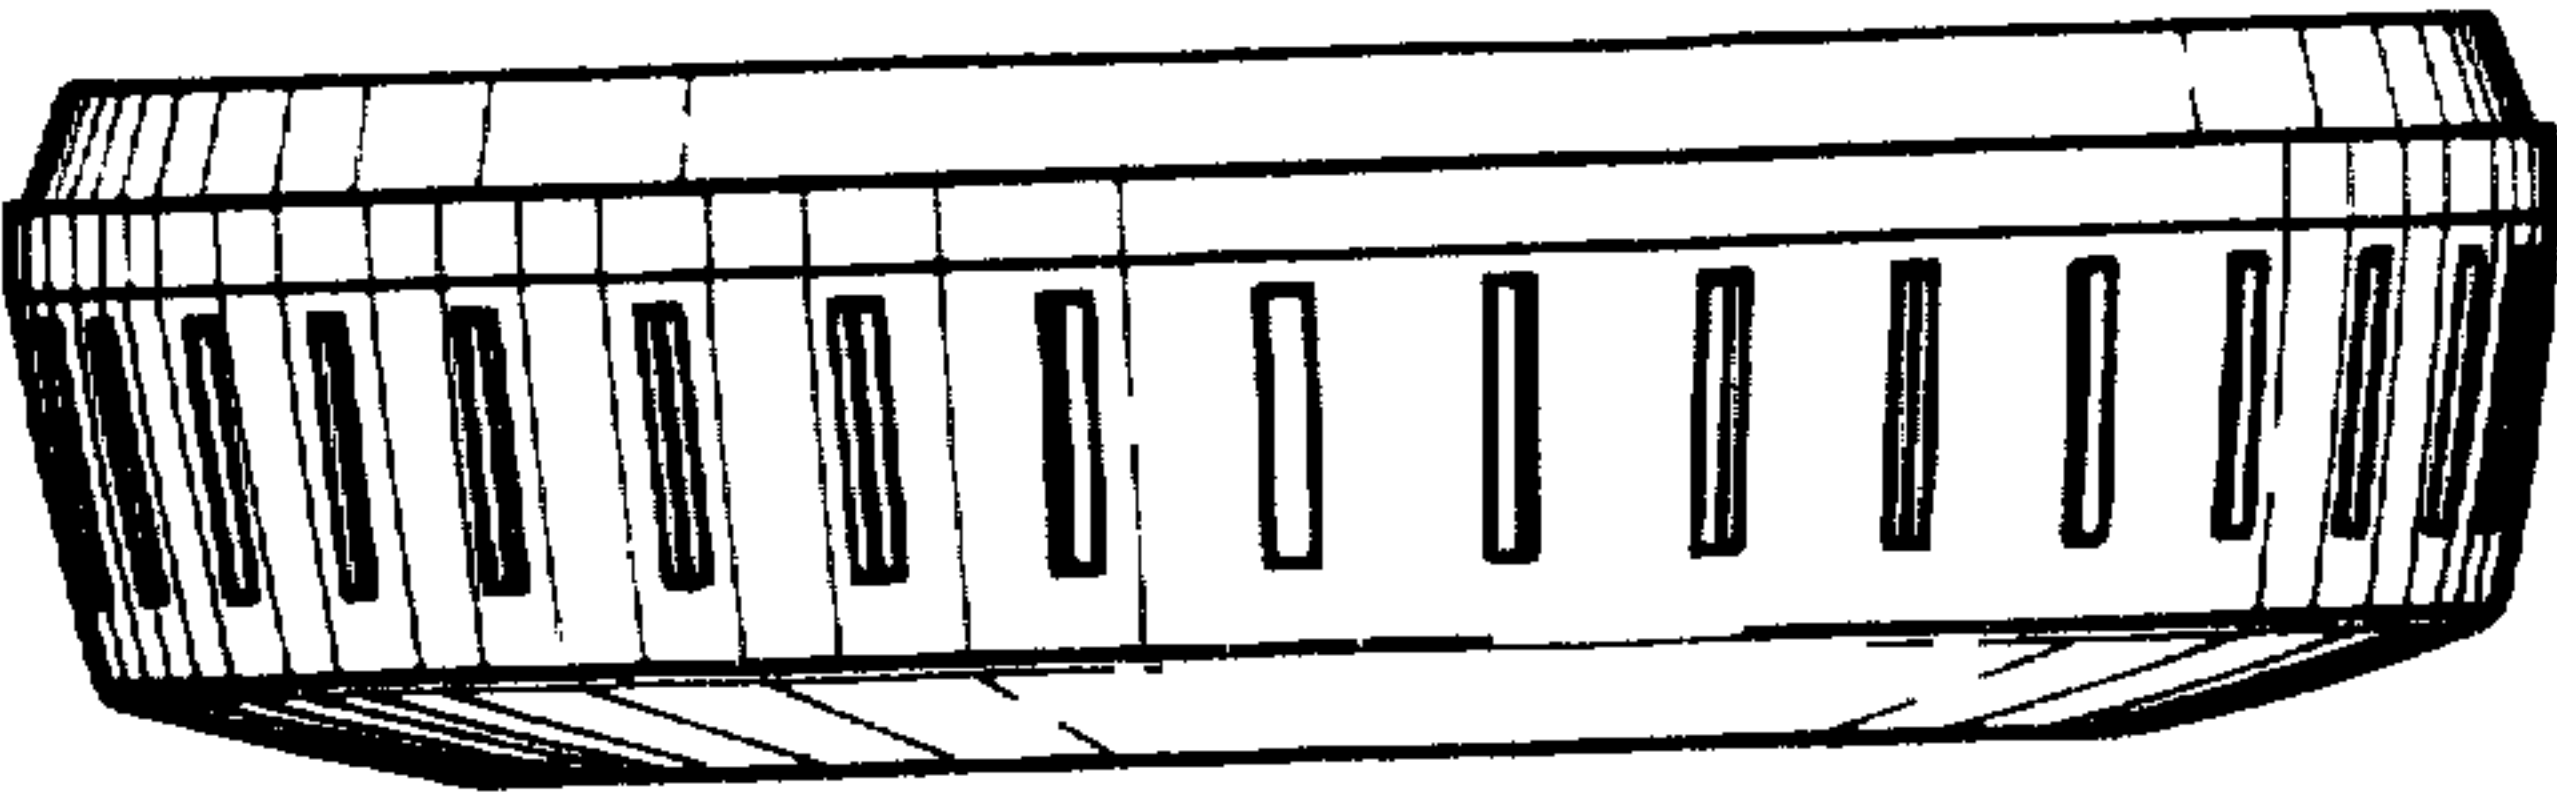


Fig. 3

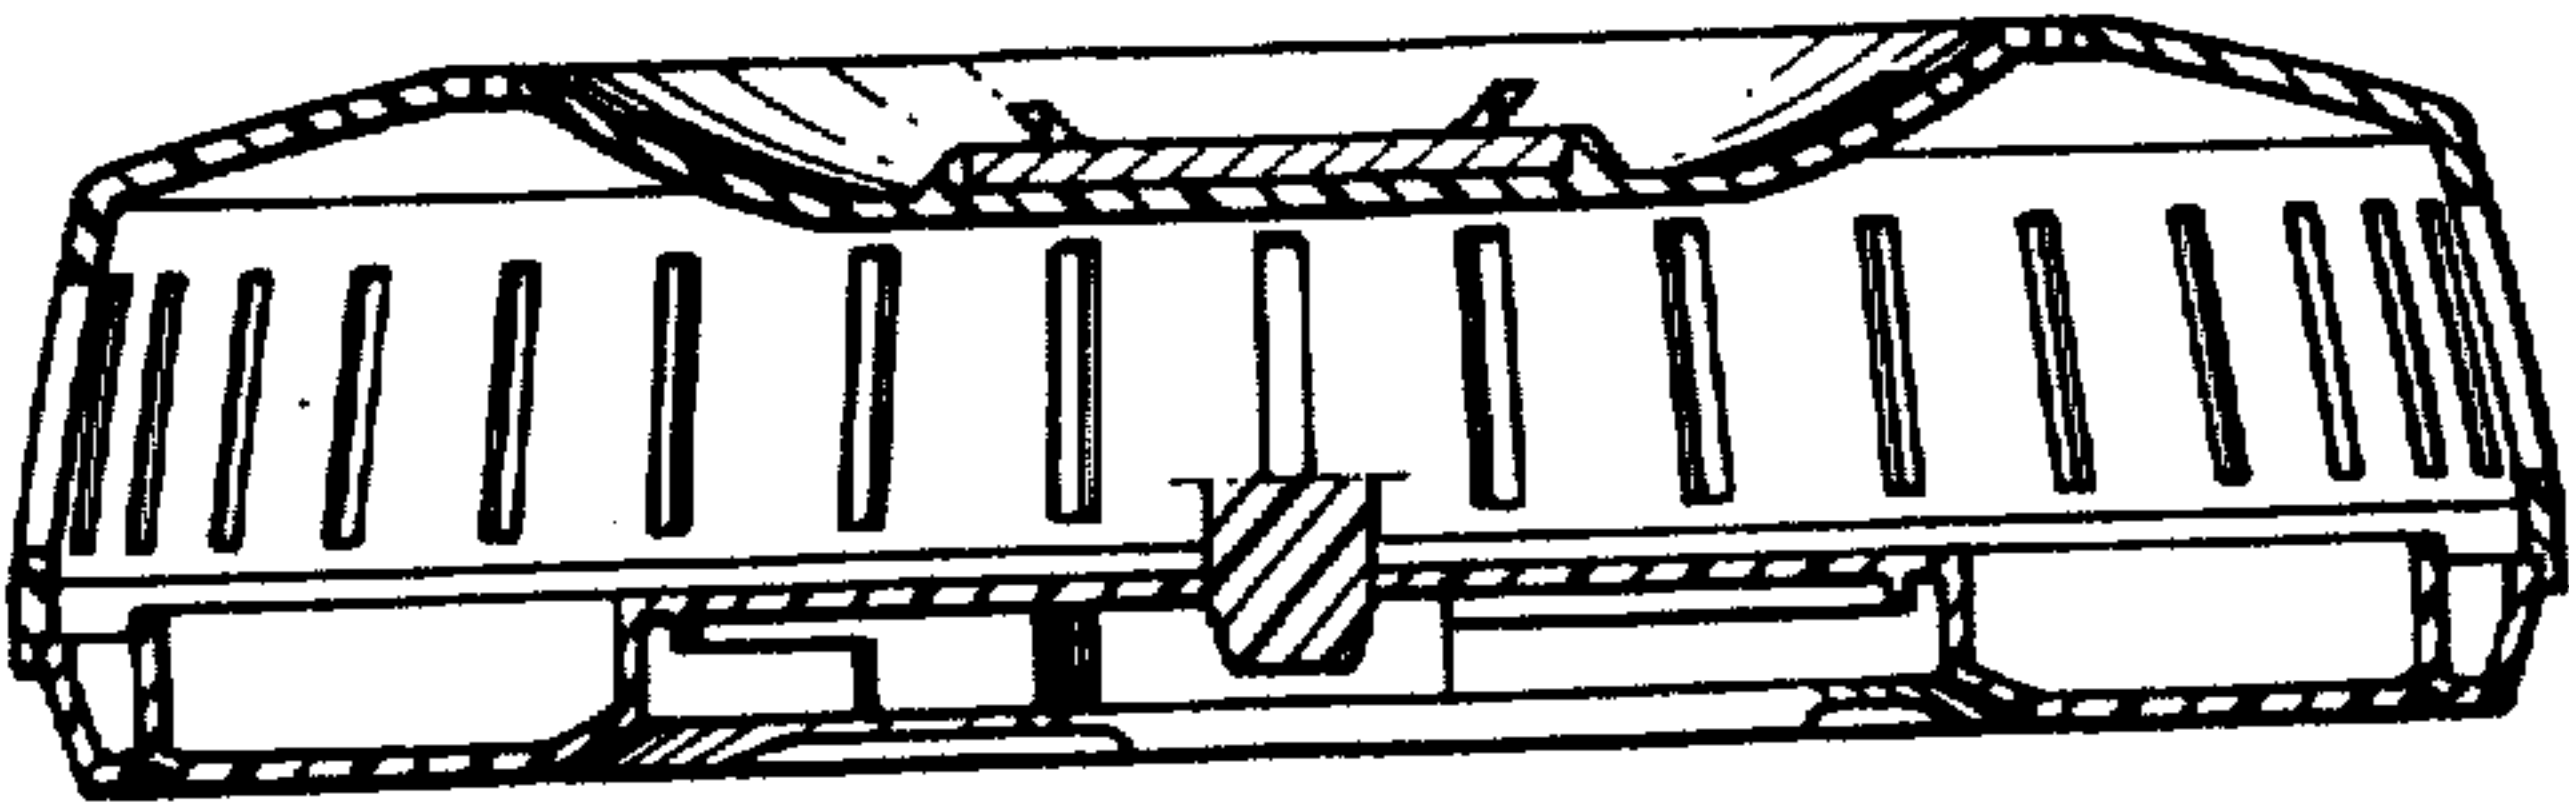


Fig. 4

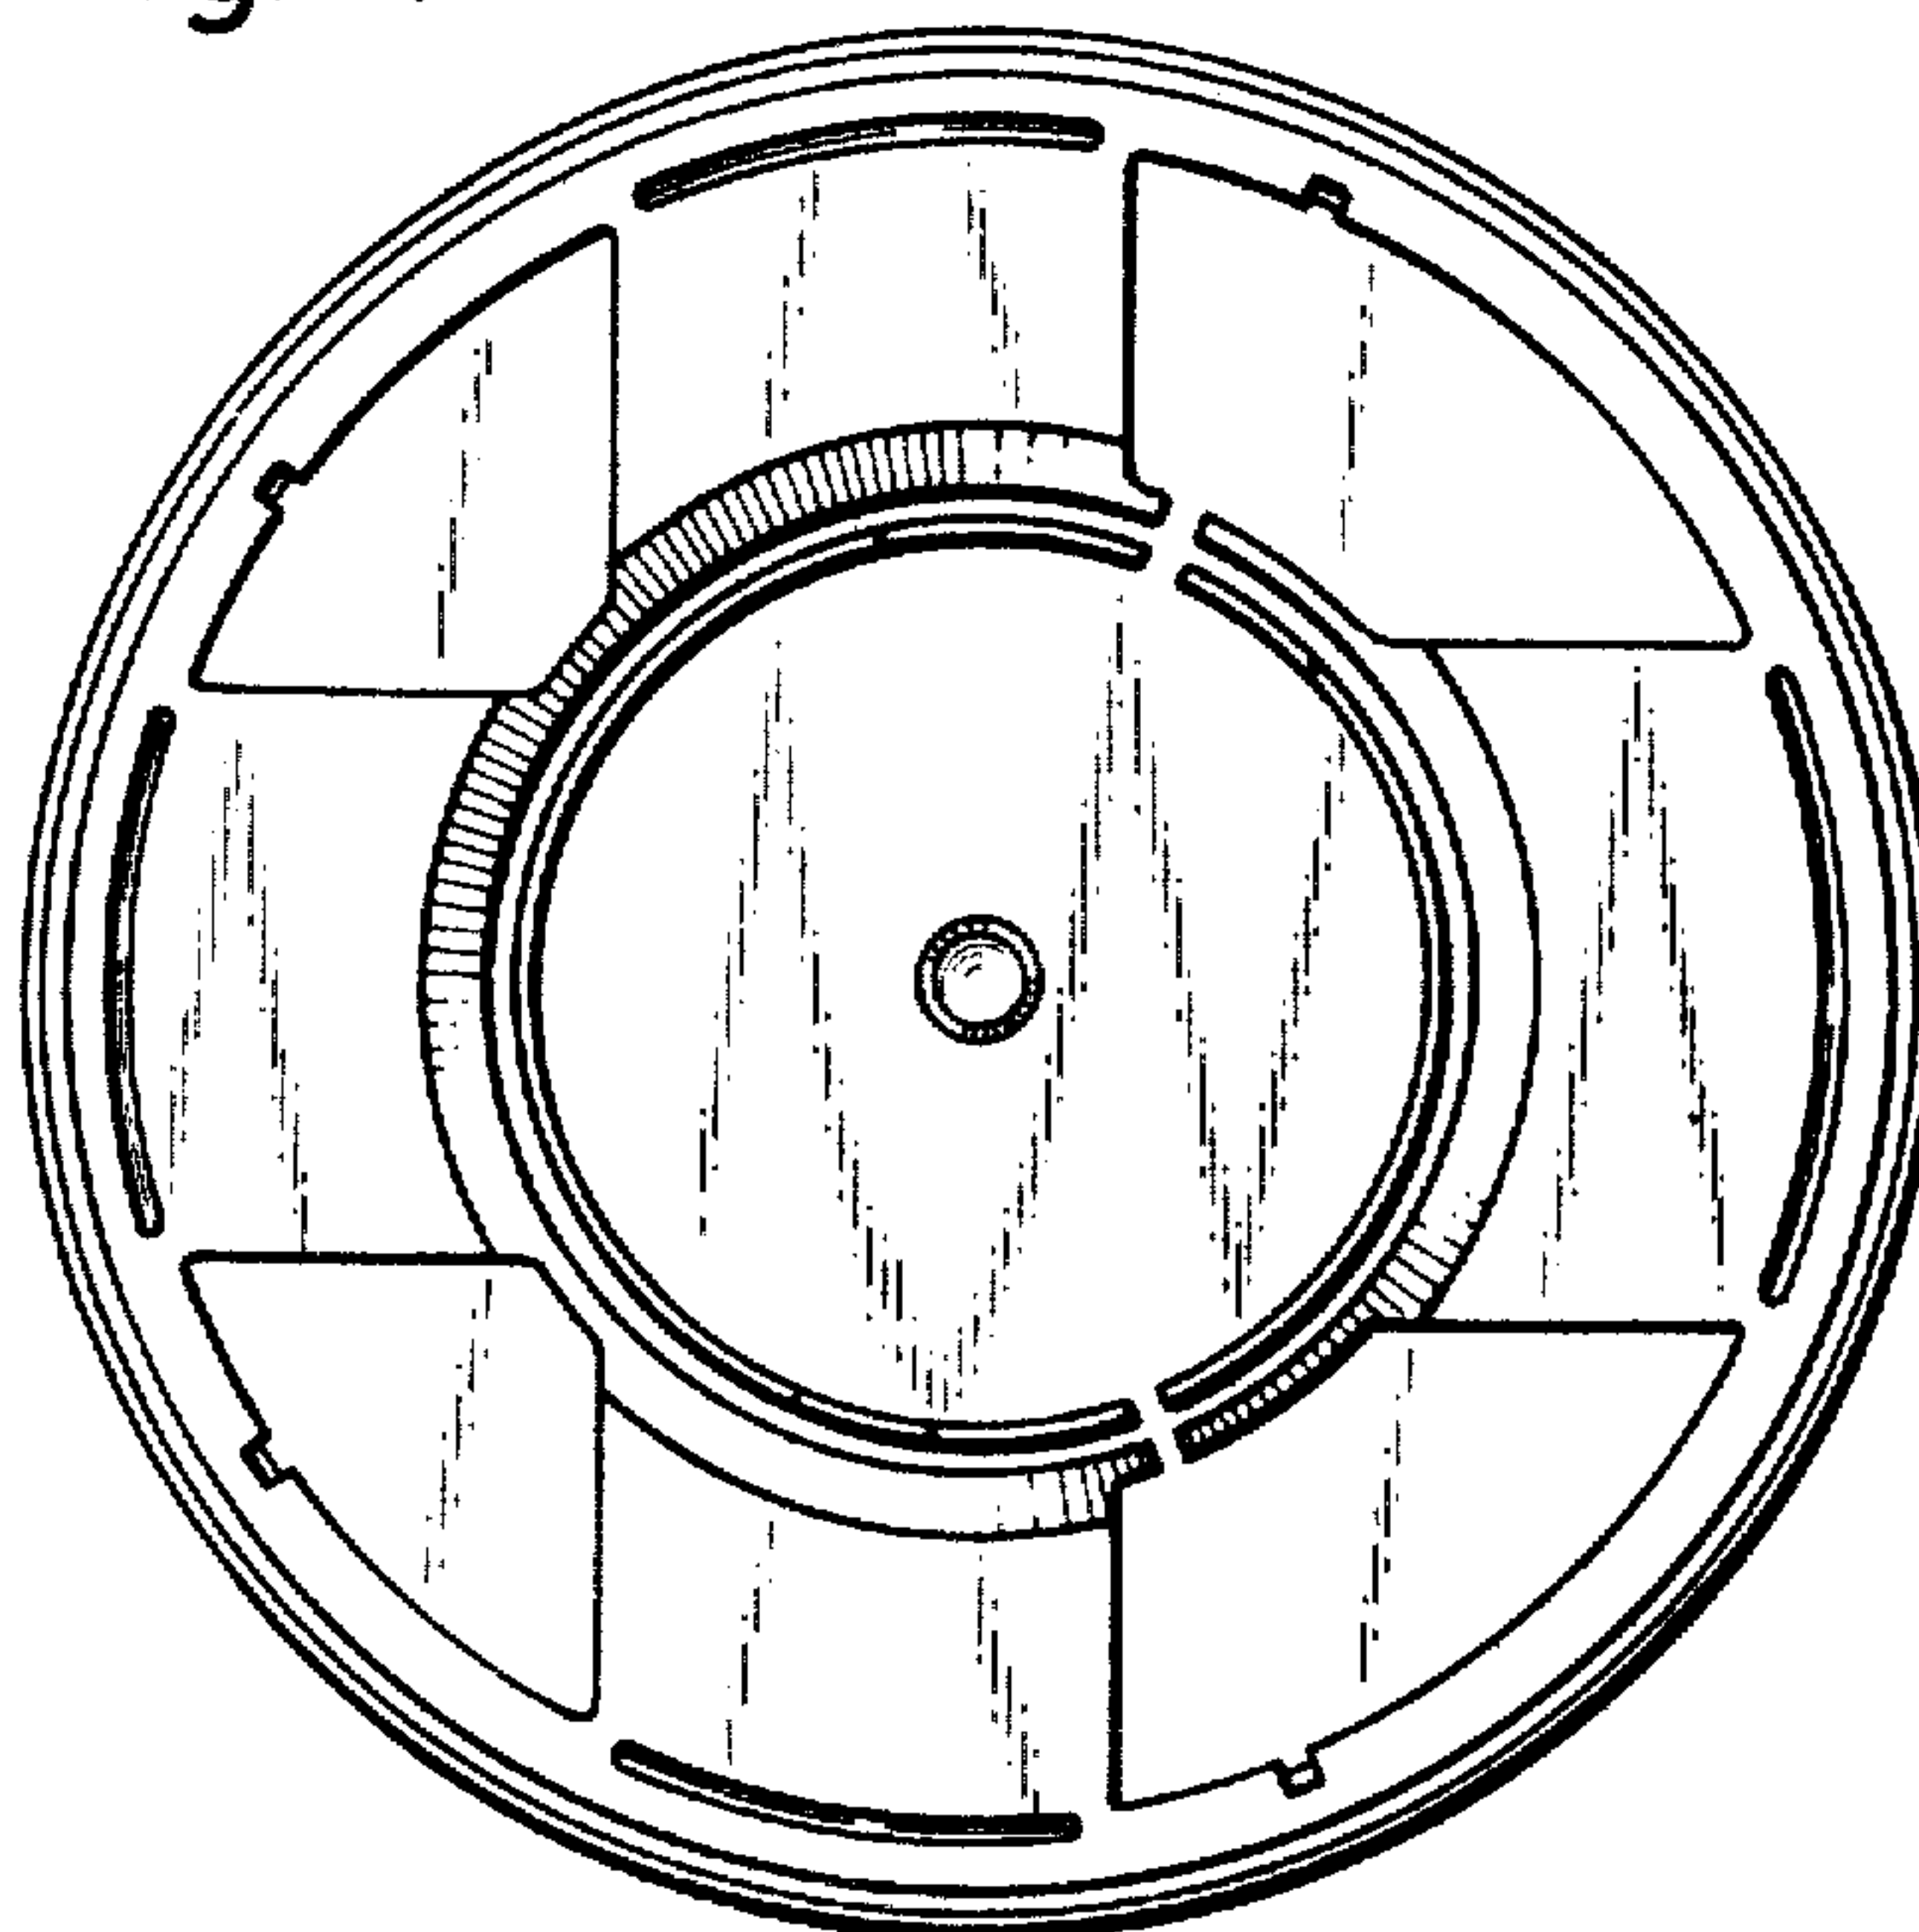


Fig. 5

