

[54] TEMPERATURE ACTIVATED ALARM FOR FIRE FIGHTERS

4,067,290 1/1978 Hartley ..... 116/99  
4,759,309 7/1988 Zexiker ..... 116/77

[75] Inventors: Frederick A. Parker, Pheasant Run; Mark P. Grady, Norristown, both of Pa.

[73] Assignee: Rampart Corporation, Hatboro, Pa.

[\*\*] Term: 14 Years

[21] Appl. No.: 152,059

[22] Filed: Feb. 4, 1988

[52] U.S. Cl. .... D10/106

[58] Field of Search ..... D10/106; 116/3, 6, 75, 116/77; 340/549, 573, 586, 321, 628, 541

[56] References Cited

U.S. PATENT DOCUMENTS

- D. 278,050 3/1985 Brenner et al. .... D10/106
- D. 280,494 9/1985 Abel ..... D10/106
- D. 283,684 5/1986 Francis ..... D10/106

OTHER PUBLICATIONS

Seatronics Inc. brochure: Thermalarm—a Temperature Alarm for Fire Fighters.


Primary Examiner—Wallace R. Burke  
Assistant Examiner—Marcus Jackson  
Attorney, Agent, or Firm—William H. Eilberg

[57] CLAIM

The ornamental design for temperature activated alarm for fire fighters, as shown and described.

DESCRIPTION

FIG. 1 is a perspective view of a temperature activated alarm for fire fighters showing my new design; FIG. 2 is a front elevational view thereof; FIG. 3 is a side elevational view thereof; FIG. 4 is a rear elevational view thereof; FIG. 5 is a top plan view thereof; FIG. 6 is a bottom plan view thereof.

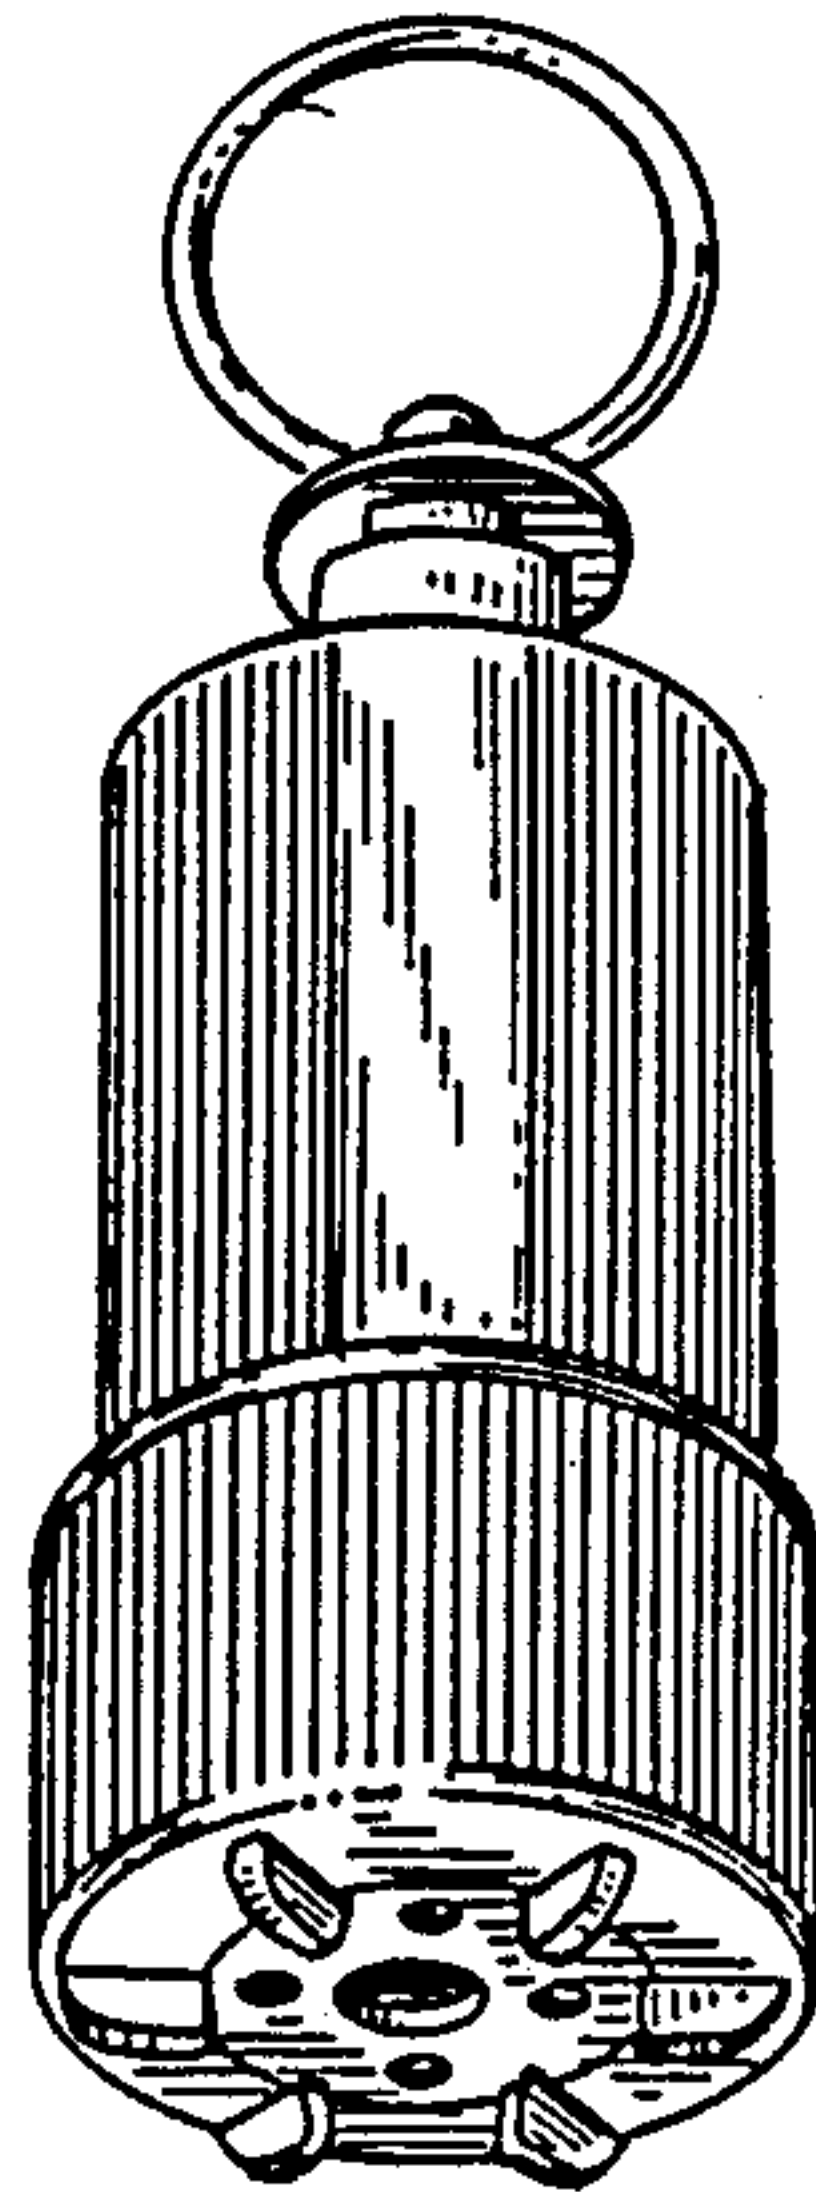

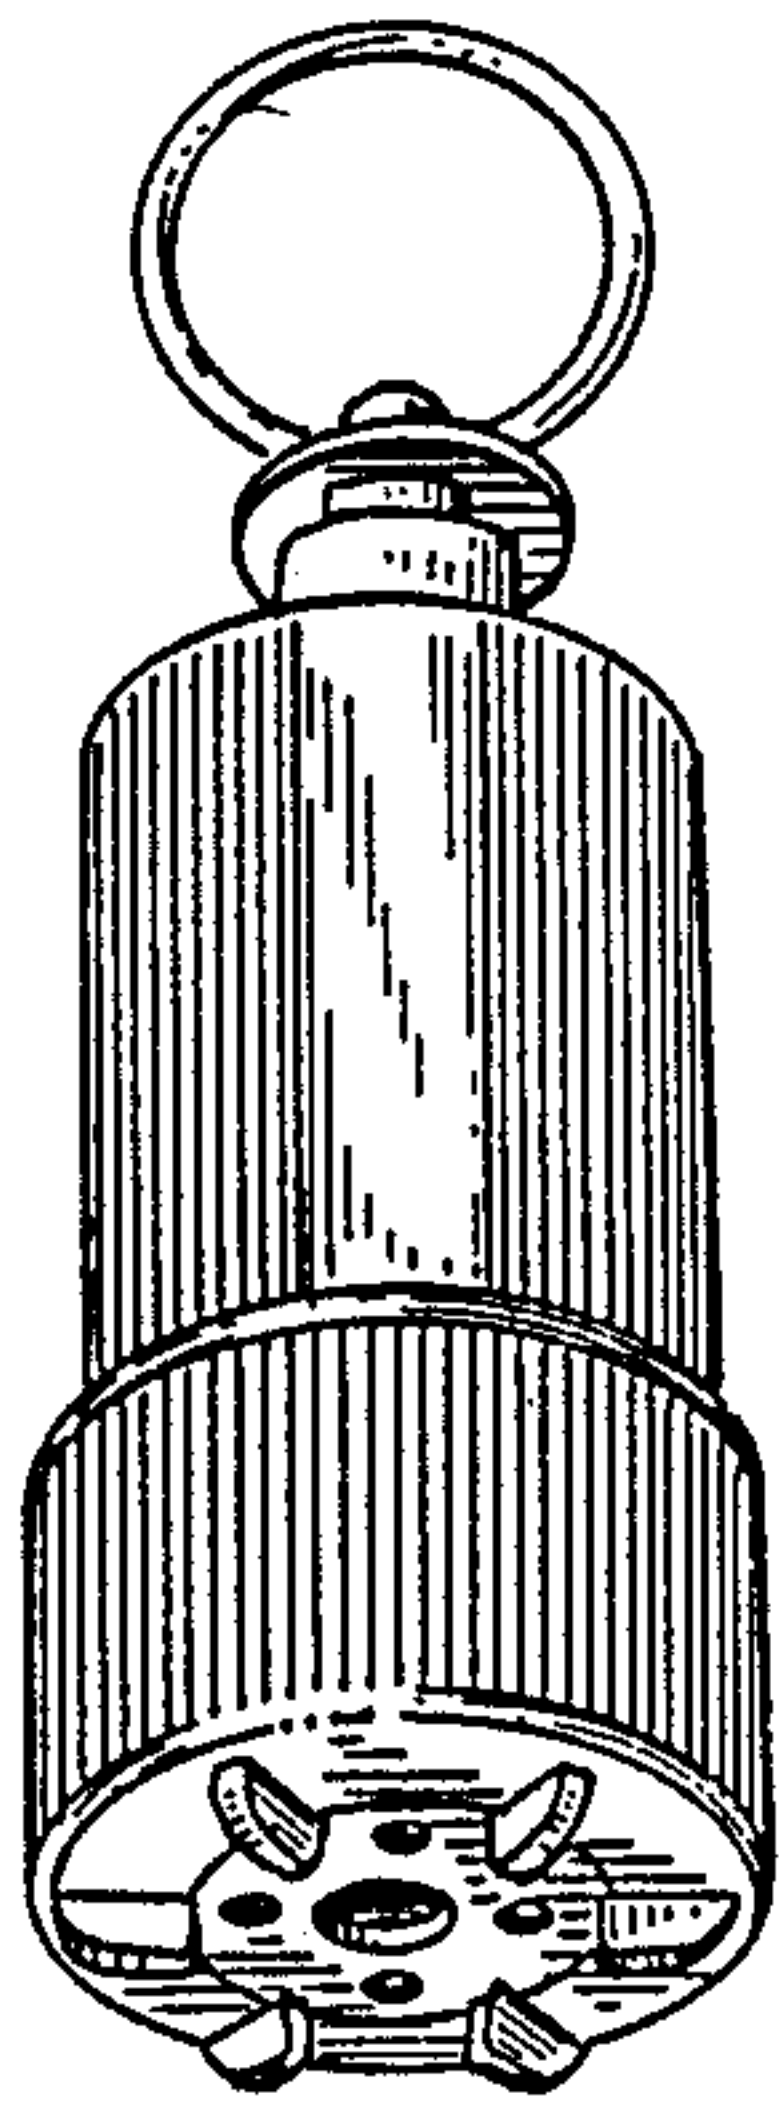


Fig. 1

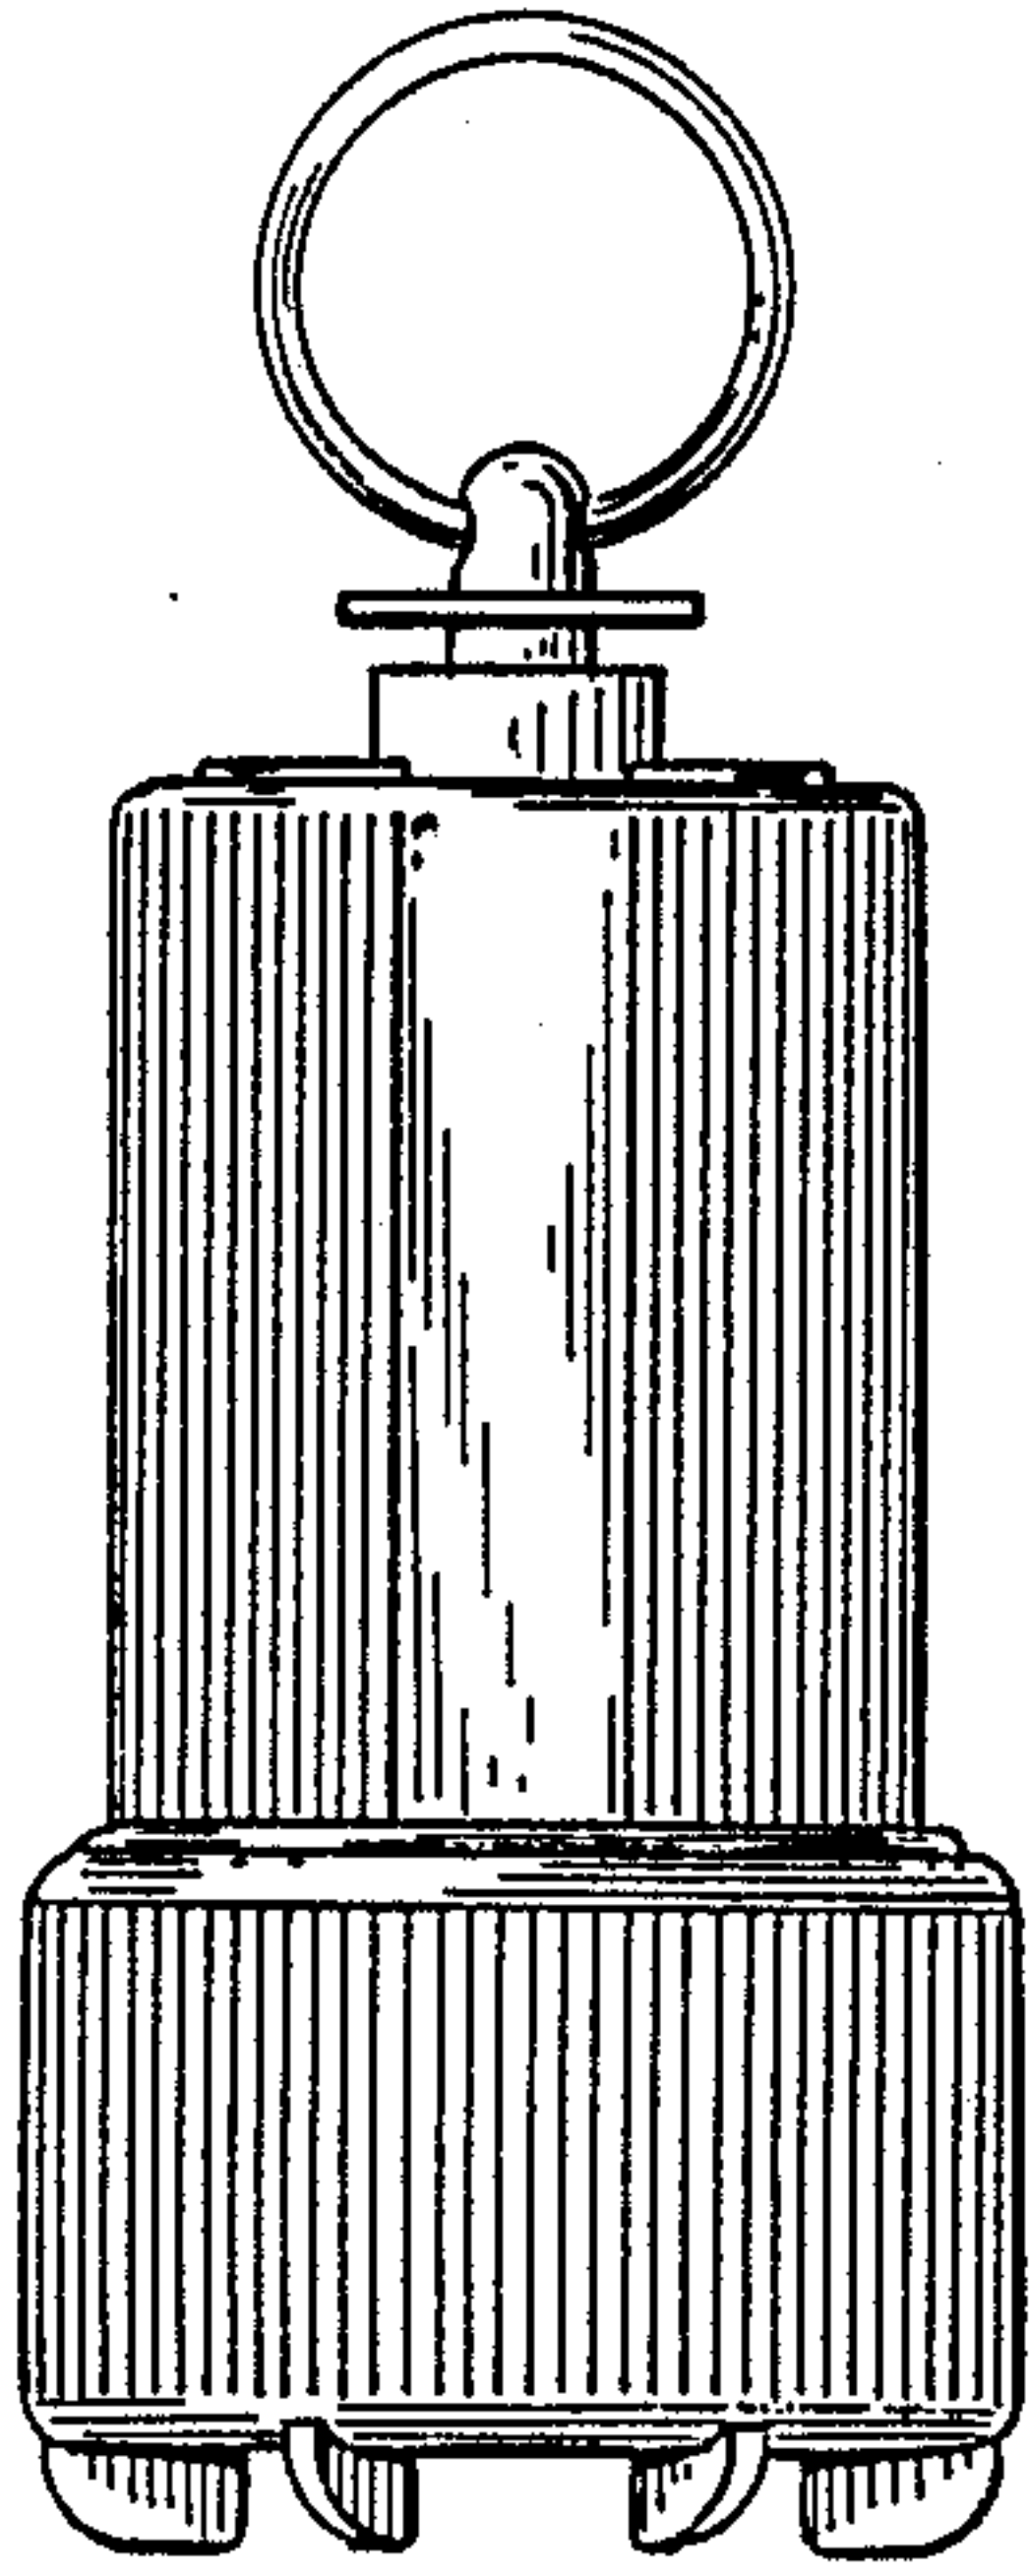


Fig. 2

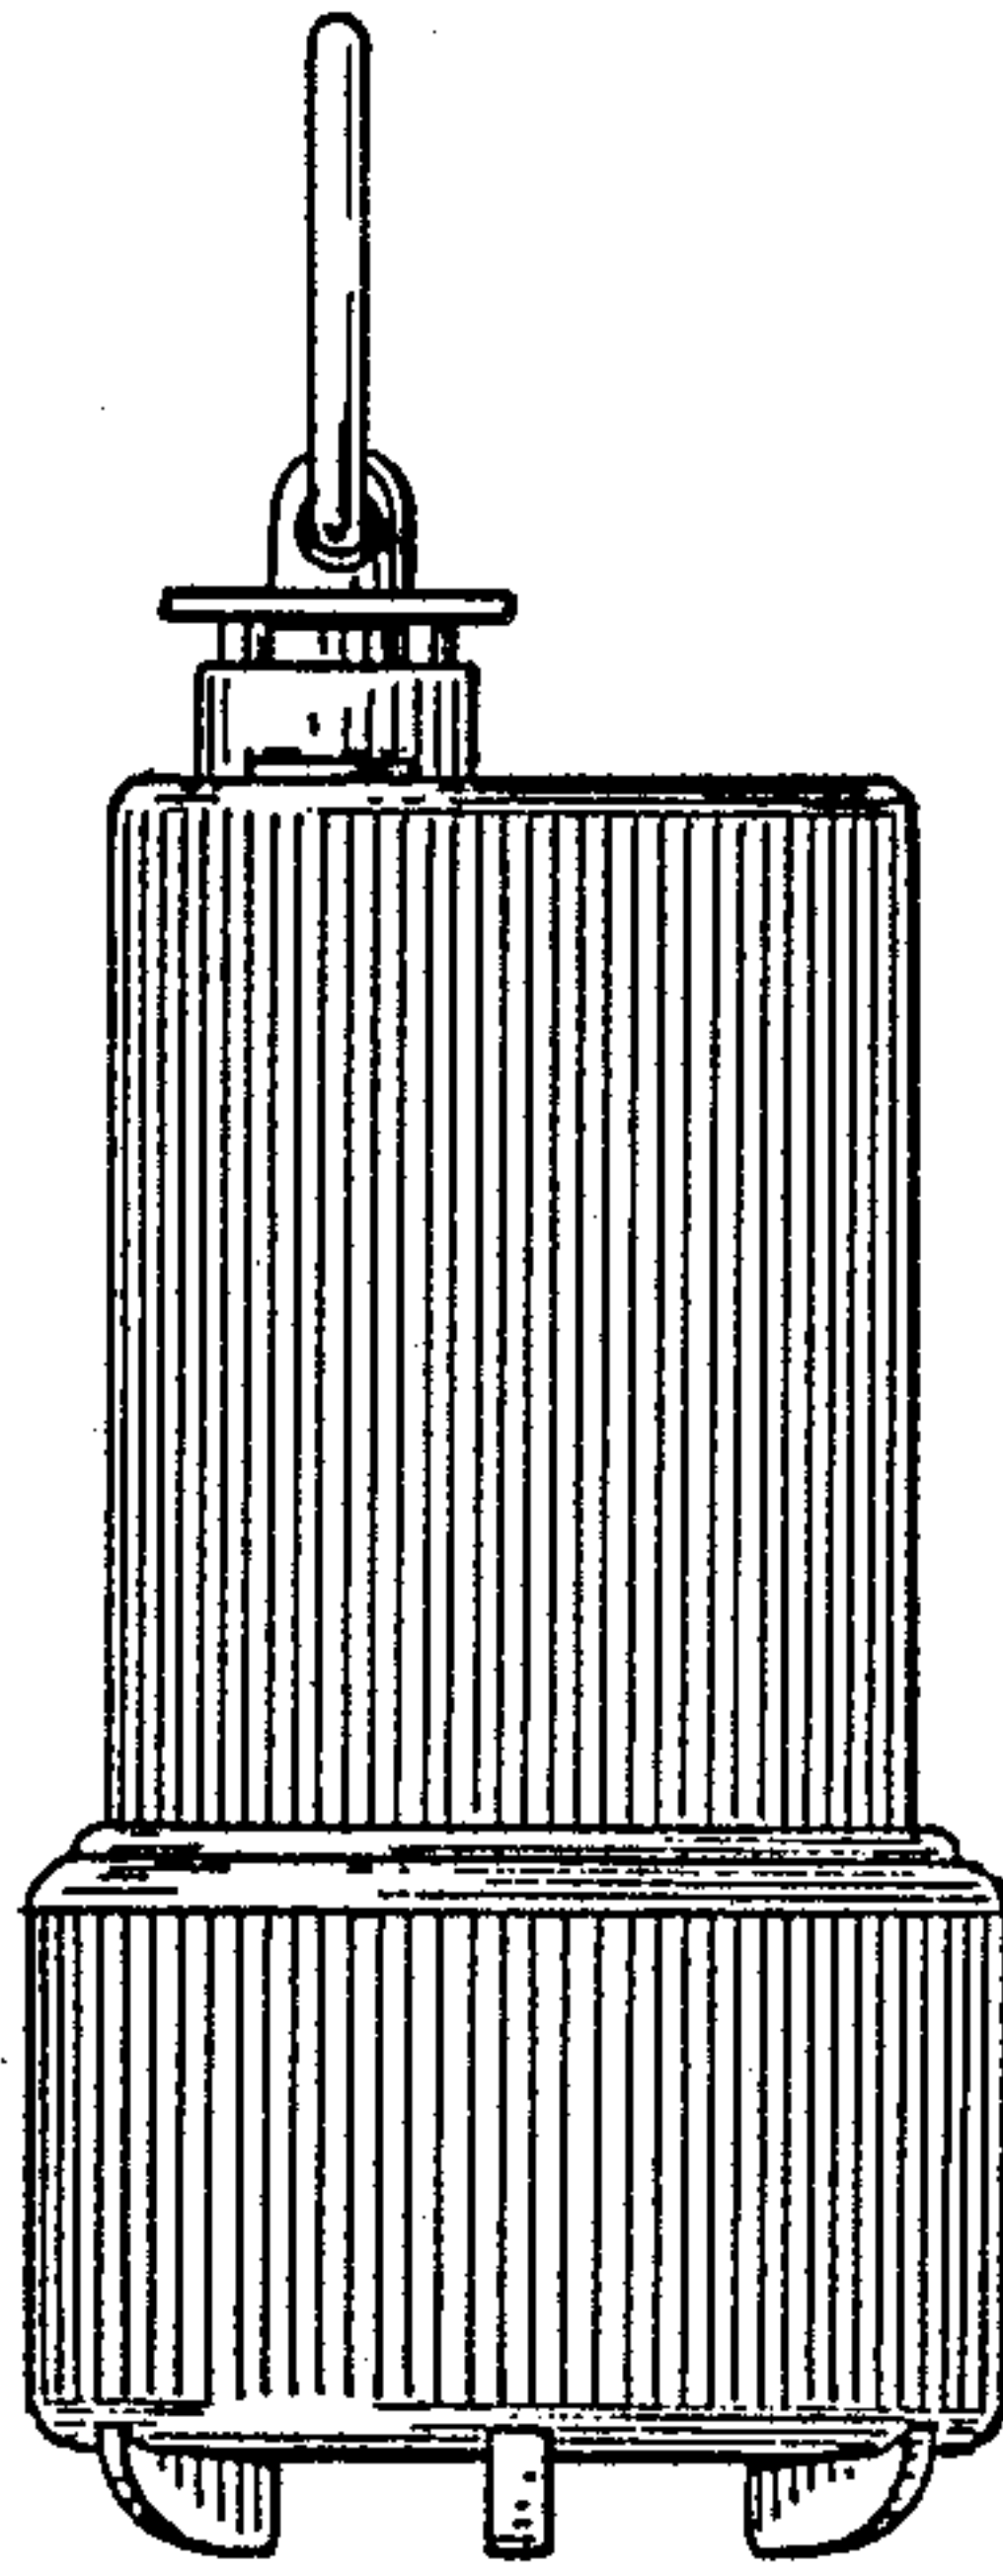


Fig. 3

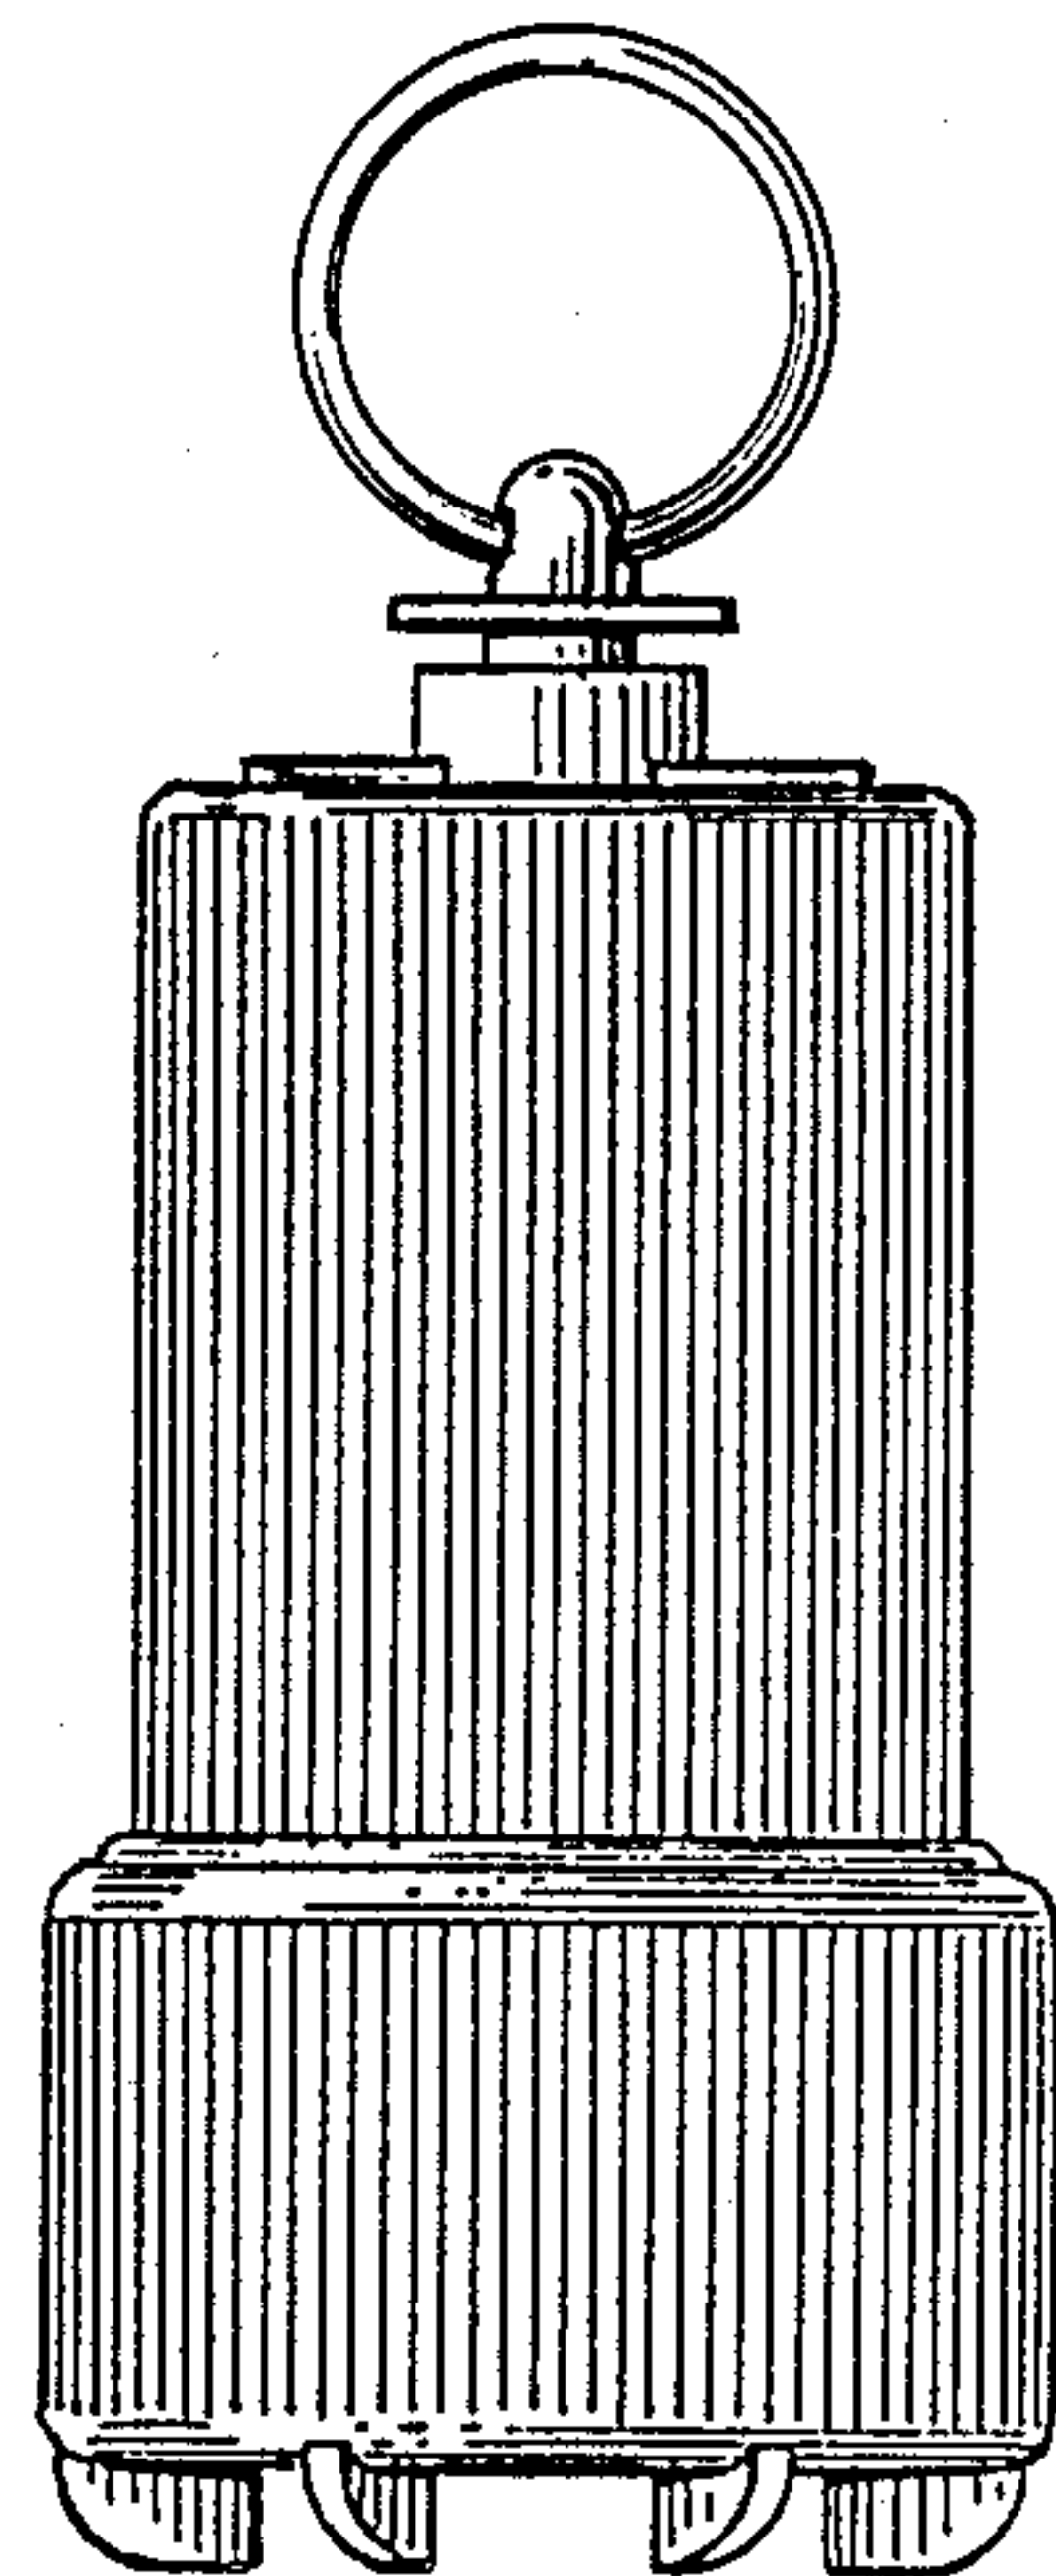


Fig. 4

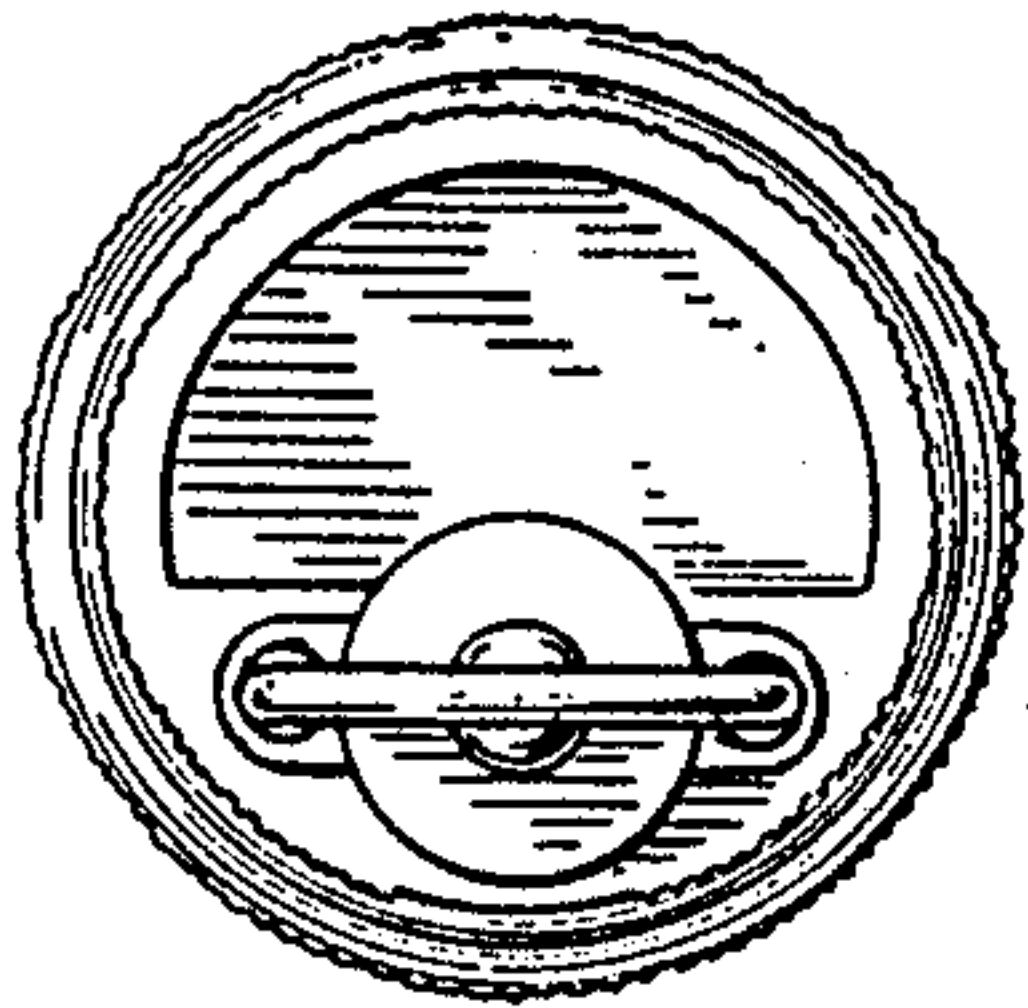


Fig. 5

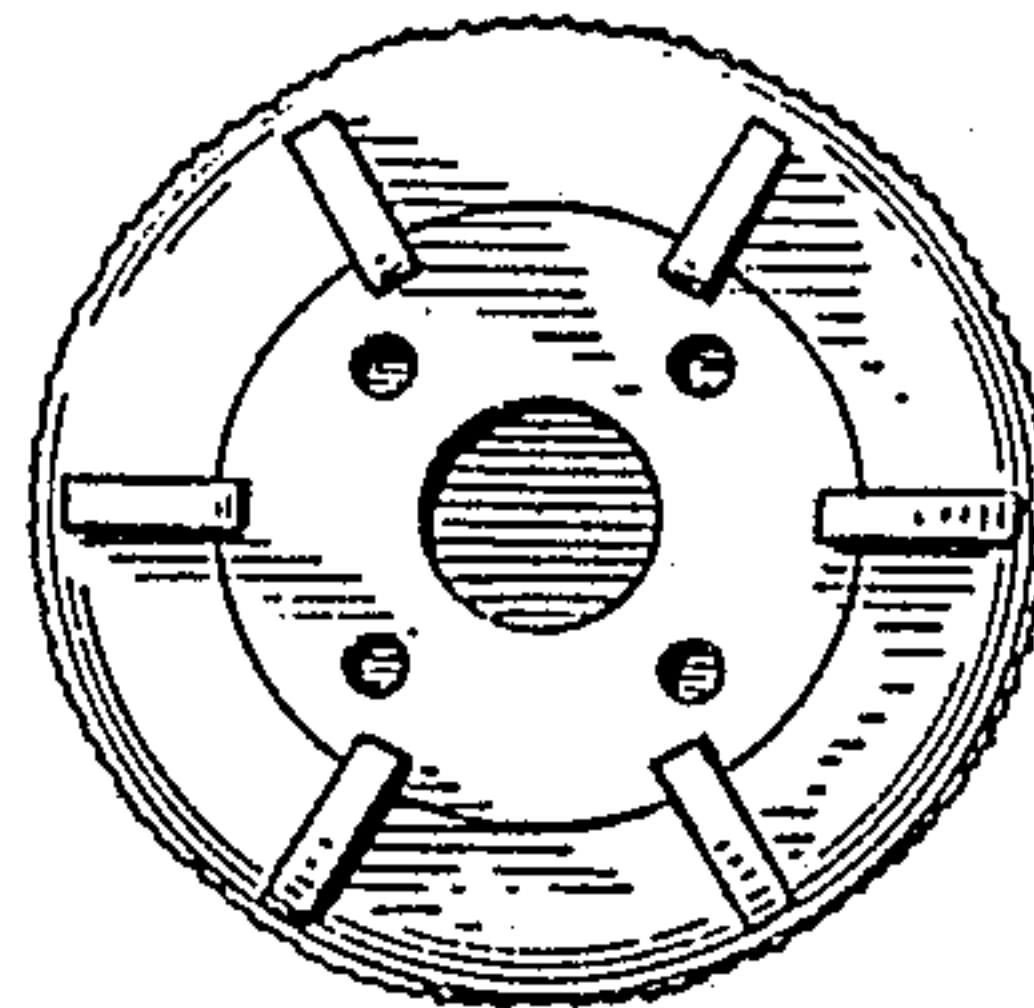


Fig. 6