

US00D393487S

United States Patent [19]
Cunitz et al.

[11] **Patent Number:** **Des. 393,487**
[45] **Date of Patent:** ****Apr. 14, 1998**

[54] **AIR CONDITIONER CORD WARNING LABEL**
[76] **Inventors:** **Robert J. Cunitz**, 5205 Trailway Dr., Rockville, Md. 20853; **Shelley Waters Deppa**, 18417 Shady View La., Brookeville, Md. 20833; **William P. Lightfoot**, 2020 K St., N.W., Suite 500, Washington, D.C. 20006; **Paulette E. Chapman**, 2020 K St., N.W., Suite 500, Washington, D.C. 20006; **Victor E. Long**, 2020 K St., N.W., Suite 500, Washington, D.C. 20006

[**] **Term:** **14 Years**

[21] **Appl. No.:** **68,957**
[22] **Filed:** **Apr. 15, 1997**

[51] **LOC (6) Cl.** **19-08**
[52] **U.S. Cl.** **D20/25; D20/22; D20/40; D20/27**
[58] **Field of Search** **D20/10, 11, 22, D20/24, 27, 40, 42, 25; D10/109, 114; 283/81, 75, 114, 109, 900; 40/124.1, 630, 299, 638**

[56] **References Cited**
U.S. PATENT DOCUMENTS
D. 305,673 1/1990 Davidson et al. D20/42
D. 338,044 8/1993 Rusiewicz, Jr. D20/40

OTHER PUBLICATIONS
Sign attachment sets and Floor signs—Items FL32 and WLC1, Setons Catalog, p. J53, Aug. 1987.
Primary Examiner—Susan J. Lucas
Assistant Examiner—Jennifer Regester

[57] **CLAIM**
The ornamental design for an air conditioner cord warning label, as shown and described.

DESCRIPTION
FIG. 1 is a front elevational view of an air conditioner cord warning label showing our new design; and, FIG. 2 is a rear elevational view of the air conditioner cord warning label.
The label has no substantial thickness and is black and white as shown in the Figures with the exception of the stippled areas which are solidly colored Safety Orange as defined by the American National Standard ANSI Z535.1-1991.

1 Claim, 1 Drawing Sheet

WARNING

TO AVOID OVERHEATING AND FIRE

(Continued)

when temporarily using an extension cord:

NEVER plug other products into extension cord outlets.
NEVER use more than one extension cord for the air conditioner.

PERMANENT use of an extension cord is **UNSAFE**.

Continued on other side. Do not remove this tag.

WARNING

FIRE AND ELECTRIC SHOCK HAZARD.
Extension cord use can cause serious injury or death.
SAFEST: PLUG AIR CONDITIONER DIRECTLY INTO WALL OUTLET. If plug cannot reach, have a new outlet installed before using this product. We strongly recommend you do not use an extension cord.
LESS SAFE: Use of an extension cord before a new outlet is actually installed. If you must use an extension cord, use only the shortest possible cord with three prongs and a tag on the cord marked: **15A** (Amps or Amperes) and **"UL"** (Underwriters Laboratories).
Follow diagram on the other side.

Continued on other side. Do not remove this tag.

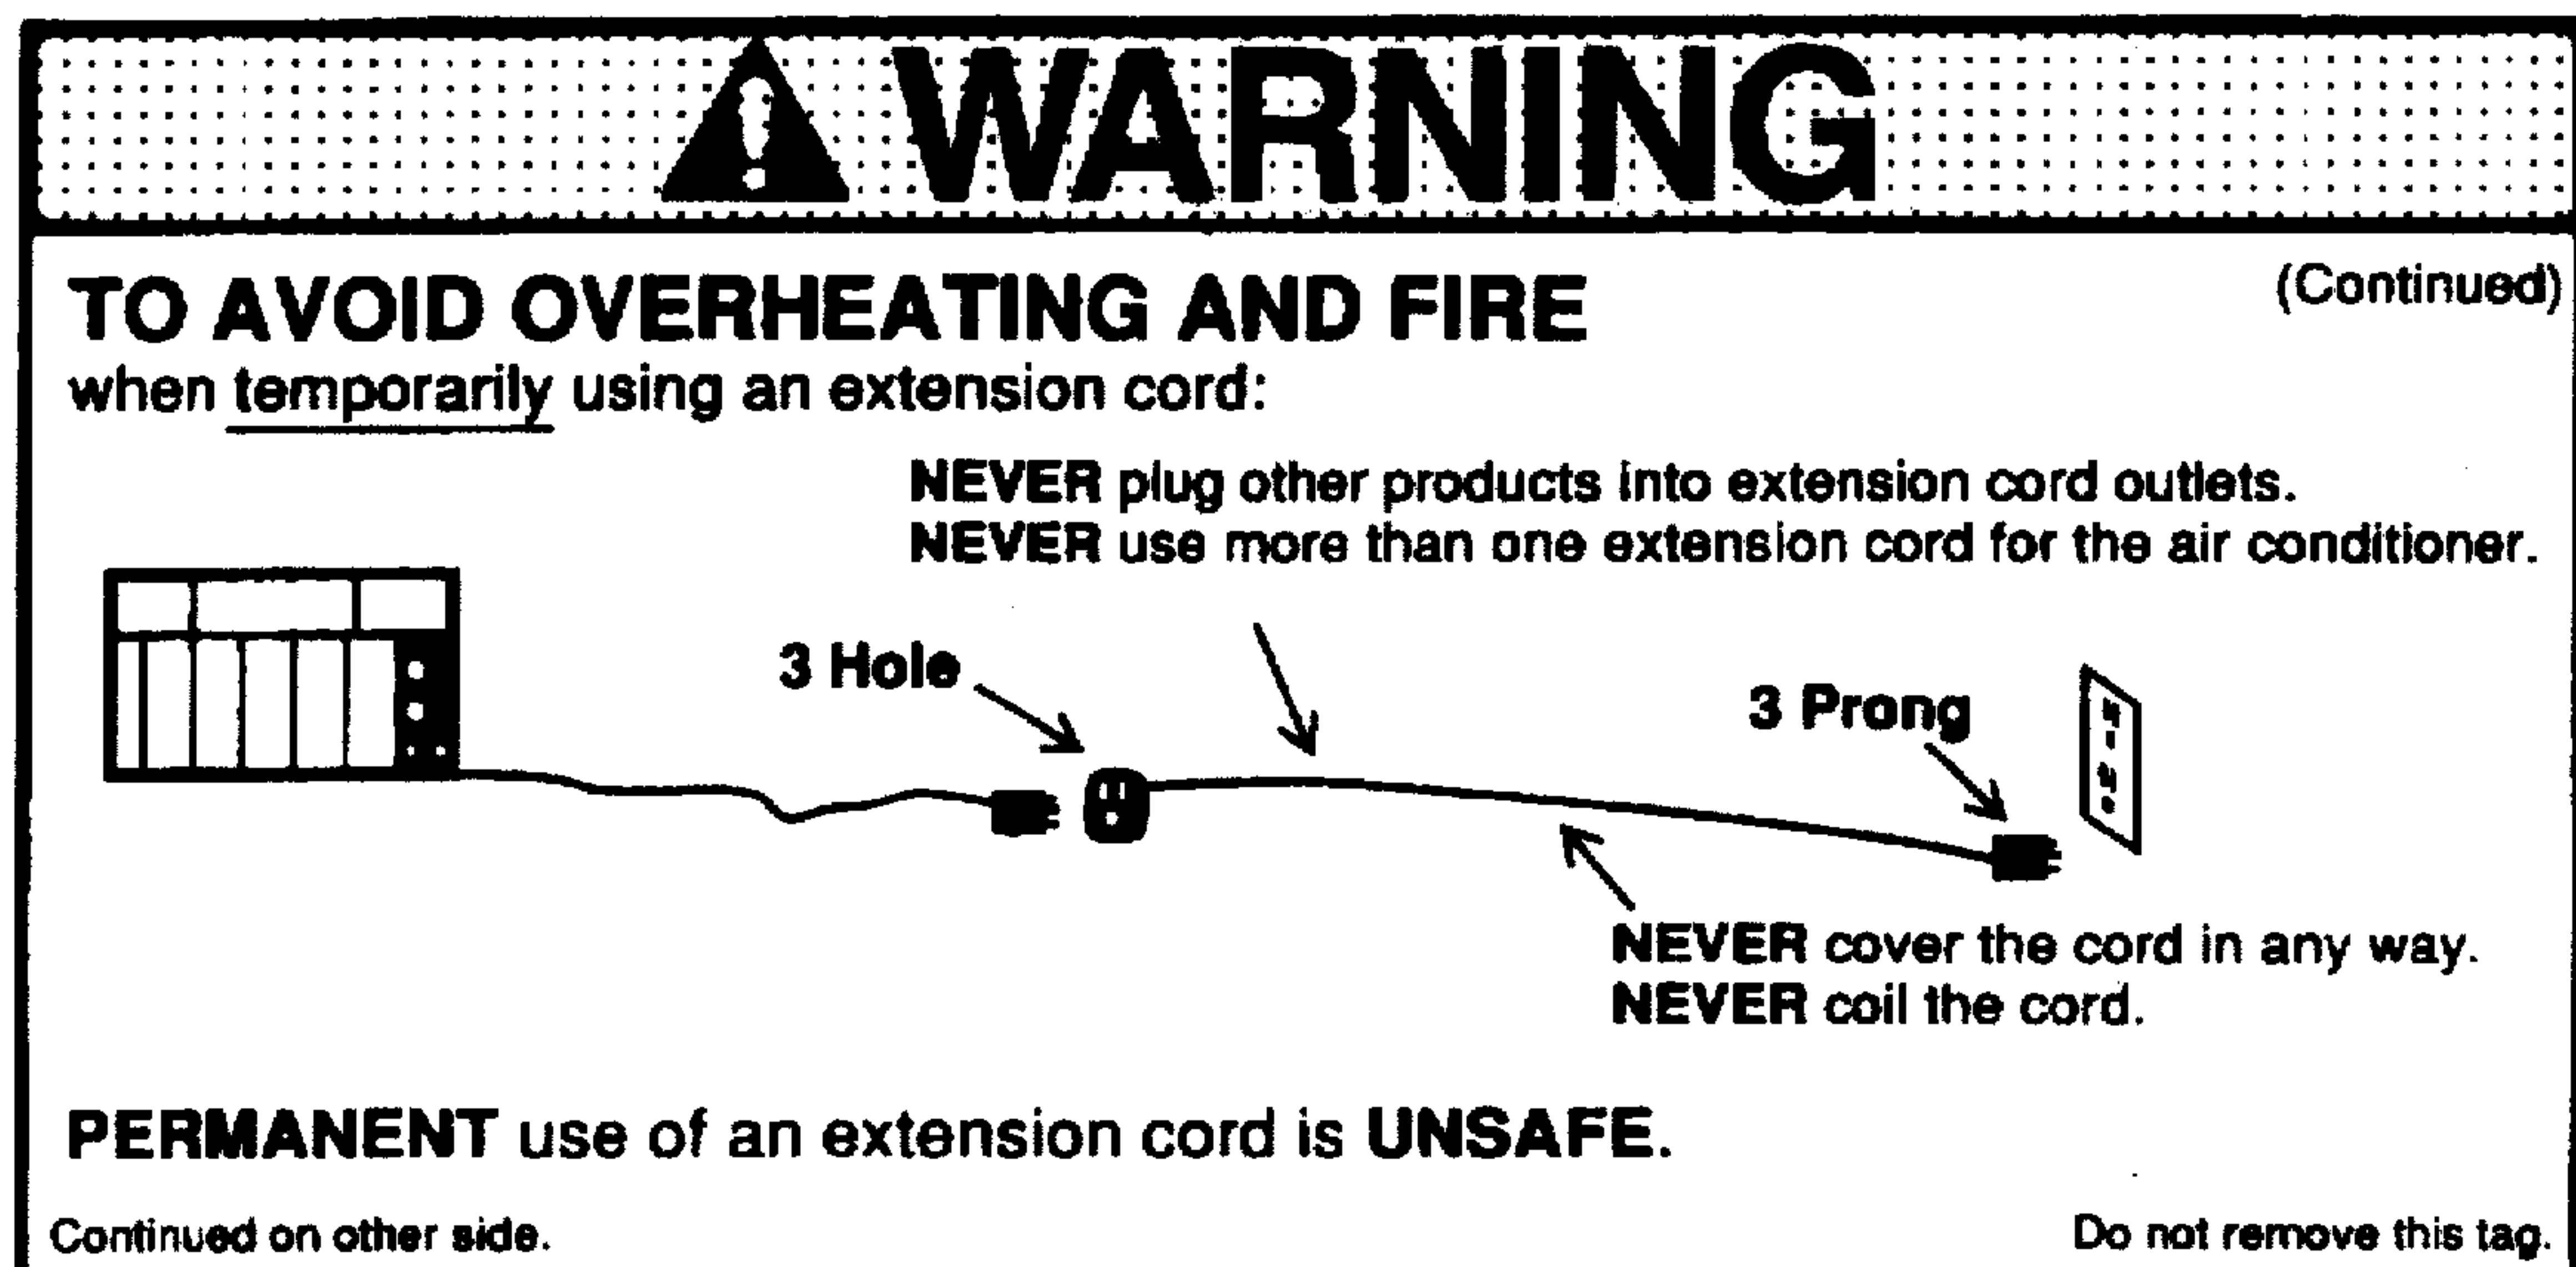


Fig. 1

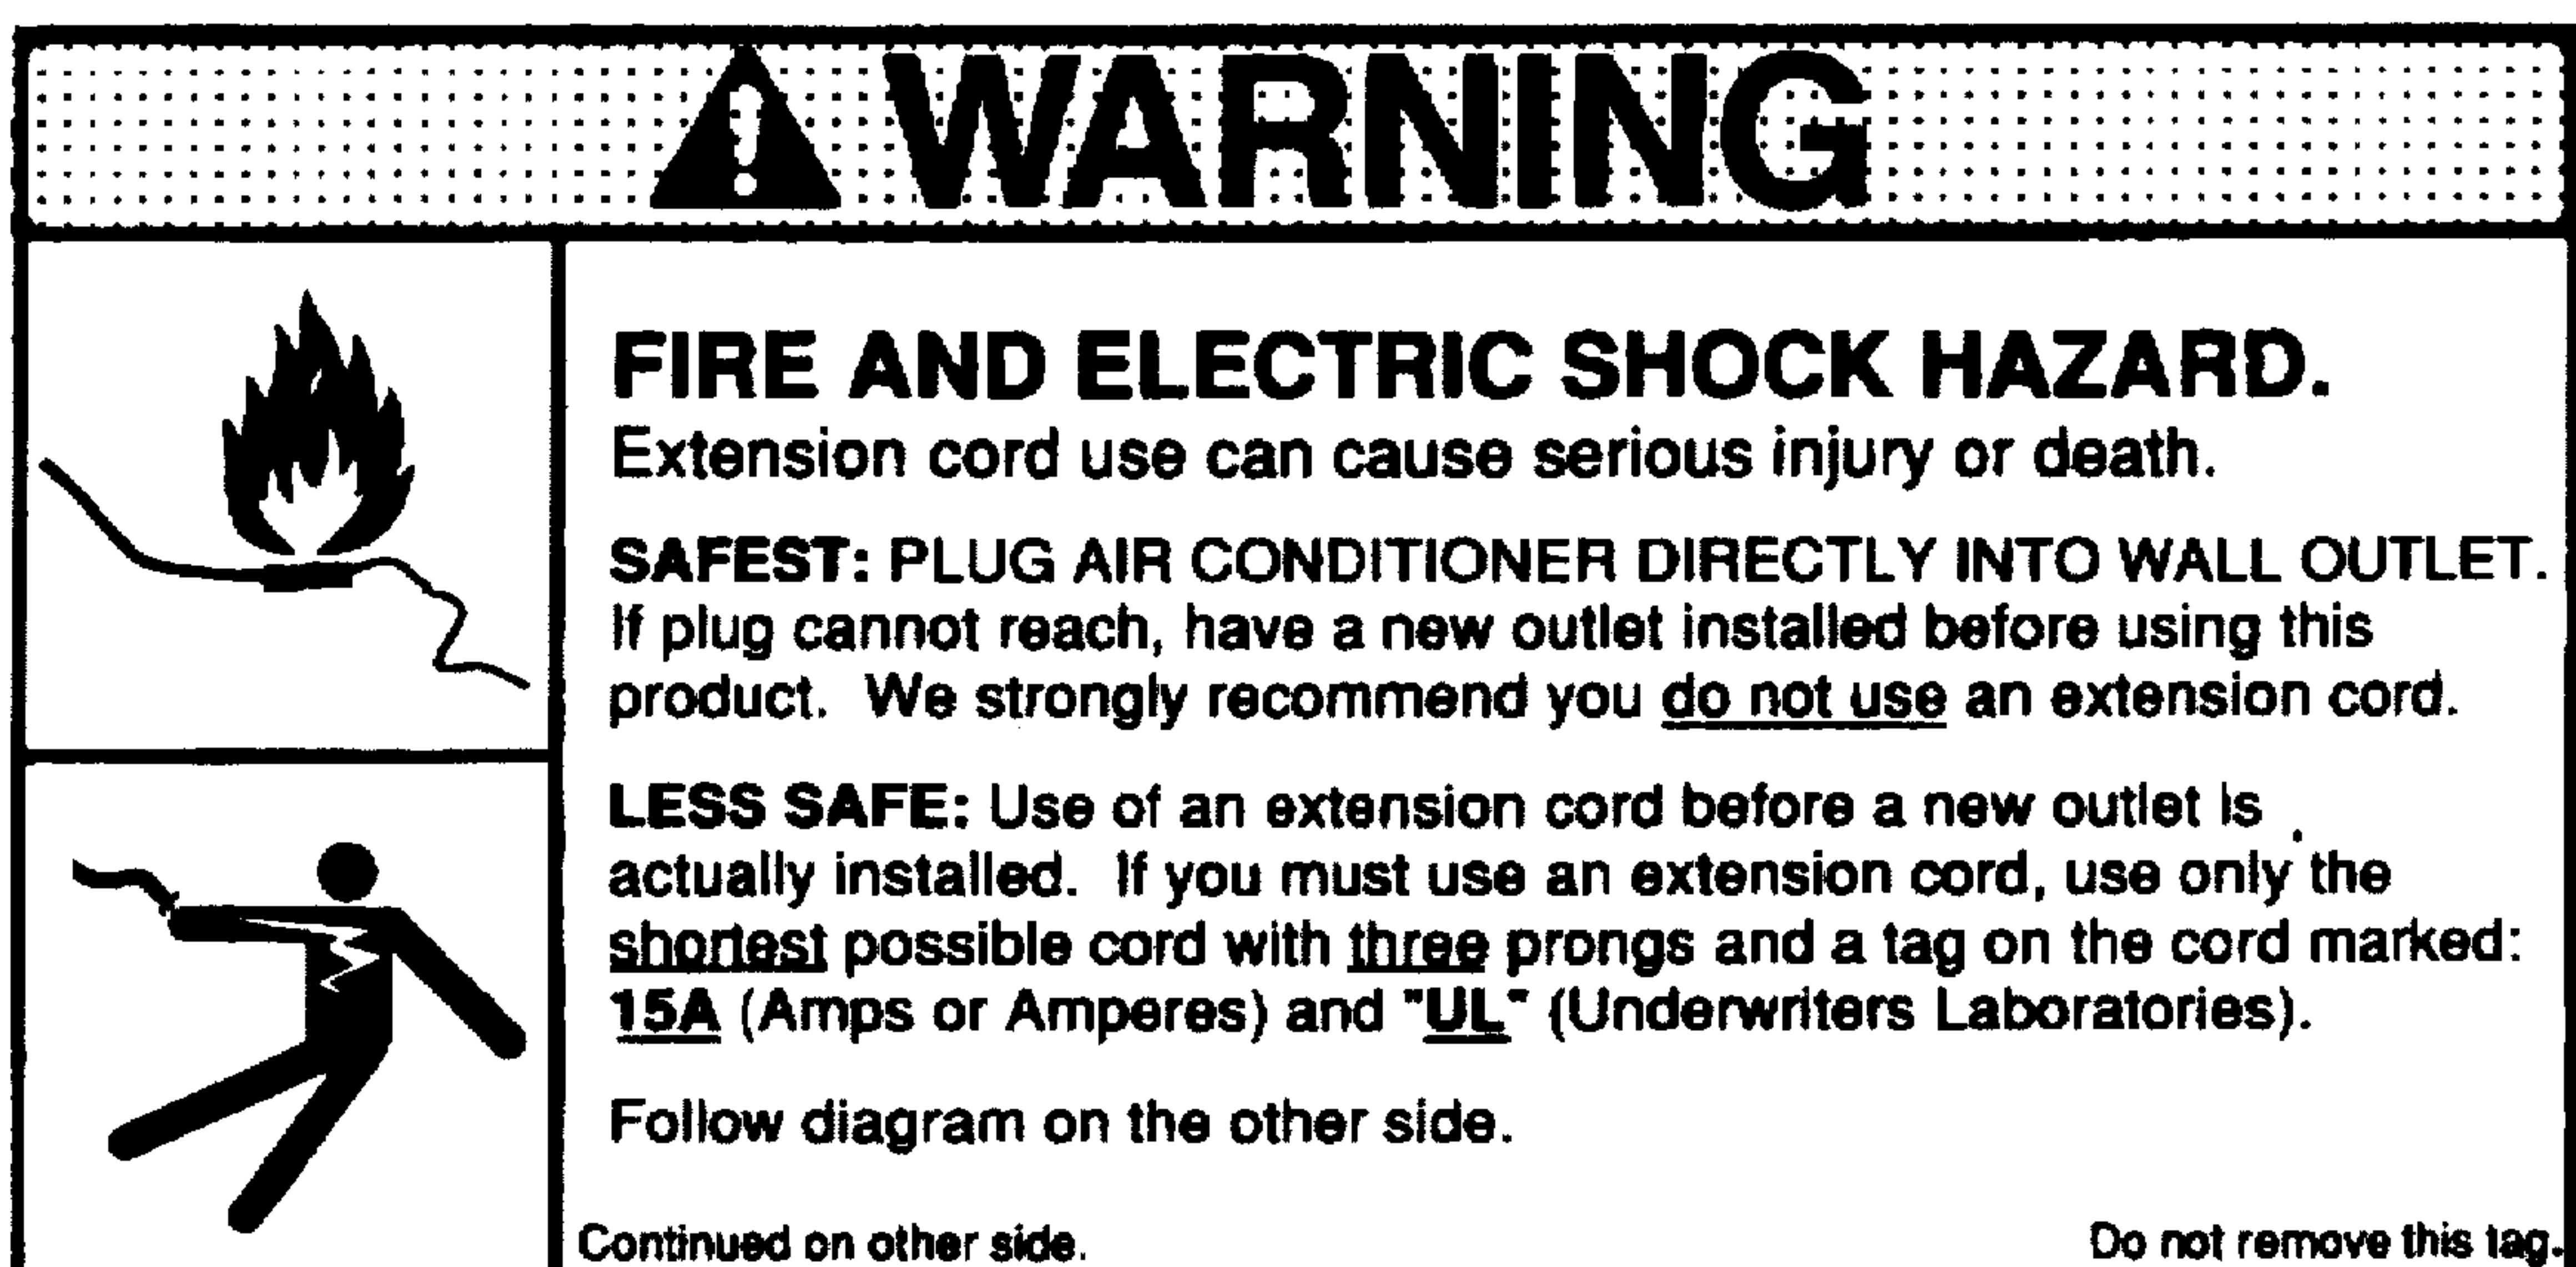


Fig. 2