



US00D454546S

(12) **United States Design Patent**
MacKay

(10) **Patent No.:** **US D454,546 S**

(45) **Date of Patent:** **** Mar. 19, 2002**

(54) **IN-LINE GROUND FAULT CIRCUIT INTERRUPTER**

D401,908 S * 12/1998 Cook D13/160
5,864,455 A * 1/1999 Gernhardt et al. 361/42
D414,747 S 10/1999 Aromin
D418,482 S 1/2000 MacKay

(75) Inventor: **Peter MacKay**, Warwick, RI (US)

* cited by examiner

(73) Assignee: **Tower Manufacturing Corporation**, Providence, RI (US)

Primary Examiner—Ted Shooman

Assistant Examiner—Selina Sikder

(**) Term: **14 Years**

(74) *Attorney, Agent, or Firm*—Kriegsman & Kriegsman

(21) Appl. No.: **29/126,114**

(57) **CLAIM**

(22) Filed: **Jul. 10, 2000**

The ornamental design for an in-line ground fault circuit interrupter, as shown and described.

(51) **LOC (7) Cl.** **13-03**

(52) **U.S. Cl.** **D13/160**

(58) **Field of Search** D13/160, 162,
D13/178; 174/65 R, 77 R, 92; 361/42,
45, 115

DESCRIPTION

(56) **References Cited**

U.S. PATENT DOCUMENTS

D313,971 S * 1/1991 Rosenbaum et al. D13/160
D336,633 S * 6/1993 Trabold D13/160
D356,066 S * 3/1995 Rao et al. D13/160
5,684,272 A * 11/1997 Gernhardt et al. 174/65 R
D391,922 S * 3/1998 Aromin D13/160

FIG. 1 is a front perspective view of an in-line ground fault circuit interrupter showing my new design;


FIG. 2 is a front view of the in-line ground fault circuit interrupter shown in FIG. 1;

FIG. 3 is a left side view of the in-line ground fault circuit interrupter shown in FIG. 1;

FIG. 4 is a rear view of the in-line ground fault circuit interrupter shown in FIG. 1; and,

FIG. 5 is a bottom view of the in-line ground fault circuit interrupter shown in FIG. 1.

1 Claim, 2 Drawing Sheets

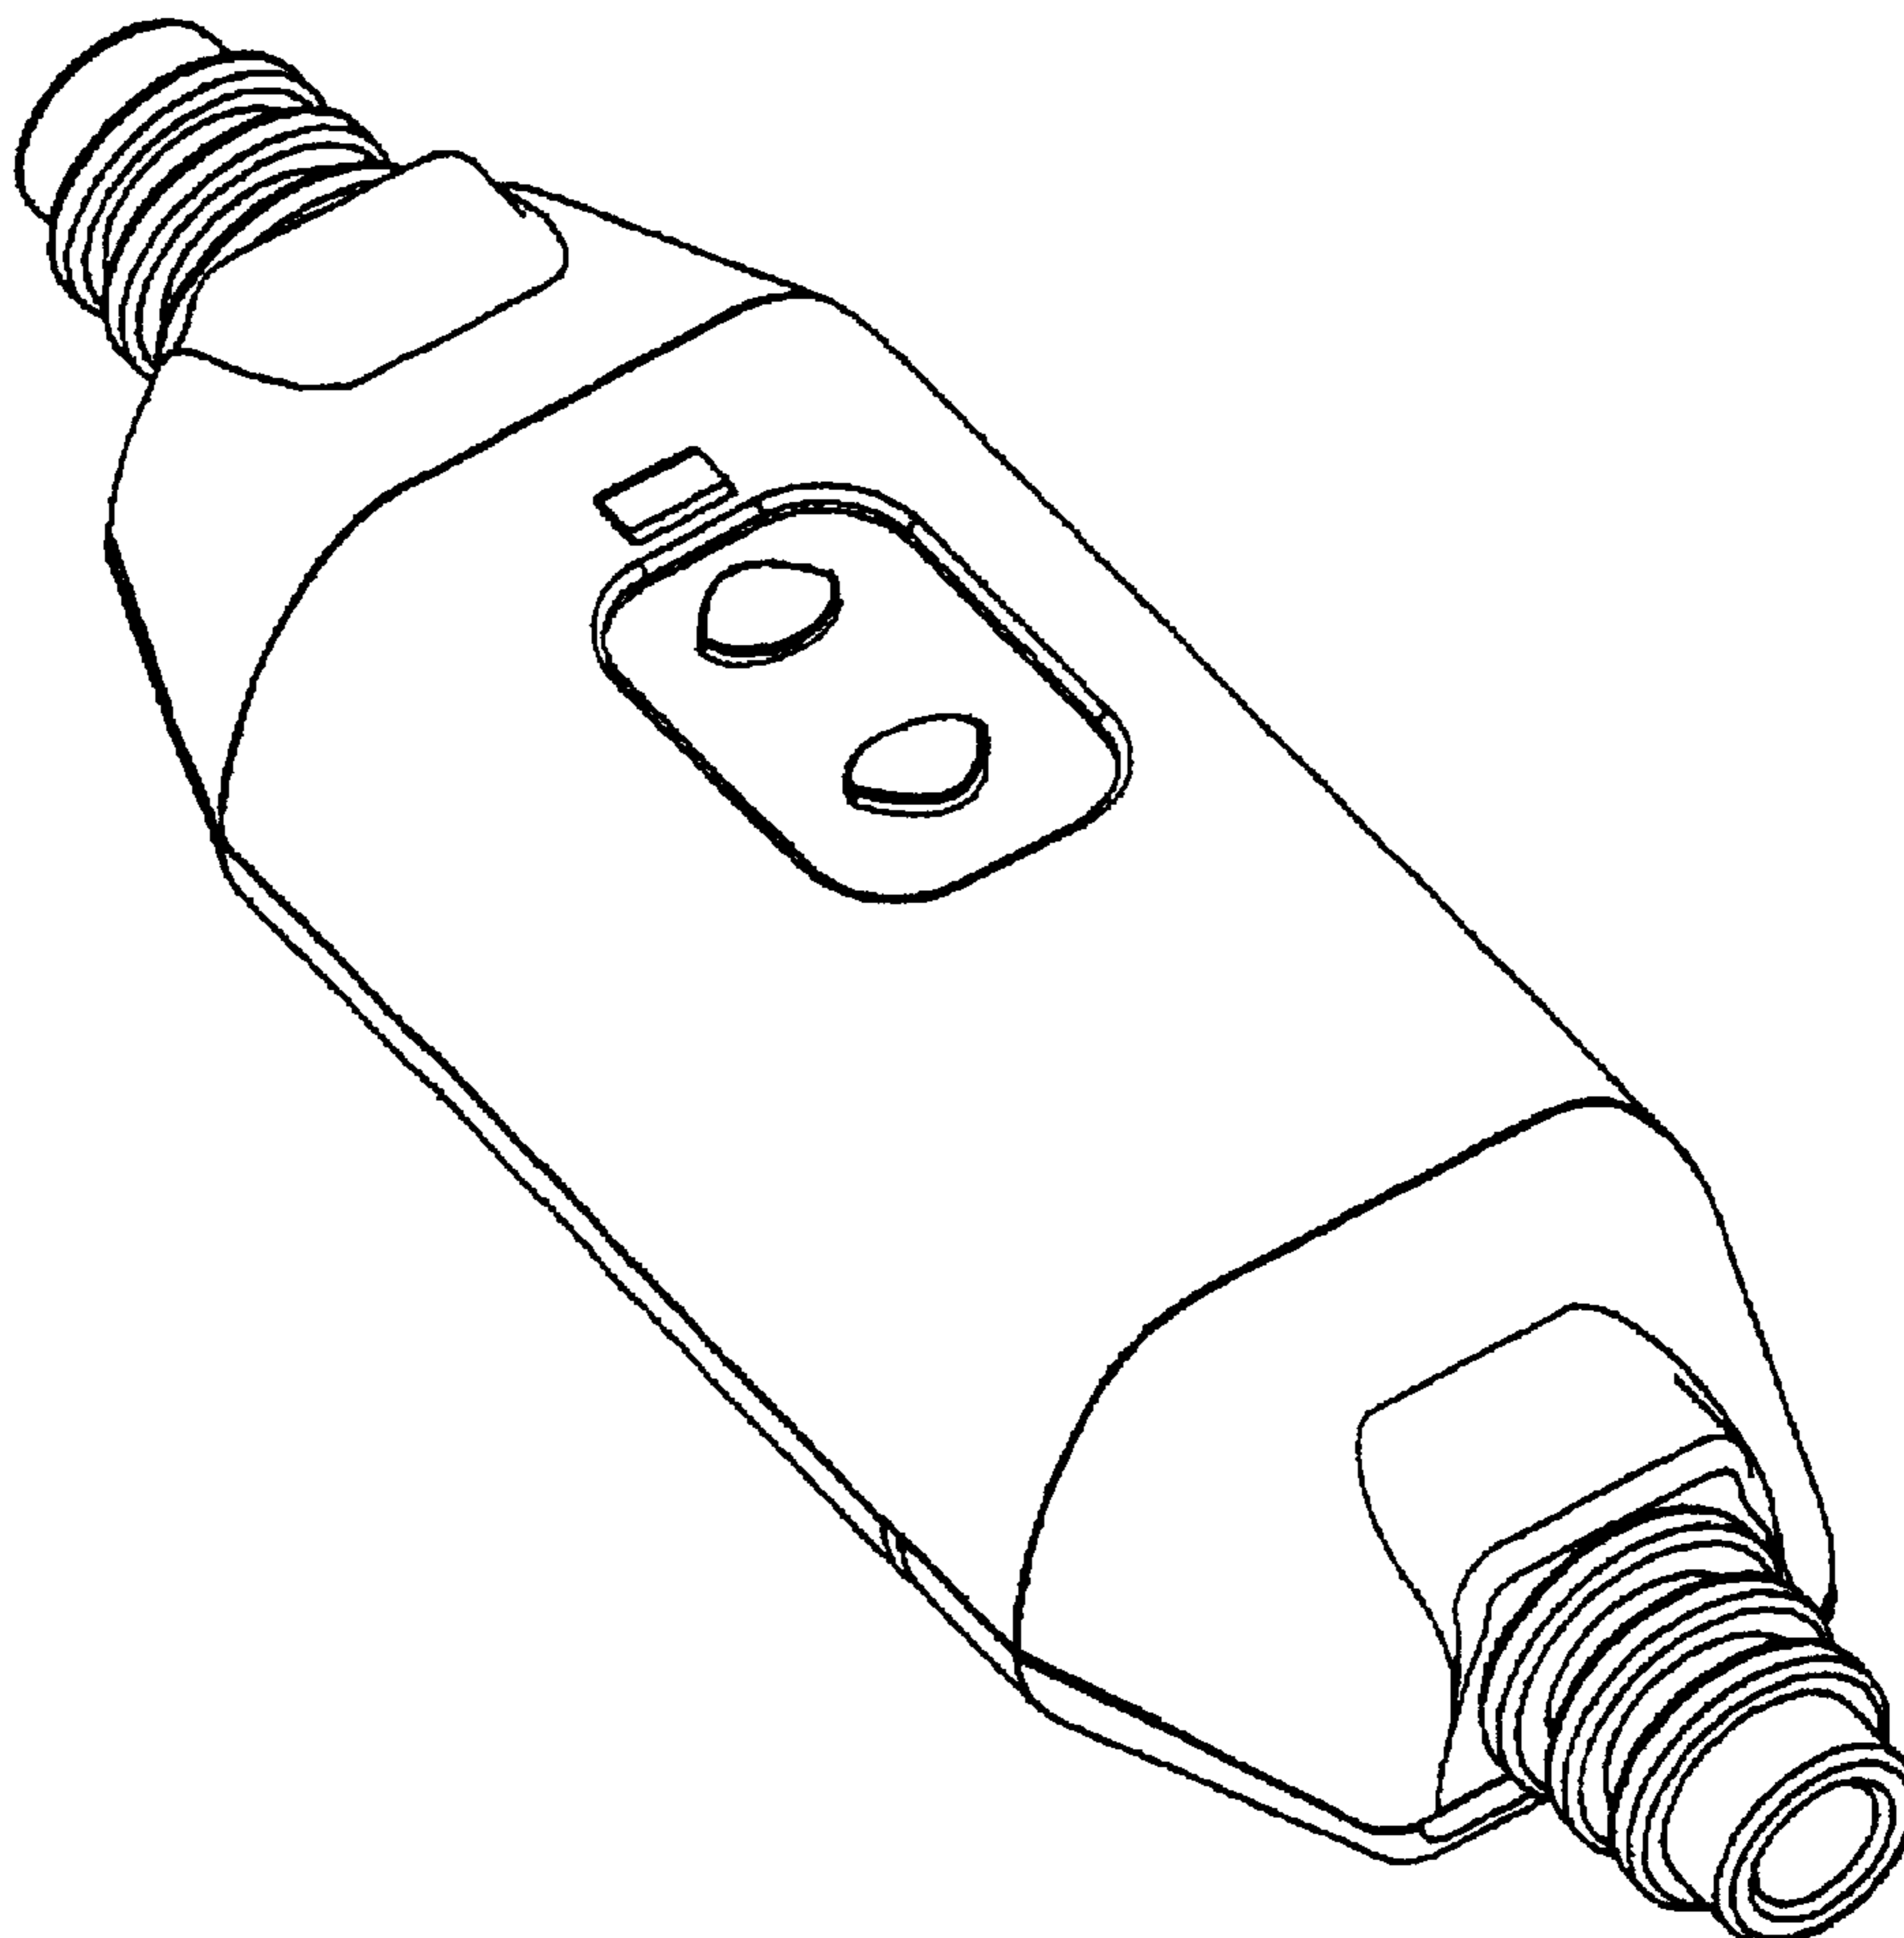

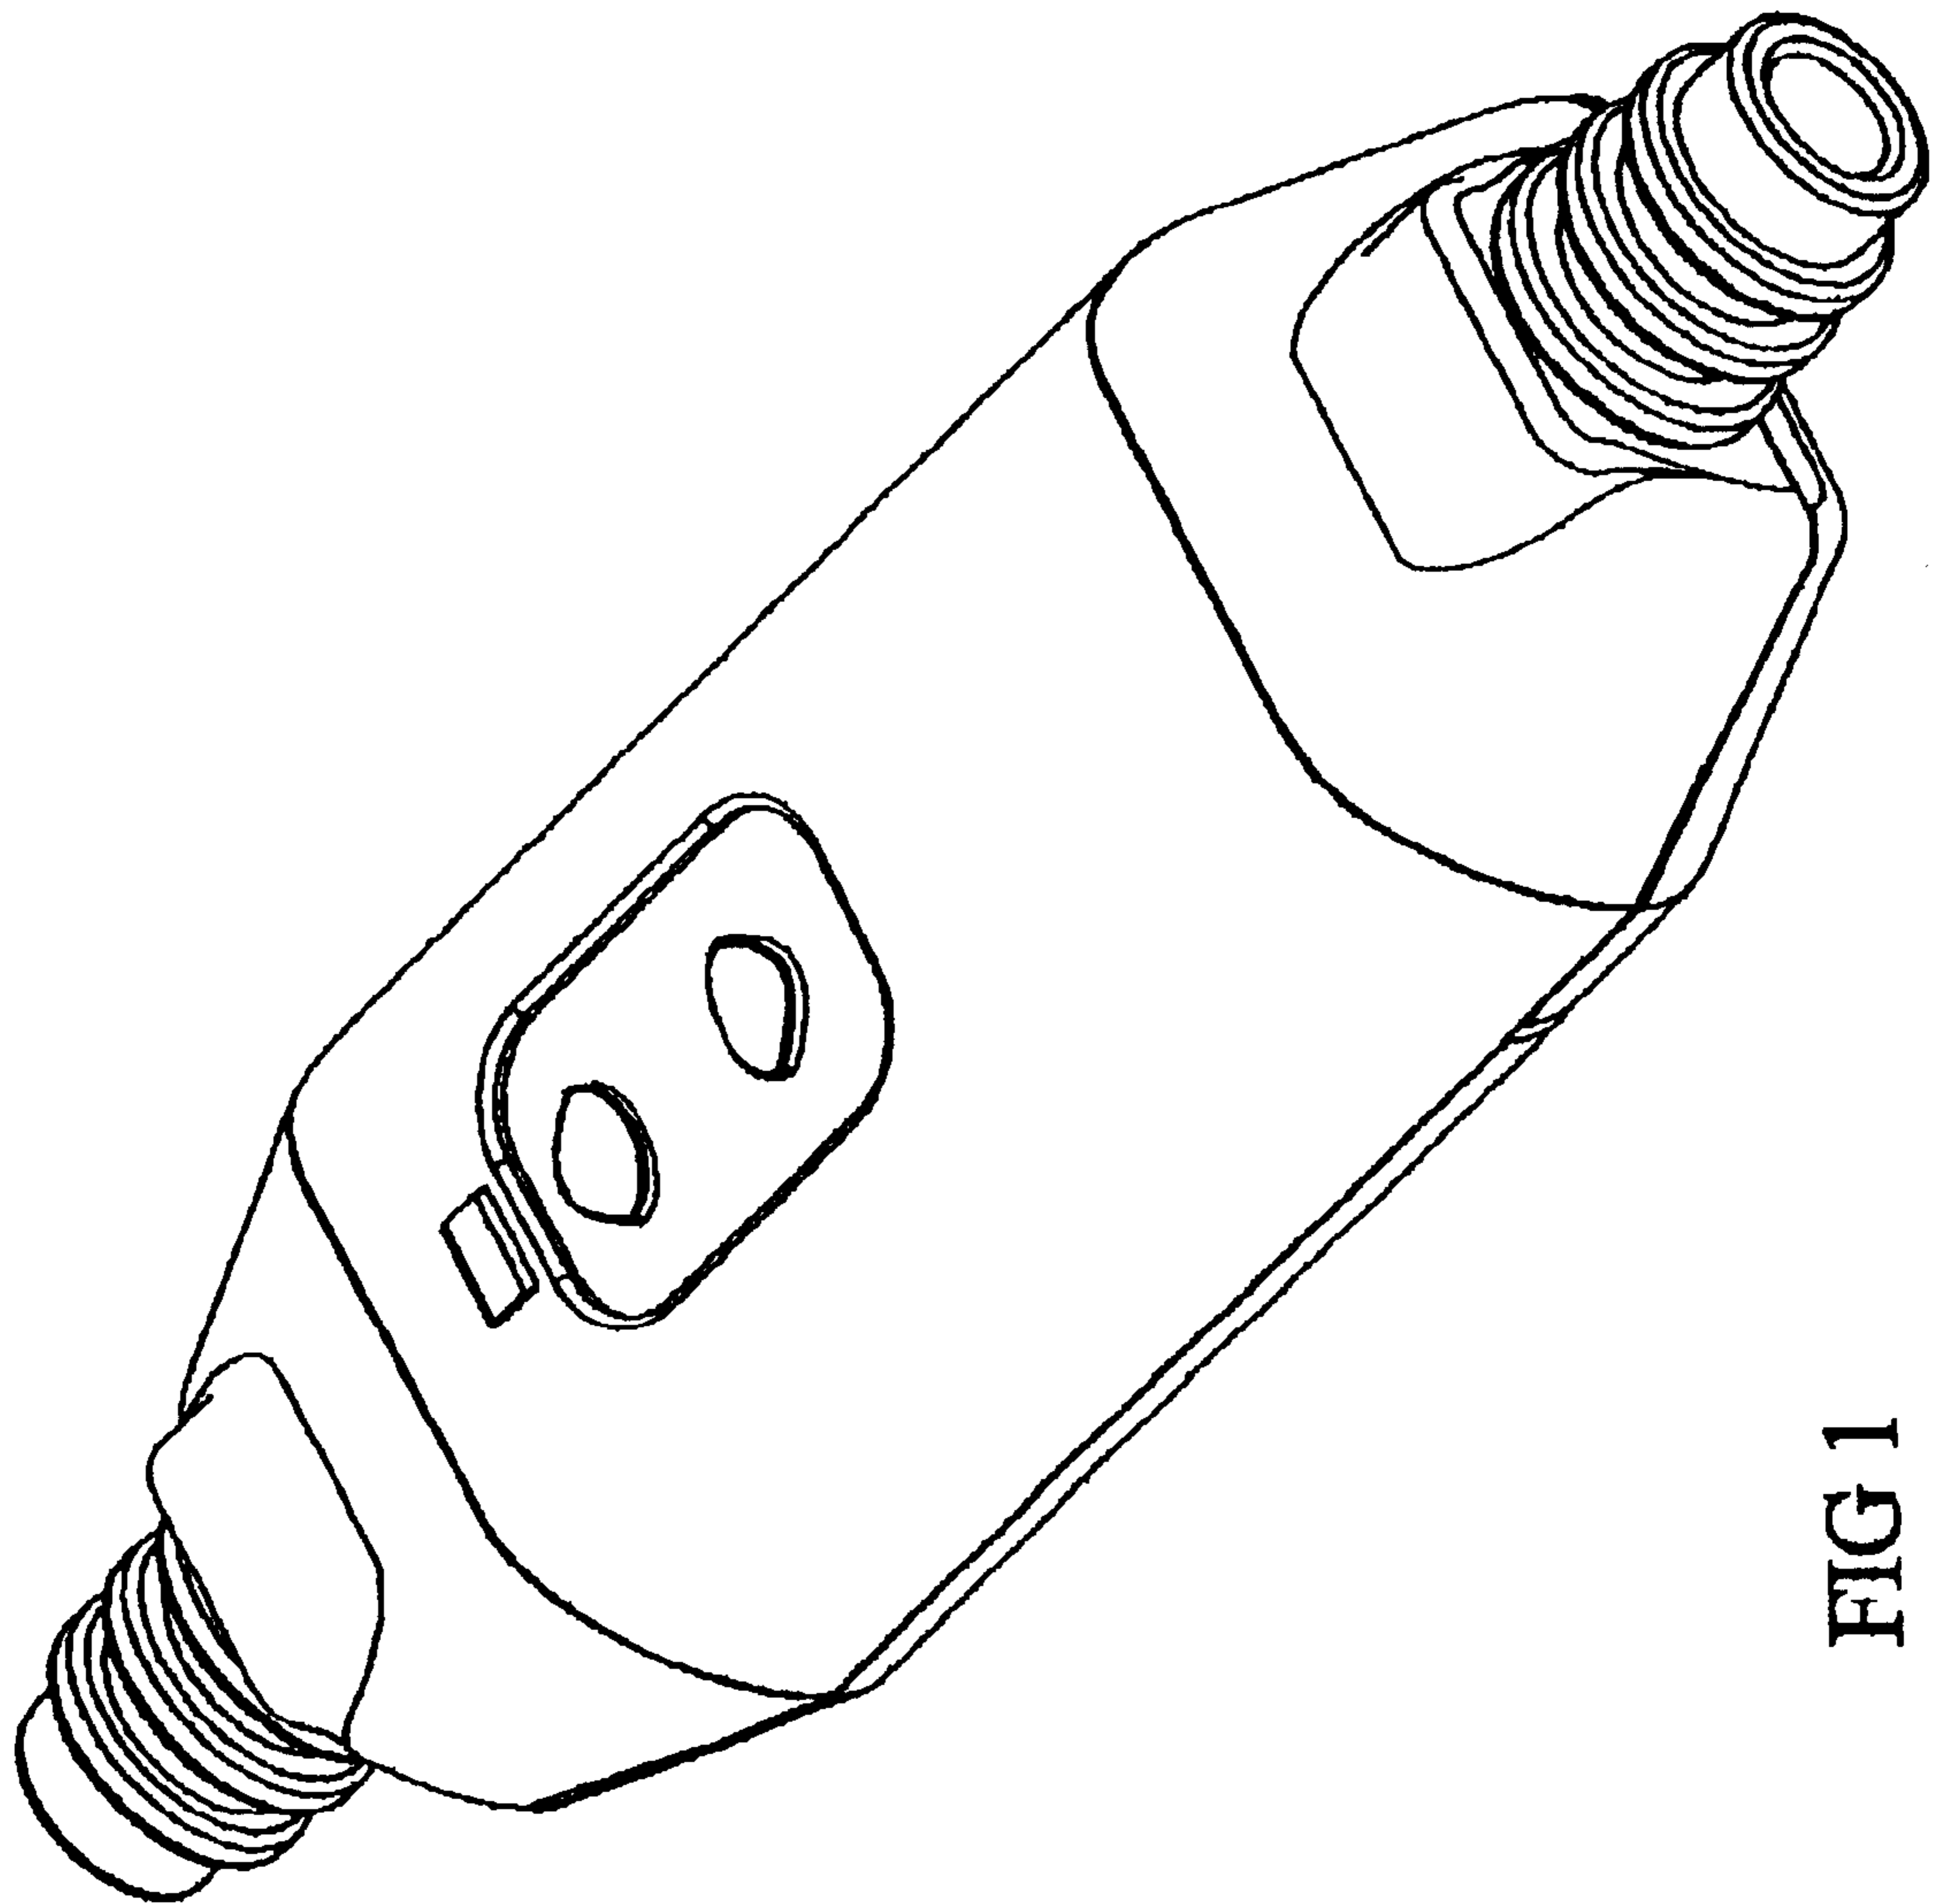


FIG 1

