



US00D519936S

(12) **United States Design Patent**
Smith

(10) **Patent No.:** **US D519,936 S**

(45) **Date of Patent:** **** May 2, 2006**

(54) **115/220 VOLT FIRE ALARM CIRCUIT BREAKER**

(76) **Inventor:** **Venson C. Smith**, 5483 Stephen Forest, Memphis, TN (US) 38141

(**) **Term:** **14 Years**

(21) **Appl. No.:** **29/199,565**

(22) **Filed:** **Feb. 18, 2004**

(51) **LOC (8) Cl.** **13-03**

(52) **U.S. Cl.** **D13/160**

(58) **Field of Classification Search** D13/160,
D13/138.1, 138.2, 137.1, 137.3; 70/203;
174/50, 66, 65 R, 67, 70 R, 77 R, 77 S, 92;
200/5 R, 43.11, 43.14, 50.01, 50.15, 293,
200/293.1, 303, 401; 361/42, 44, 45, 50,
361/71, 115, 118, 119, 679; 335/68, 132,
335/202

See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

4,438,477 A * 3/1984 Cawley 361/119
4,876,713 A * 10/1989 Crosby et al. 379/412

D314,077 S * 1/1991 Judd et al. D13/160
D333,812 S * 3/1993 Krasser D13/160
D341,816 S * 11/1993 Nagano D13/138.1
D382,251 S * 8/1997 Tsui D13/137.1

* cited by examiner

Primary Examiner—Stella Reid
Assistant Examiner—Selina Sikder

(74) *Attorney, Agent, or Firm*—Crossley Patent Law; Mark A. Crossley



(57) **CLAIM**

The ornamental design for a 115/220 volt fire alarm circuit breaker, as shown and described.

DESCRIPTION

FIG. 1 is a front elevation view of the 115/220 volt fire alarm circuit breaker showing my new design;
FIG. 2 is a rear elevation view thereof;
FIG. 3 is a left side elevation view thereof;
FIG. 4 is a right side elevation view thereof;
FIG. 5 is a top plan view thereof;
FIG. 6 is a bottom plan view thereof; and,
FIG. 7 is a perspective thereof.

1 Claim, 7 Drawing Sheets

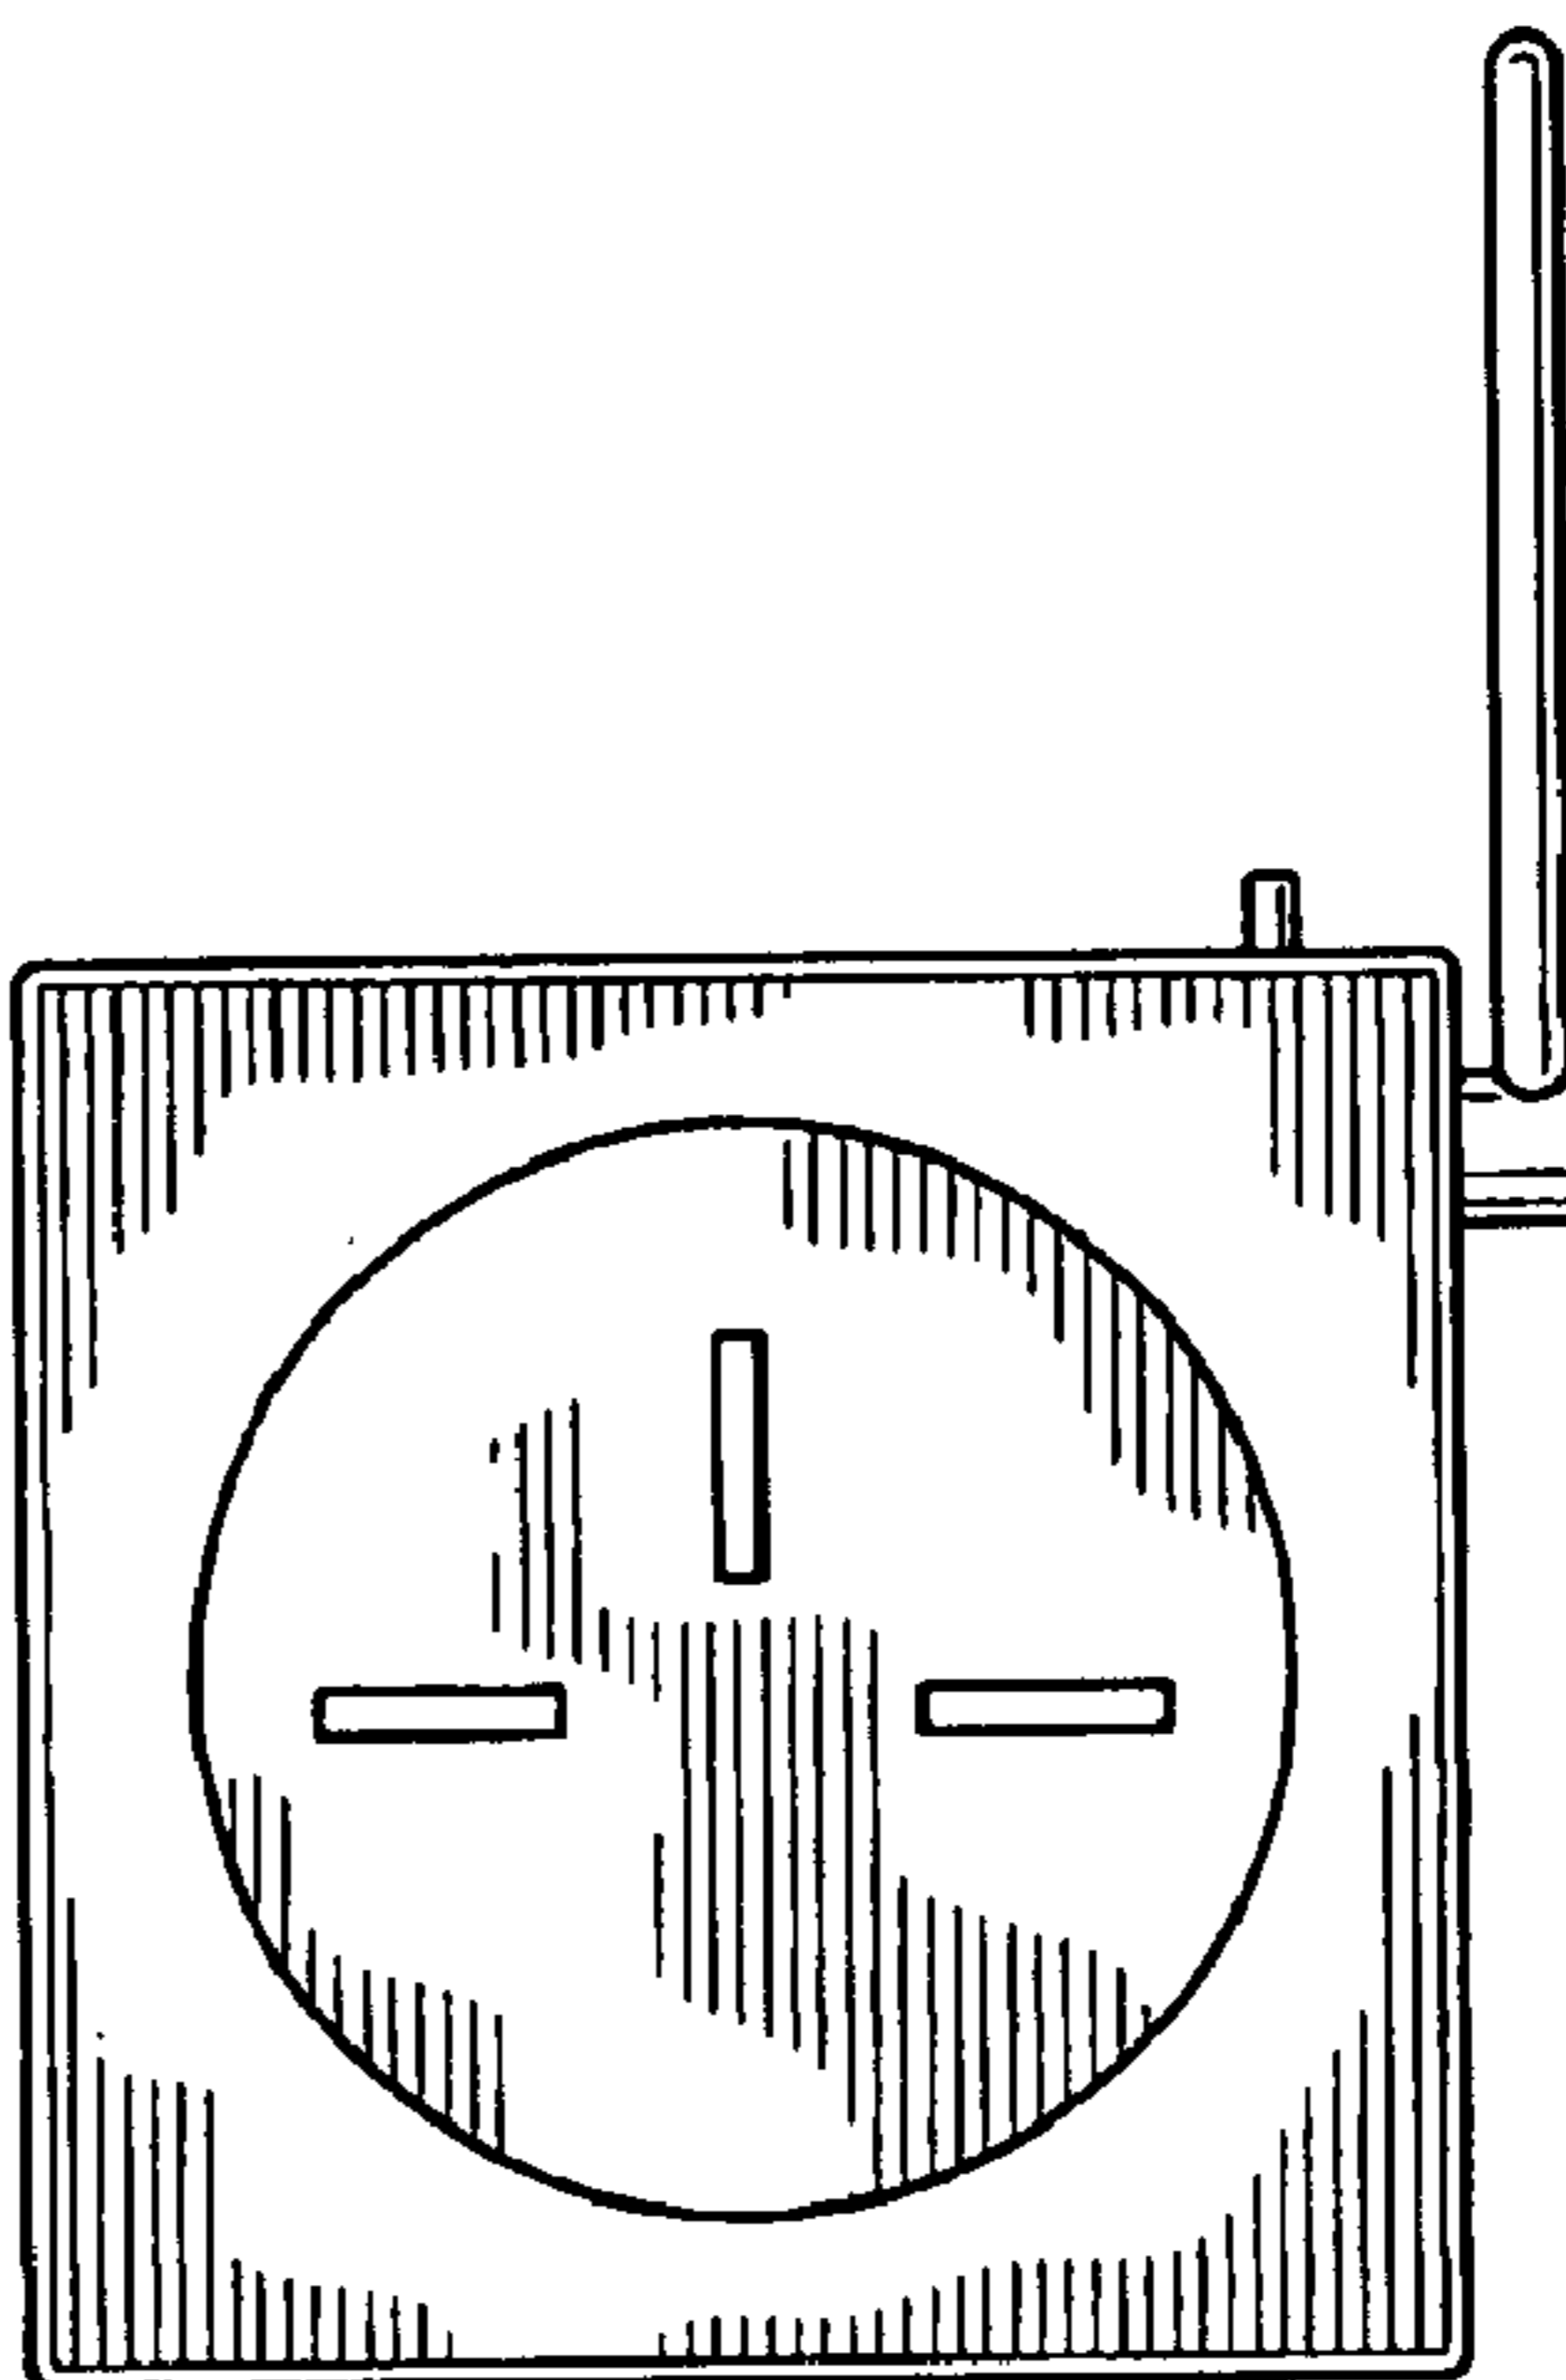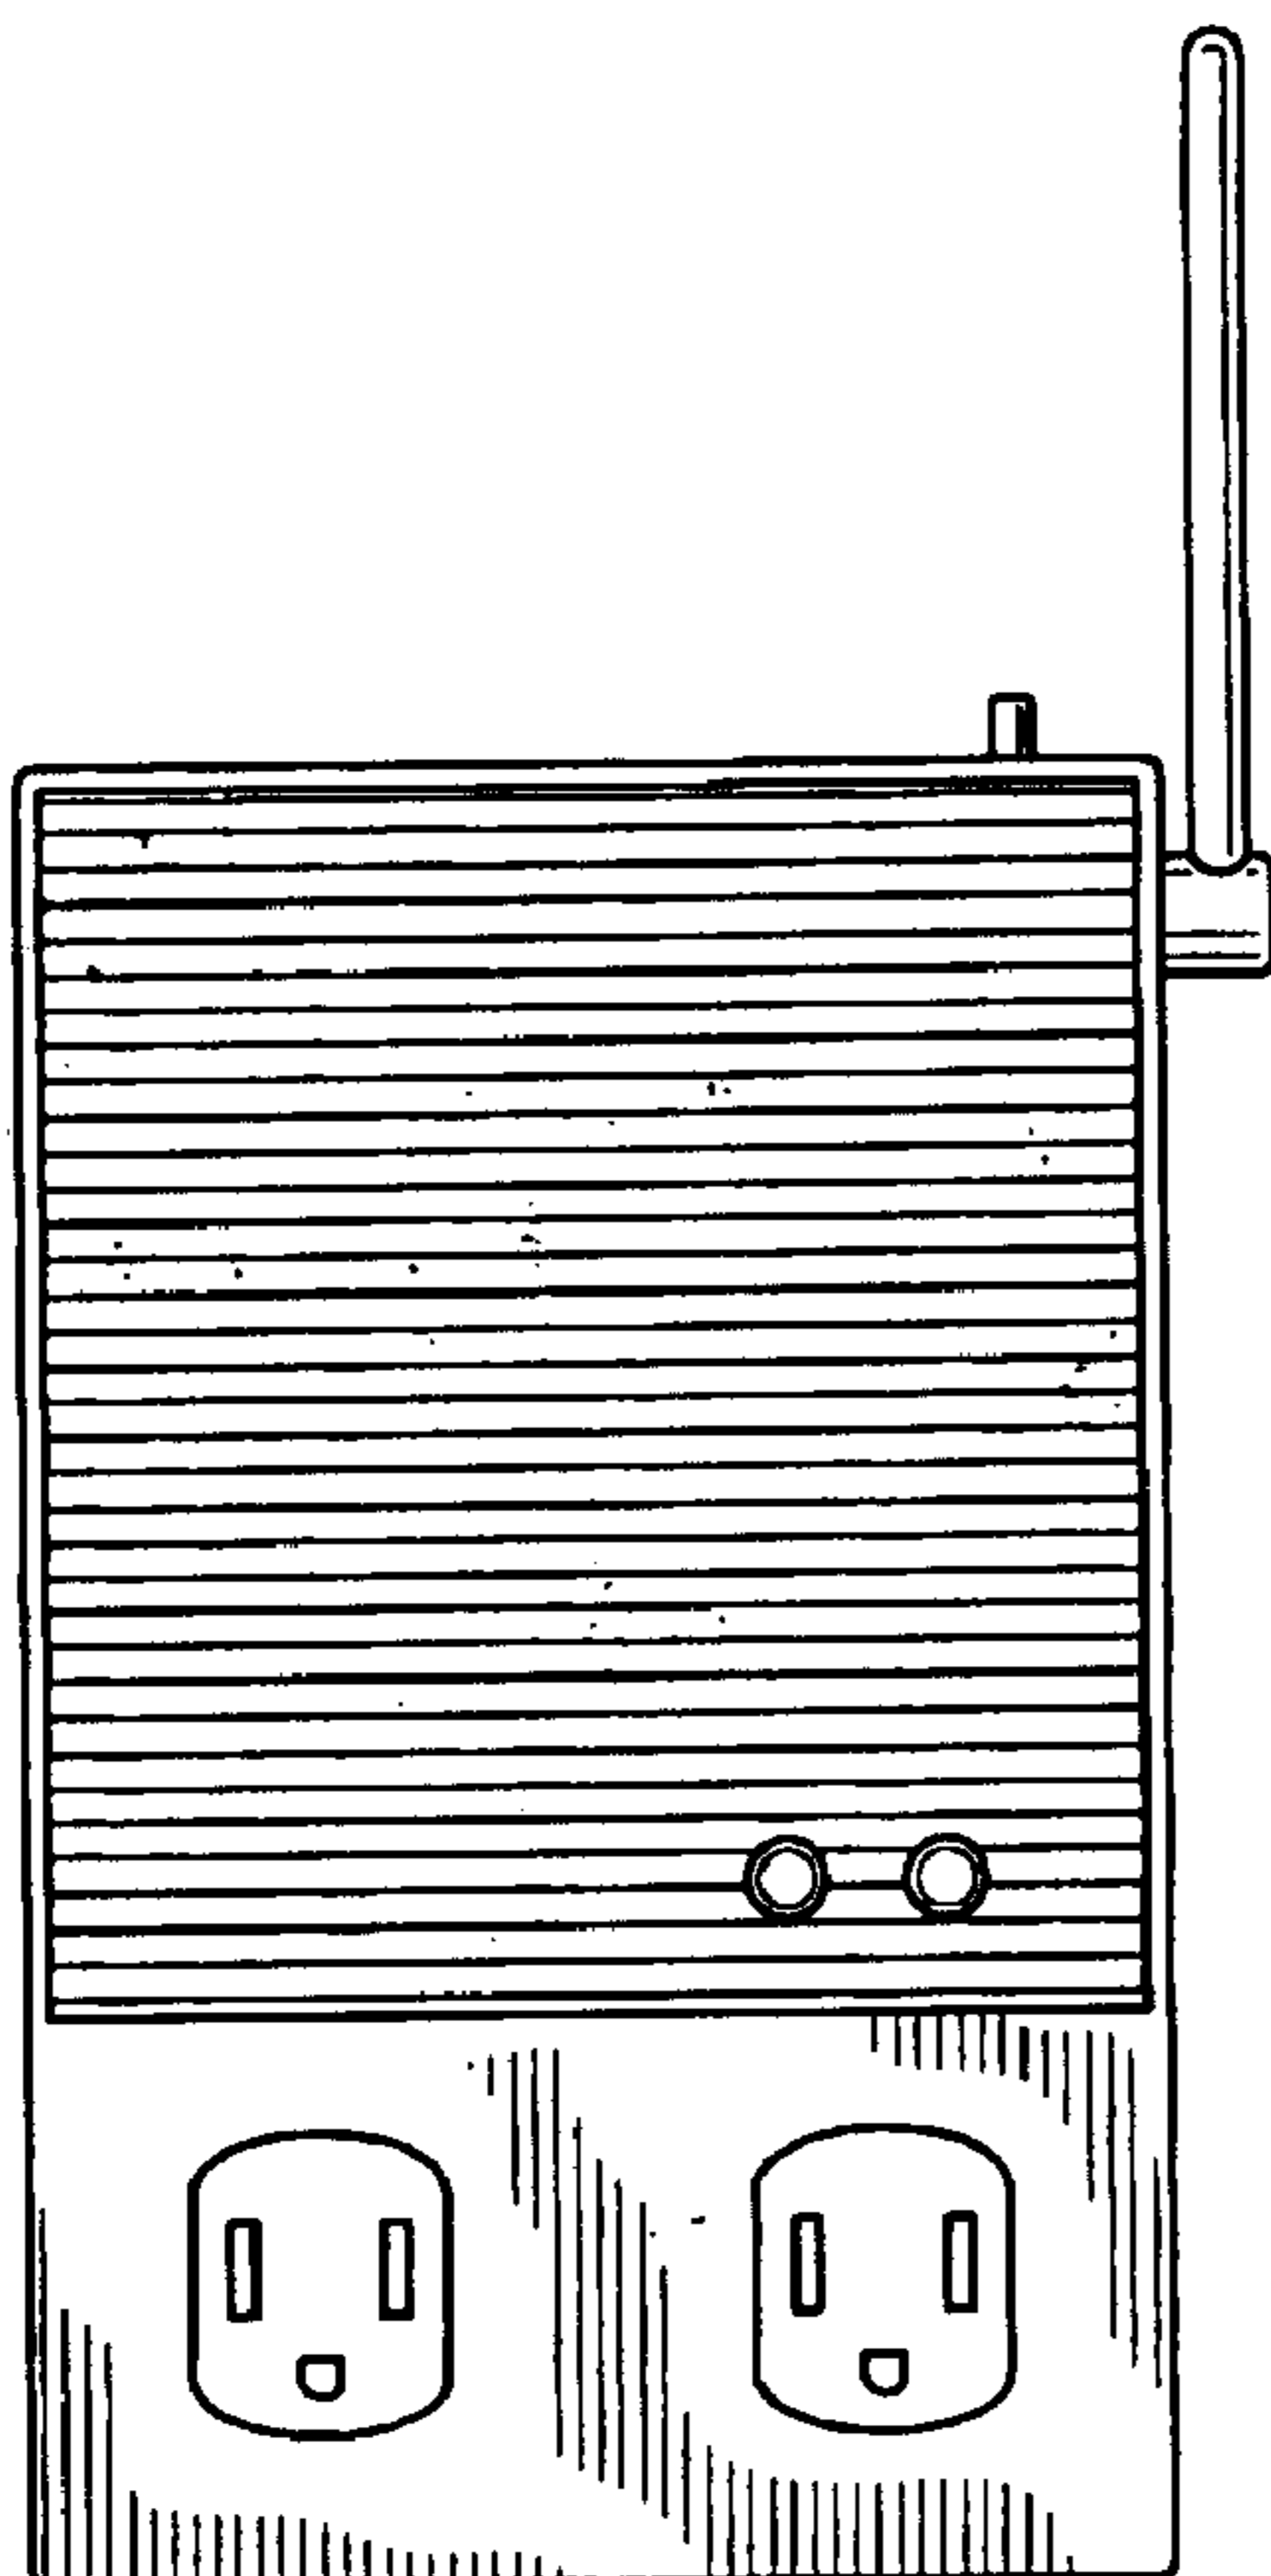

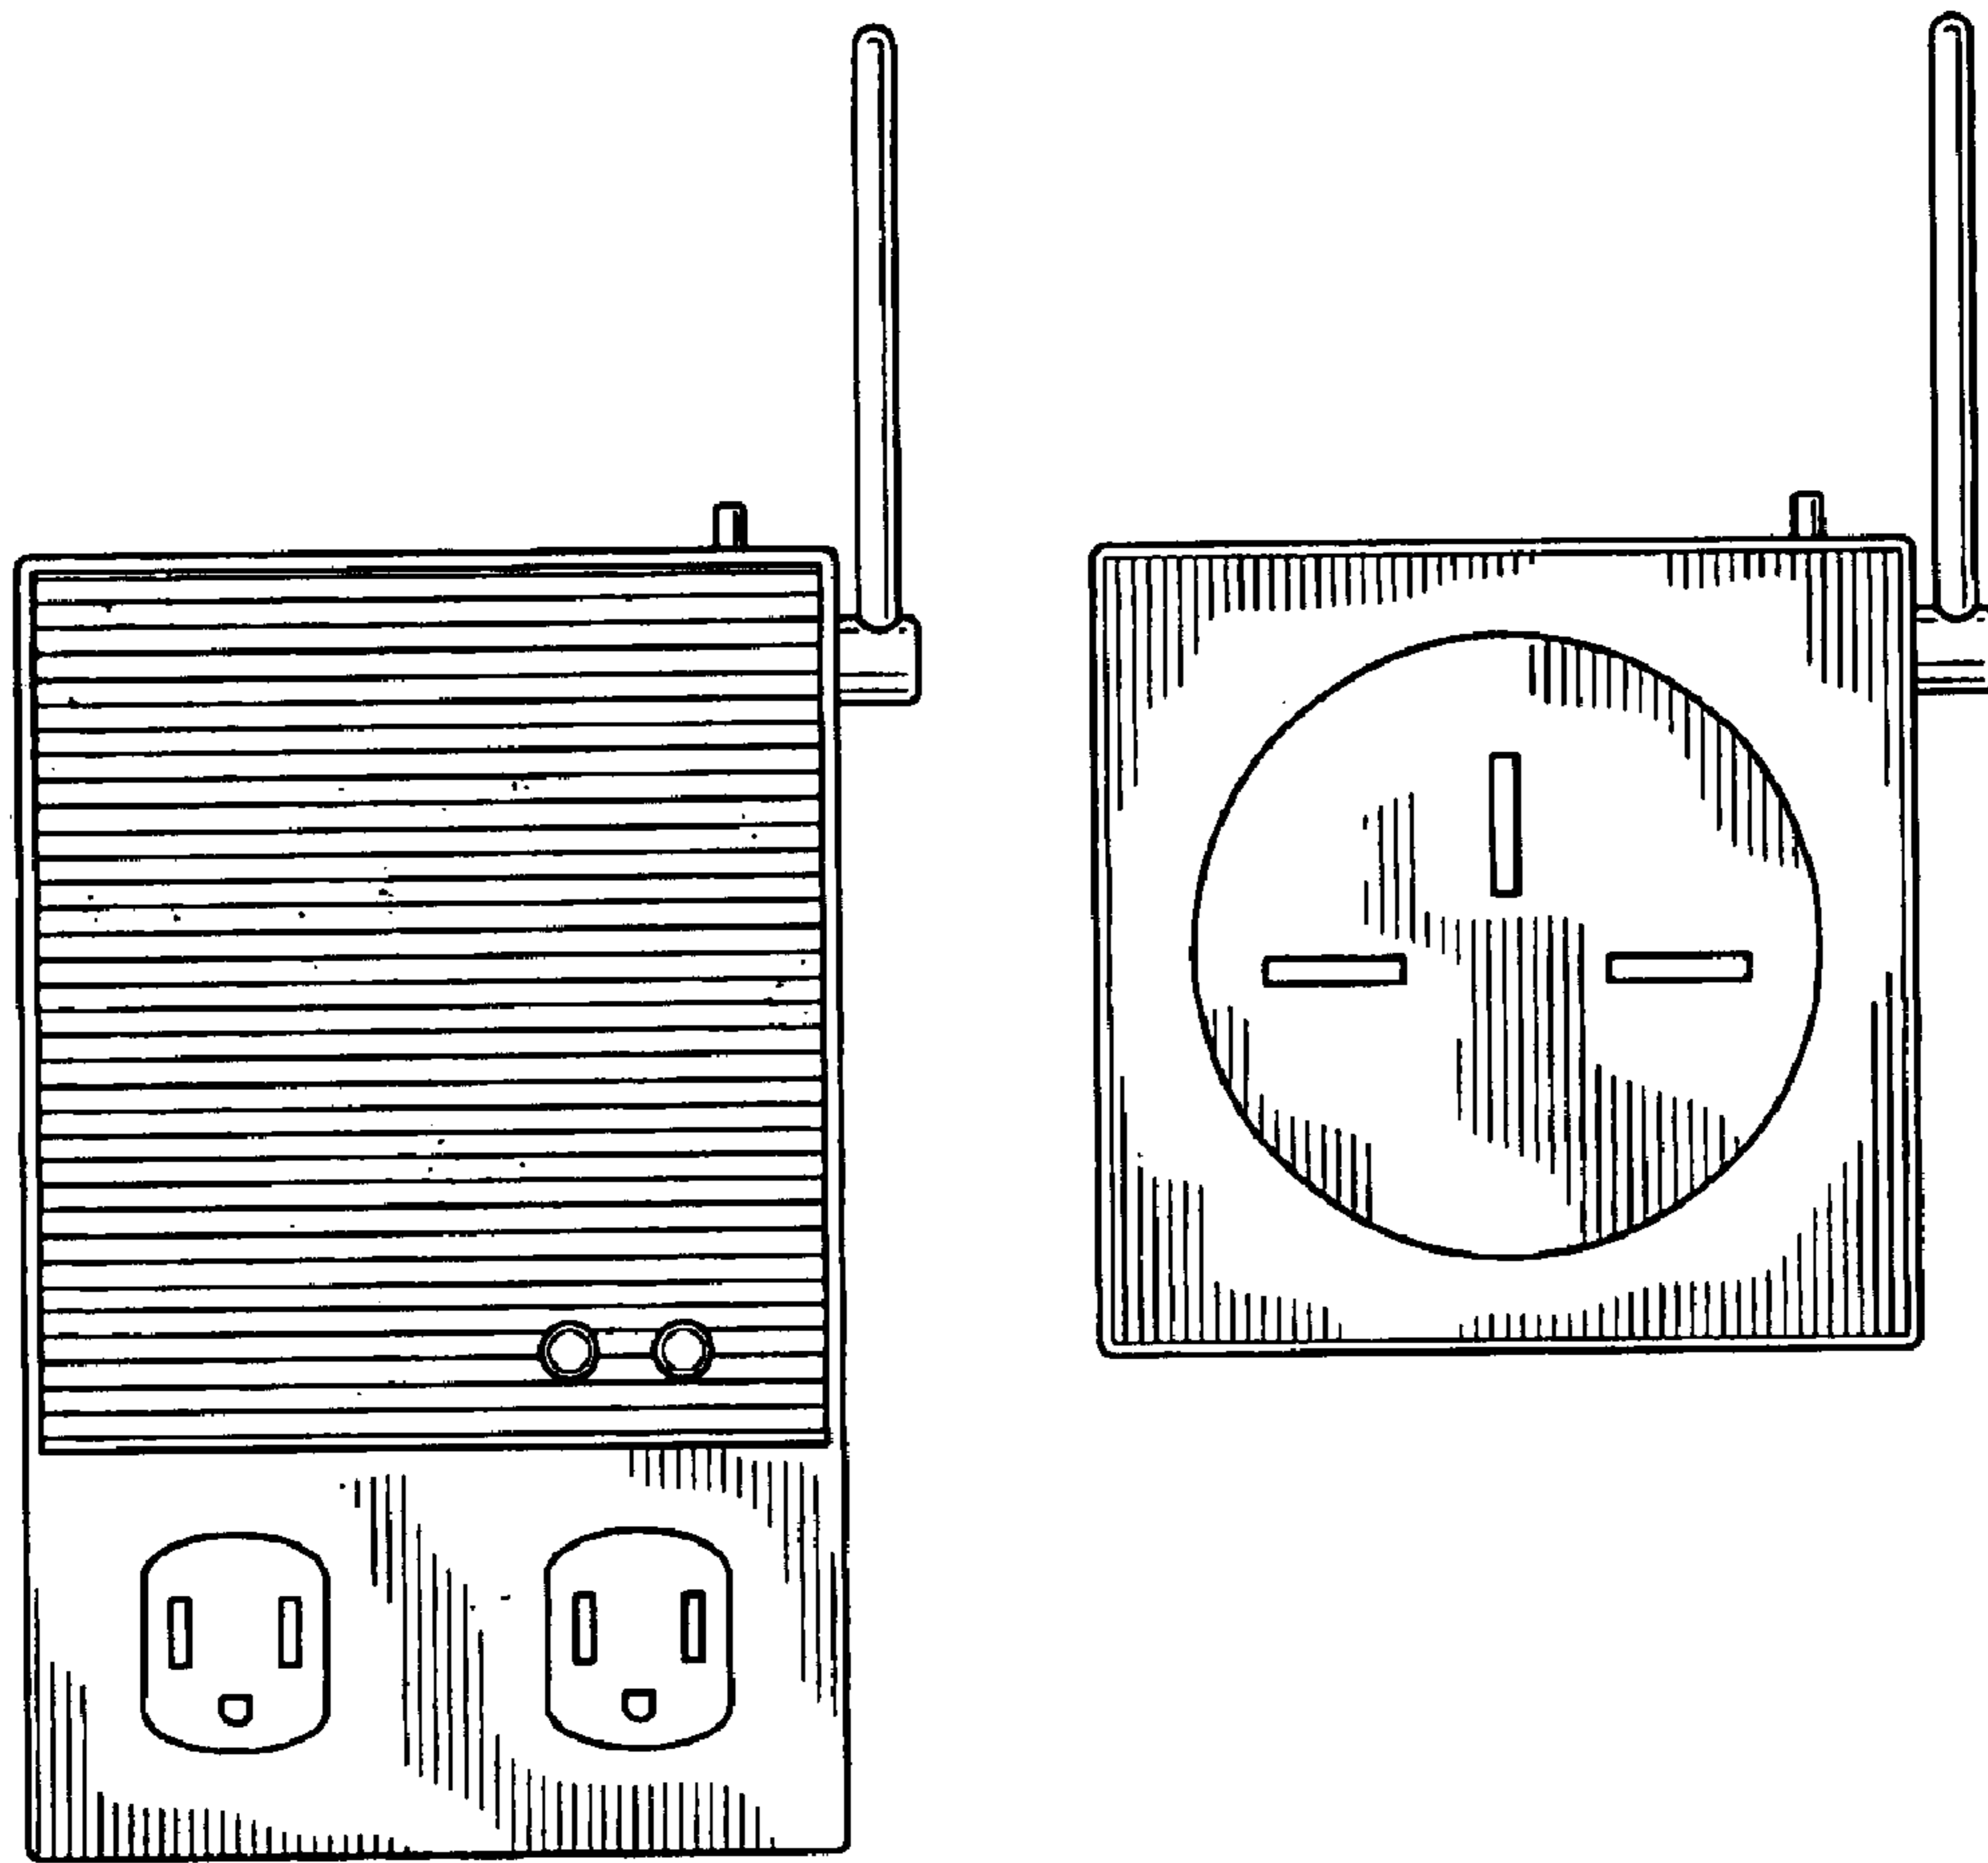


FIG.1

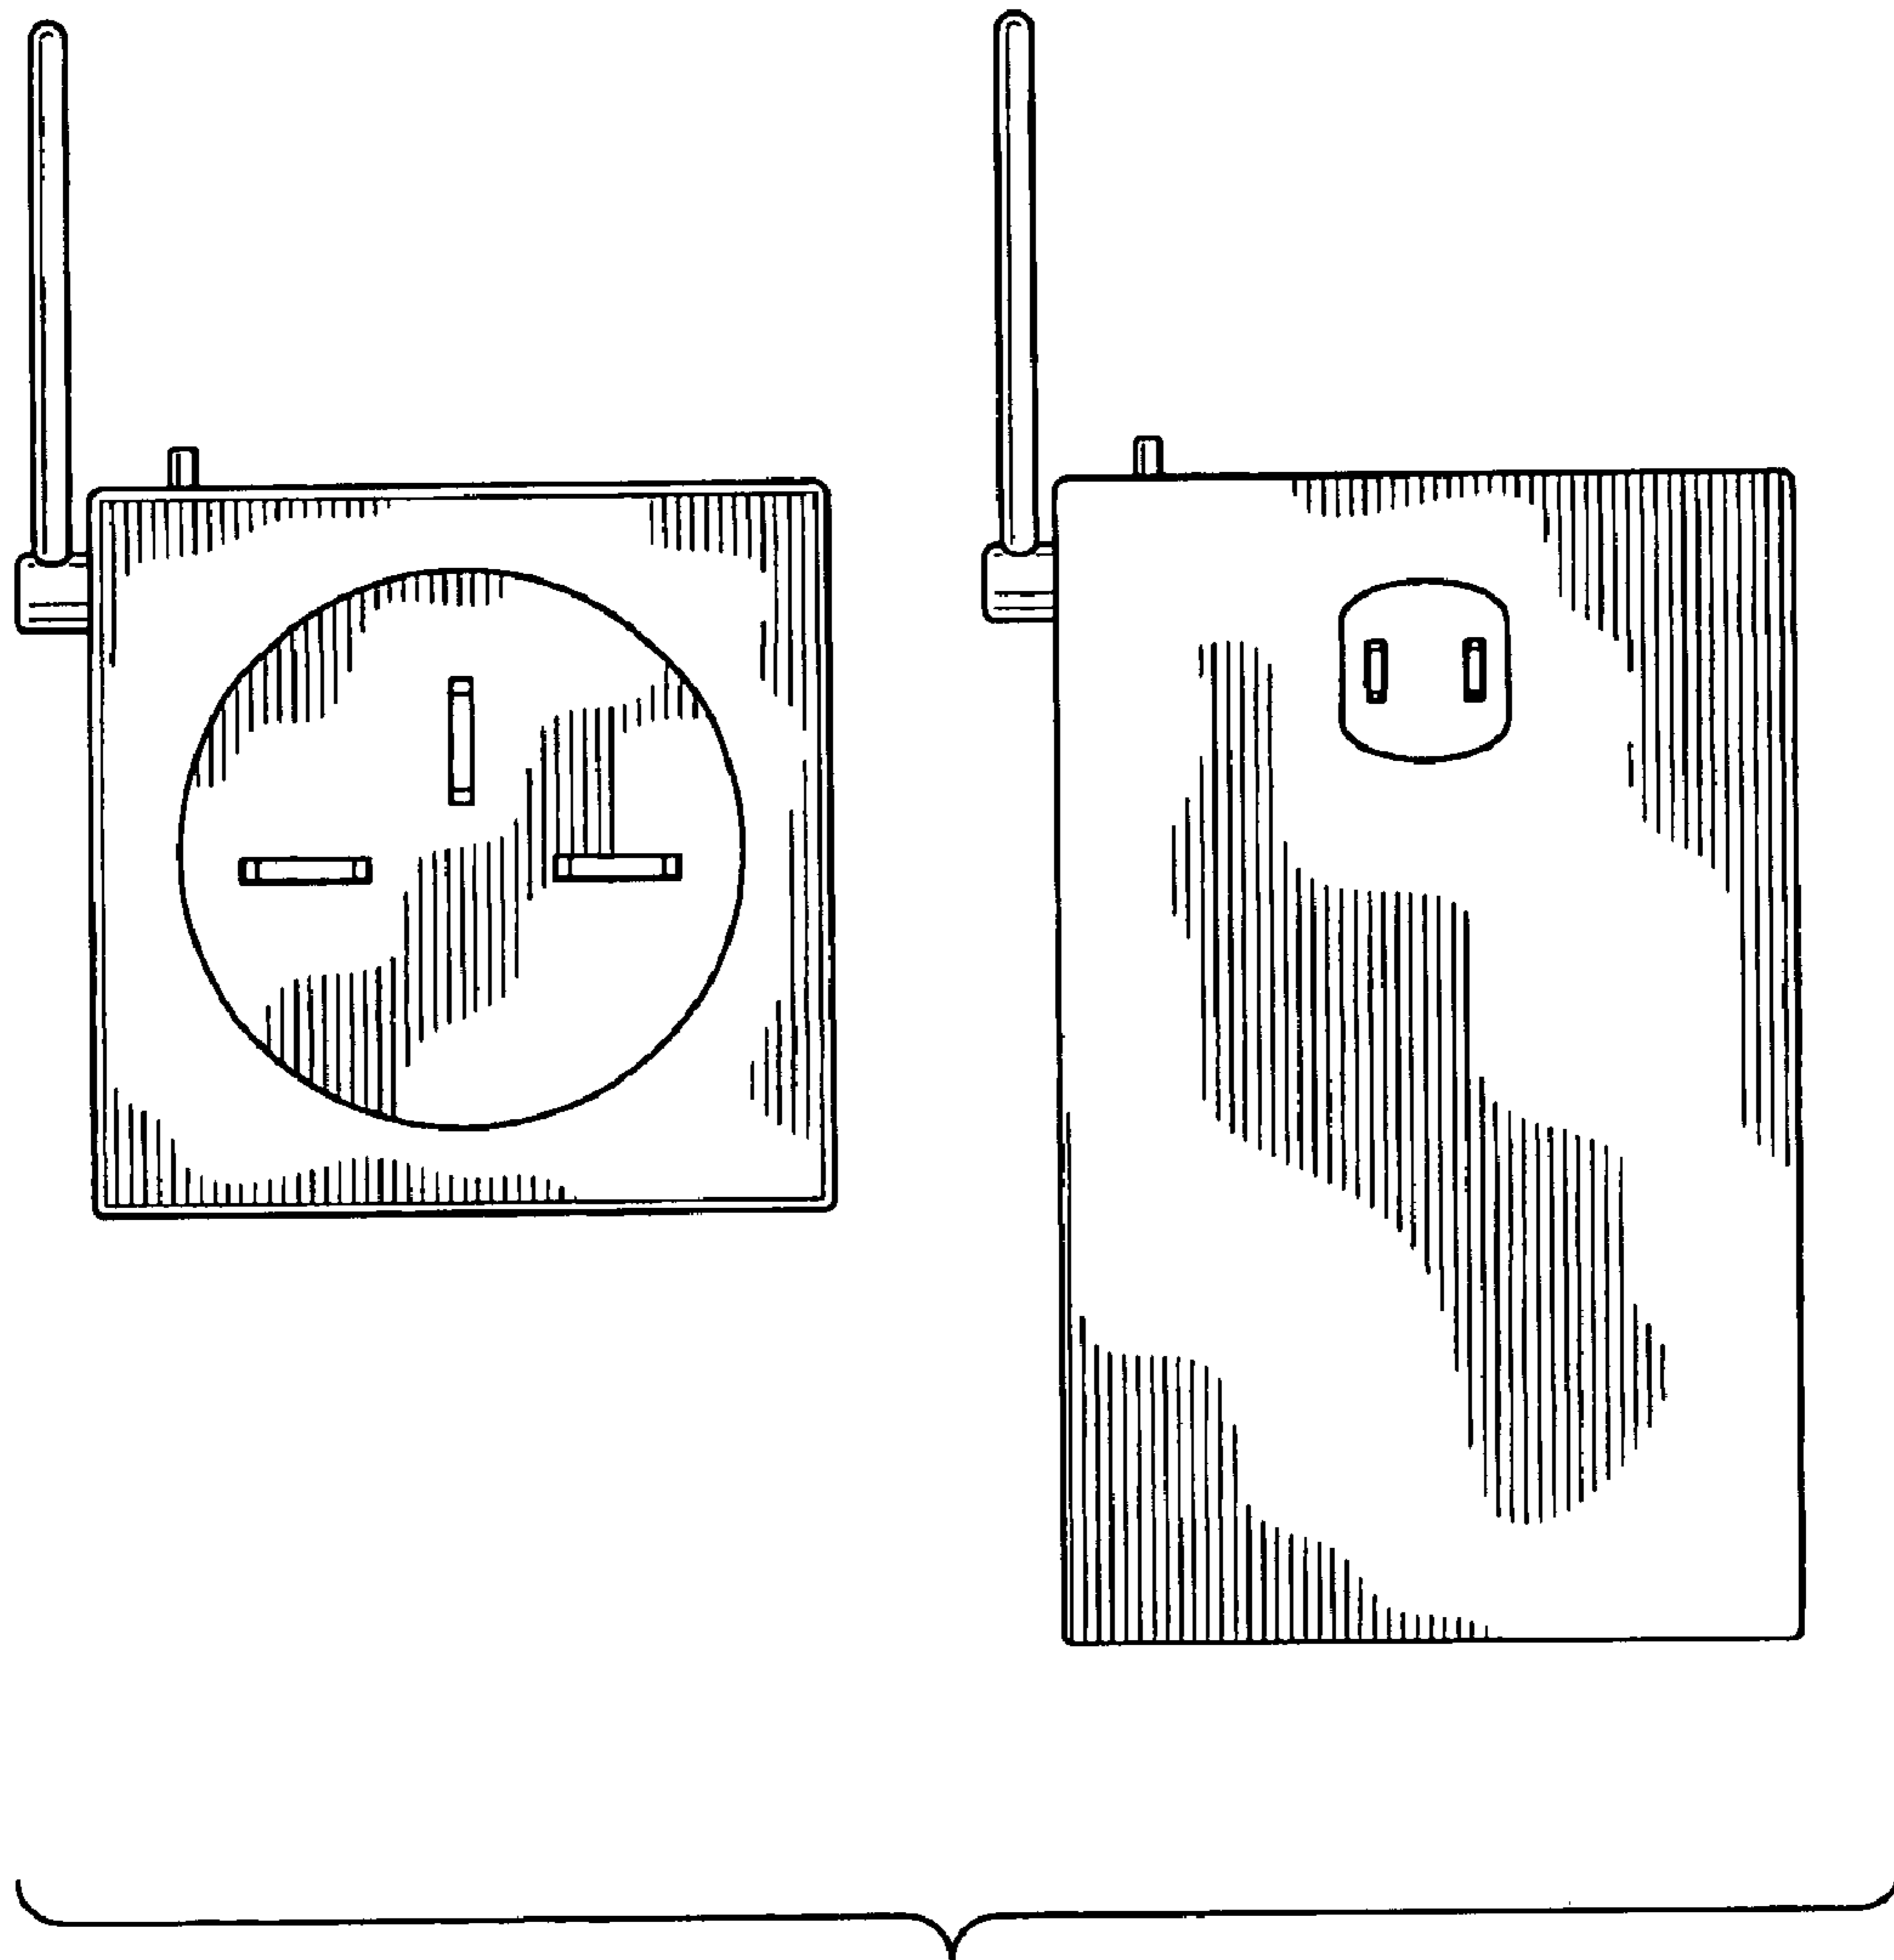


FIG.2

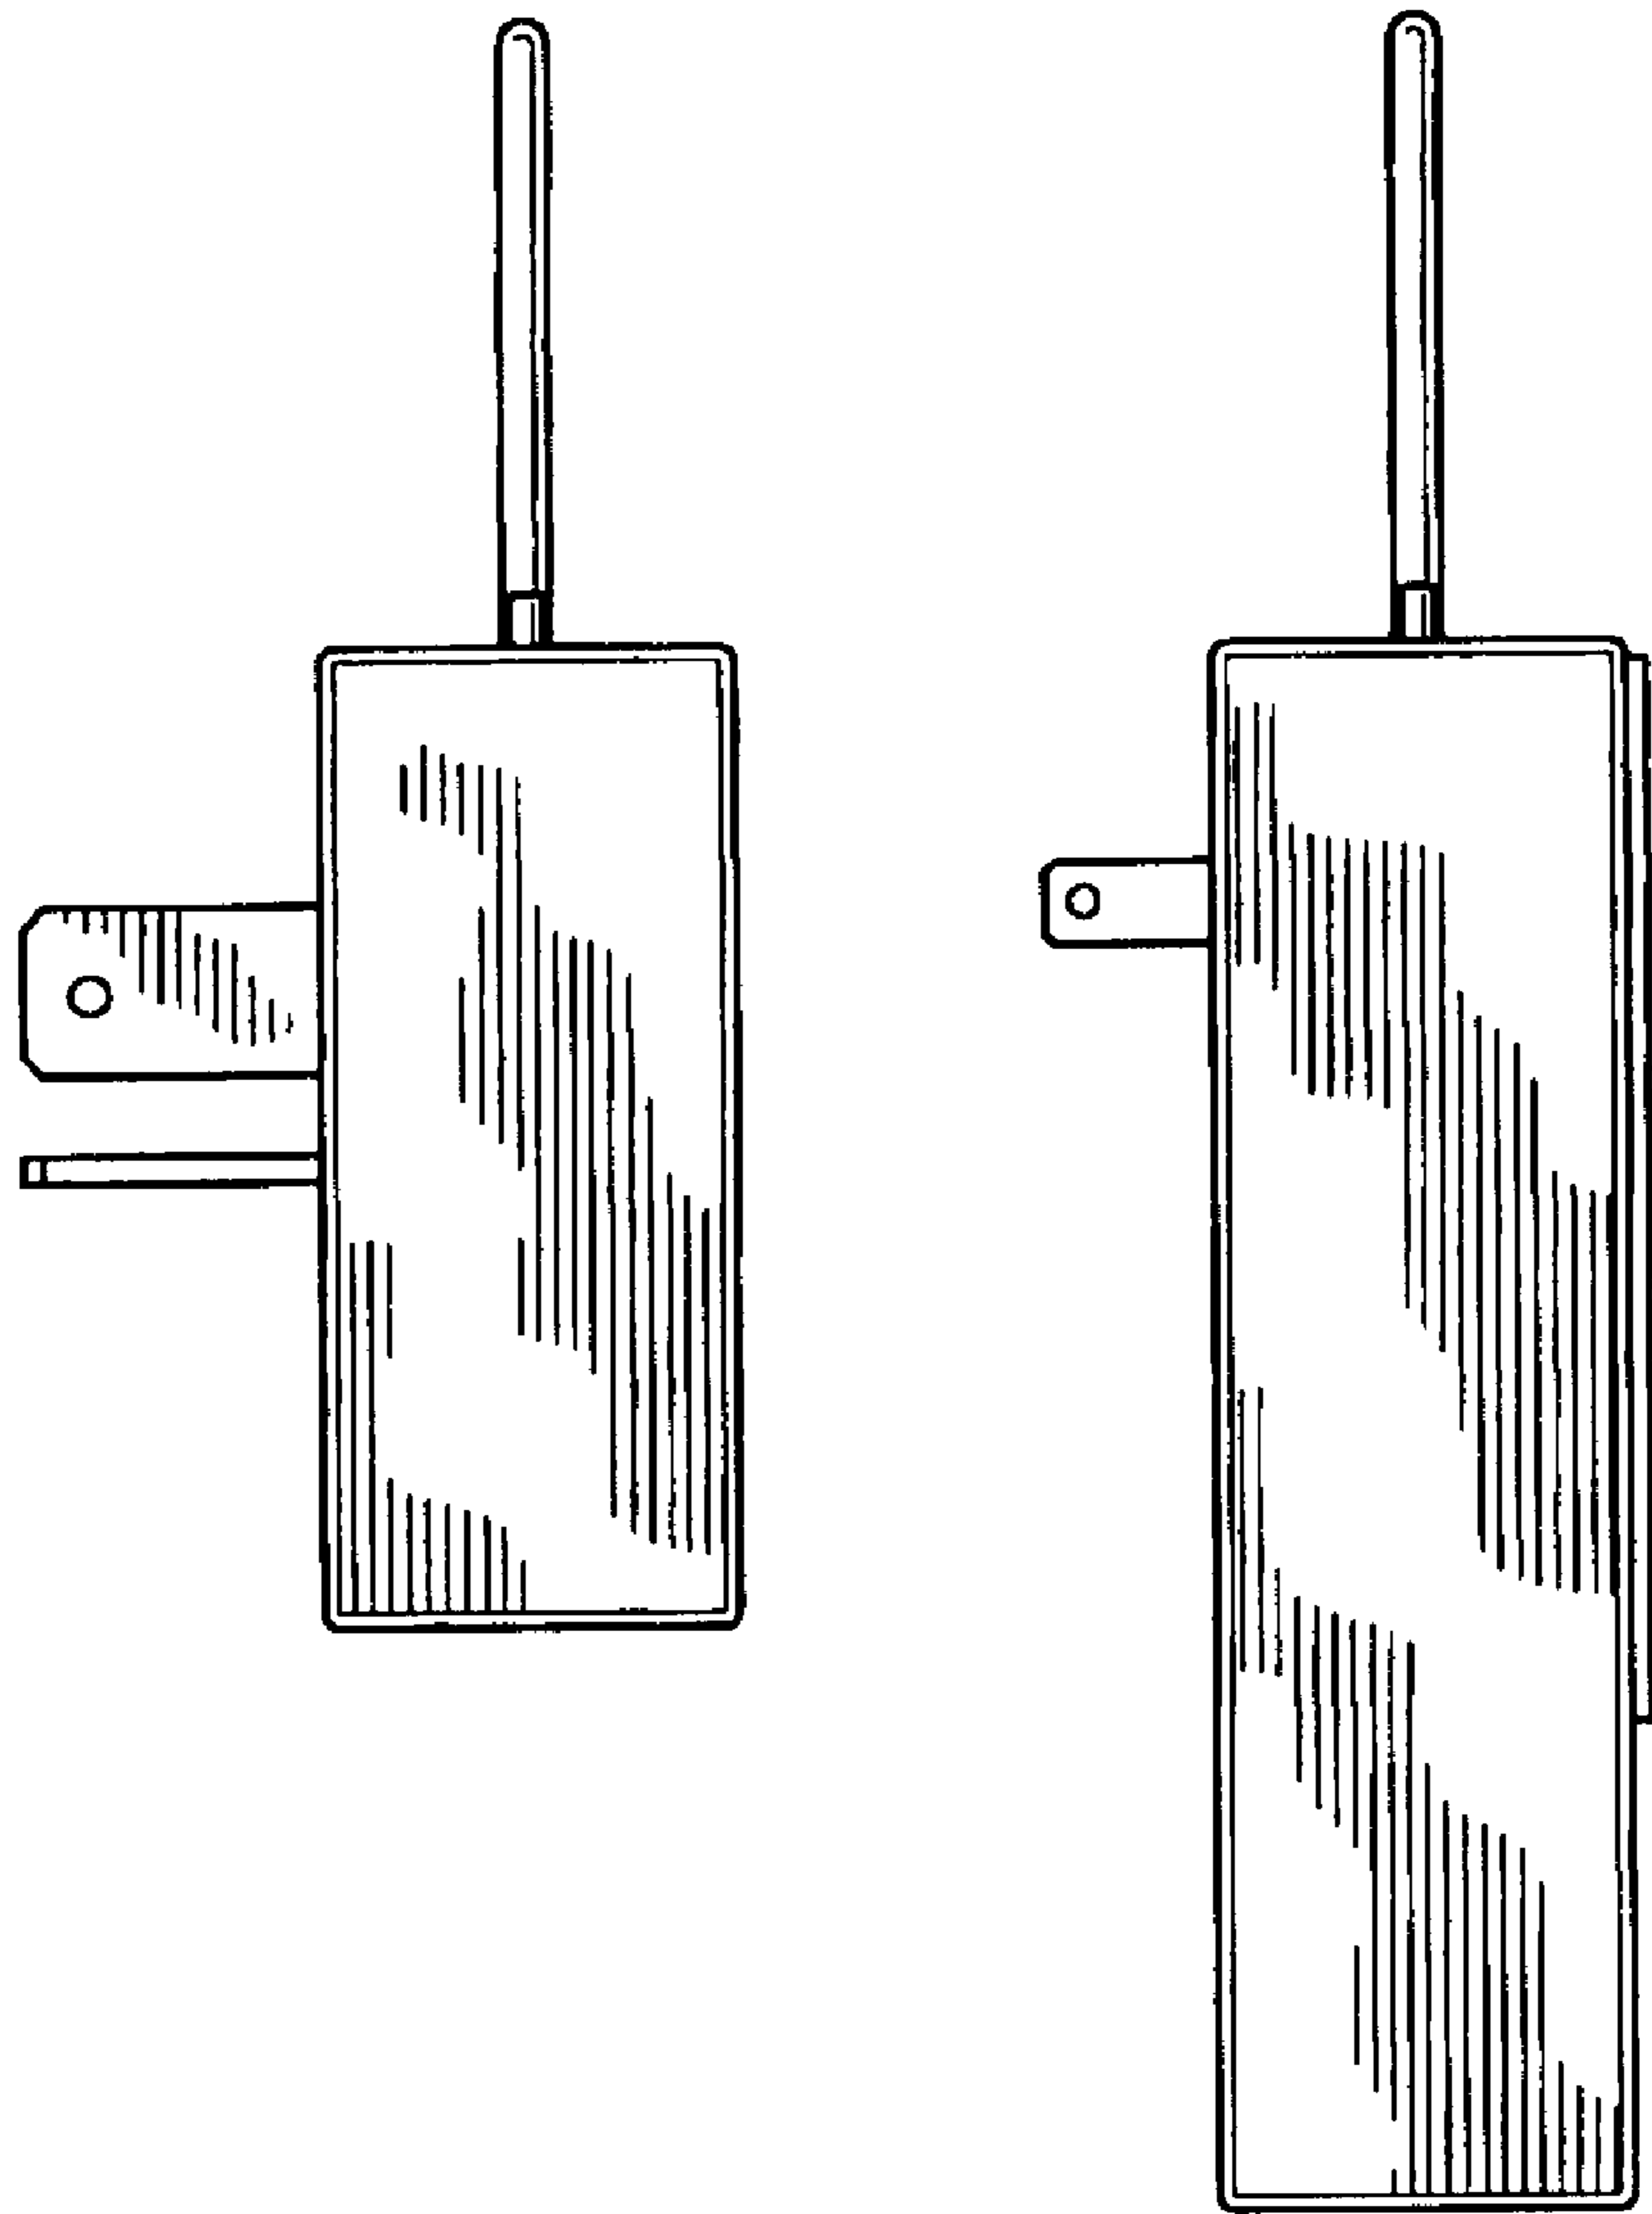


FIG.3

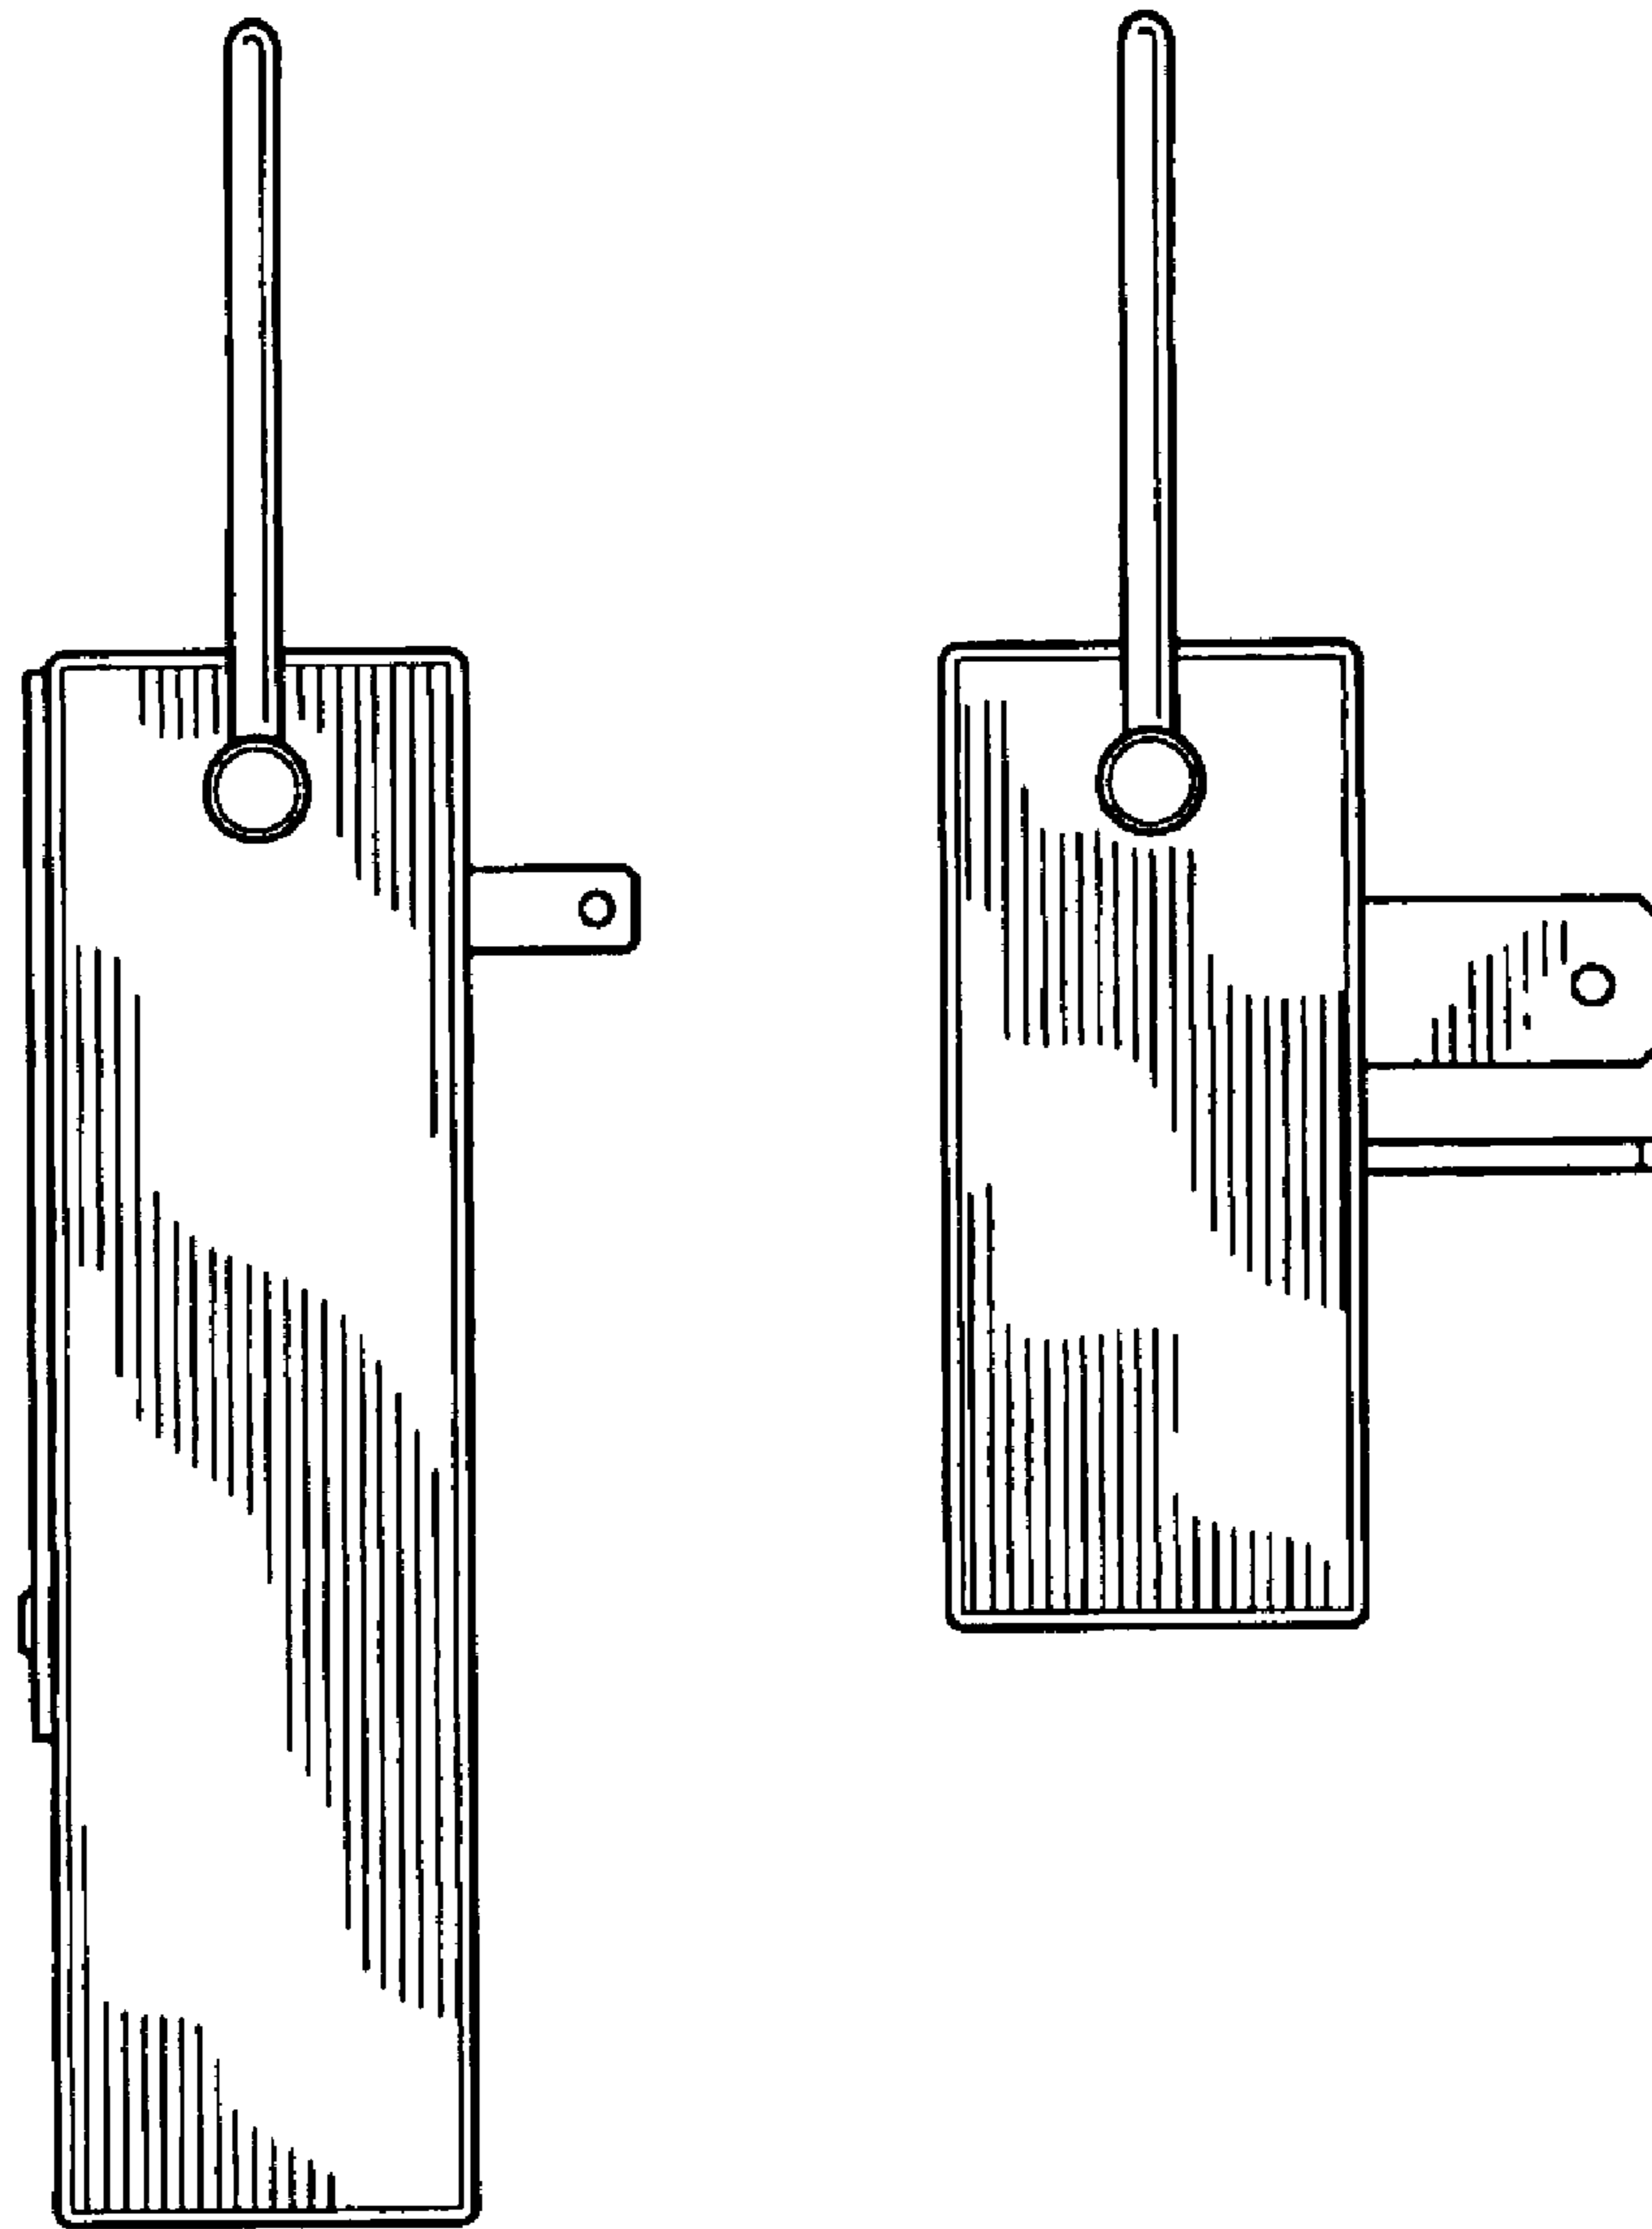


FIG.4

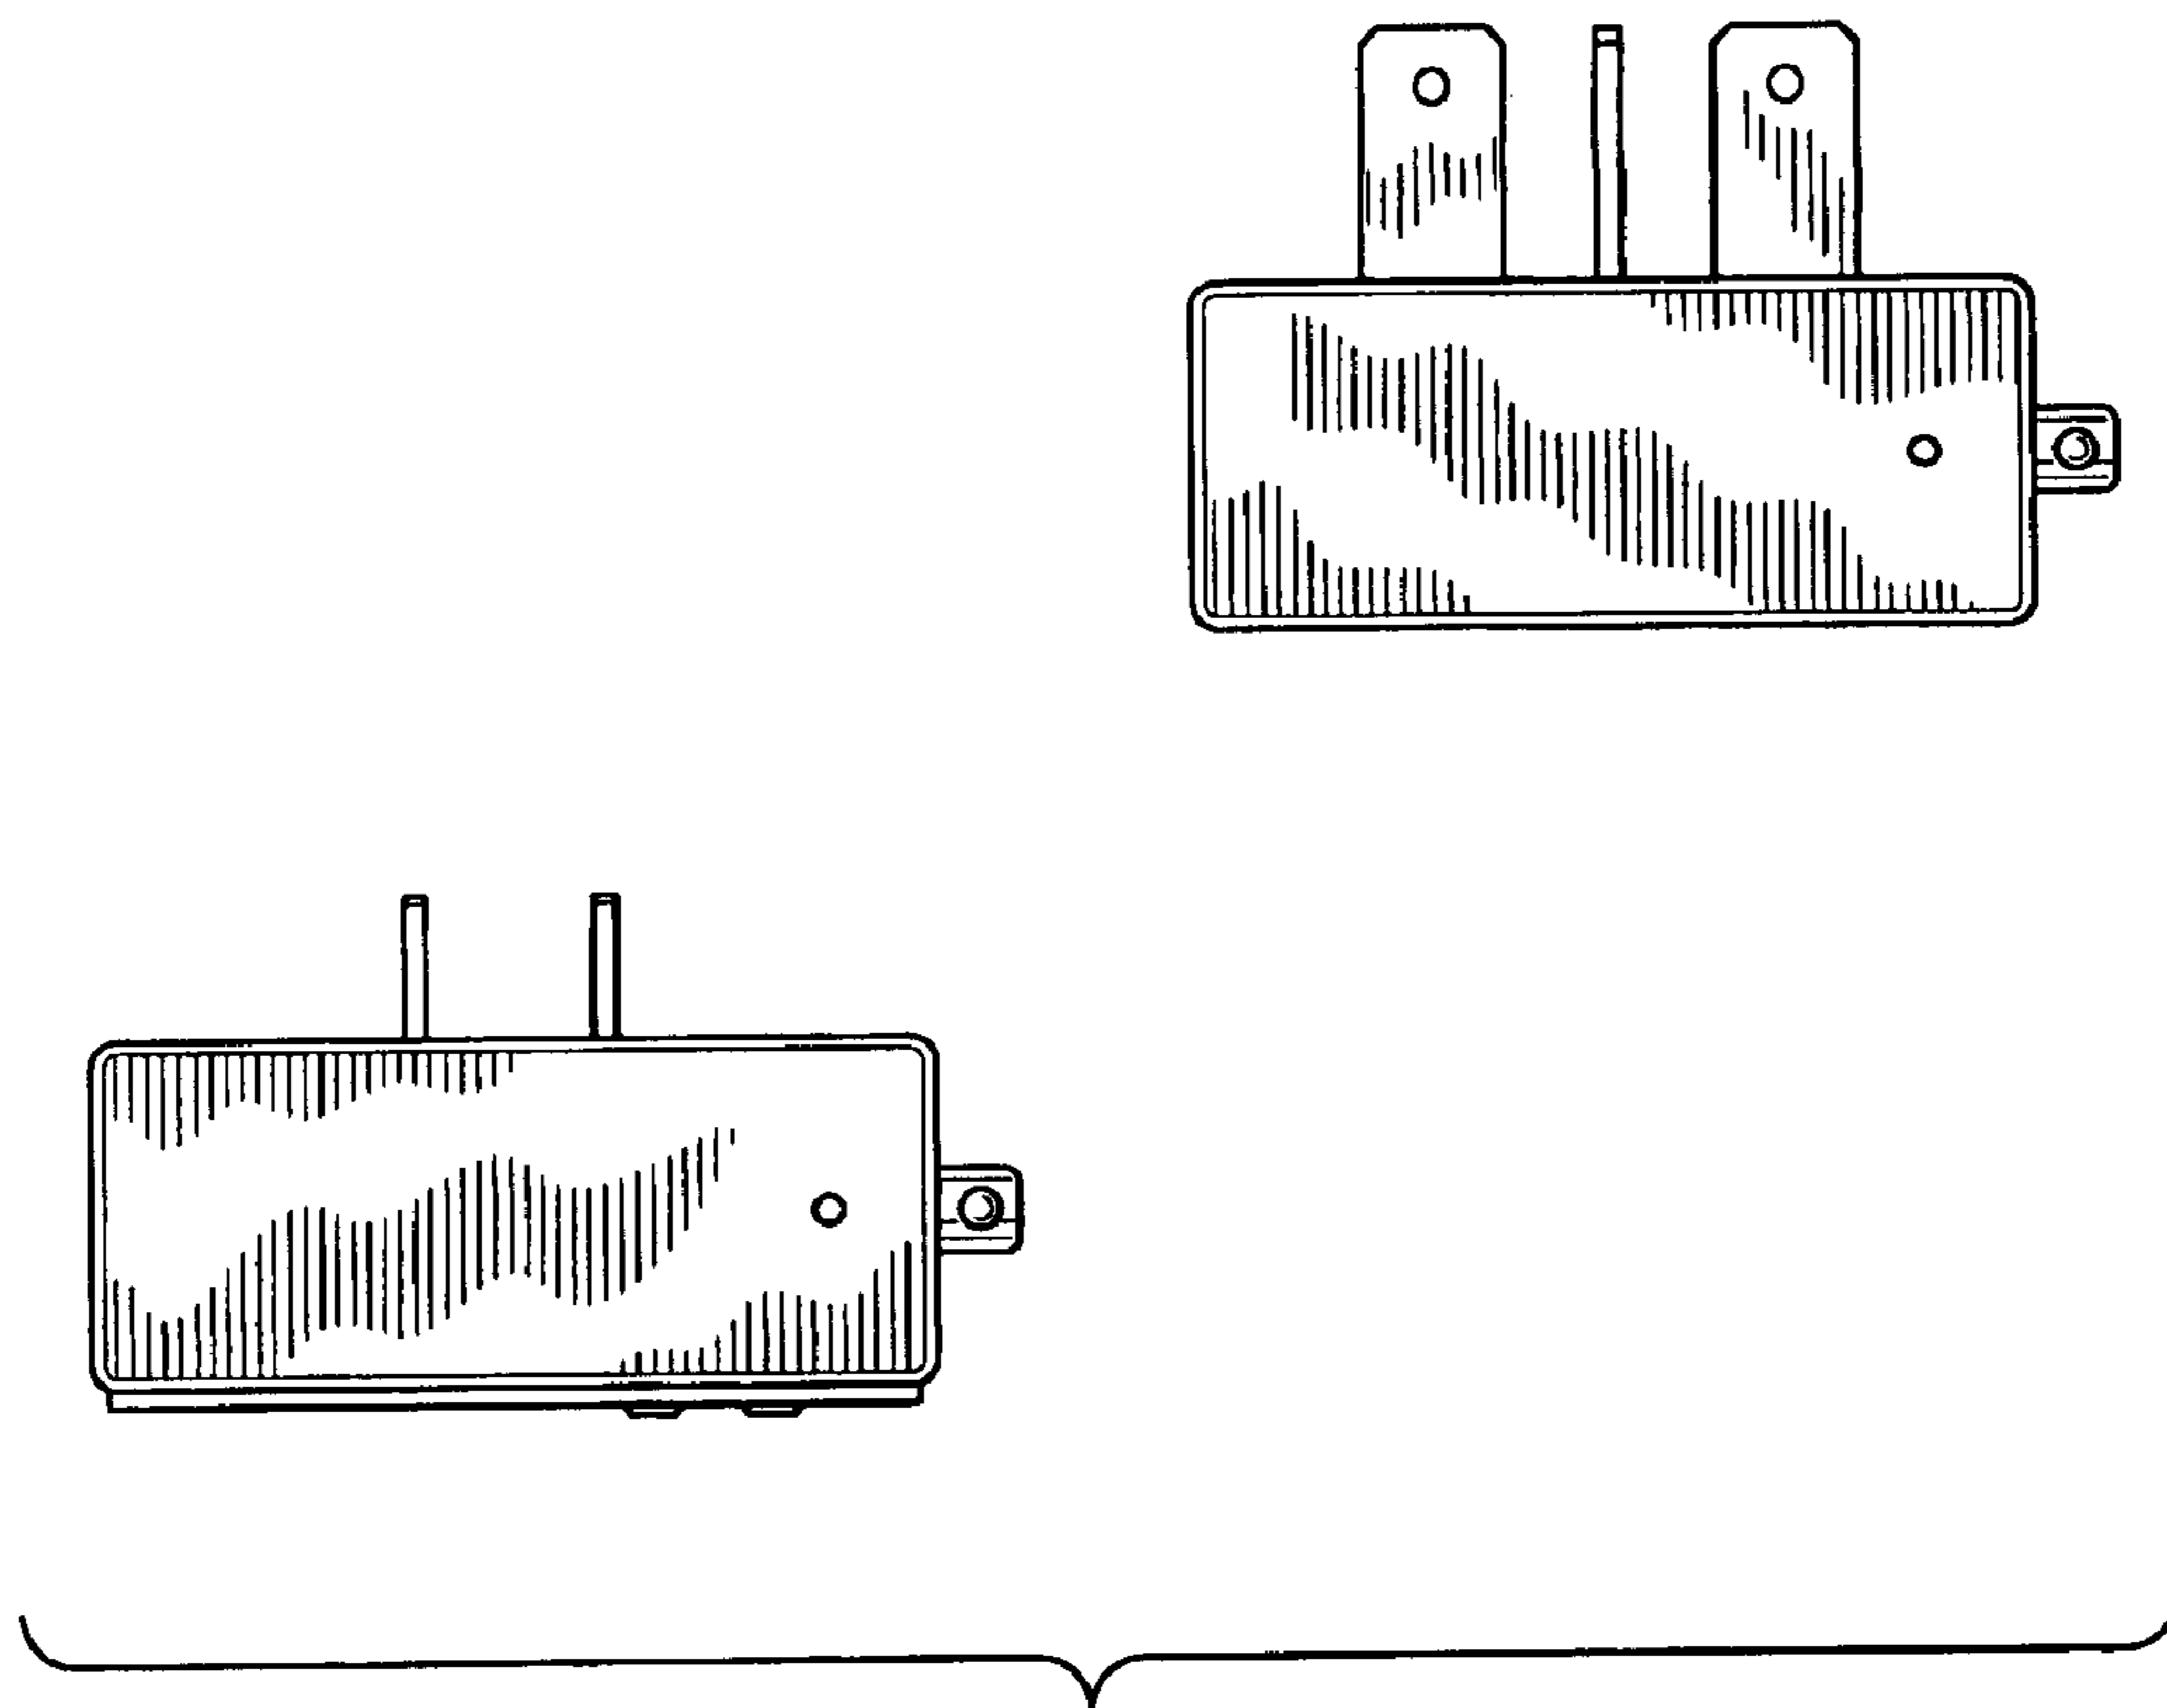


FIG.5

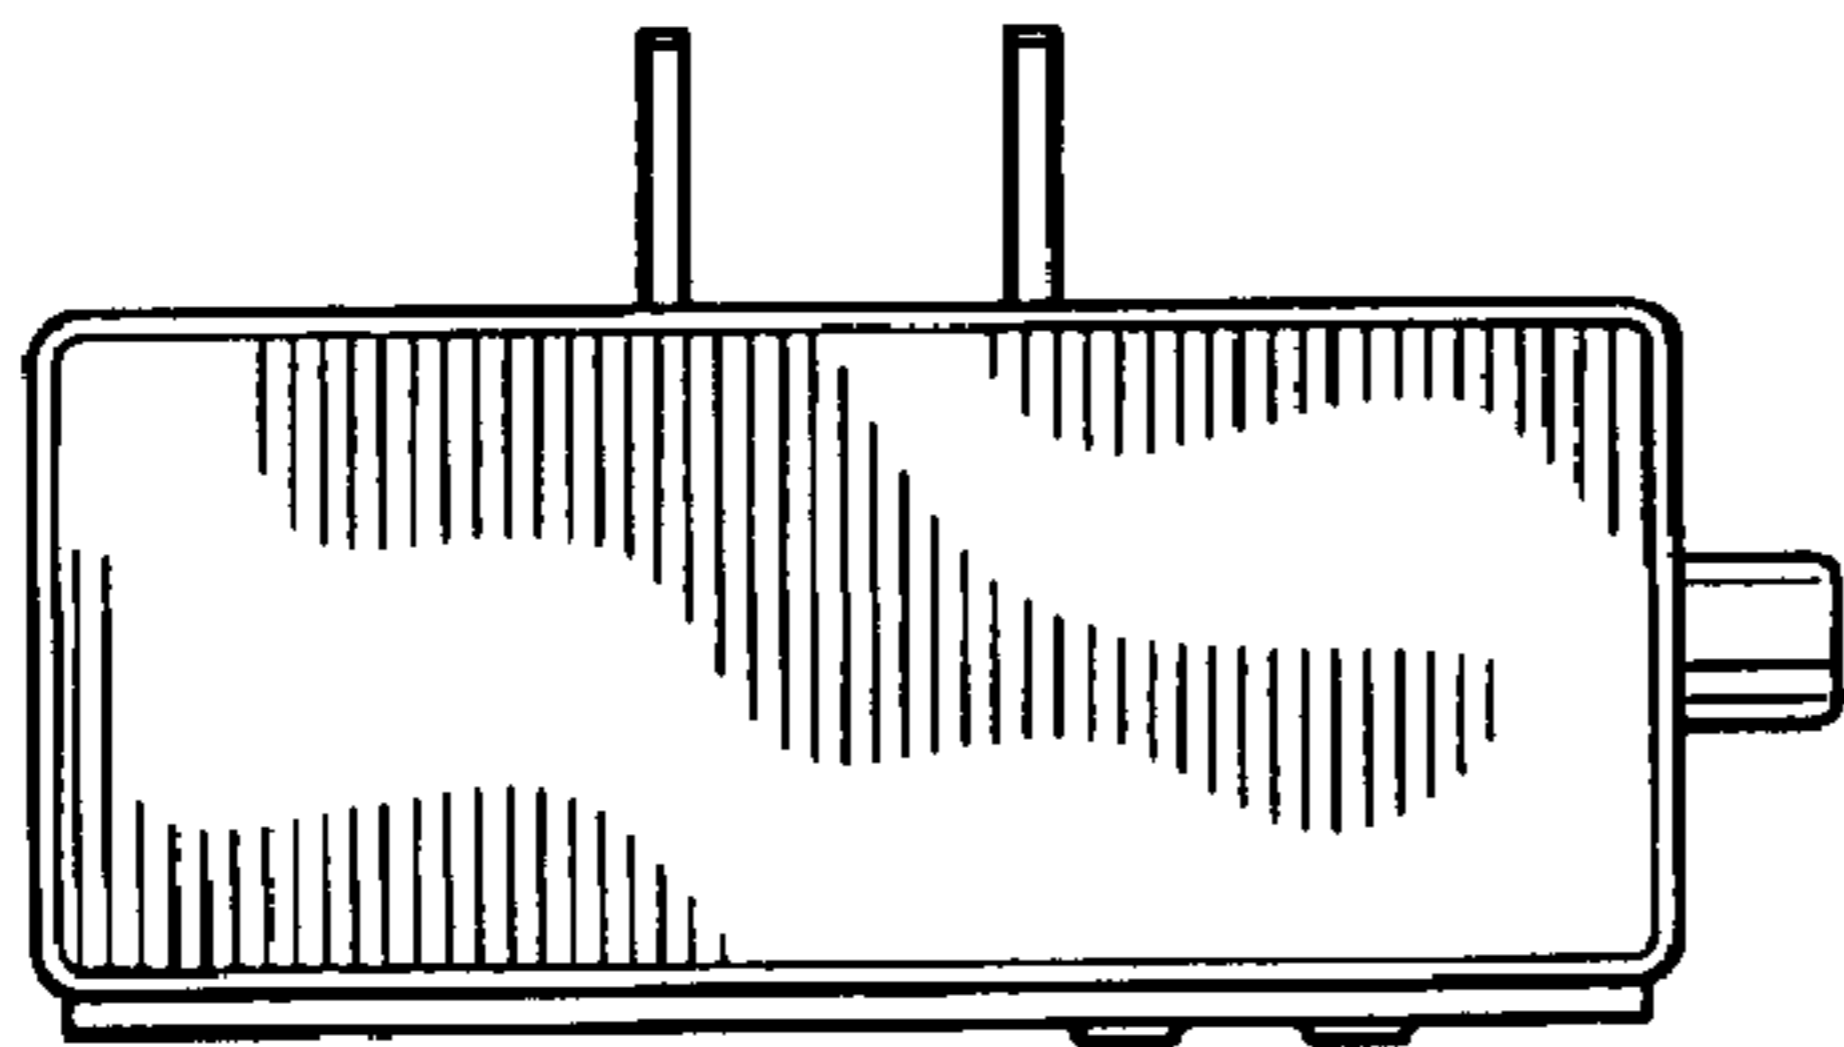
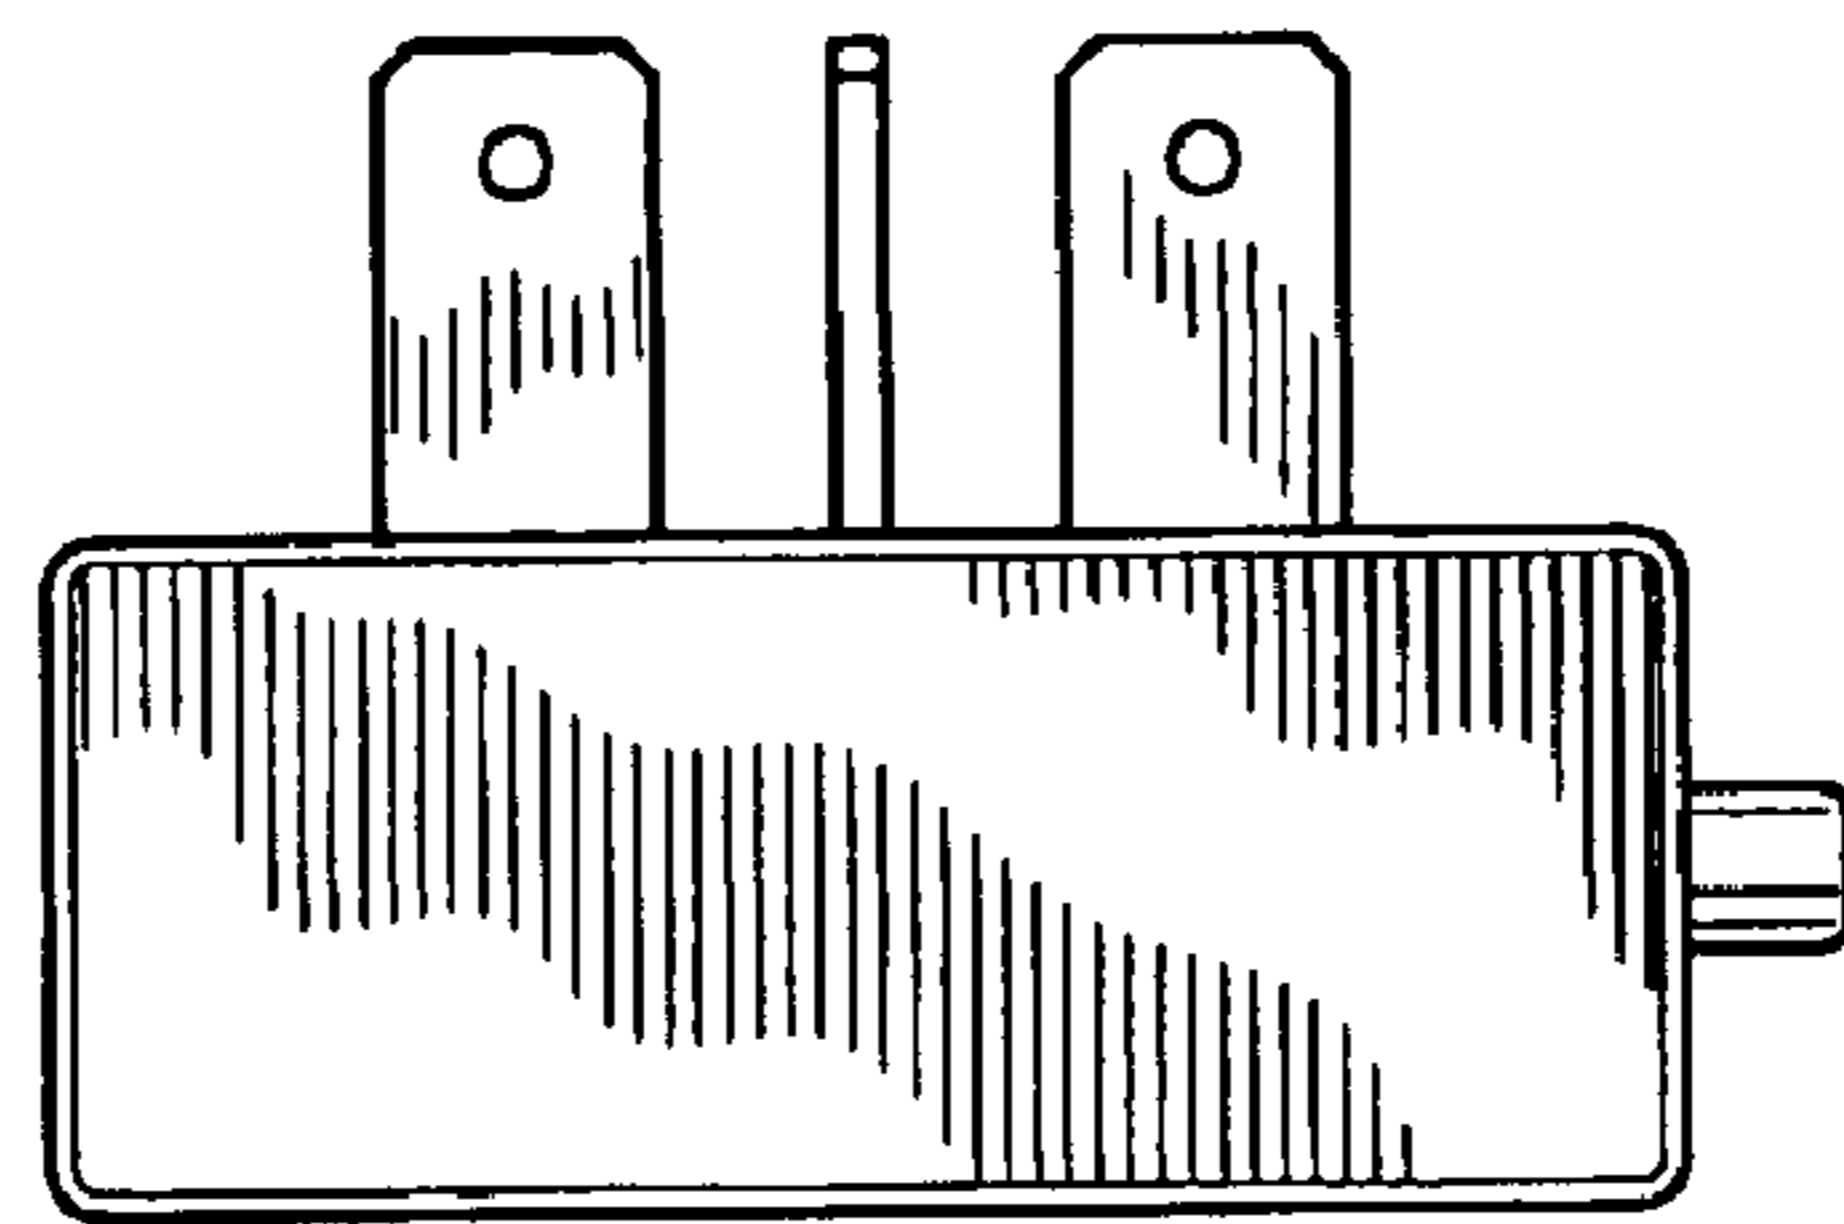


FIG.6

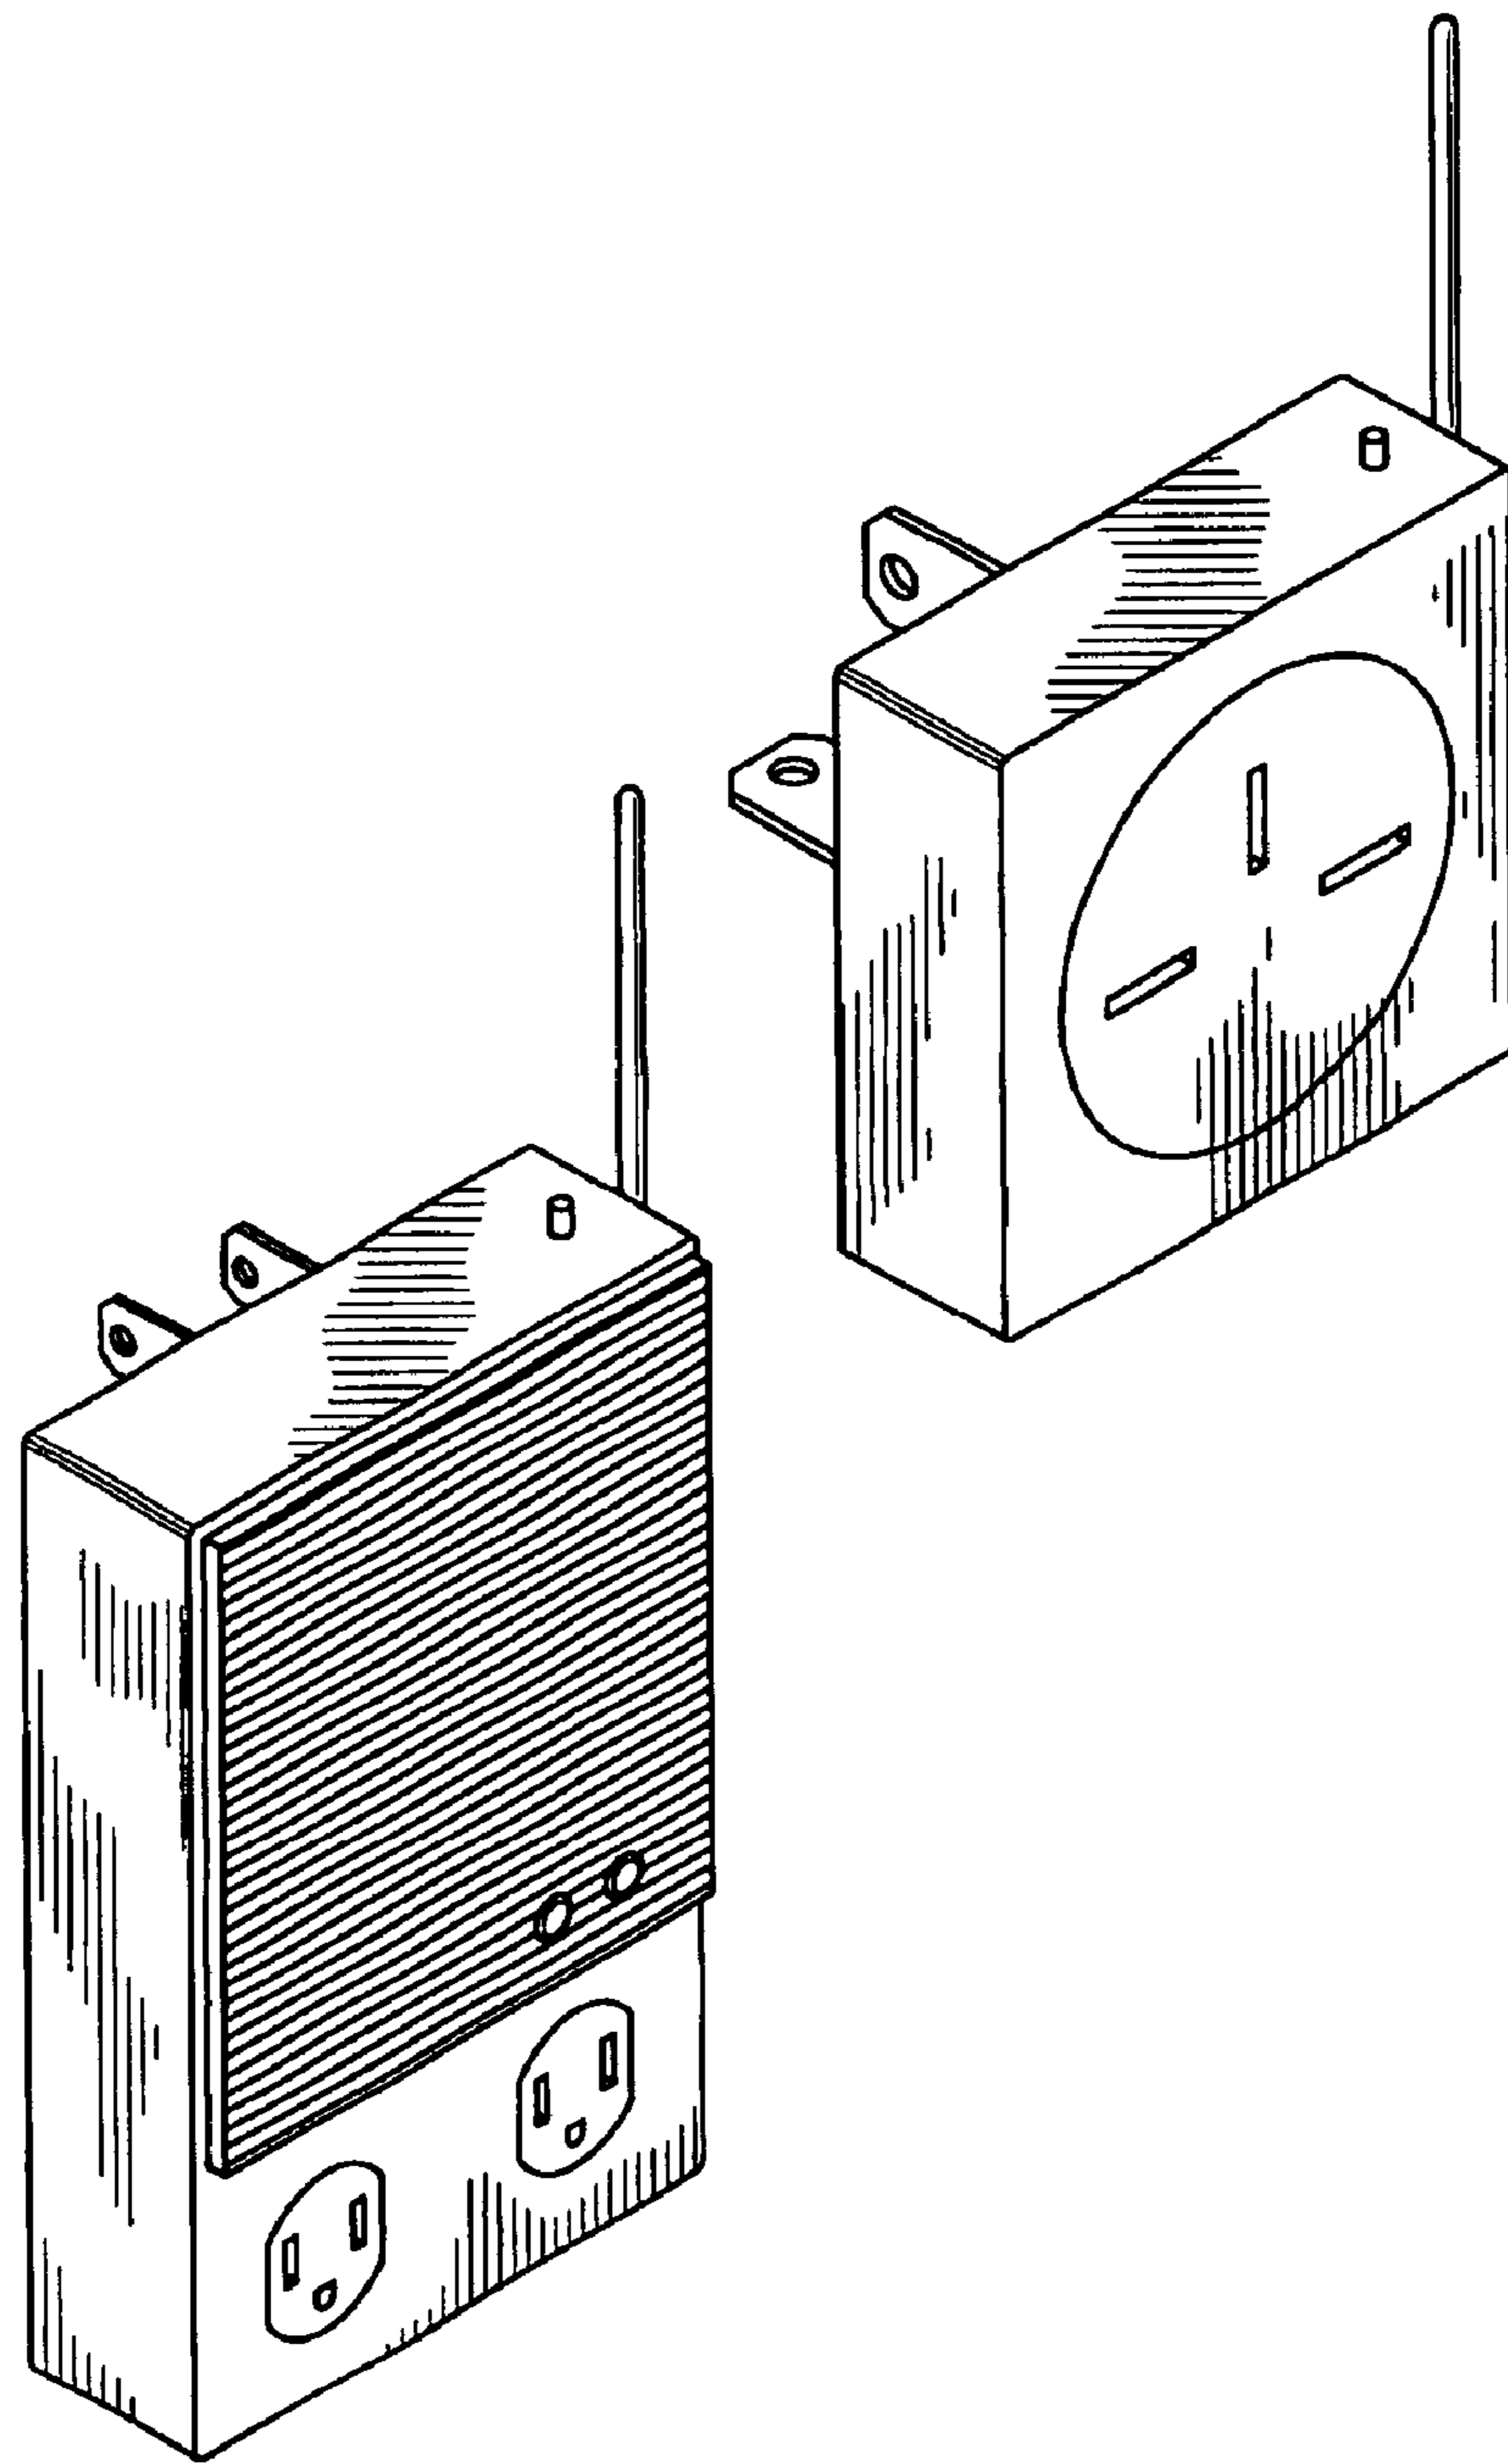


FIG.7