



US00D591700S

(12) **United States Design Patent**
Vojtila et al.

(10) **Patent No.:** **US D591,700 S**
(45) **Date of Patent:** **** May 5, 2009**

(54) **INSULATION BARRIER FOR ELECTRICAL POWER EQUIPMENT**

(75) Inventors: **Robert Vojtila**, Southington, CT (US);
Mark Hatje, Cheshire, CT (US);
Herbert Kleinegger, Bristol, CT (US)

(73) Assignee: **Midsun Group, Inc.**, Southington, CT (US)

(**) Term: **14 Years**

(21) Appl. No.: **29/288,212**

(22) Filed: **Jun. 4, 2007**

(51) **LOC (9) Cl.** **13-99**

(52) **U.S. Cl.** **D13/199; D30/199**

(58) **Field of Classification Search** D13/199;
D30/199; 119/174; 174/5 R, 135, 139; 52/101
See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

1,766,636 A	6/1930	Holzel
2,999,479 A	9/1961	Carder
3,005,436 A	10/1961	Caldwell
3,192,311 A	6/1965	Weinfurt
3,410,936 A	11/1968	Juras
3,639,678 A	2/1972	Muschong
3,639,681 A	2/1972	Ettlinger
4,053,707 A	10/1977	Ely et al.
4,110,943 A	9/1978	Carlson
4,201,883 A	5/1980	Shepherd
4,359,844 A	11/1982	Hoggard et al.
4,500,595 A	2/1985	Gerteisen et al.
4,535,197 A	8/1985	Butler
4,637,164 A	1/1987	Brown
4,664,971 A	5/1987	Soens
4,731,507 A	3/1988	Torimoto et al.
4,803,819 A	2/1989	Kelsey
4,845,307 A	7/1989	Cumming et al.
4,906,801 A	3/1990	Beasley
5,023,406 A	6/1991	Thornley
5,293,721 A	3/1994	Richard et al.

5,293,835 A	3/1994	Shagoury
5,299,528 A	4/1994	Blankenship
5,326,947 A	7/1994	Edds et al.
5,446,242 A	8/1995	Barrett
5,644,641 A	7/1997	Ikeda
5,648,641 A	7/1997	Guthrie
5,650,594 A	7/1997	Urnovitz

(Continued)

FOREIGN PATENT DOCUMENTS

GB 1021457 11/1964

(Continued)

OTHER PUBLICATIONS

“Animal Caused Outages”, Figures 8.1, 8.16, and 8.20, prepared by Southern Engineering Company Rural Electric Research, National Rural Electric Cooperative Association Copyright 1996, 5 pages.

(Continued)

Primary Examiner—Selina Sikder
(74) *Attorney, Agent, or Firm*—Howard IP Law Group, PC


(57) **CLAIM**

The ornamental design for an insulation barrier for electrical power equipment, as shown and described.

DESCRIPTION

FIG. 1 is a perspective view of an insulation barrier for electrical power equipment showing our new design;
FIG. 2 is a top plan view thereof; a bottom plan view being a mirror image thereof;
FIG. 3 is a right-side elevational view thereof; a left-side elevational view being a mirror image thereof;
FIG. 4 is a front elevational view thereof; and,
FIG. 5 is a rear elevational view thereof.

1 Claim, 4 Drawing Sheets

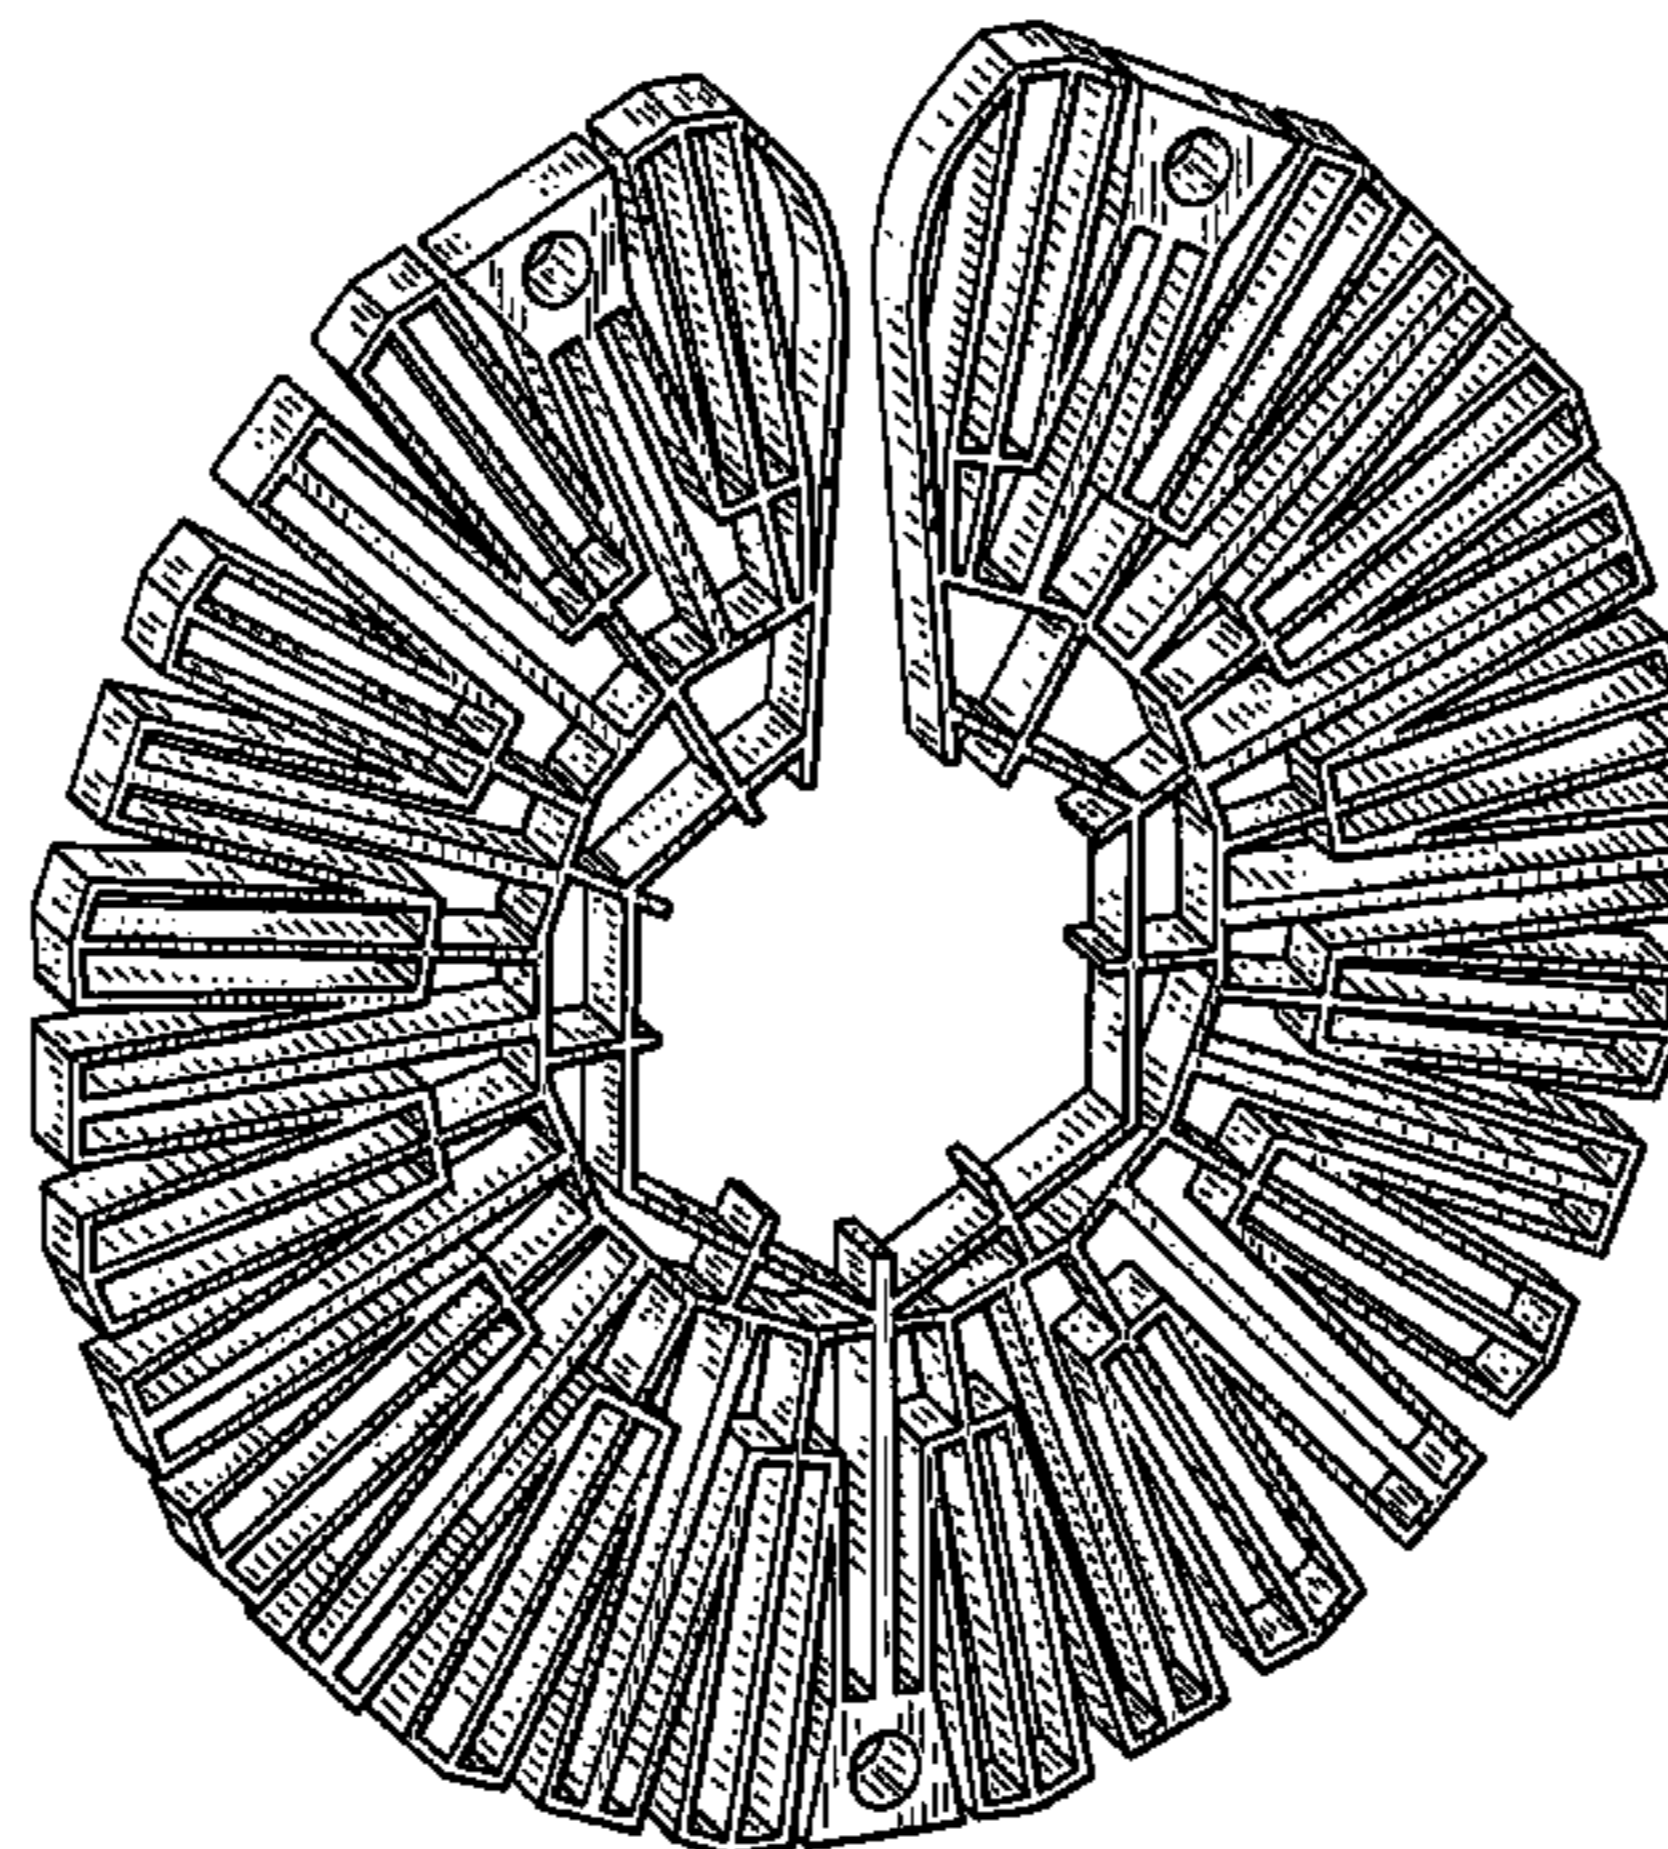

US D591,700 S

Page 2

U.S. PATENT DOCUMENTS

5,679,922 A 10/1997 Harben
5,682,015 A 10/1997 Harben
5,794,495 A 8/1998 Anderson
5,834,686 A 11/1998 Barrett et al.
5,864,096 A 1/1999 Williams et al.
5,873,324 A 2/1999 Kaddas et al.
5,884,426 A 3/1999 Ishida
6,005,196 A 12/1999 Spillyards
D432,742 S 10/2000 Puigcerver et al.
6,571,517 B2 6/2003 Wulff et al.
6,693,242 B1 2/2004 Bailey
6,878,883 B1 4/2005 Rauckman
2003/0015330 A1* 1/2003 Wood et al. 174/5 R
2008/0217053 A1* 9/2008 Vojtila et al. 174/5 R

FOREIGN PATENT DOCUMENTS

GB 1542845 3/1979

WO 9510844 A1 4/1995
WO 9635217 A1 11/1996

OTHER PUBLICATIONS

Cooper Power Systems equipment brochure No. K-SEC 183, "Hi-Line Cover-Up Equipment" pp. 1-20, dated Mar. 1998.
Hubbell/Chance Power Systems, Inc., catalog p. 2403 "Conductor and Insulator Covers" and p. 2408 Crossarm Cover and Conductor and Insulator Covers dated Jan. 2002.
Internet pages printed Sep. 11, 2003 from www.critterguard.org: "Reliability demands the only true barrier!" (5 sheets total, 2 of which are essentially blank).
3M brochure No. 78-8121-1101-7, copyright 1998: "Electrostatic Animal Guard (formerly the Guthrie Guard)" (4 sheets total).
Page 325 (undated) of 3M Cable Accessory Products catalog "Electrostatic Animal Guard".

* cited by examiner

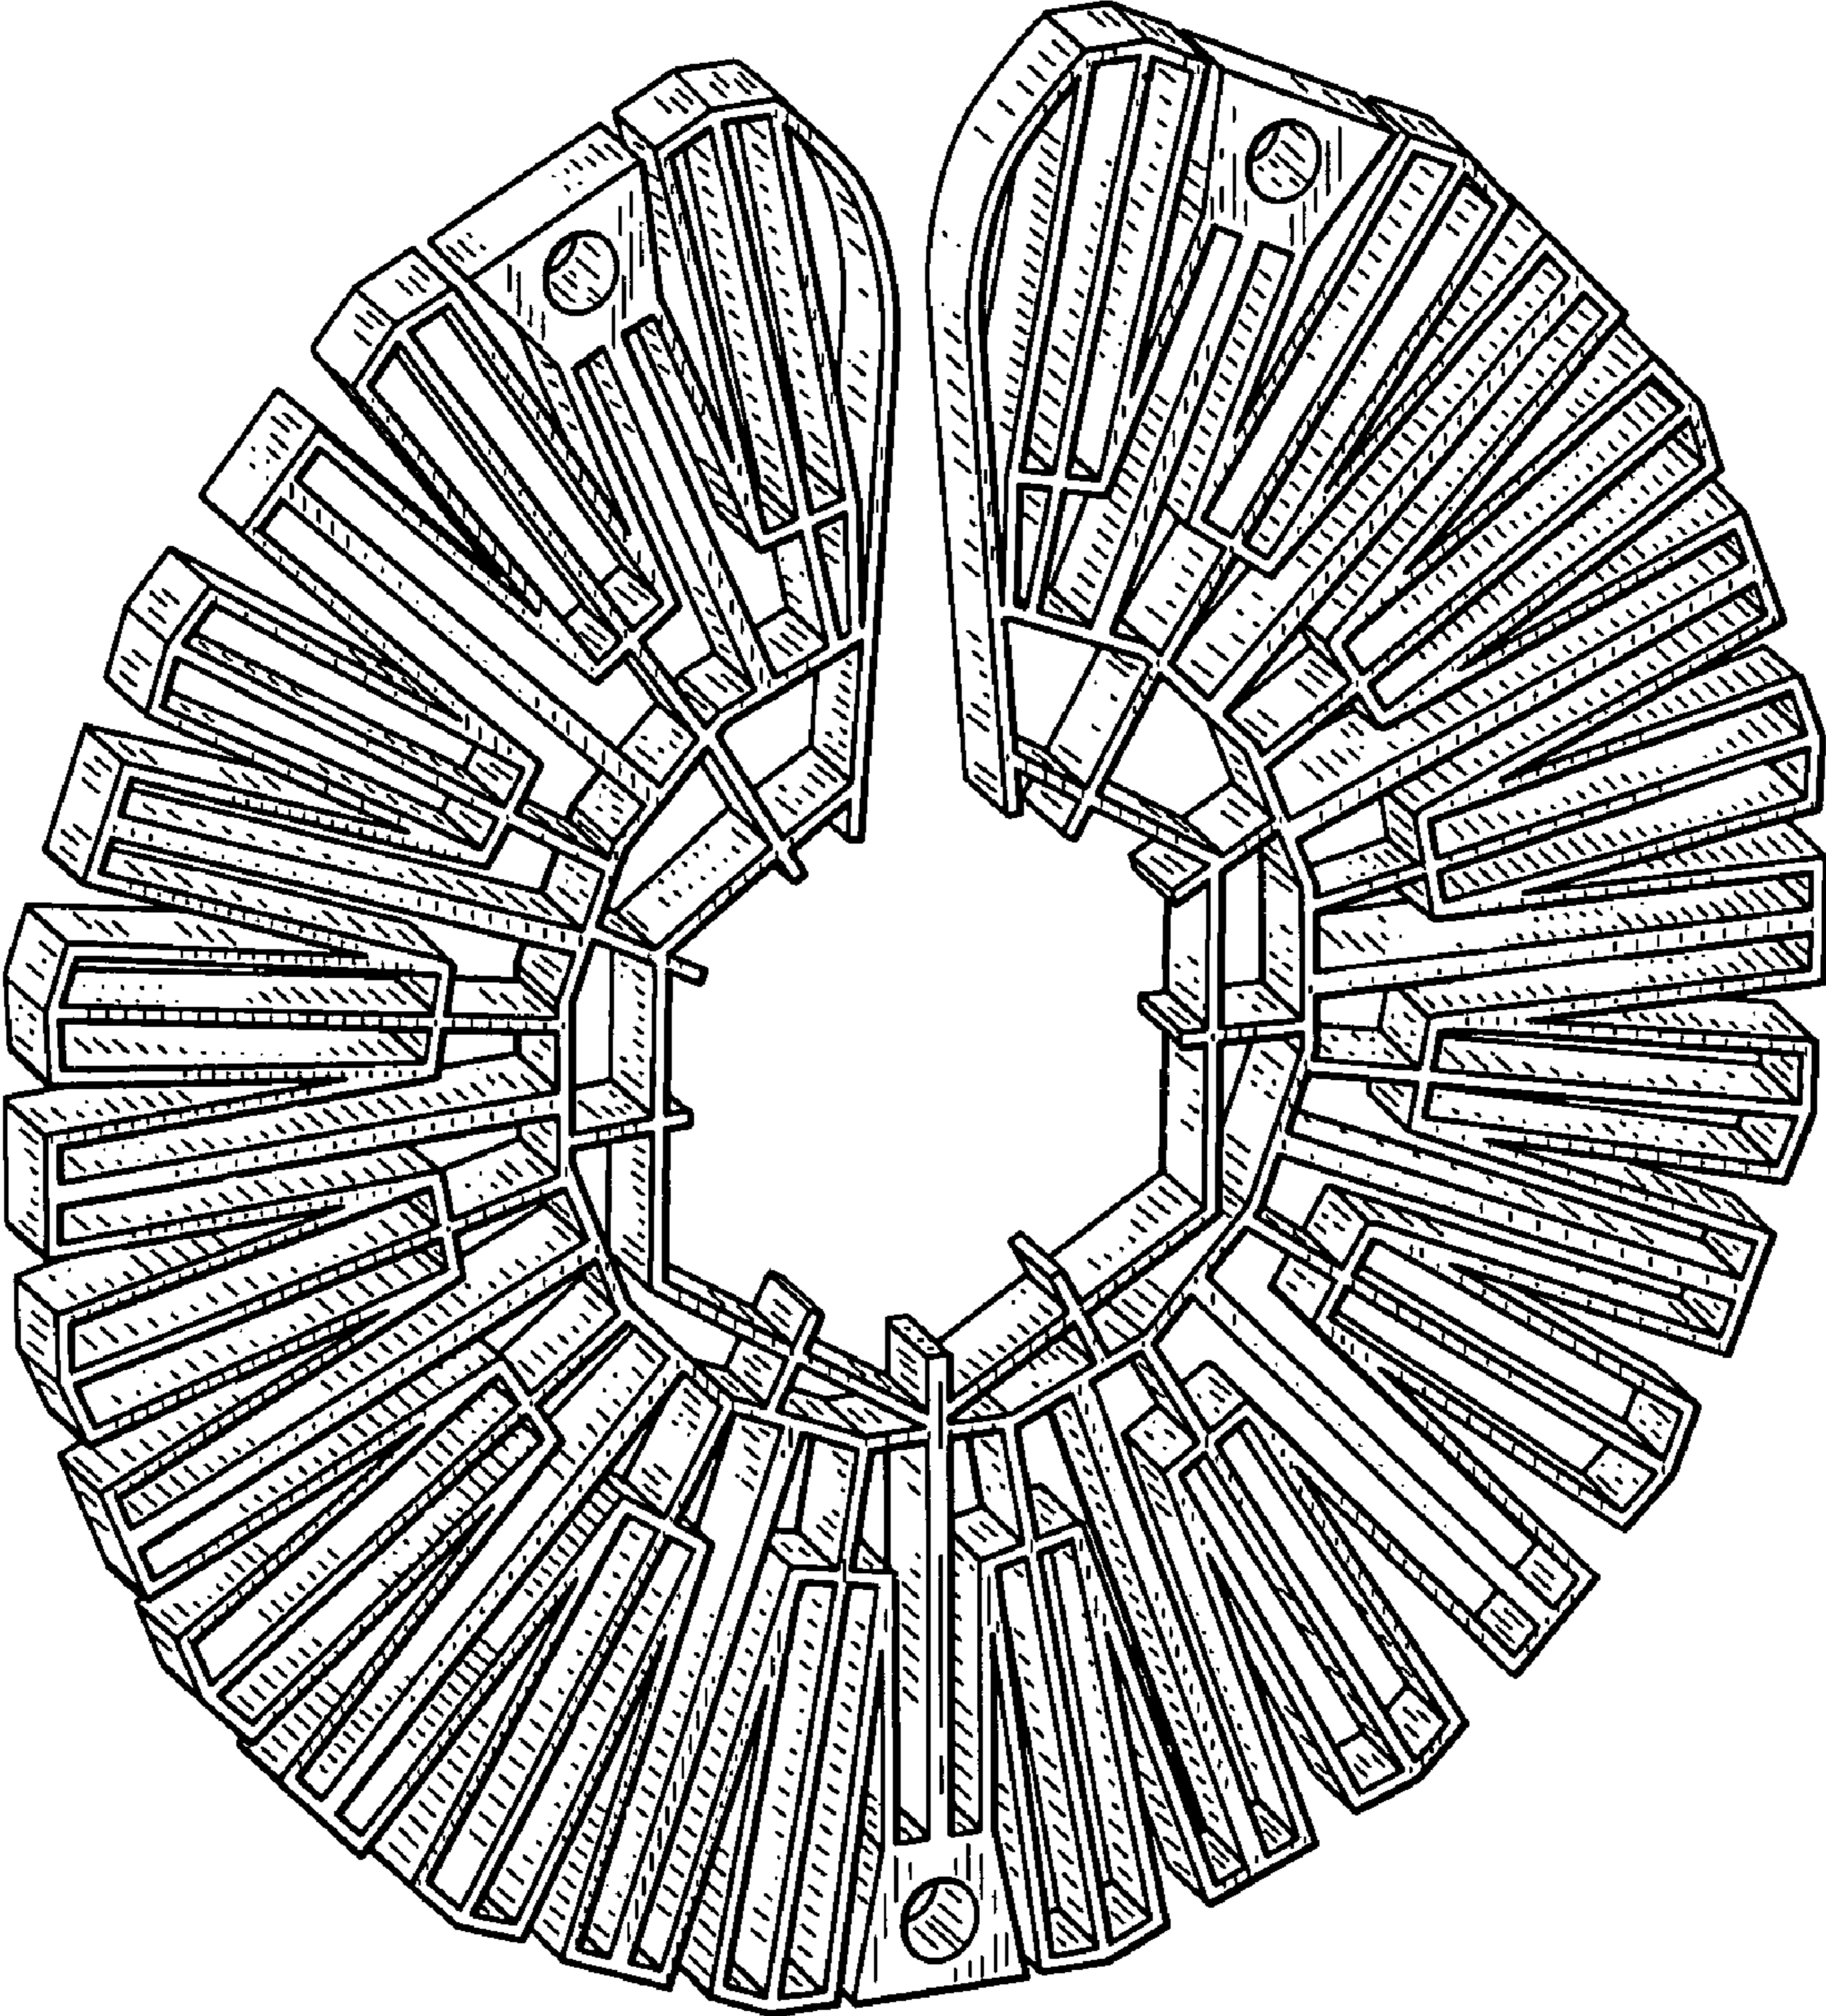


FIG. 1

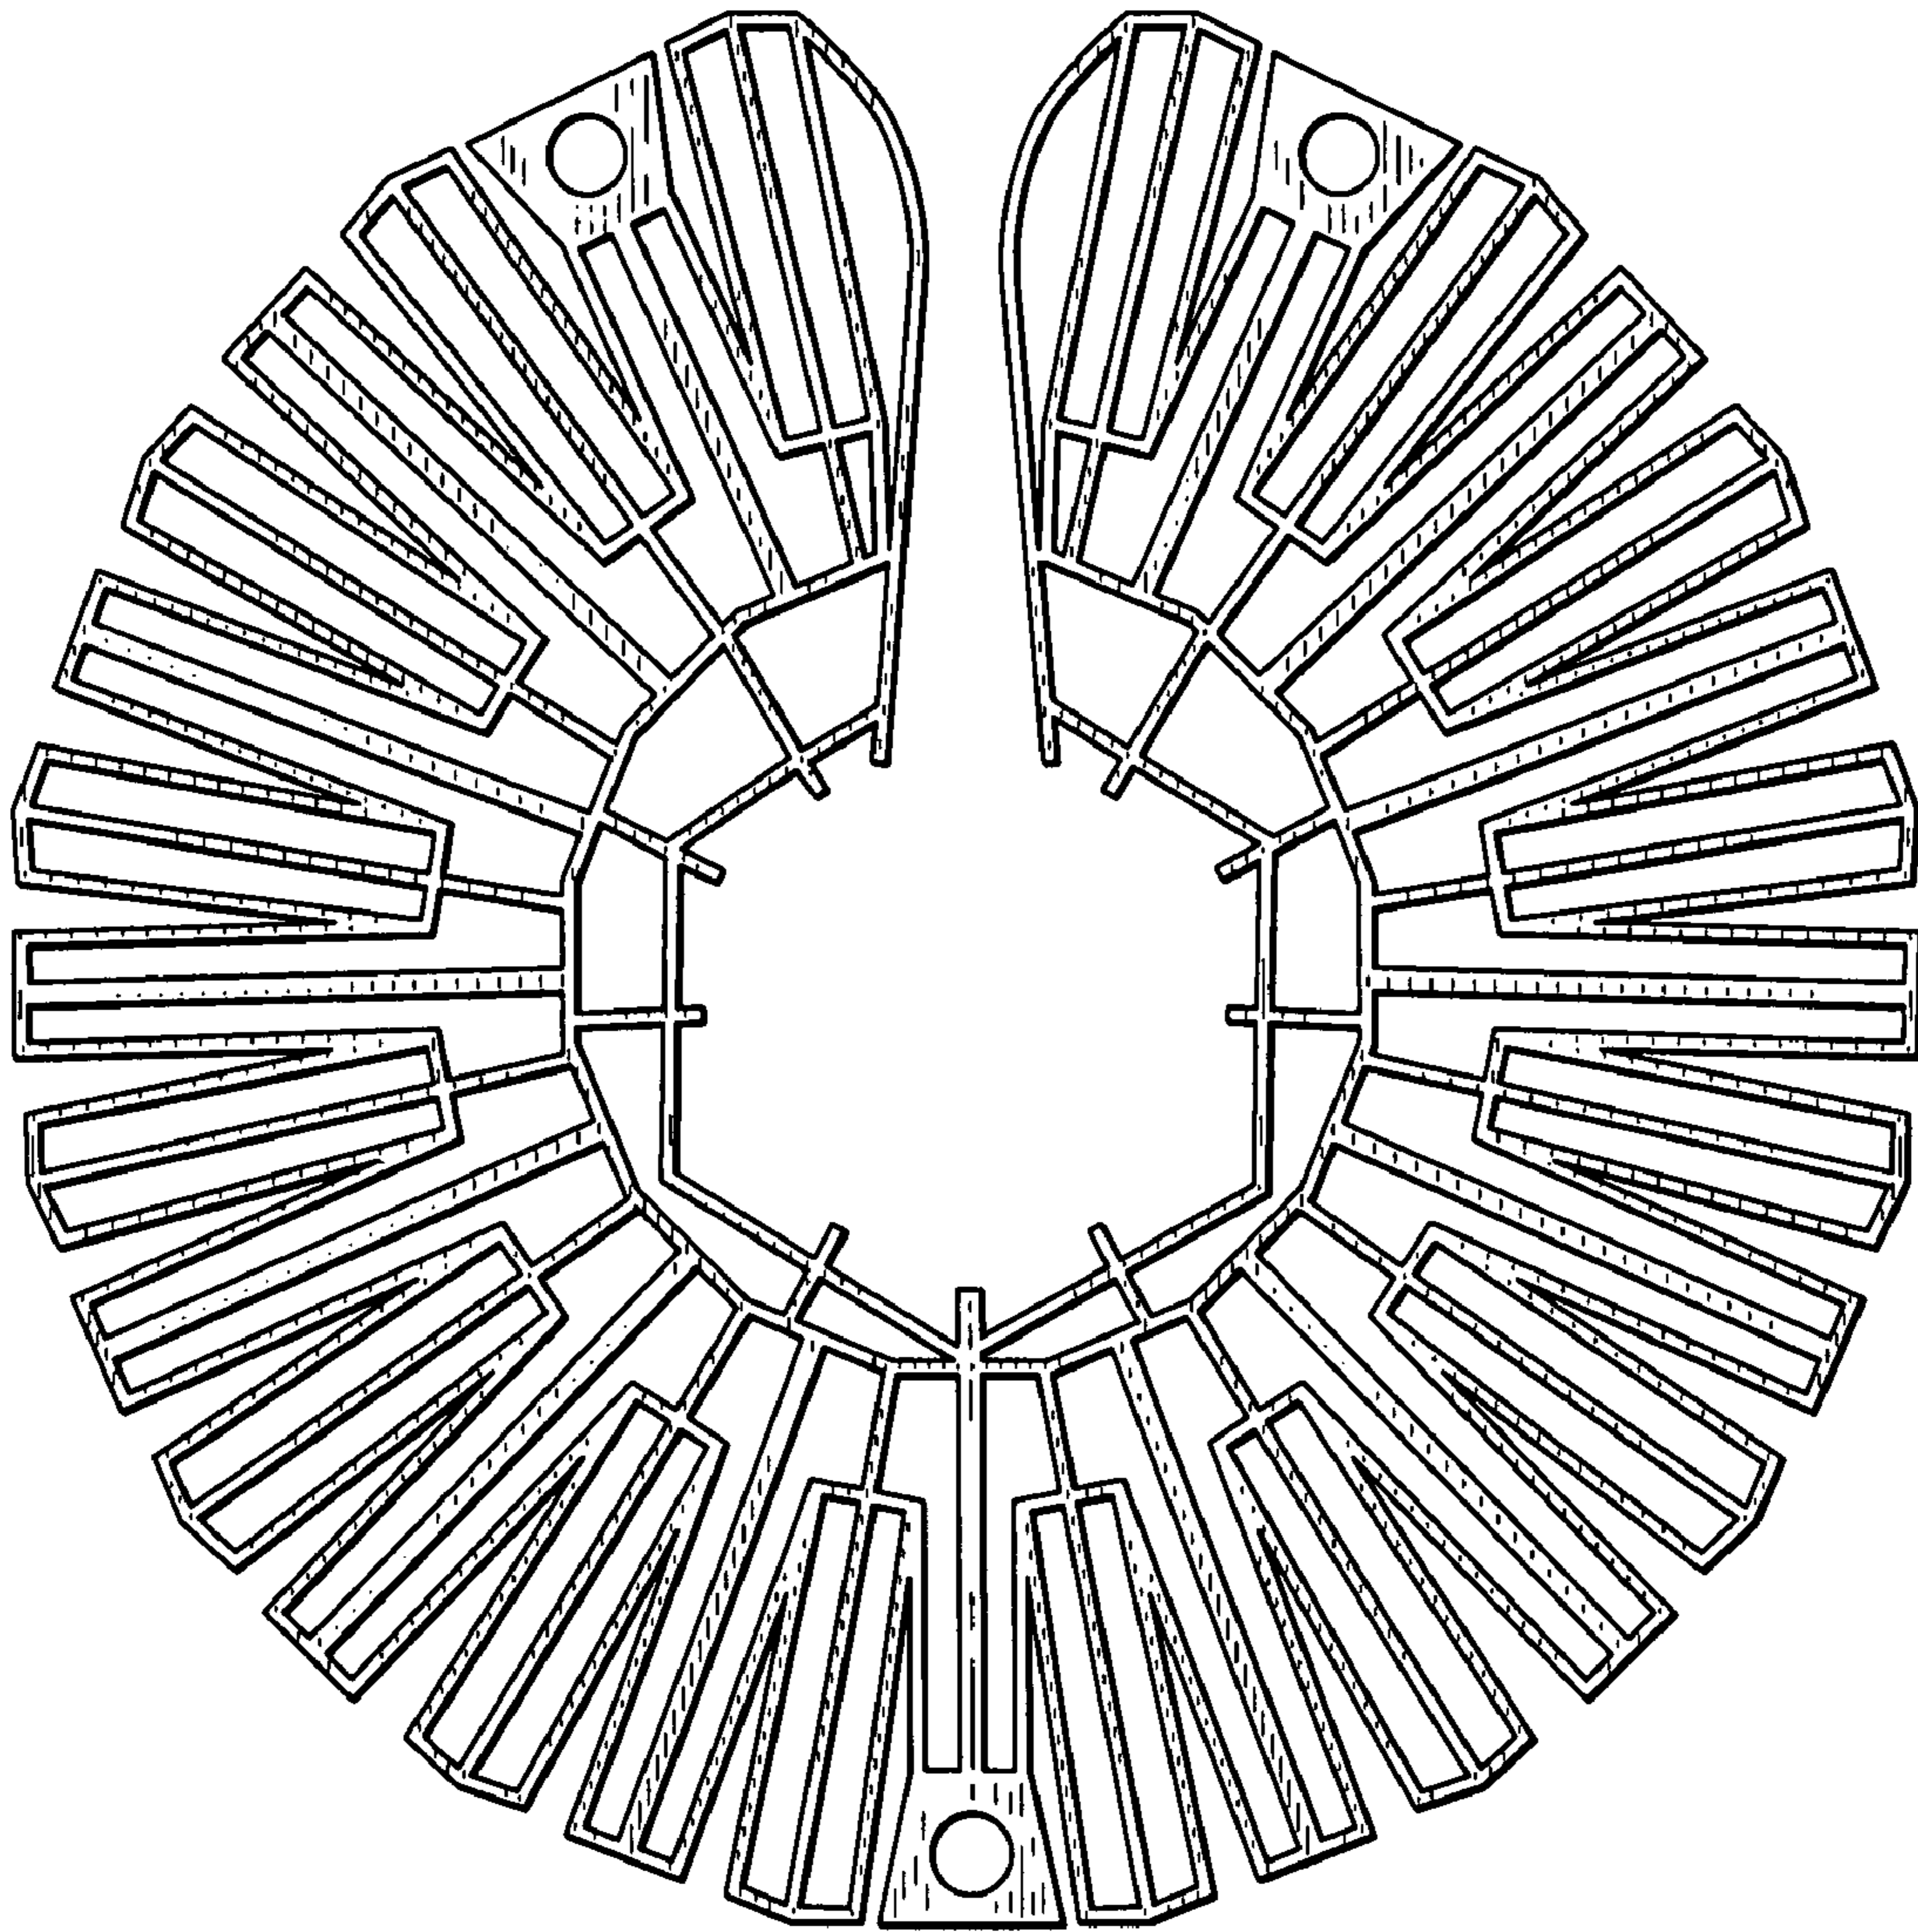


FIG. 2



FIG. 3



FIG. 4

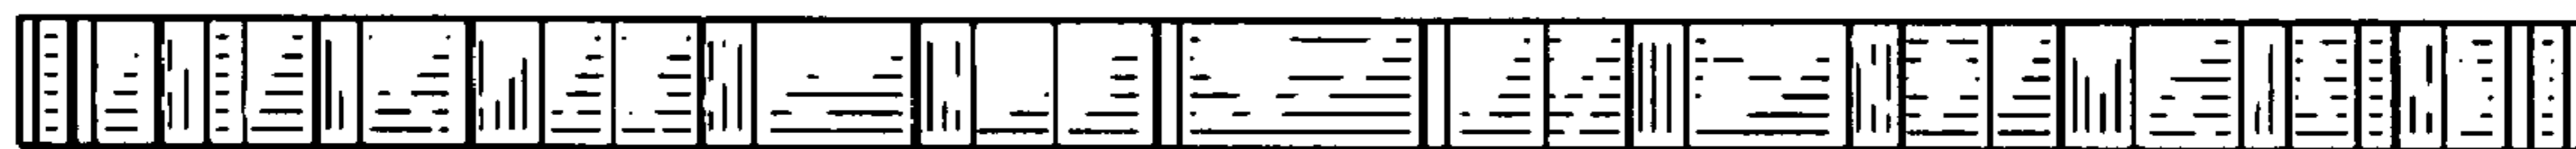


FIG. 5