



US00D675542S

(12) **United States Design Patent**  
**Breuer**

(10) **Patent No.:** **US D675,542 S**  
(45) **Date of Patent:** **\*\* Feb. 5, 2013**

(54) **HOUSING FOR SENSORS AND TRANSMITTERS FOR HVAC/R APPLICATIONS**

D447,963 S 9/2001 Ingebritson  
(Continued)

(75) Inventor: **Walter P. Breuer**, Westby, WI (US)

(73) Assignee: **Building Automation Products, Inc.**, Gays Mills, WI (US)

(\*\*) Term: **14 Years**

(21) Appl. No.: **29/372,846**

(22) Filed: **Jan. 21, 2011**

(51) **LOC (9) Cl.** ..... **10-04**

(52) **U.S. Cl.** ..... **D10/50**

(58) **Field of Classification Search** ..... D10/49-50;  
D13/162; 55/270, 274, 279, DIG. 7, DIG. 34;  
62/176.6, 125-130, 78, 180, 186; 73/23.2,  
73/23.34, 31.01, 31.02, 431, 170.16-170.19,  
73/170.21-170.25, 863.12, 29, 29.02, 335.01-335.14;  
236/46 R, 47, 94, 44 C, 44 R, 49.3, 44 A,  
236/96; 337/112, 327, 360; 340/602, 627,  
340/632, 634; 361/346; 364/141, 146, 147,  
364/188, 420, 557; 454/229, 239, 256, 257,  
454/258; 700/18, 159, 181

See application file for complete search history.

(56) **References Cited**

**U.S. PATENT DOCUMENTS**

|              |         |                    |        |
|--------------|---------|--------------------|--------|
| 3,946,613 A  | 3/1976  | Silver             |        |
| D264,190 S   | 5/1982  | Muller             |        |
| D314,155 S   | 1/1991  | Toivonen           |        |
| D333,792 S   | 3/1993  | Odom, Jr.          |        |
| D361,947 S   | 9/1995  | Cochran et al.     |        |
| D364,350 S   | 11/1995 | Pasquarette et al. |        |
| D366,429 S   | 1/1996  | Dexter et al.      |        |
| D378,900 S   | 4/1997  | de Sieyes et al.   |        |
| D381,279 S   | 7/1997  | Ingebritson et al. |        |
| D390,134 S   | 2/1998  | Ingebritson et al. |        |
| D390,482 S   | 2/1998  | Pasquarette        |        |
| D393,214 S   | 4/1998  | Ingebritson et al. |        |
| D403,972 S   | 1/1999  | Gaskell et al.     |        |
| D418,437 S * | 1/2000  | Peterson           | D10/78 |
| D435,224 S   | 12/2000 | King et al.        |        |
| D446,132 S   | 8/2001  | Pickens            |        |

**OTHER PUBLICATIONS**

Building Automation Products, Inc; "BAPI Printed Catalog"; Portion of Product Catalog; Jan. 1999; pp. A5-A16, B5-B16, C5-C7, D5-D14, and G5; Building Automation Products, Inc; Cross Plains, Wisconsin, USA.

(Continued)

*Primary Examiner* — Antoine D Davis

(74) *Attorney, Agent, or Firm* — Boardman & Clark LLP; Joseph W. Byrne

(57) **CLAIM**

The ornamental design for a housing for sensors and transmitters for HVAC/R applications, as shown and described.

**DESCRIPTION**

FIG. 1 is a top, front and right side perspective view of a housing for sensors and transmitters for HVAC/R applications in accordance with my new design;

FIG. 2 is a front elevation view of the housing shown in FIG. 1;

FIG. 3 is a top plan view of the housing shown in FIG. 1;

FIG. 4 is a bottom plan view of the housing shown in FIG. 1;

FIG. 5 is a right side elevation view of the housing shown in FIG. 1;

FIG. 6 is a left side elevation view of the housing shown in FIG. 1;

FIG. 7 is a top, front and right side perspective view of a second housing for sensors and transmitters for HVAC/R applications in accordance with my new design;

FIG. 8 is a front elevation view of the housing shown in FIG. 7;

FIG. 9 is a top plan view of the housing shown in FIG. 7;

FIG. 10 is a bottom plan view of the housing shown in FIG. 7;


FIG. 11 is a right side elevation view of the housing shown in FIG. 7; and,

FIG. 12 is a left side elevation view of the housing shown in FIG. 7.

The rears of the housings do not comprise any portion of the invention, and hence are not shown in the drawings.

The broken line showings are for illustrative purposes only and form no part of the claimed design.

**1 Claim, 6 Drawing Sheets**

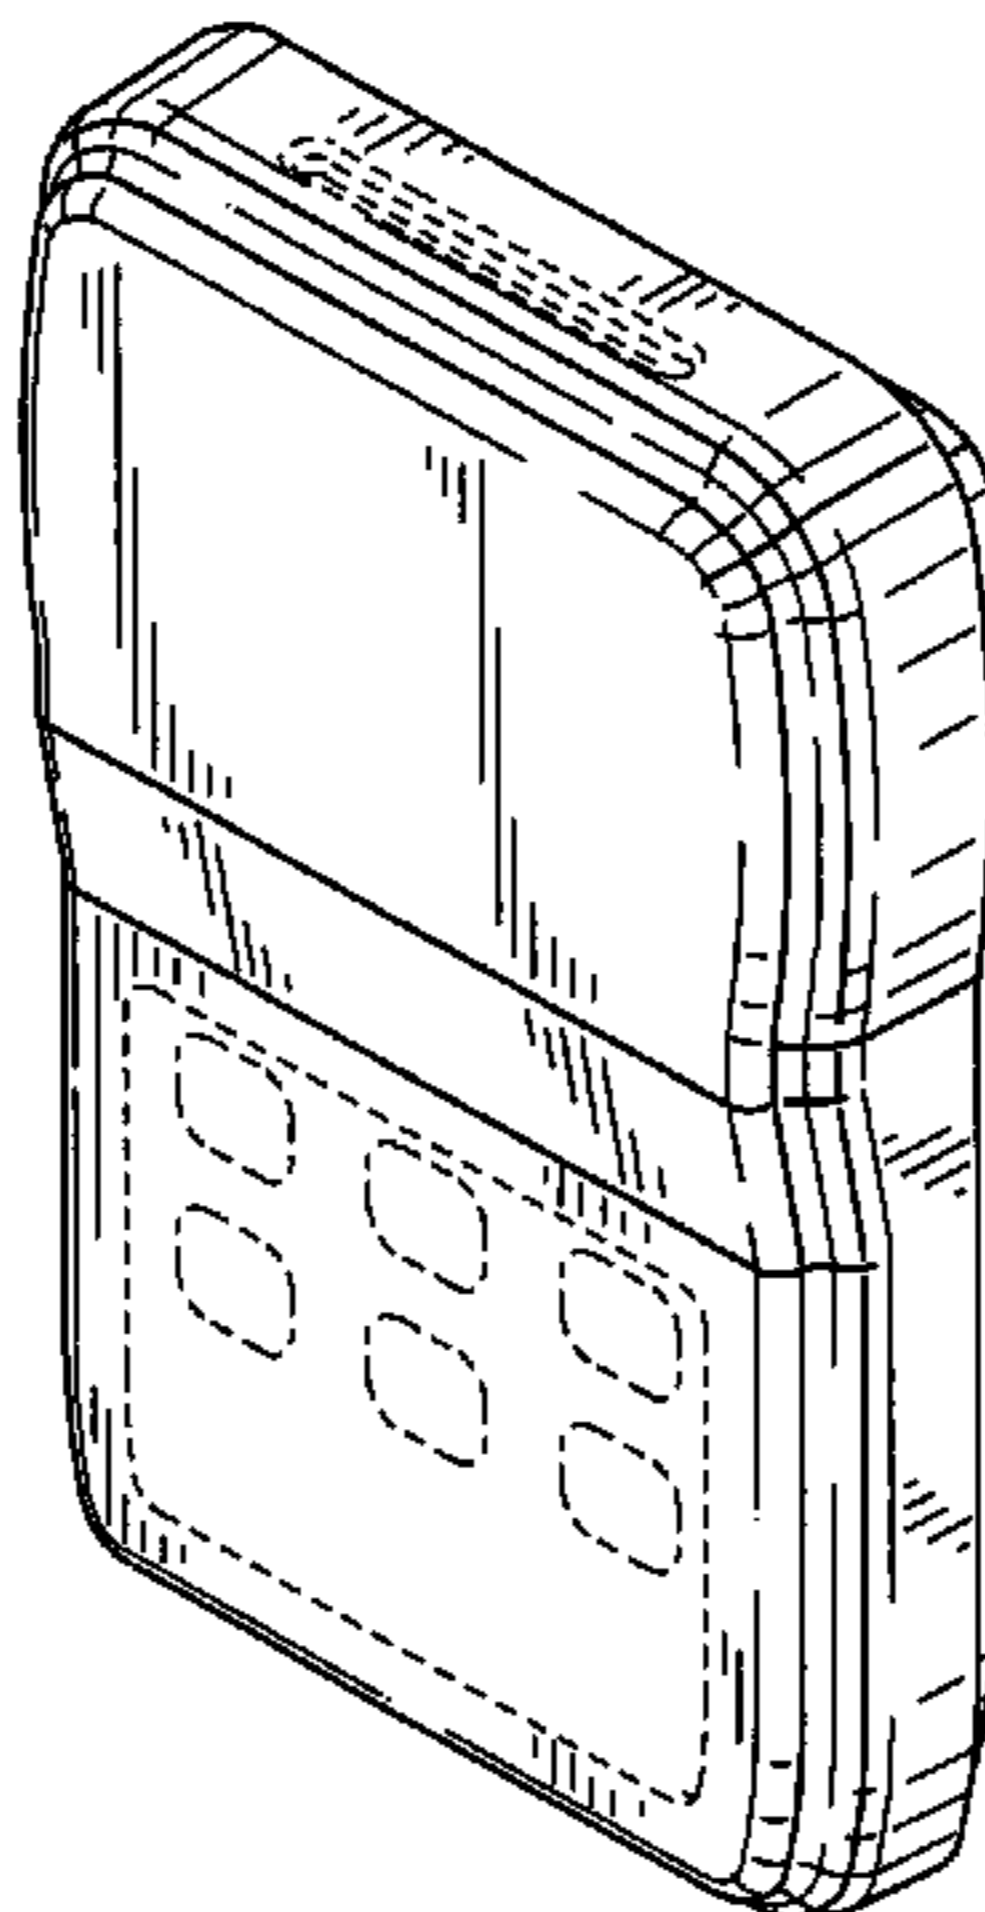

# US D675,542 S

Page 2

## U.S. PATENT DOCUMENTS

6,379,039 B1 4/2002 Tseng  
D460,923 S 7/2002 Chen  
D467,188 S 12/2002 Lui  
D478,017 S \* 8/2003 Chen ..... D10/46  
6,637,933 B1 10/2003 Liao  
6,811,308 B2 11/2004 Chapman et al.  
D504,335 S 4/2005 Stevenson et al.  
D579,798 S \* 11/2008 Kachlick et al. .... D10/50  
D580,282 S \* 11/2008 Bray et al. .... D10/50  
D585,777 S \* 2/2009 Li ..... D10/50  
D592,081 S \* 5/2009 Kachlick et al. .... D10/50  
D614,974 S \* 5/2010 Golberg et al. .... D10/50  
D629,318 S \* 12/2010 Disch et al. .... D10/78  
D636,282 S \* 4/2011 Yin et al. .... D10/78

D659,560 S \* 5/2012 Rhodes ..... D10/50  
8,190,296 B2 \* 5/2012 Alhilo ..... 700/278  
2012/0118985 A1 \* 5/2012 Soderlund ..... 236/49.3

## OTHER PUBLICATIONS

Building Automation Products, Inc.; "Building Automation Products, Inc. Sensors for HVAC/R 2009 Product Catalog Temperature—Humidity—Pressure—Air Quality—Accessories—Wireless—ETA Interface & Communication"; Portion of Product Catalog; 2009; cover page and pp. 1-4, A1-A29, B1-B15, C1, C8-C9, E1, E8-E11, and H1-H3; Building Automation Products, Inc.; Gays Mills, WI, USA.

\* cited by examiner

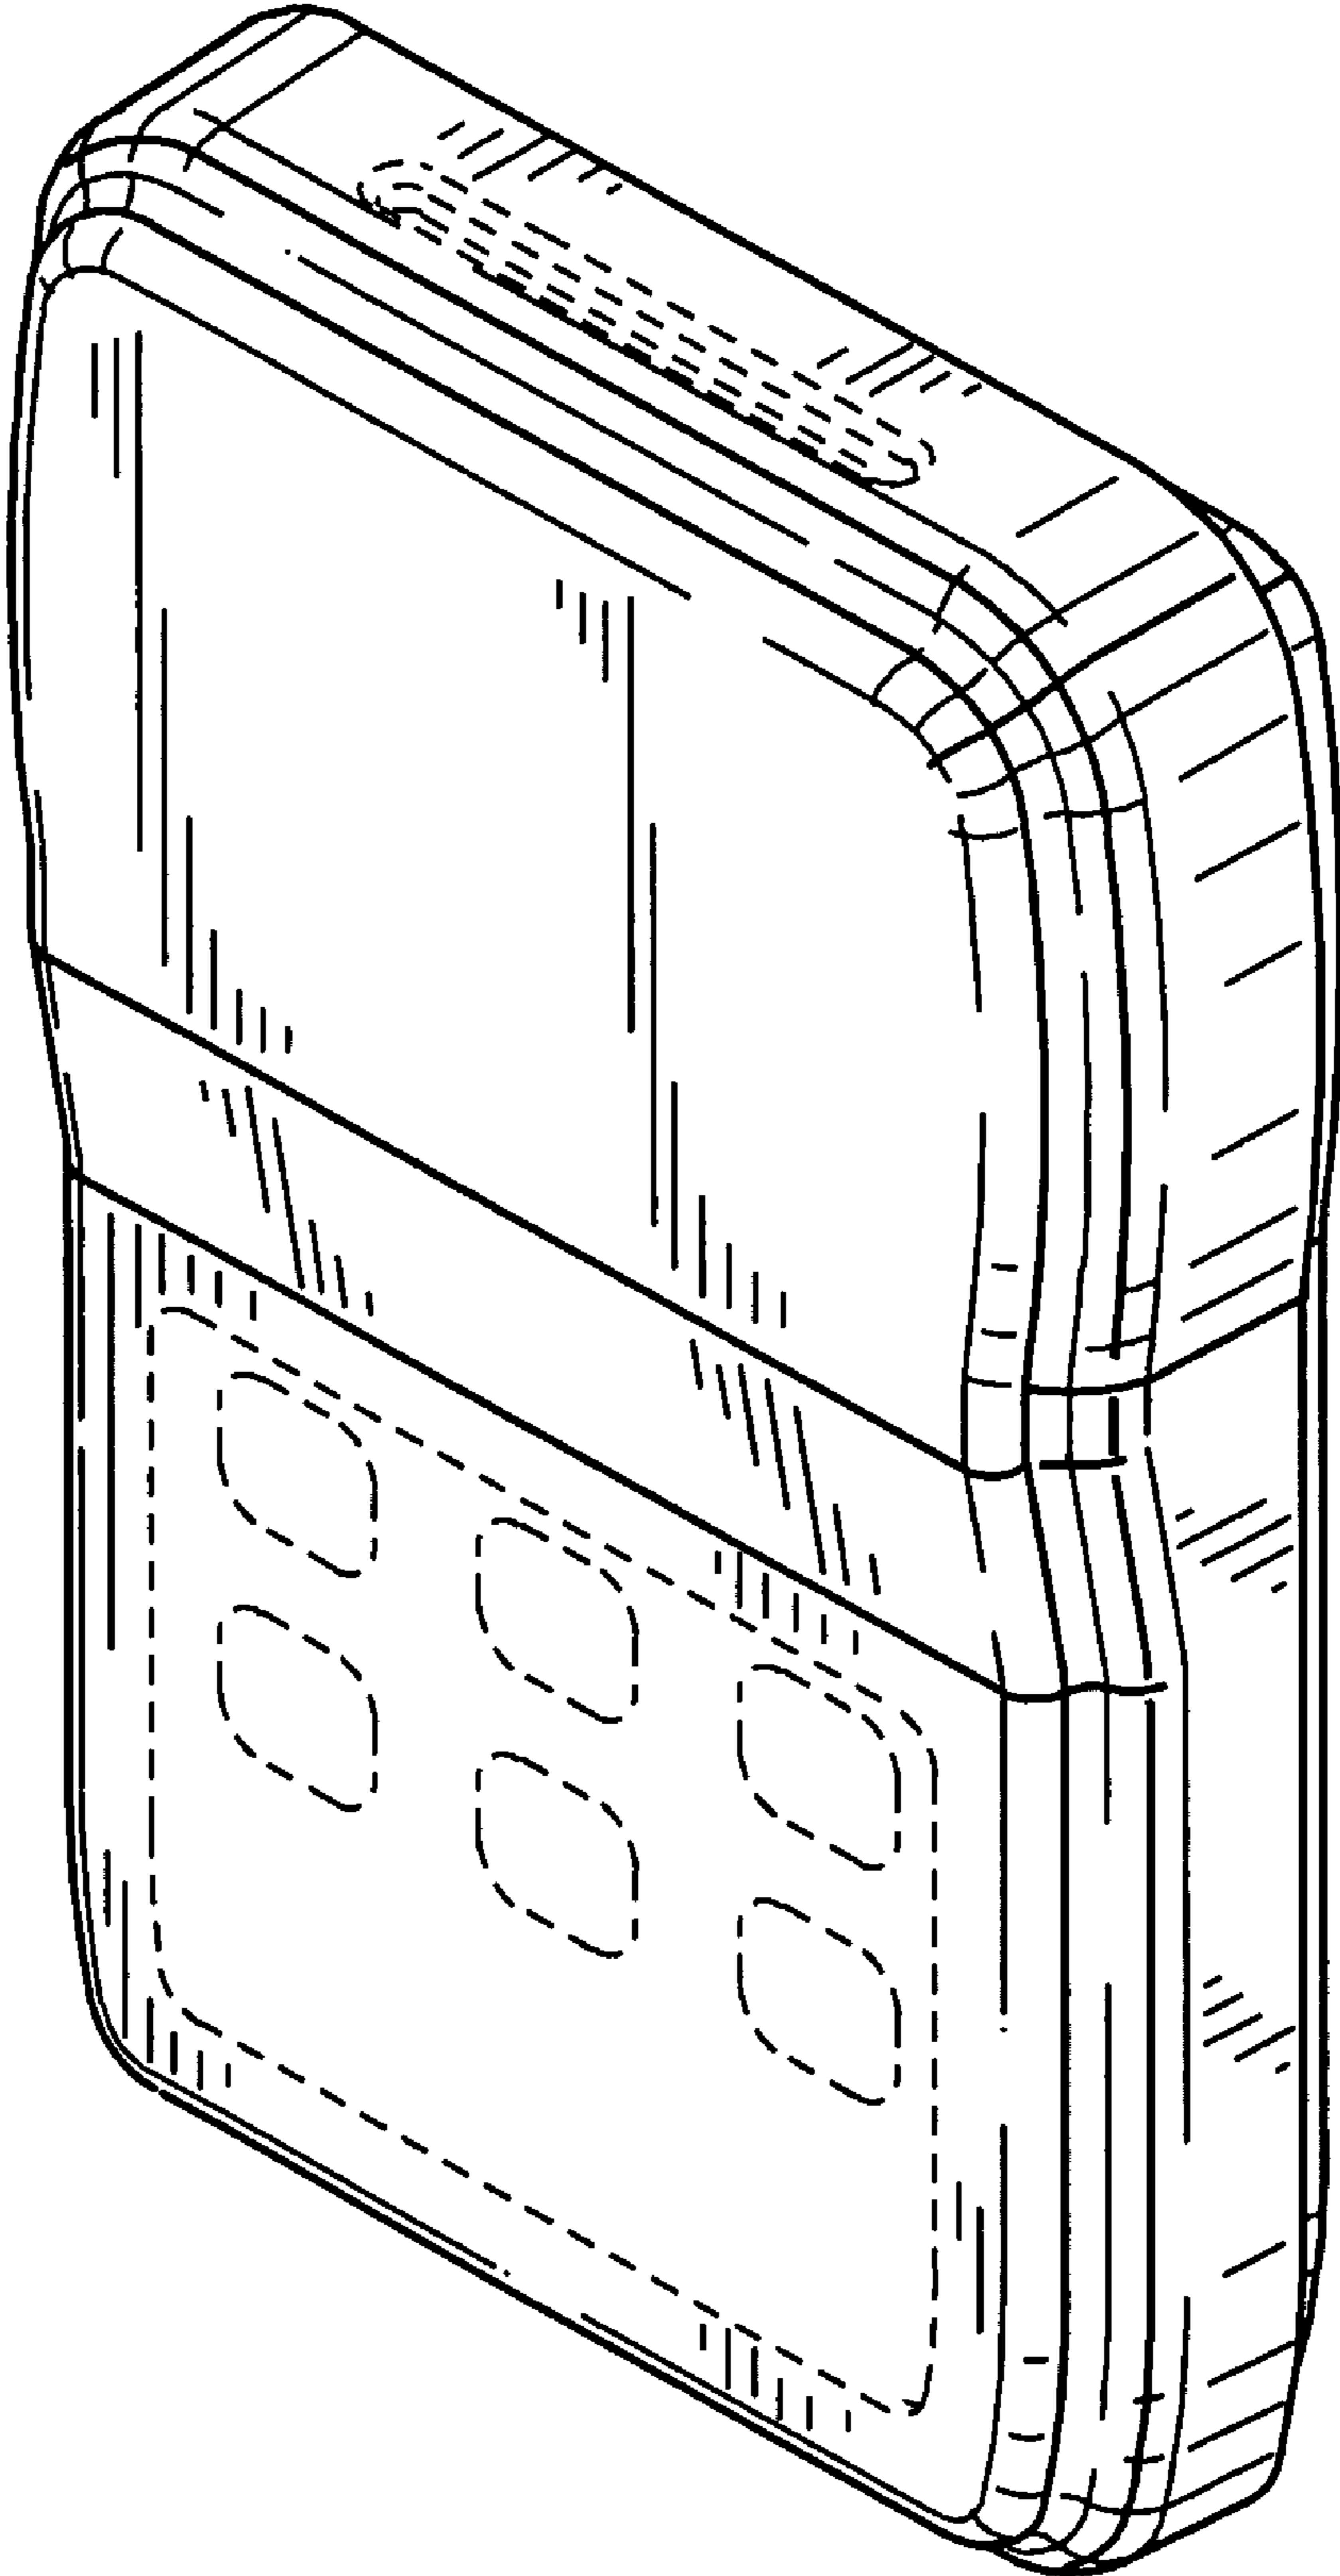


FIG. 1

FIG. 2

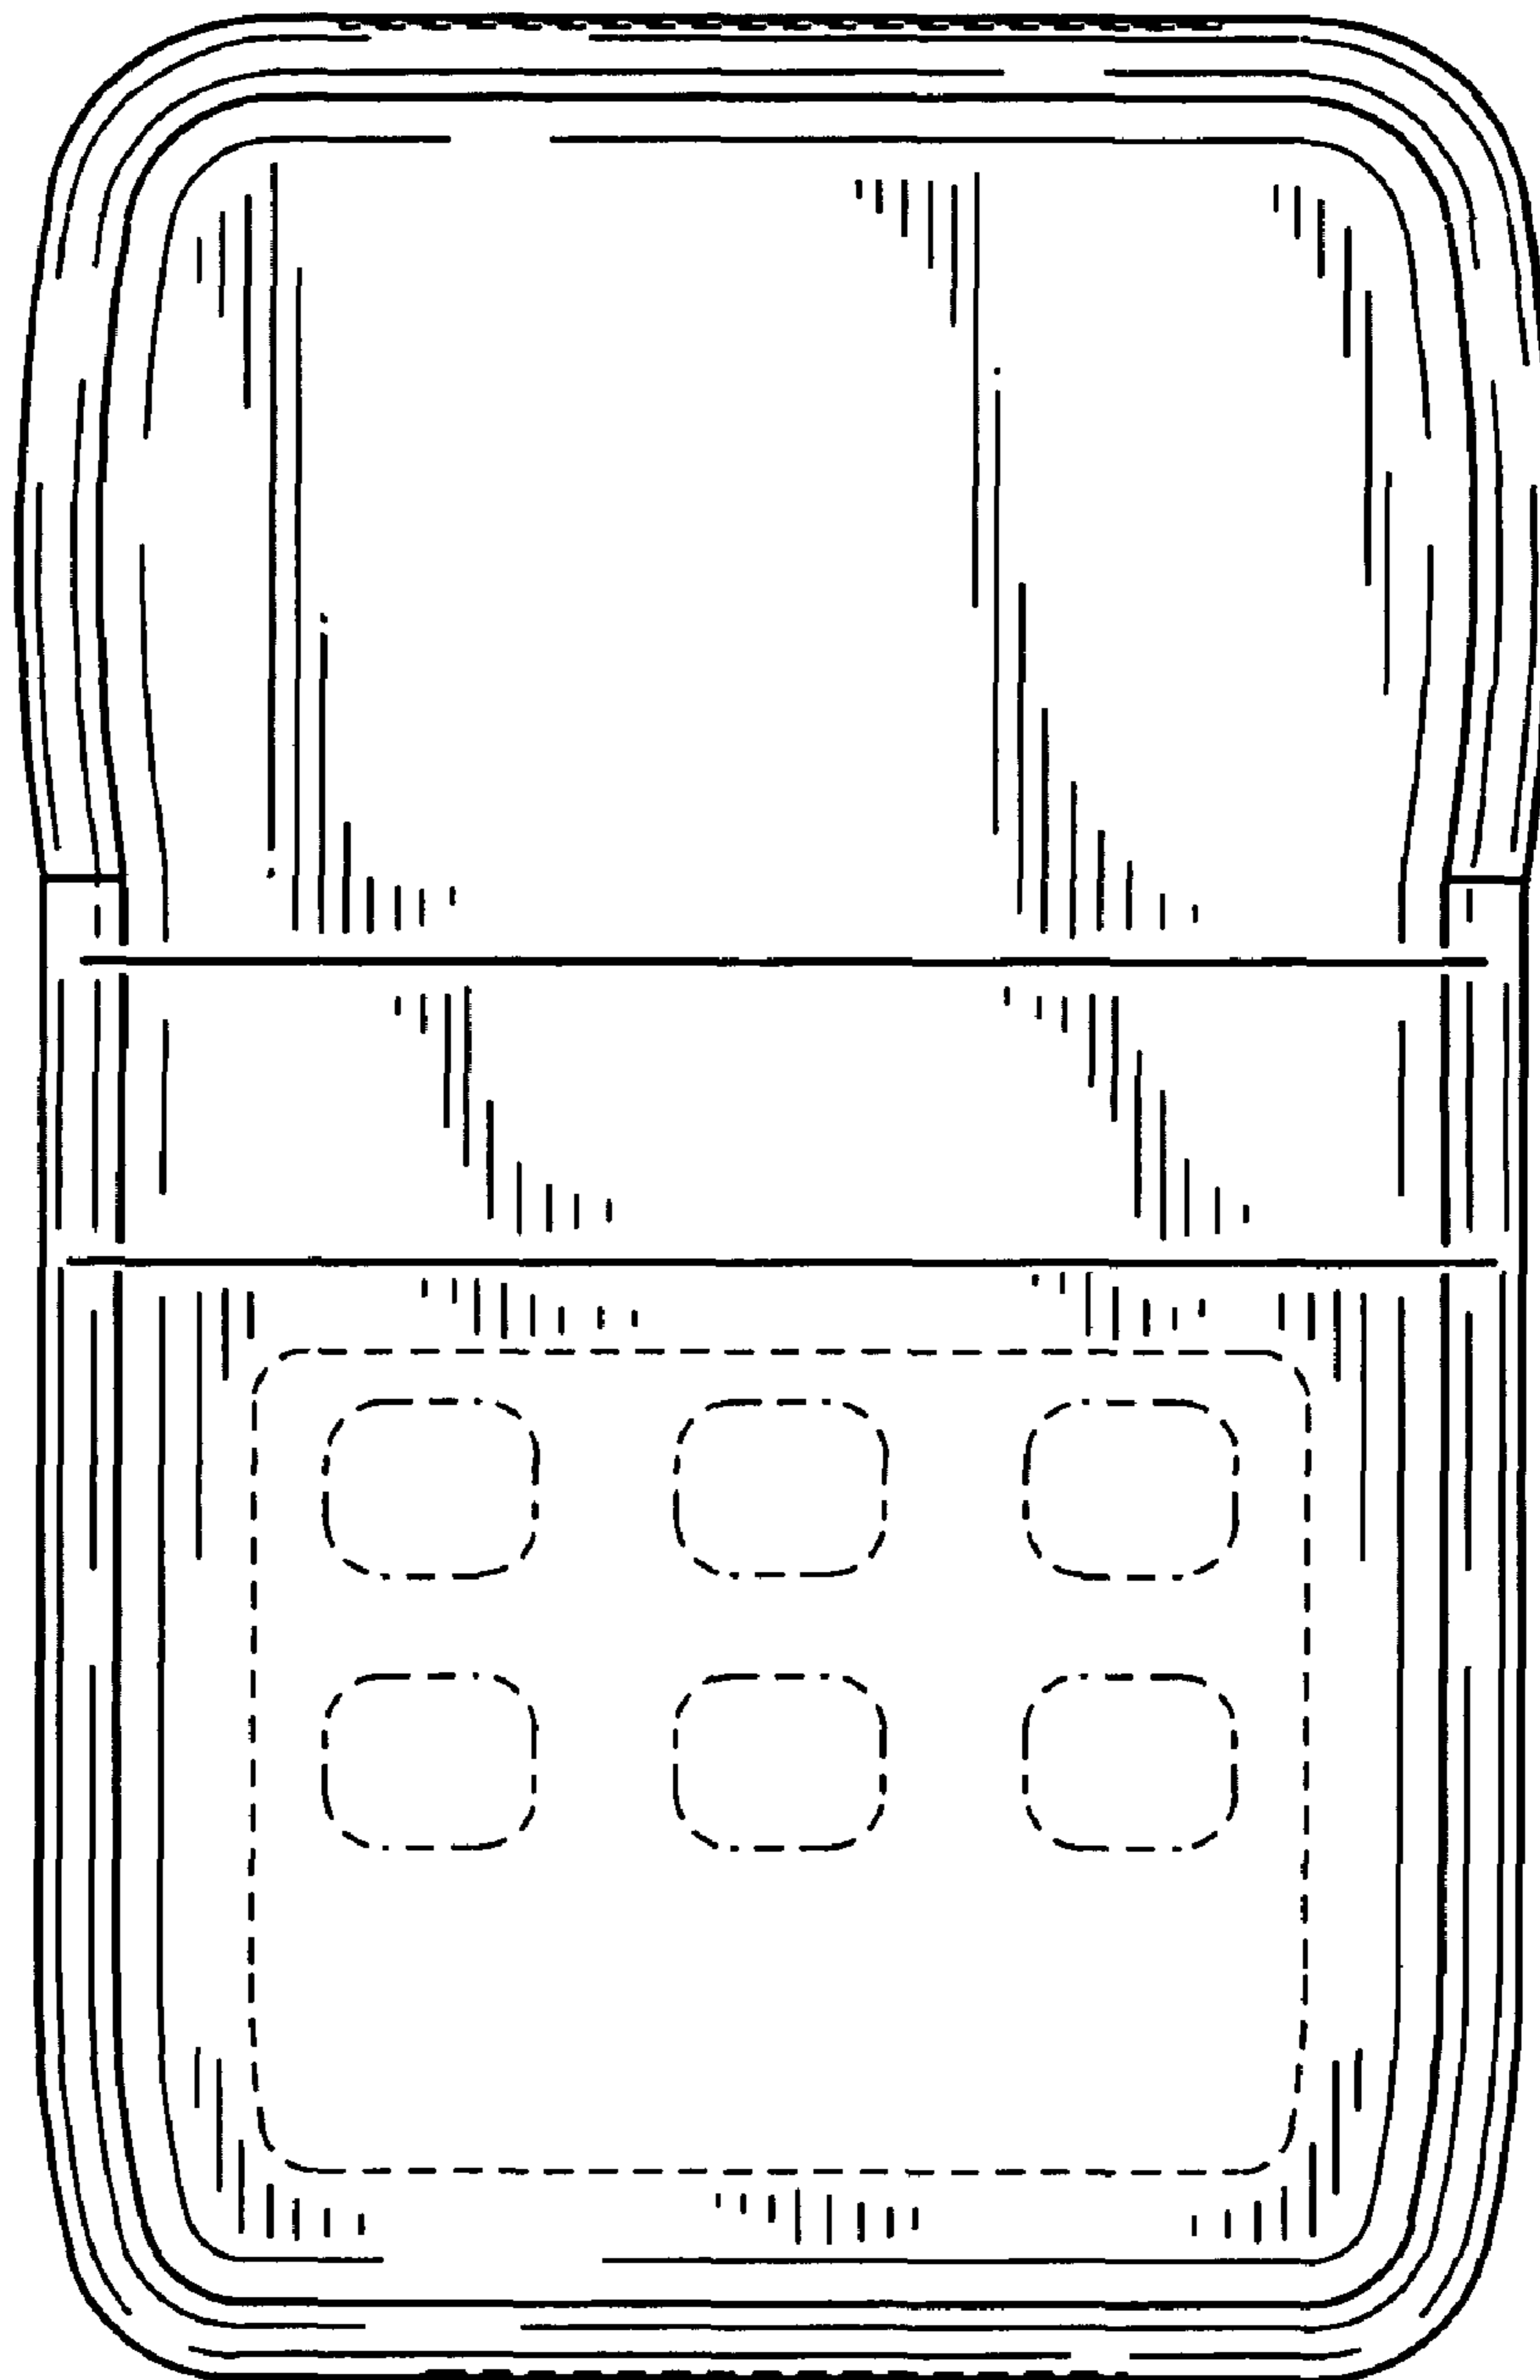


FIG. 3

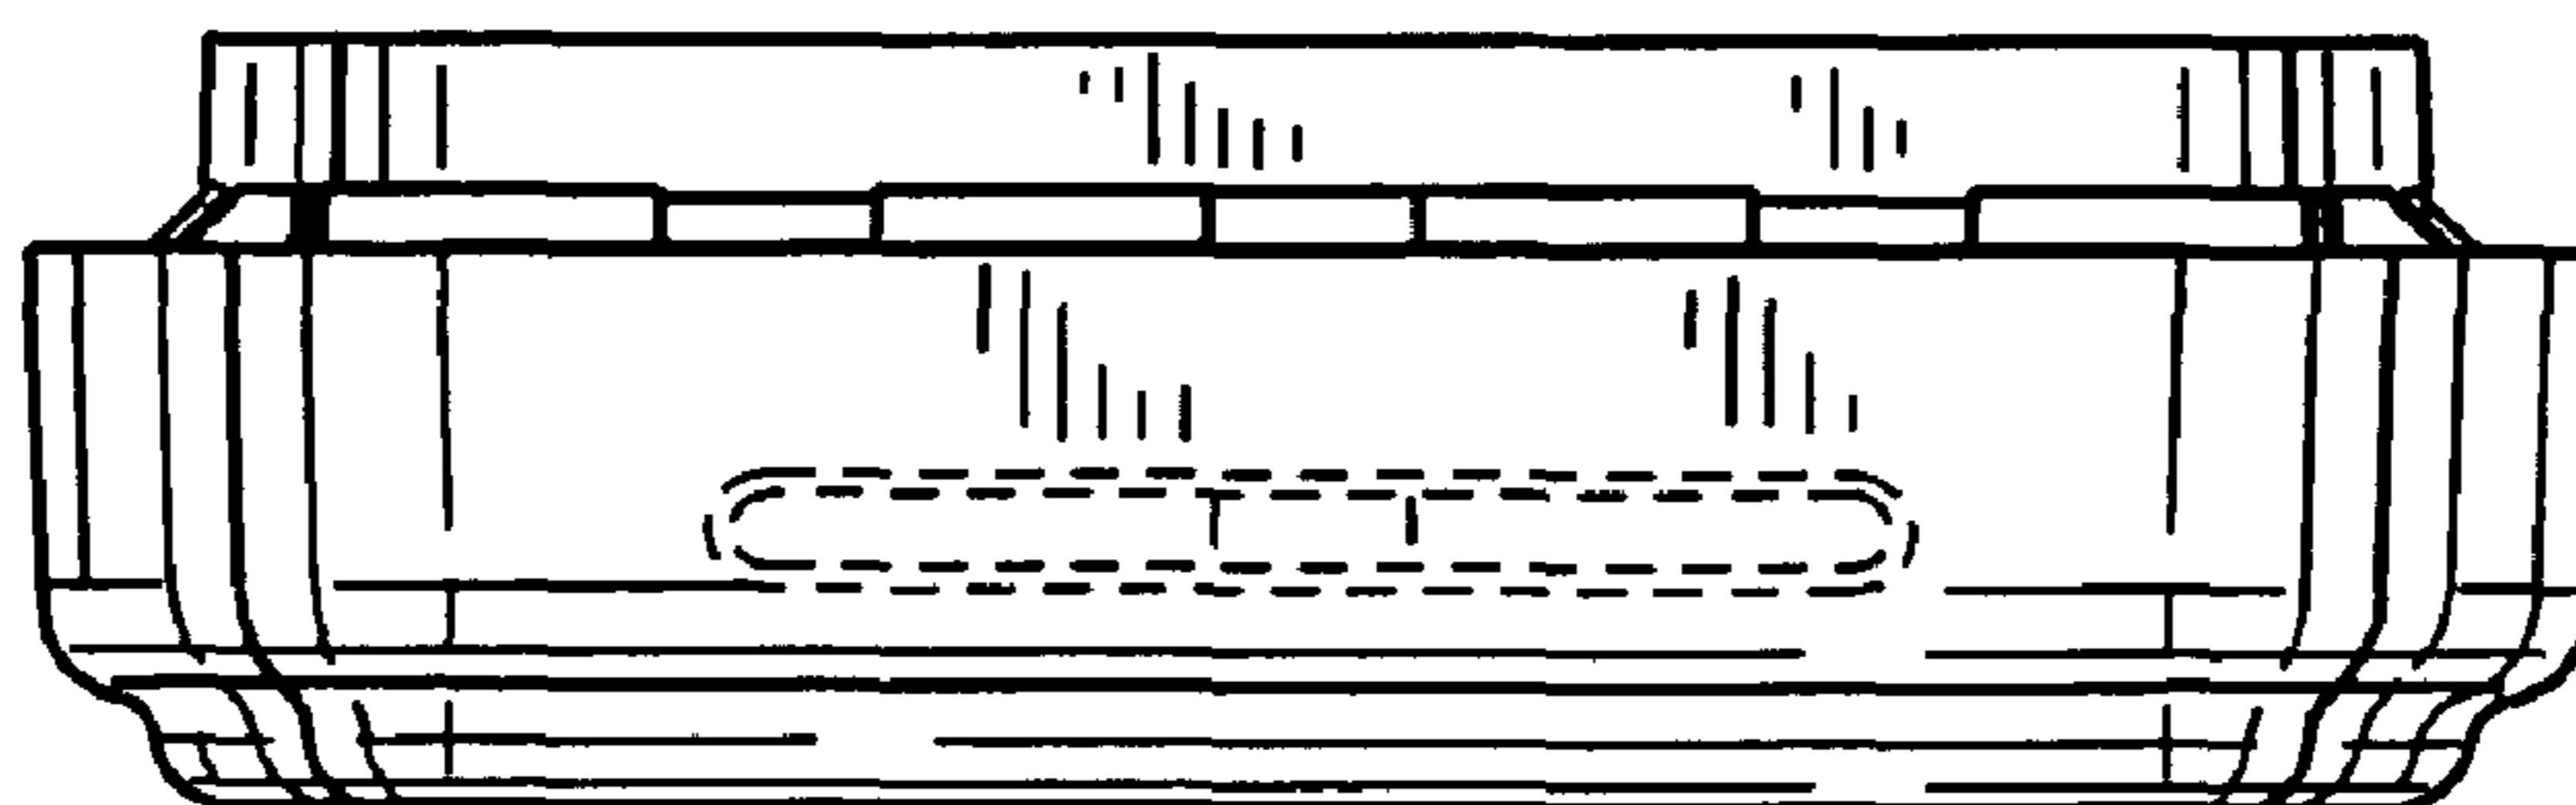


FIG. 4

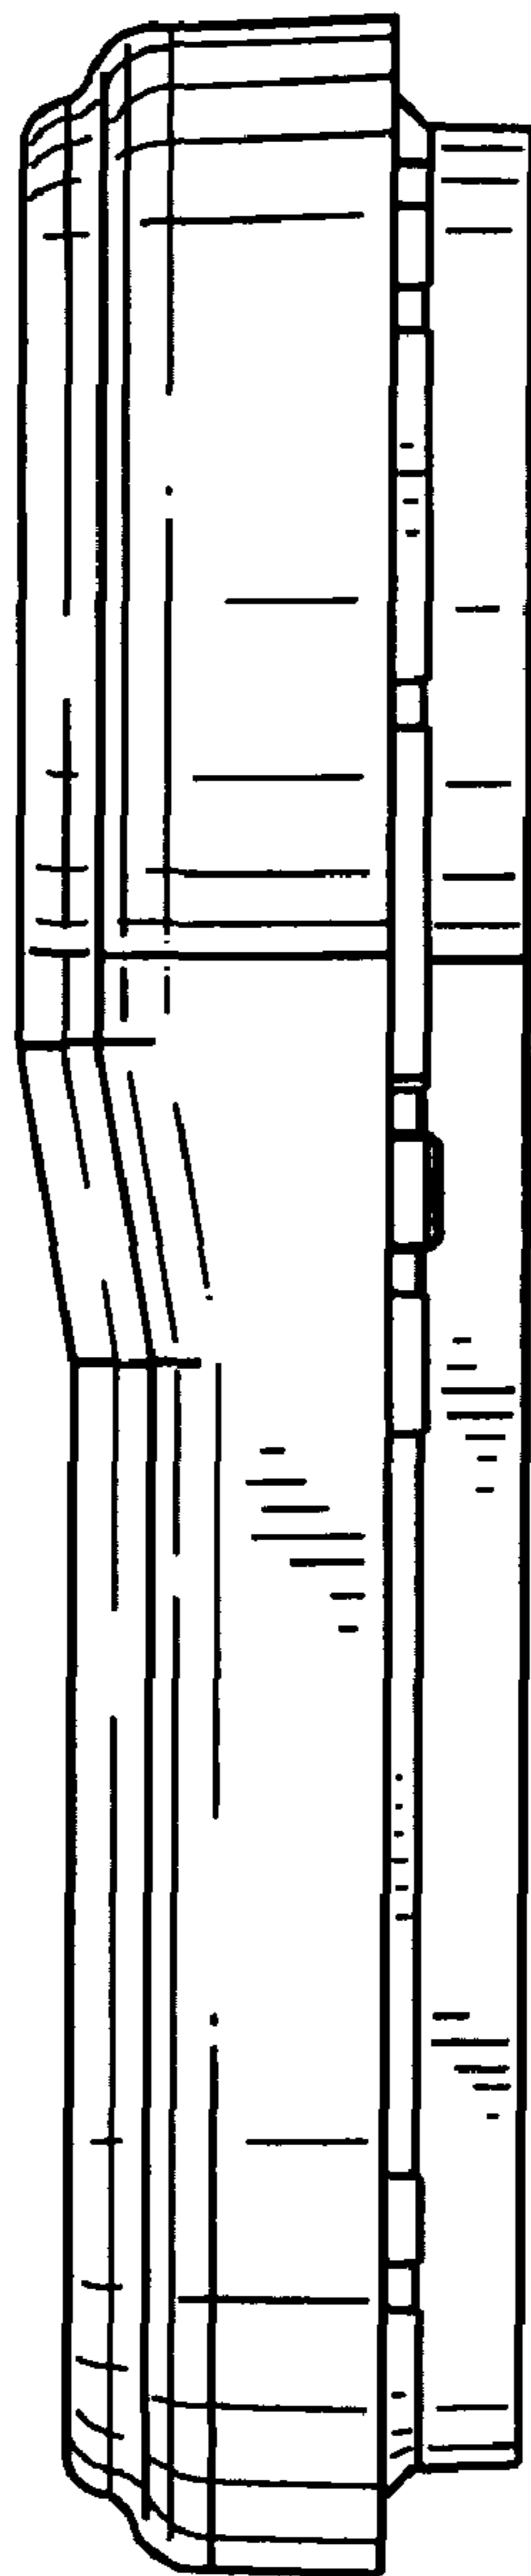
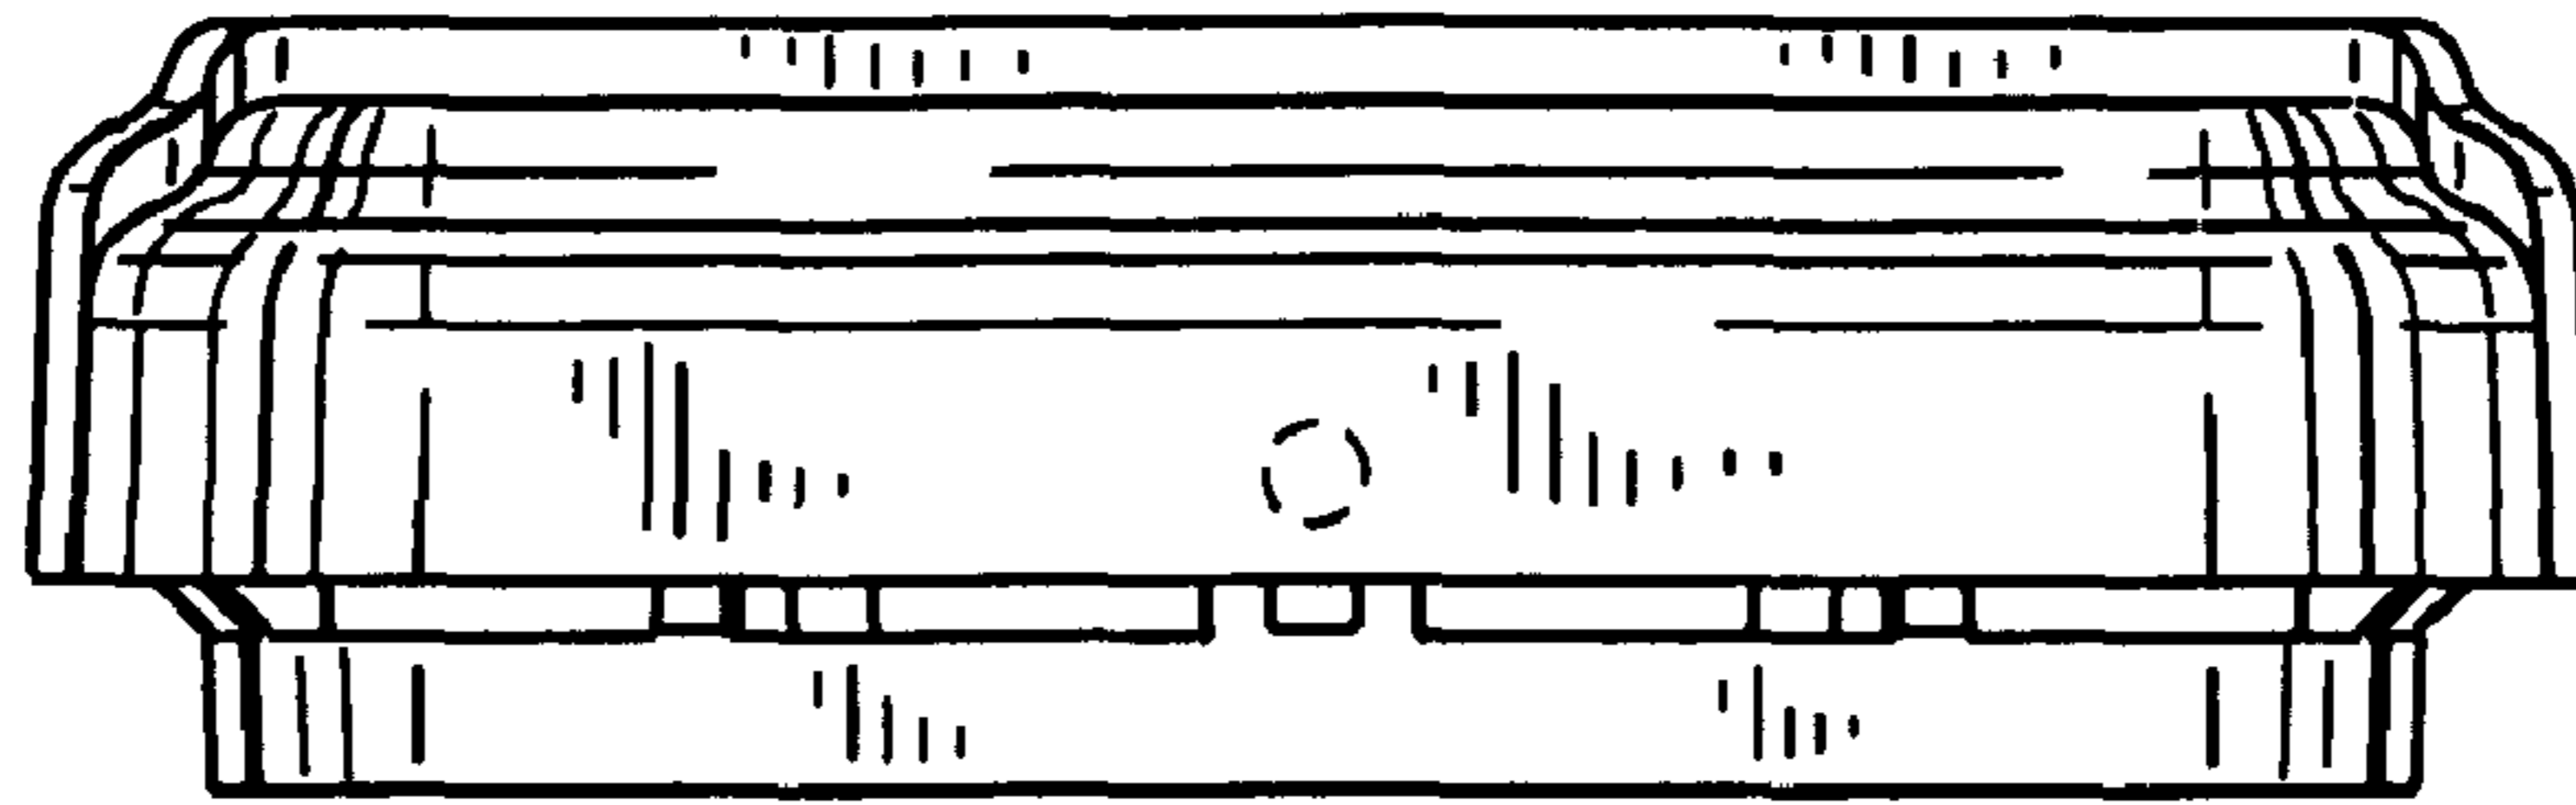


FIG. 5

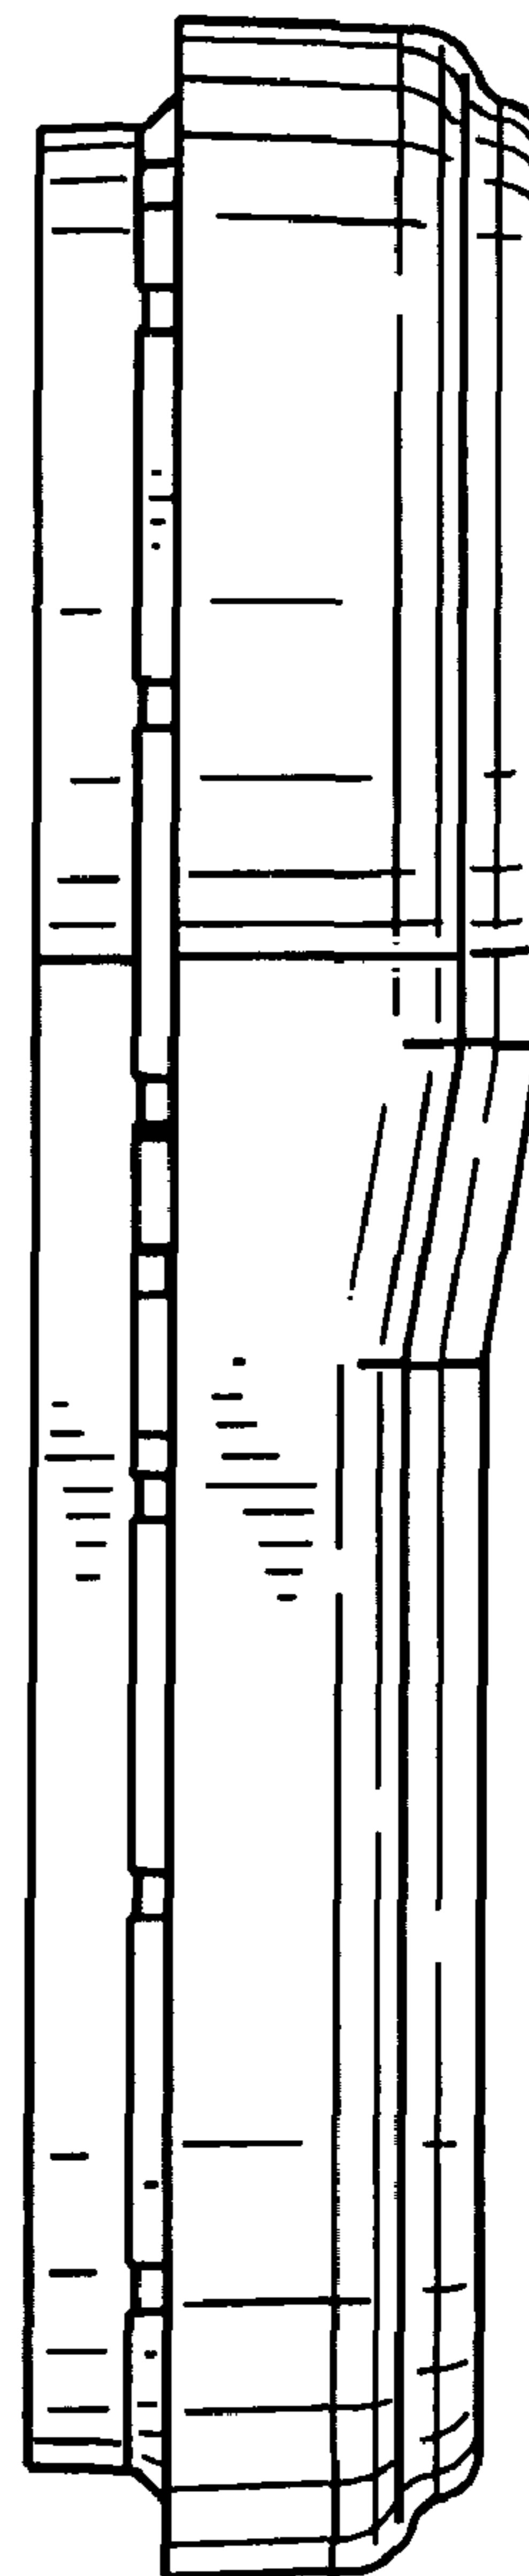


FIG. 6

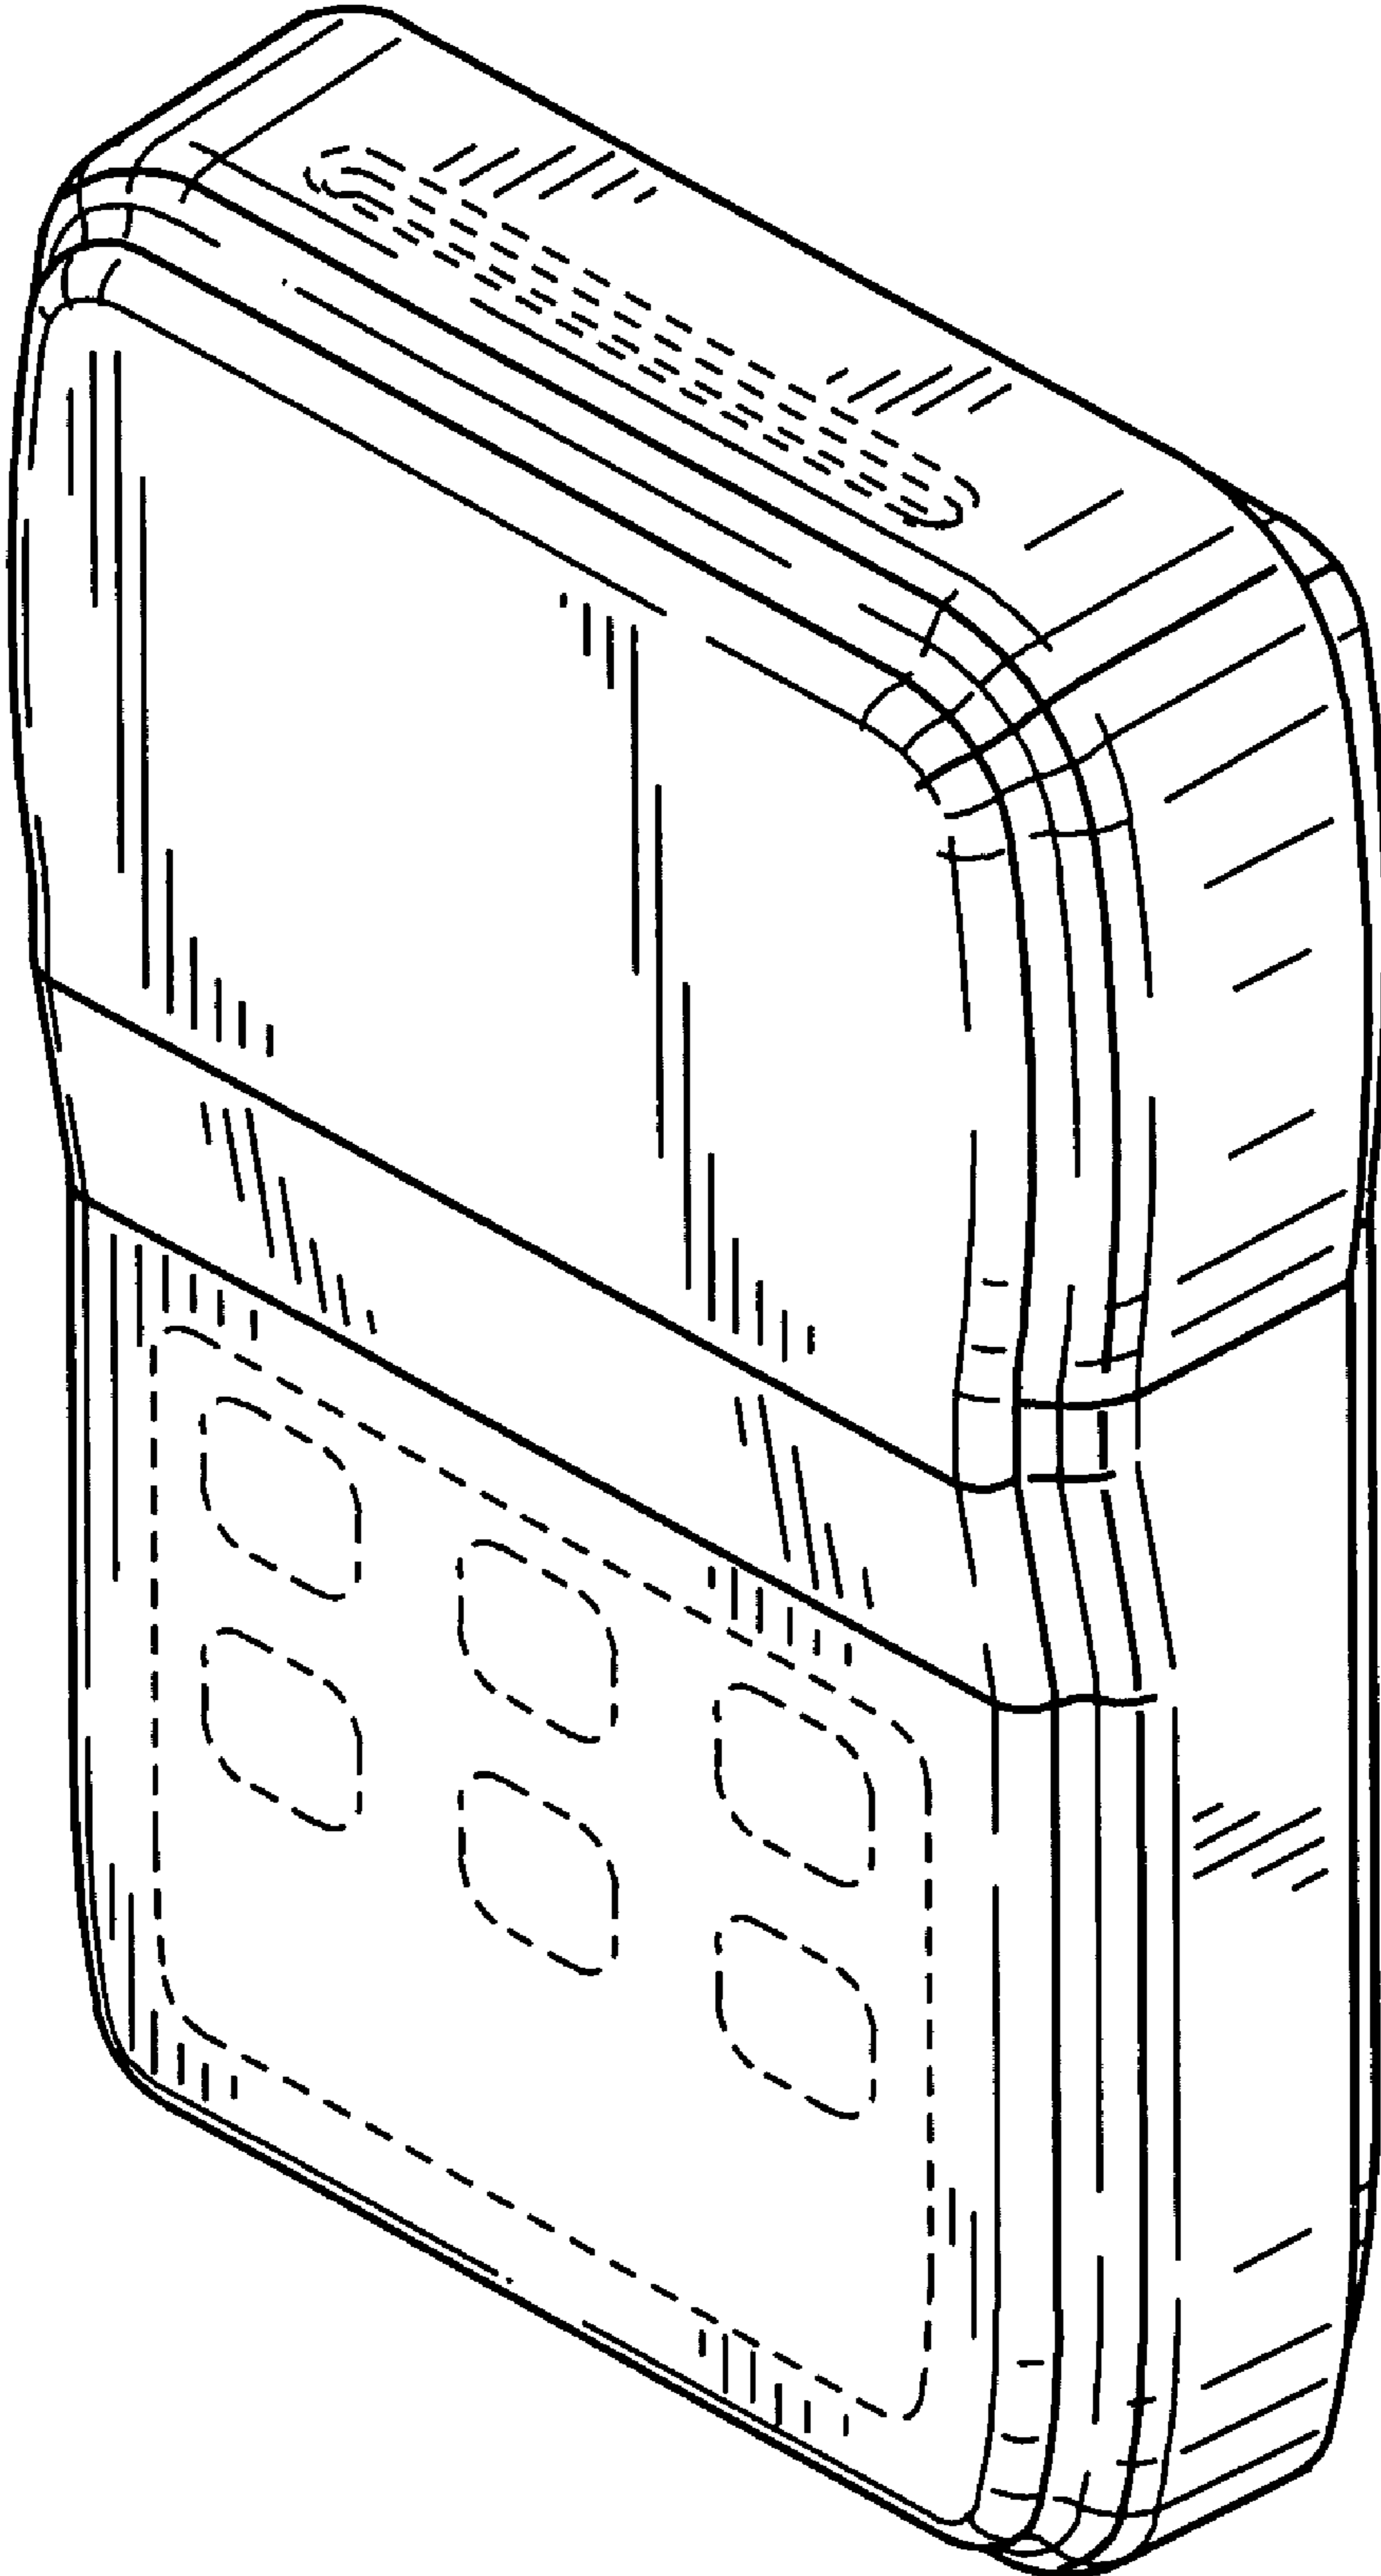


FIG. 7

FIG. 8

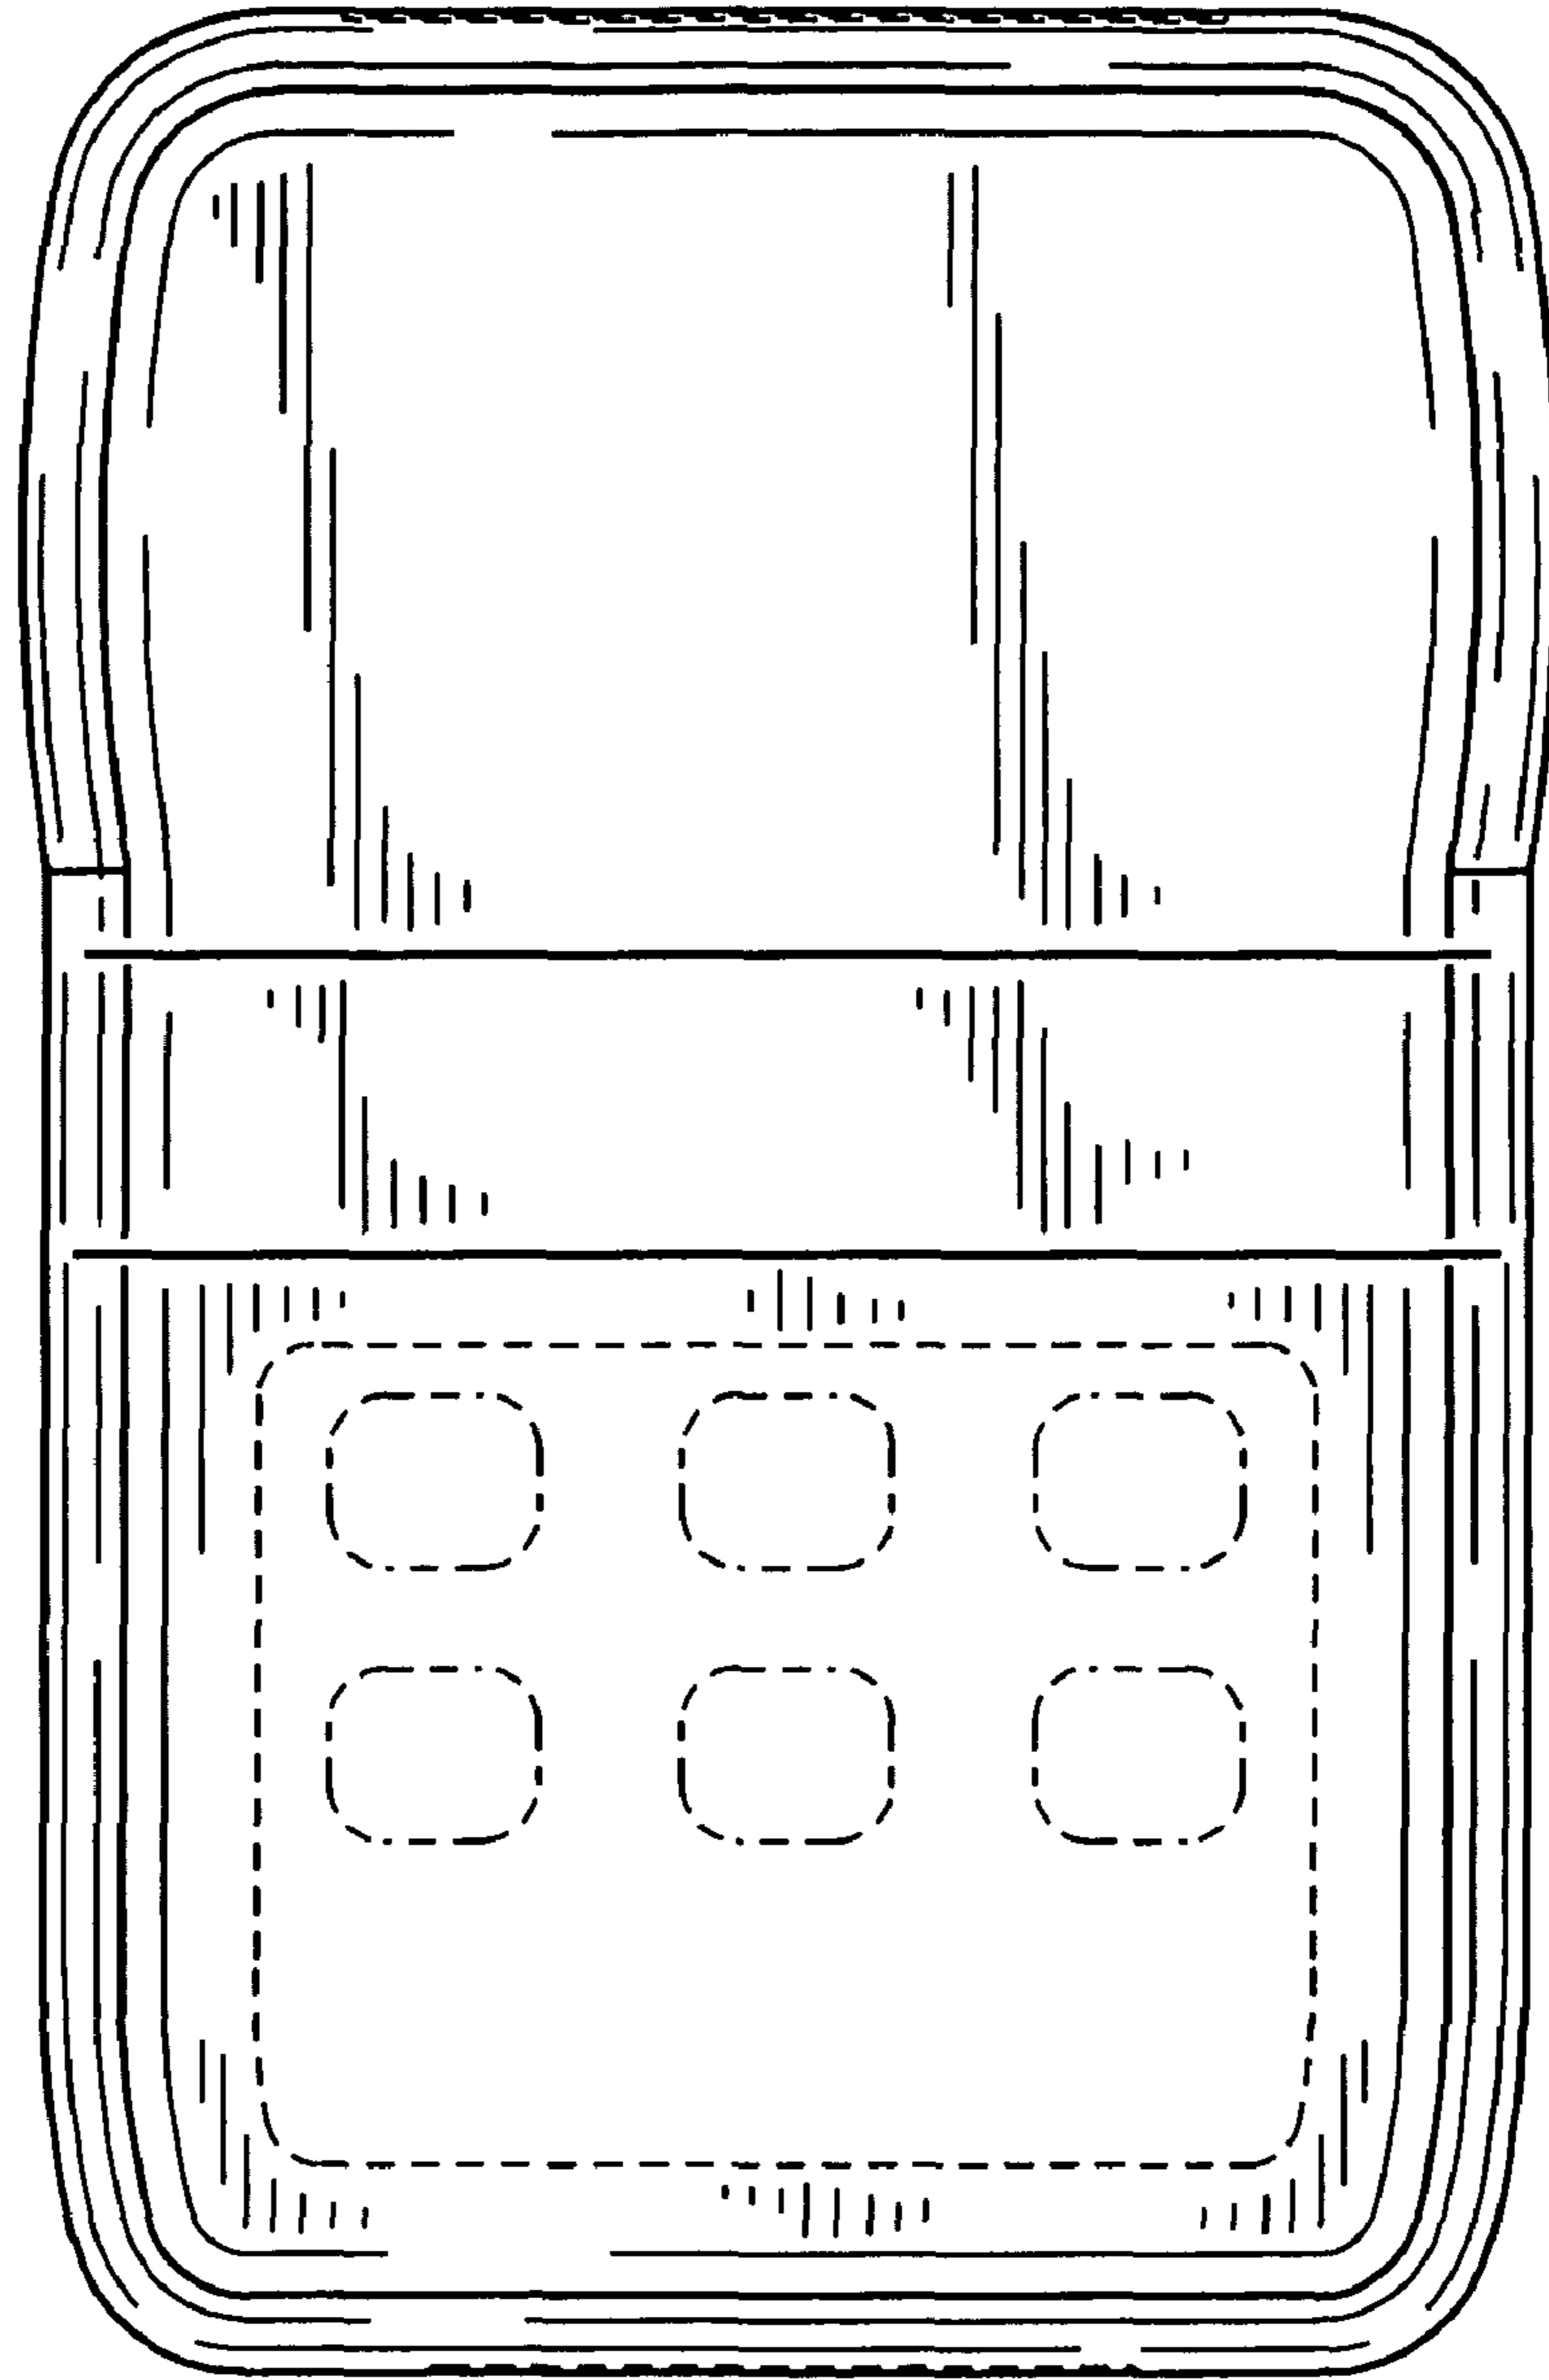


FIG. 9



FIG. 10

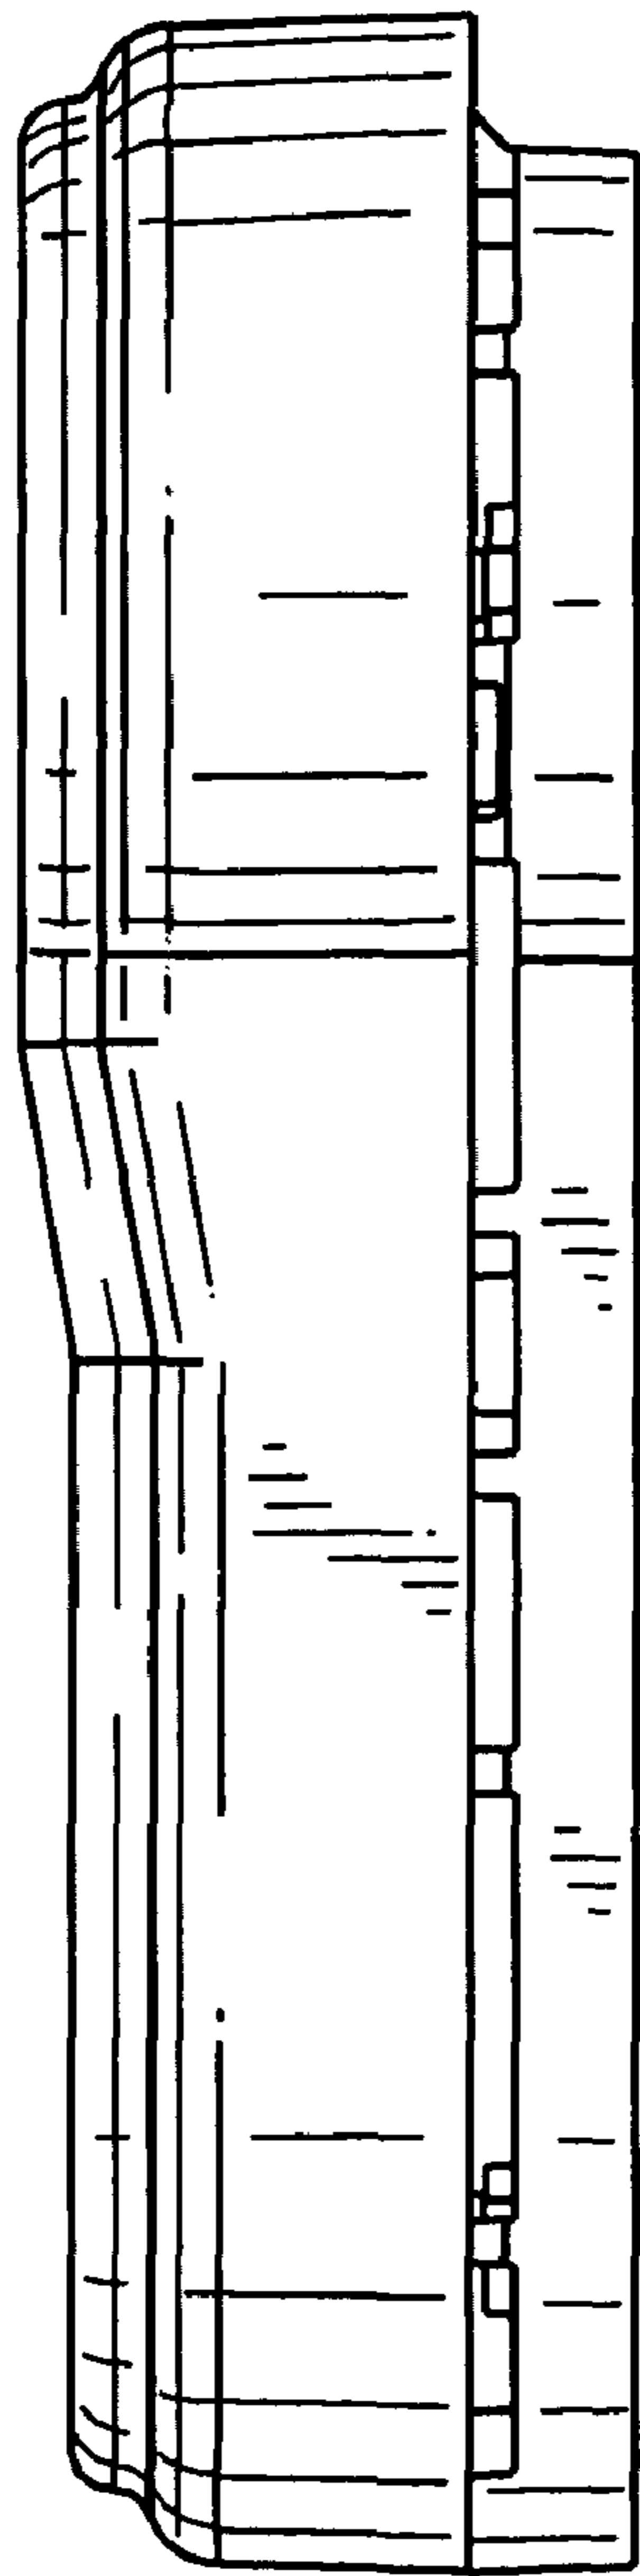
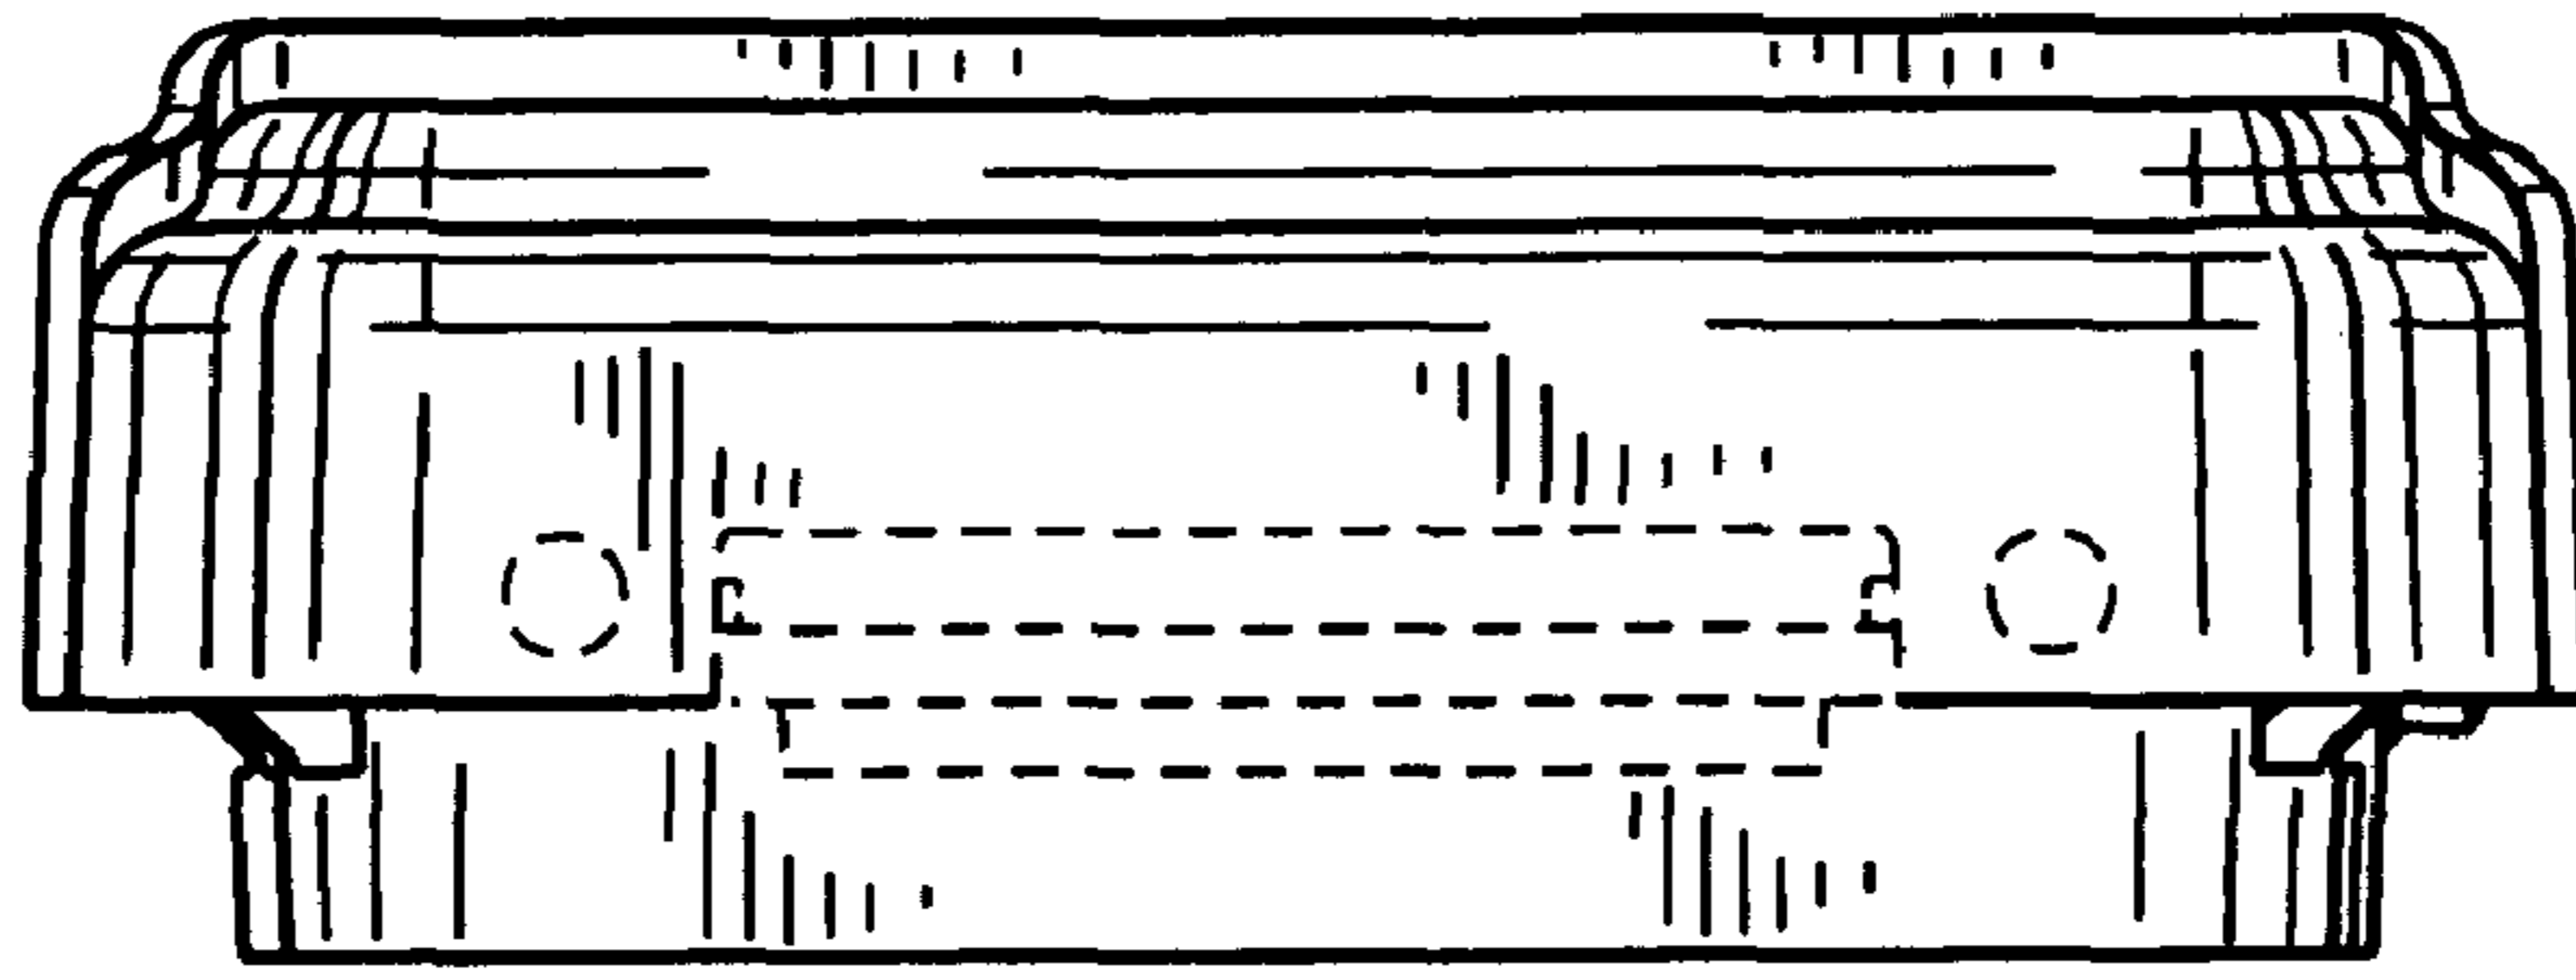


FIG. 11

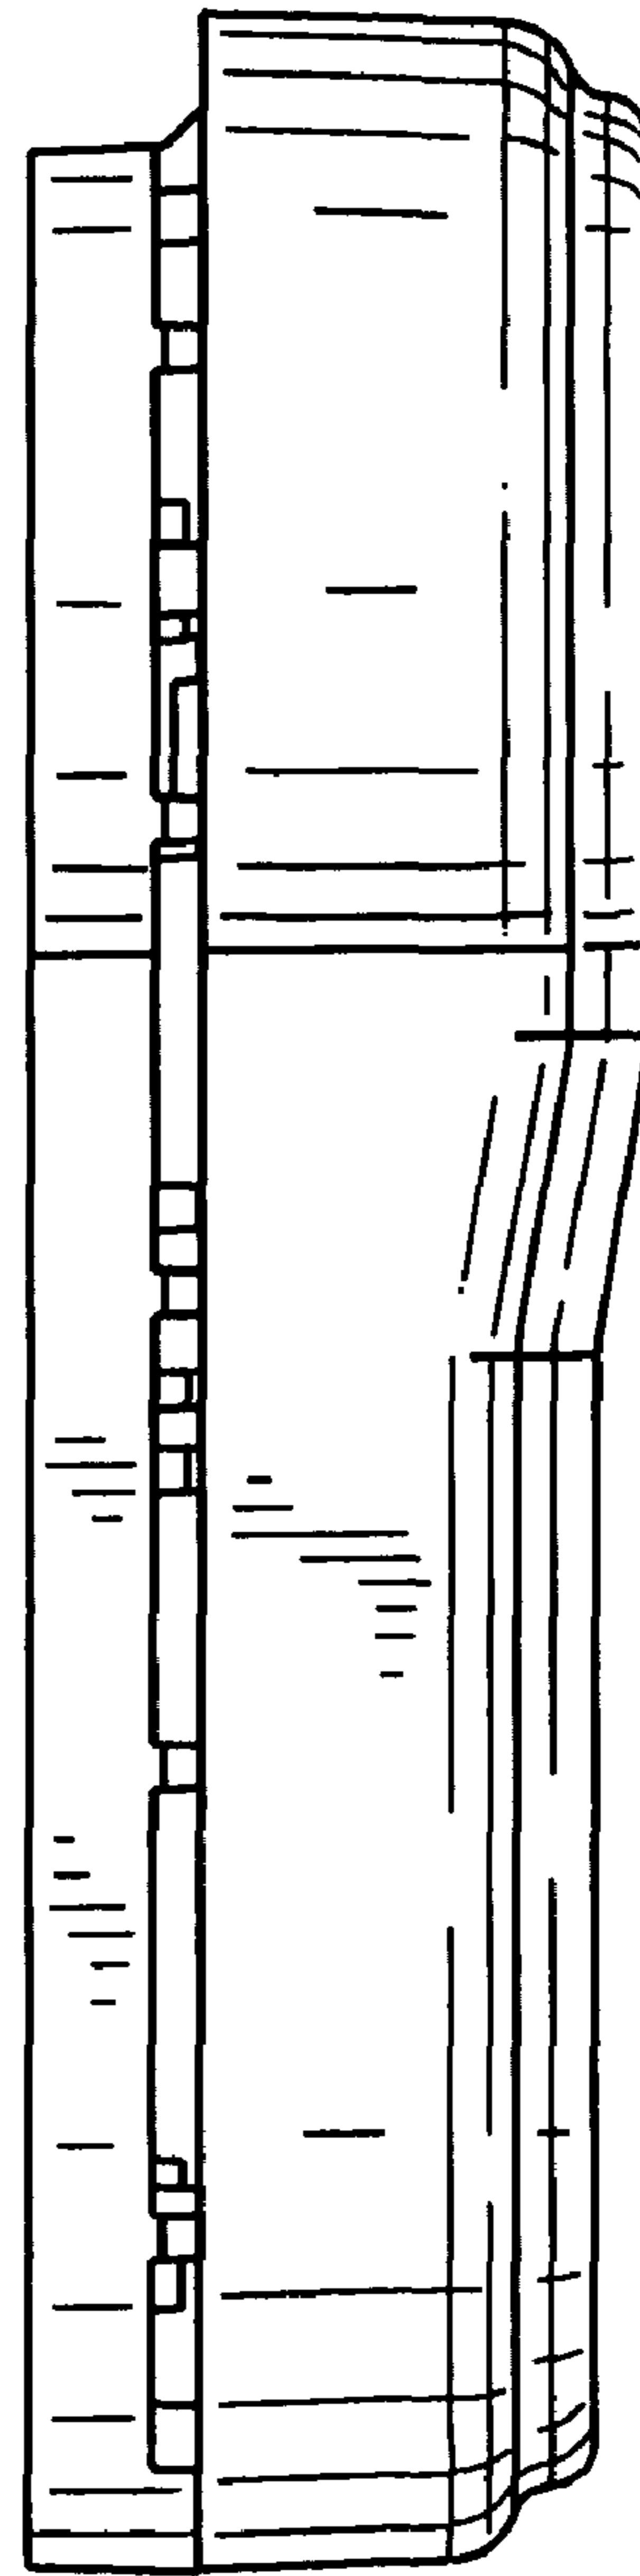


FIG. 12