



US00D682330S

(12) **United States Design Patent**  
**Reay**

(10) **Patent No.:** **US D682,330 S**

(45) **Date of Patent:** **\*\* May 14, 2013**

(54) **AGITATION DEVICE**

(76) Inventor: **Gavin Reay**, London (GB)

(\*\*) Term: **14 Years**

(21) Appl. No.: **29/401,245**

(22) Filed: **Sep. 9, 2011**

**Related U.S. Application Data**

(63) Continuation-in-part of application No. 12/556,744, filed on Sep. 10, 2009, now Pat. No. 8,313,228.

(51) **LOC (9) Cl.** ..... **15-09**

(52) **U.S. Cl.**  
USPC ..... **D15/147**; D15/138

(58) **Field of Classification Search** ..... D7/317,  
D7/318, 376-386, 412-415, 665, 690; D14/230;  
D15/138, 147; D21/721; 68/213; 134/140,  
134/147, 149, 152, 157, 900; 366/65, 81,  
366/129, 135, 185, 246, 250, 251, 262, 265,  
366/293, 303, 305, 317, 320, 321, 327, 327.3,  
366/329, 329.1, 347, 605; 416/231 A, 135;  
526/65

See application file for complete search history.

(56) **References Cited**

**U.S. PATENT DOCUMENTS**

335,739 A \* 2/1886 Brammer et al. .... 366/254  
427,963 A \* 5/1890 Booz et al. .... 15/104.18  
1,723,091 A \* 8/1929 St John ..... 294/19.2

2,092,353 A \* 9/1937 Kyseth et al. .... 416/72  
3,259,272 A \* 7/1966 Larson ..... 222/1  
5,630,666 A \* 5/1997 Rodriguez ..... 366/192  
6,068,395 A \* 5/2000 Ondracek ..... 366/129  
6,334,705 B1 \* 1/2002 Weetman ..... 366/330.1  
D524,886 S \* 7/2006 Baril ..... D21/721  
D576,186 S \* 9/2008 Rosso et al. .... D15/138  
7,578,611 B2 \* 8/2009 Hamilton ..... 366/129  
D599,178 S \* 9/2009 Reay ..... D7/690  
D617,135 S \* 6/2010 Reay ..... D7/376

\* cited by examiner

*Primary Examiner* — Patricia Palasik

(74) *Attorney, Agent, or Firm* — Eugene M. Cummings, P.C.

(57) **CLAIM**

The ornamental design for an agitation device, as shown and described.

**DESCRIPTION**

FIG. 1 is a top perspective view of an agitation device showing the new design.

FIG. 2 is a bottom perspective view of the agitation device.

FIG. 3 is a side view of the agitation device.


FIG. 4 is another side view of the agitation device.

FIG. 5 is a top plan view of the agitation device; and,

FIG. 6 is a bottom view of the agitation device.

The broken lines shown in the Figures are used for illustrative purposes only and form no part of the claimed design.

**1 Claim, 4 Drawing Sheets**

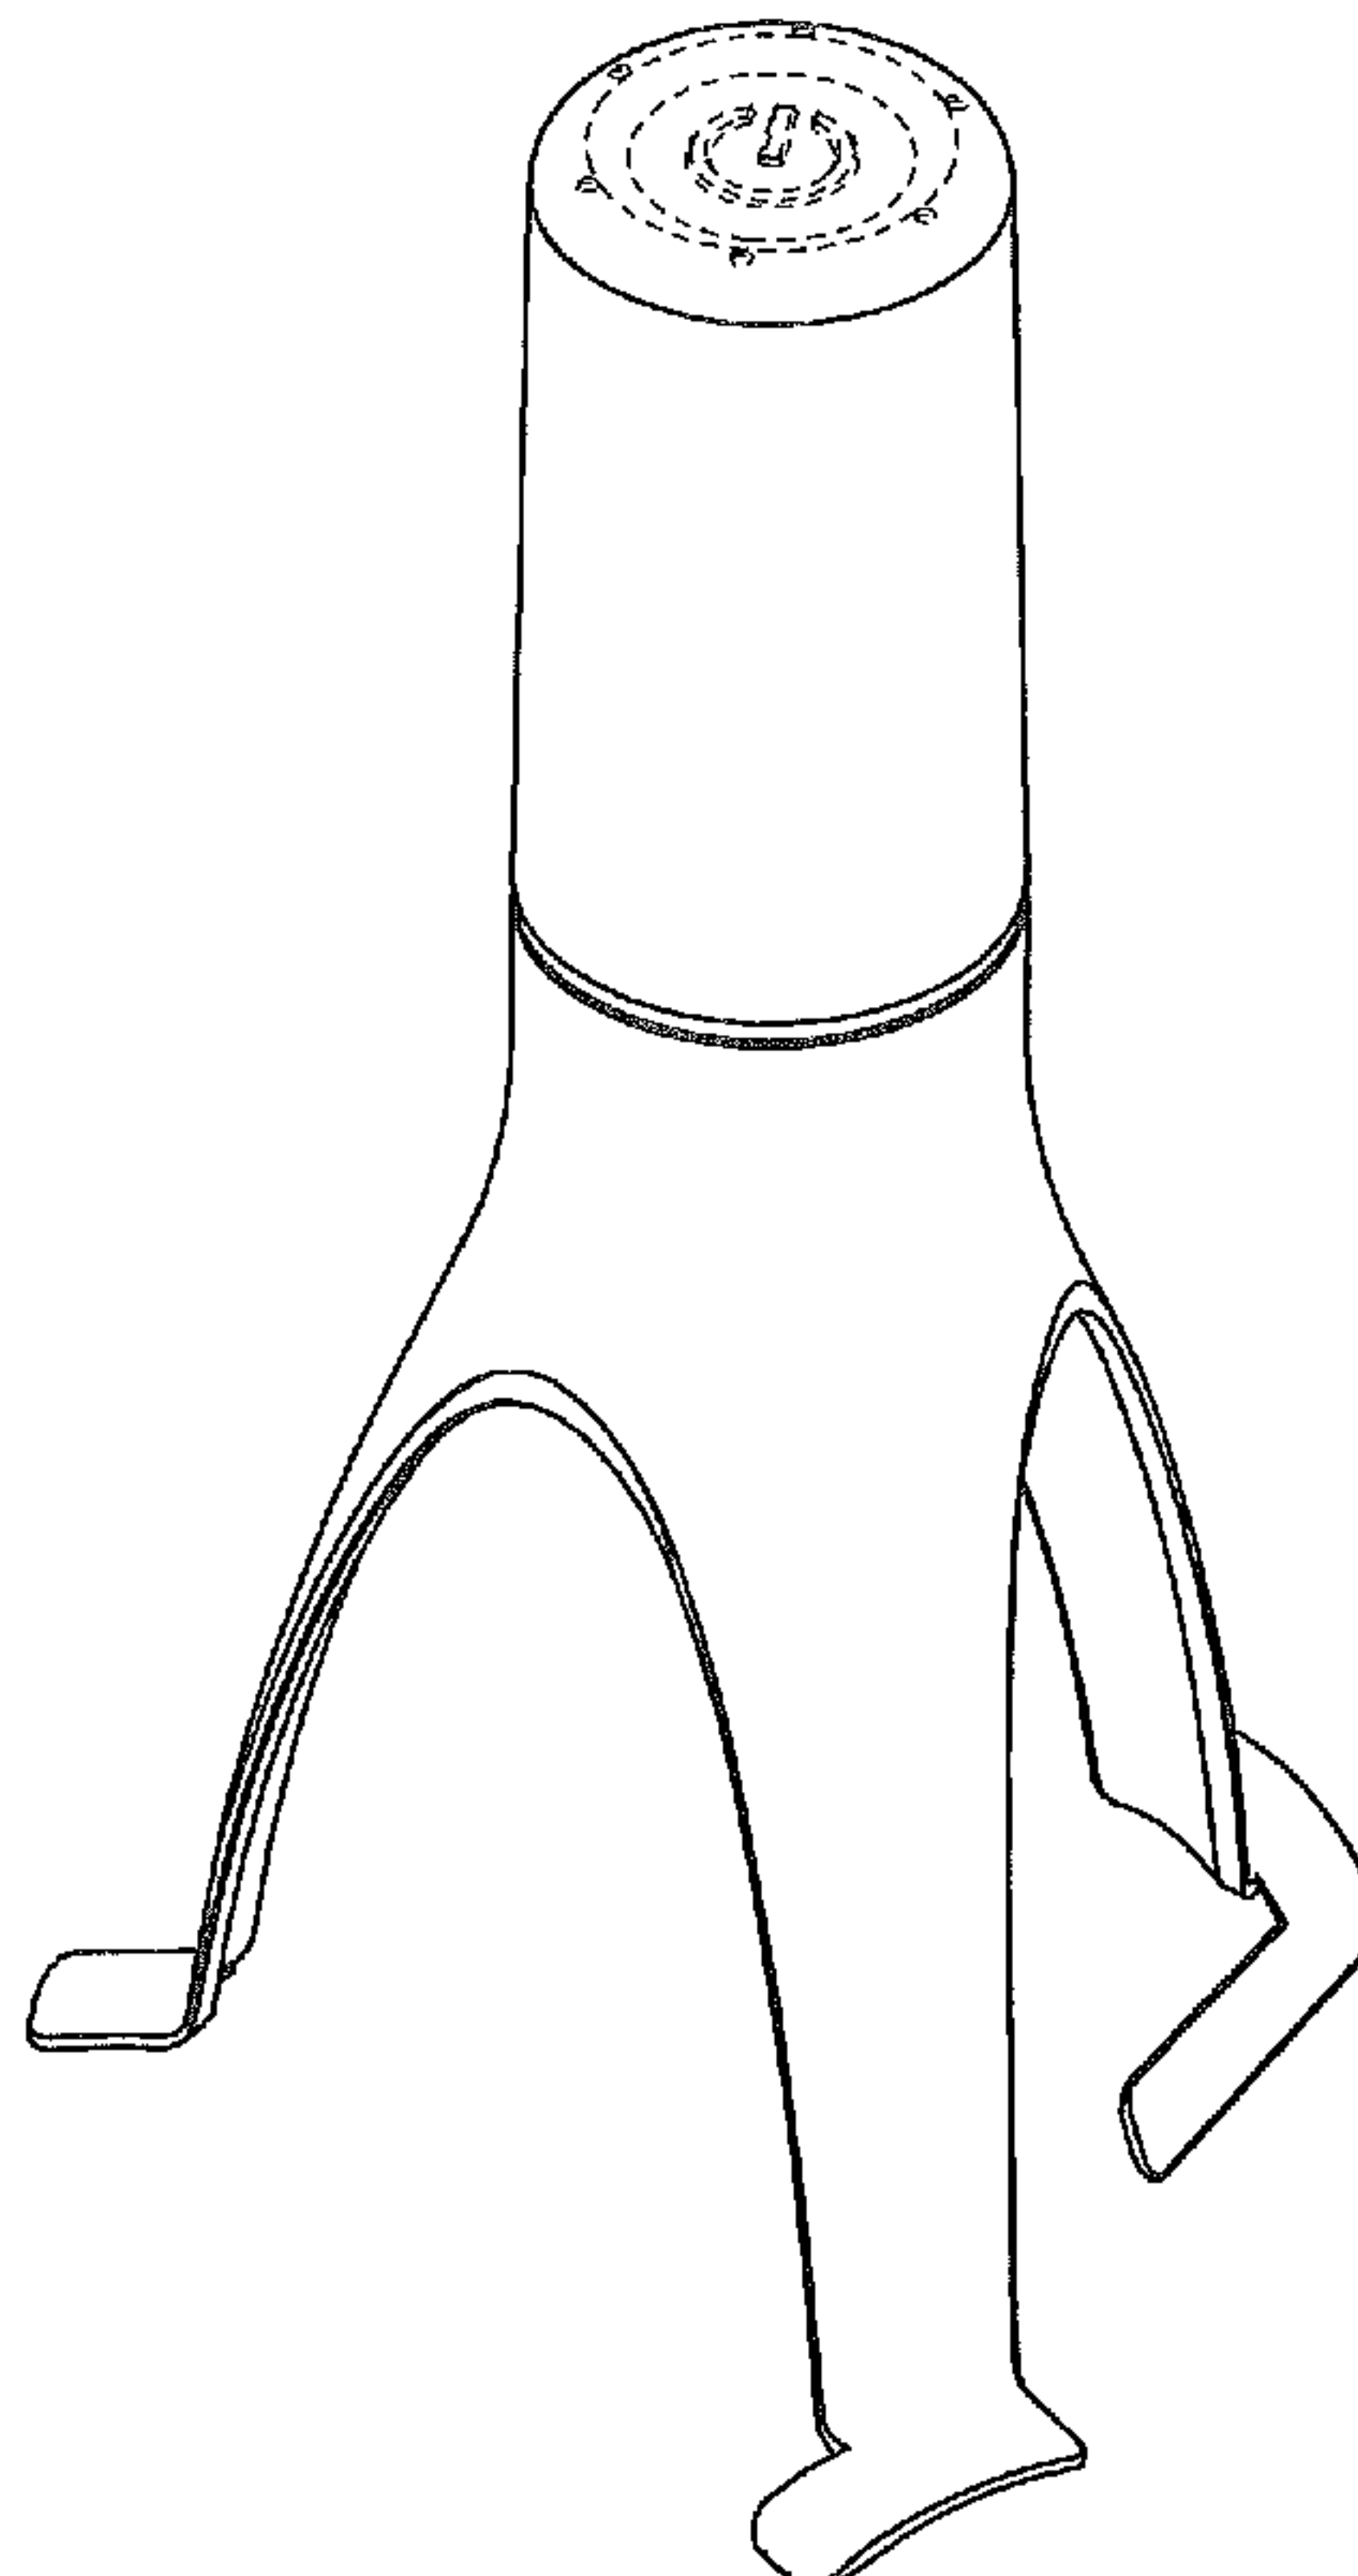

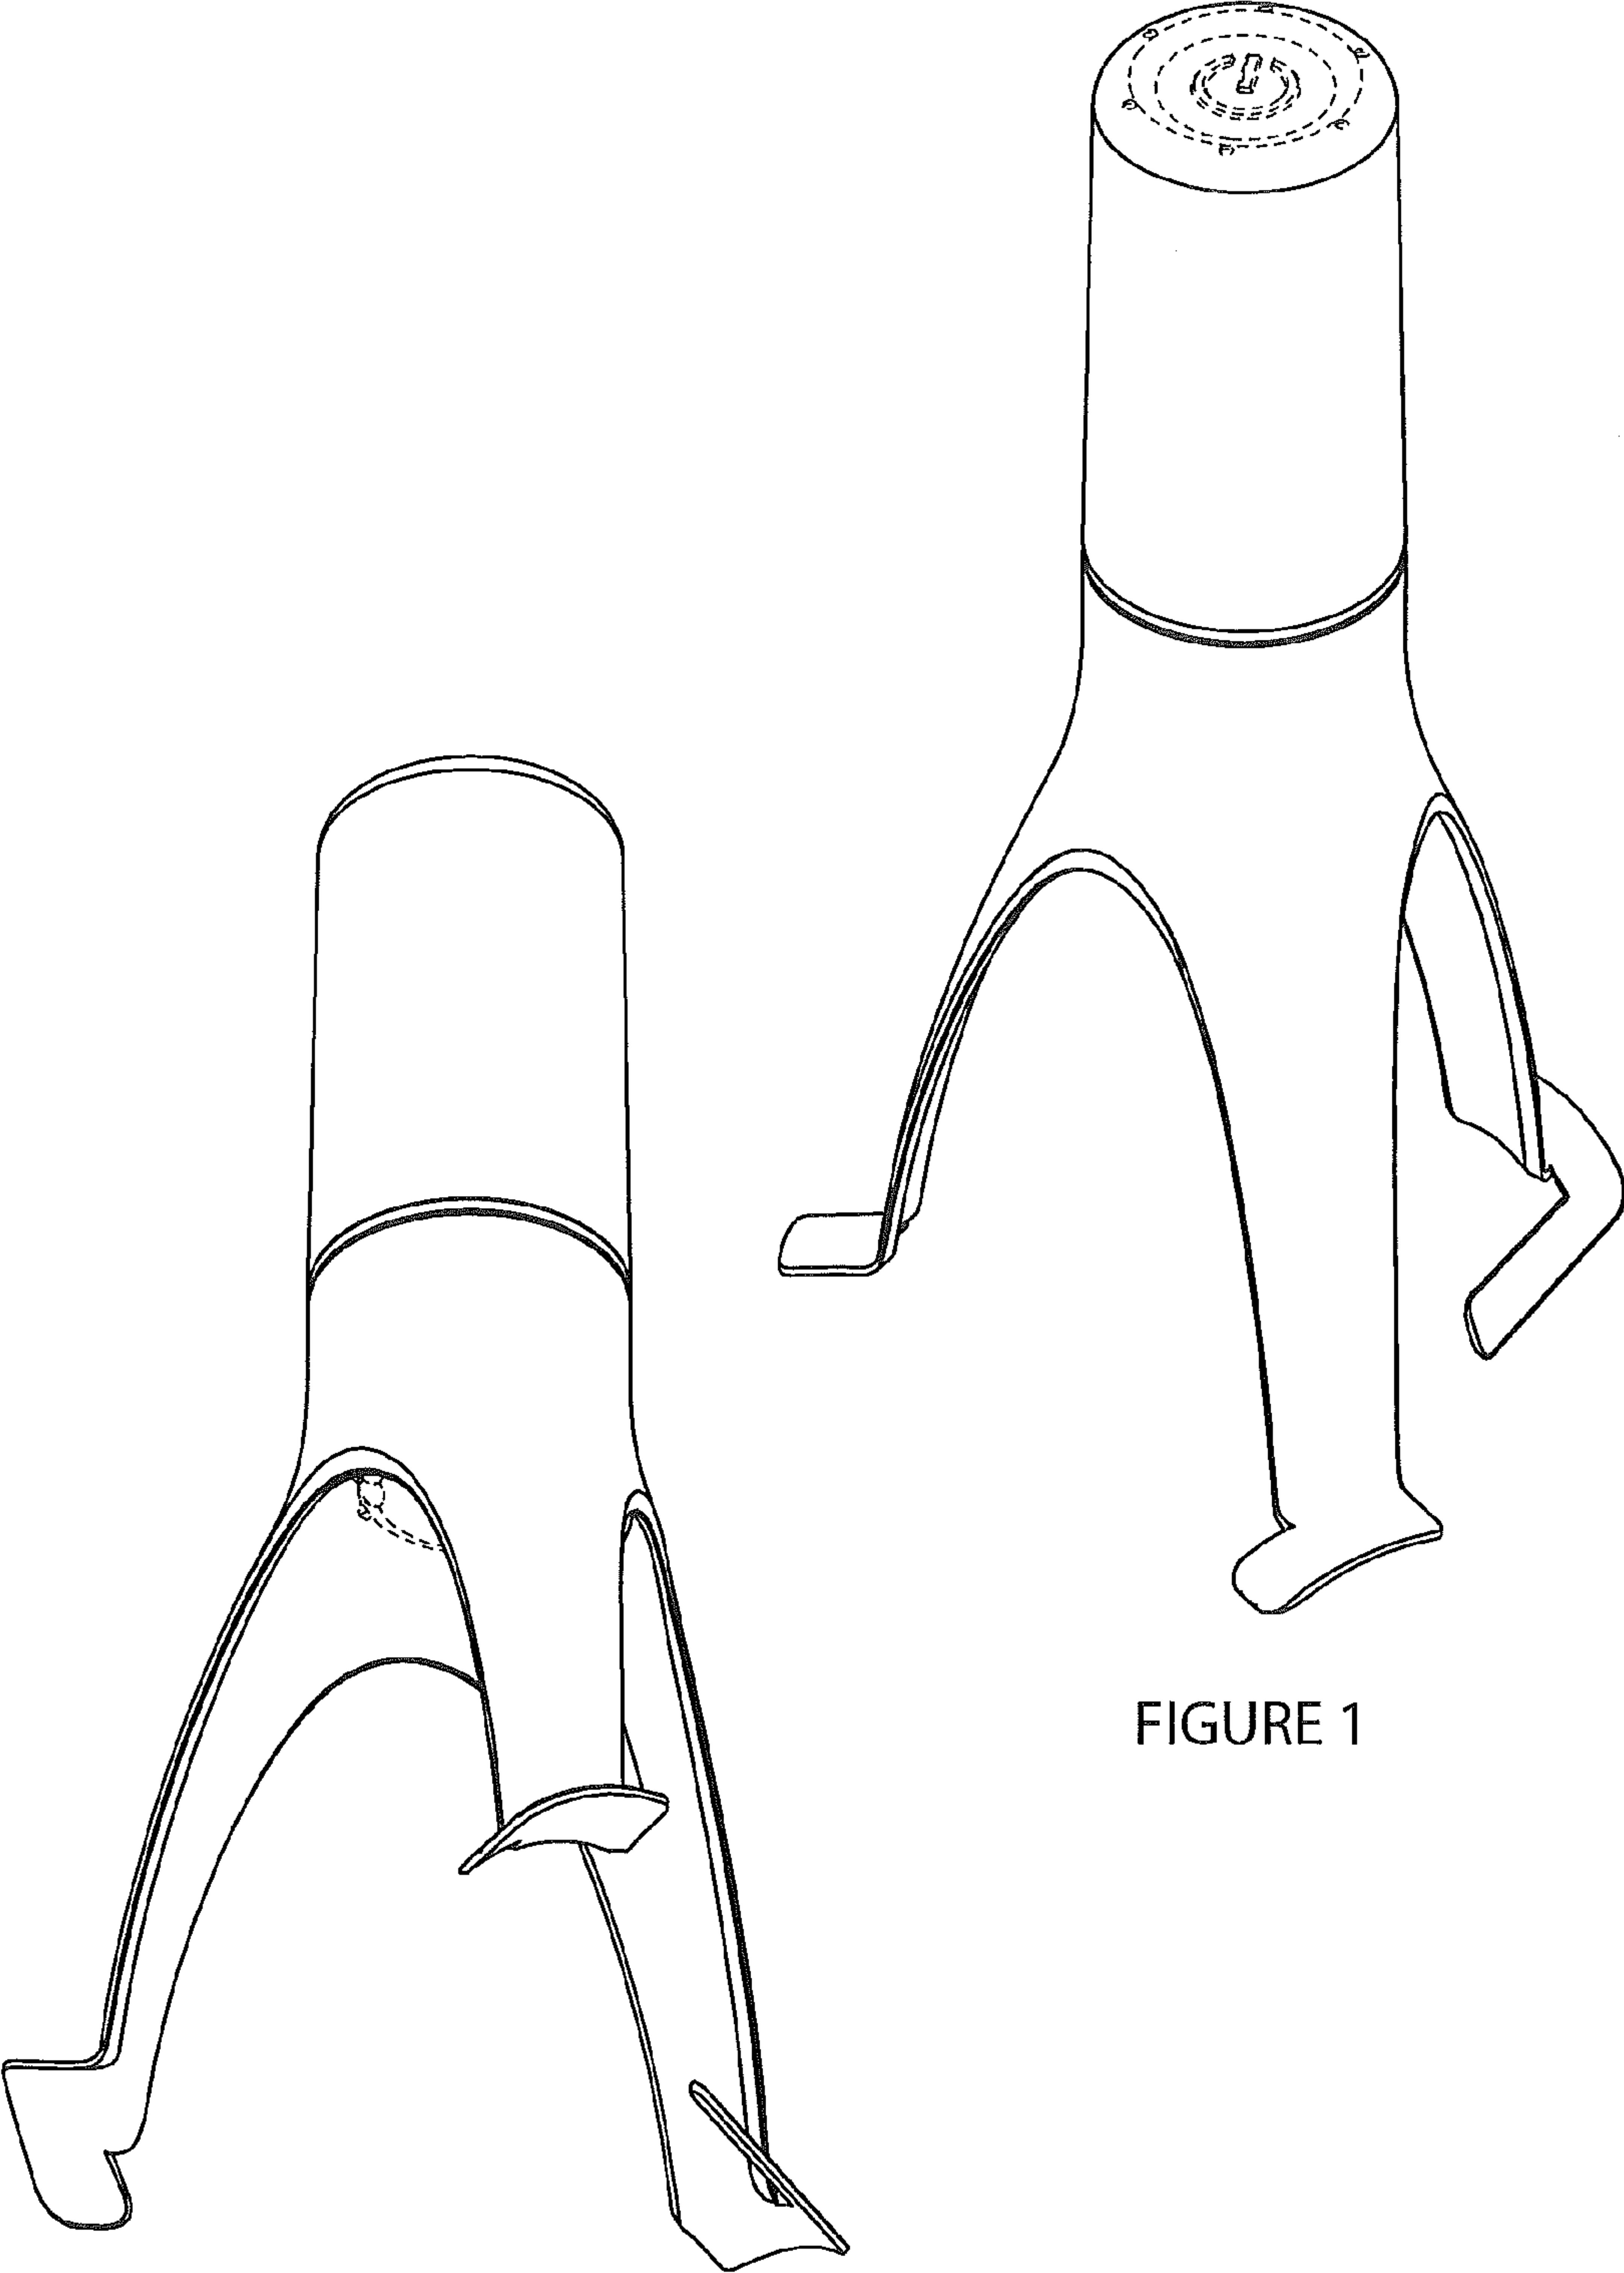


FIGURE 1

FIGURE 2

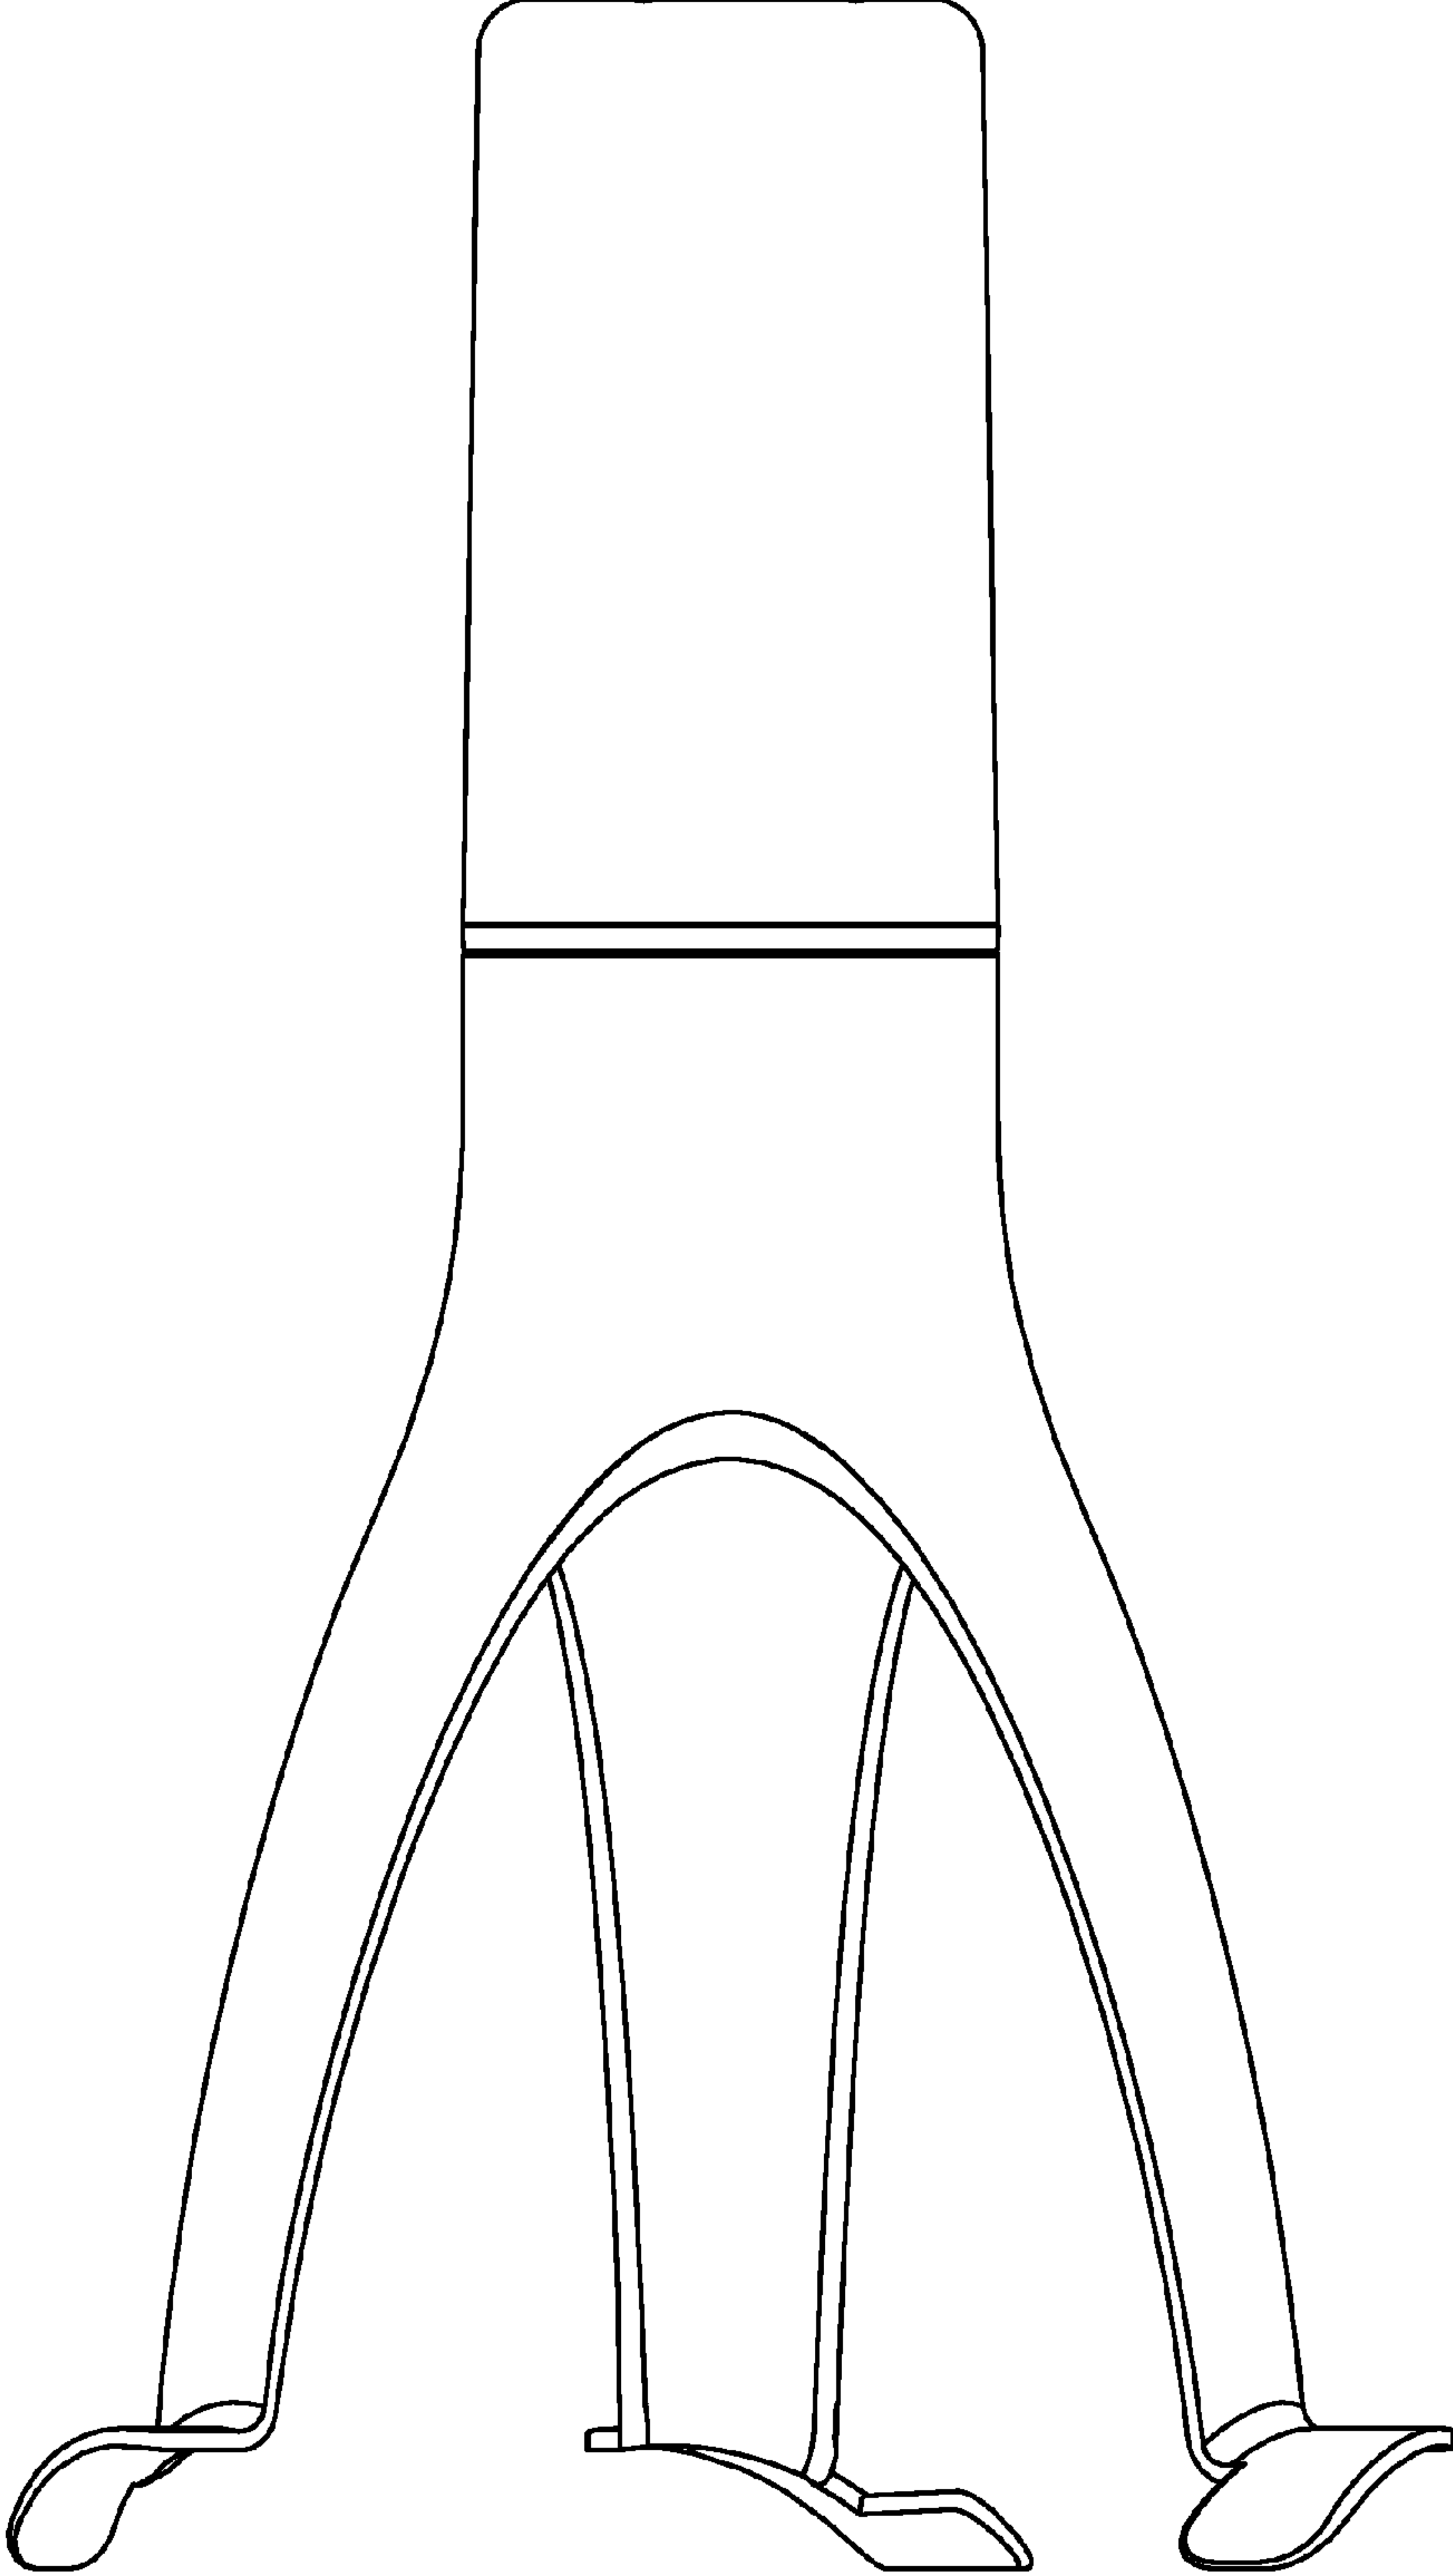


FIGURE 3

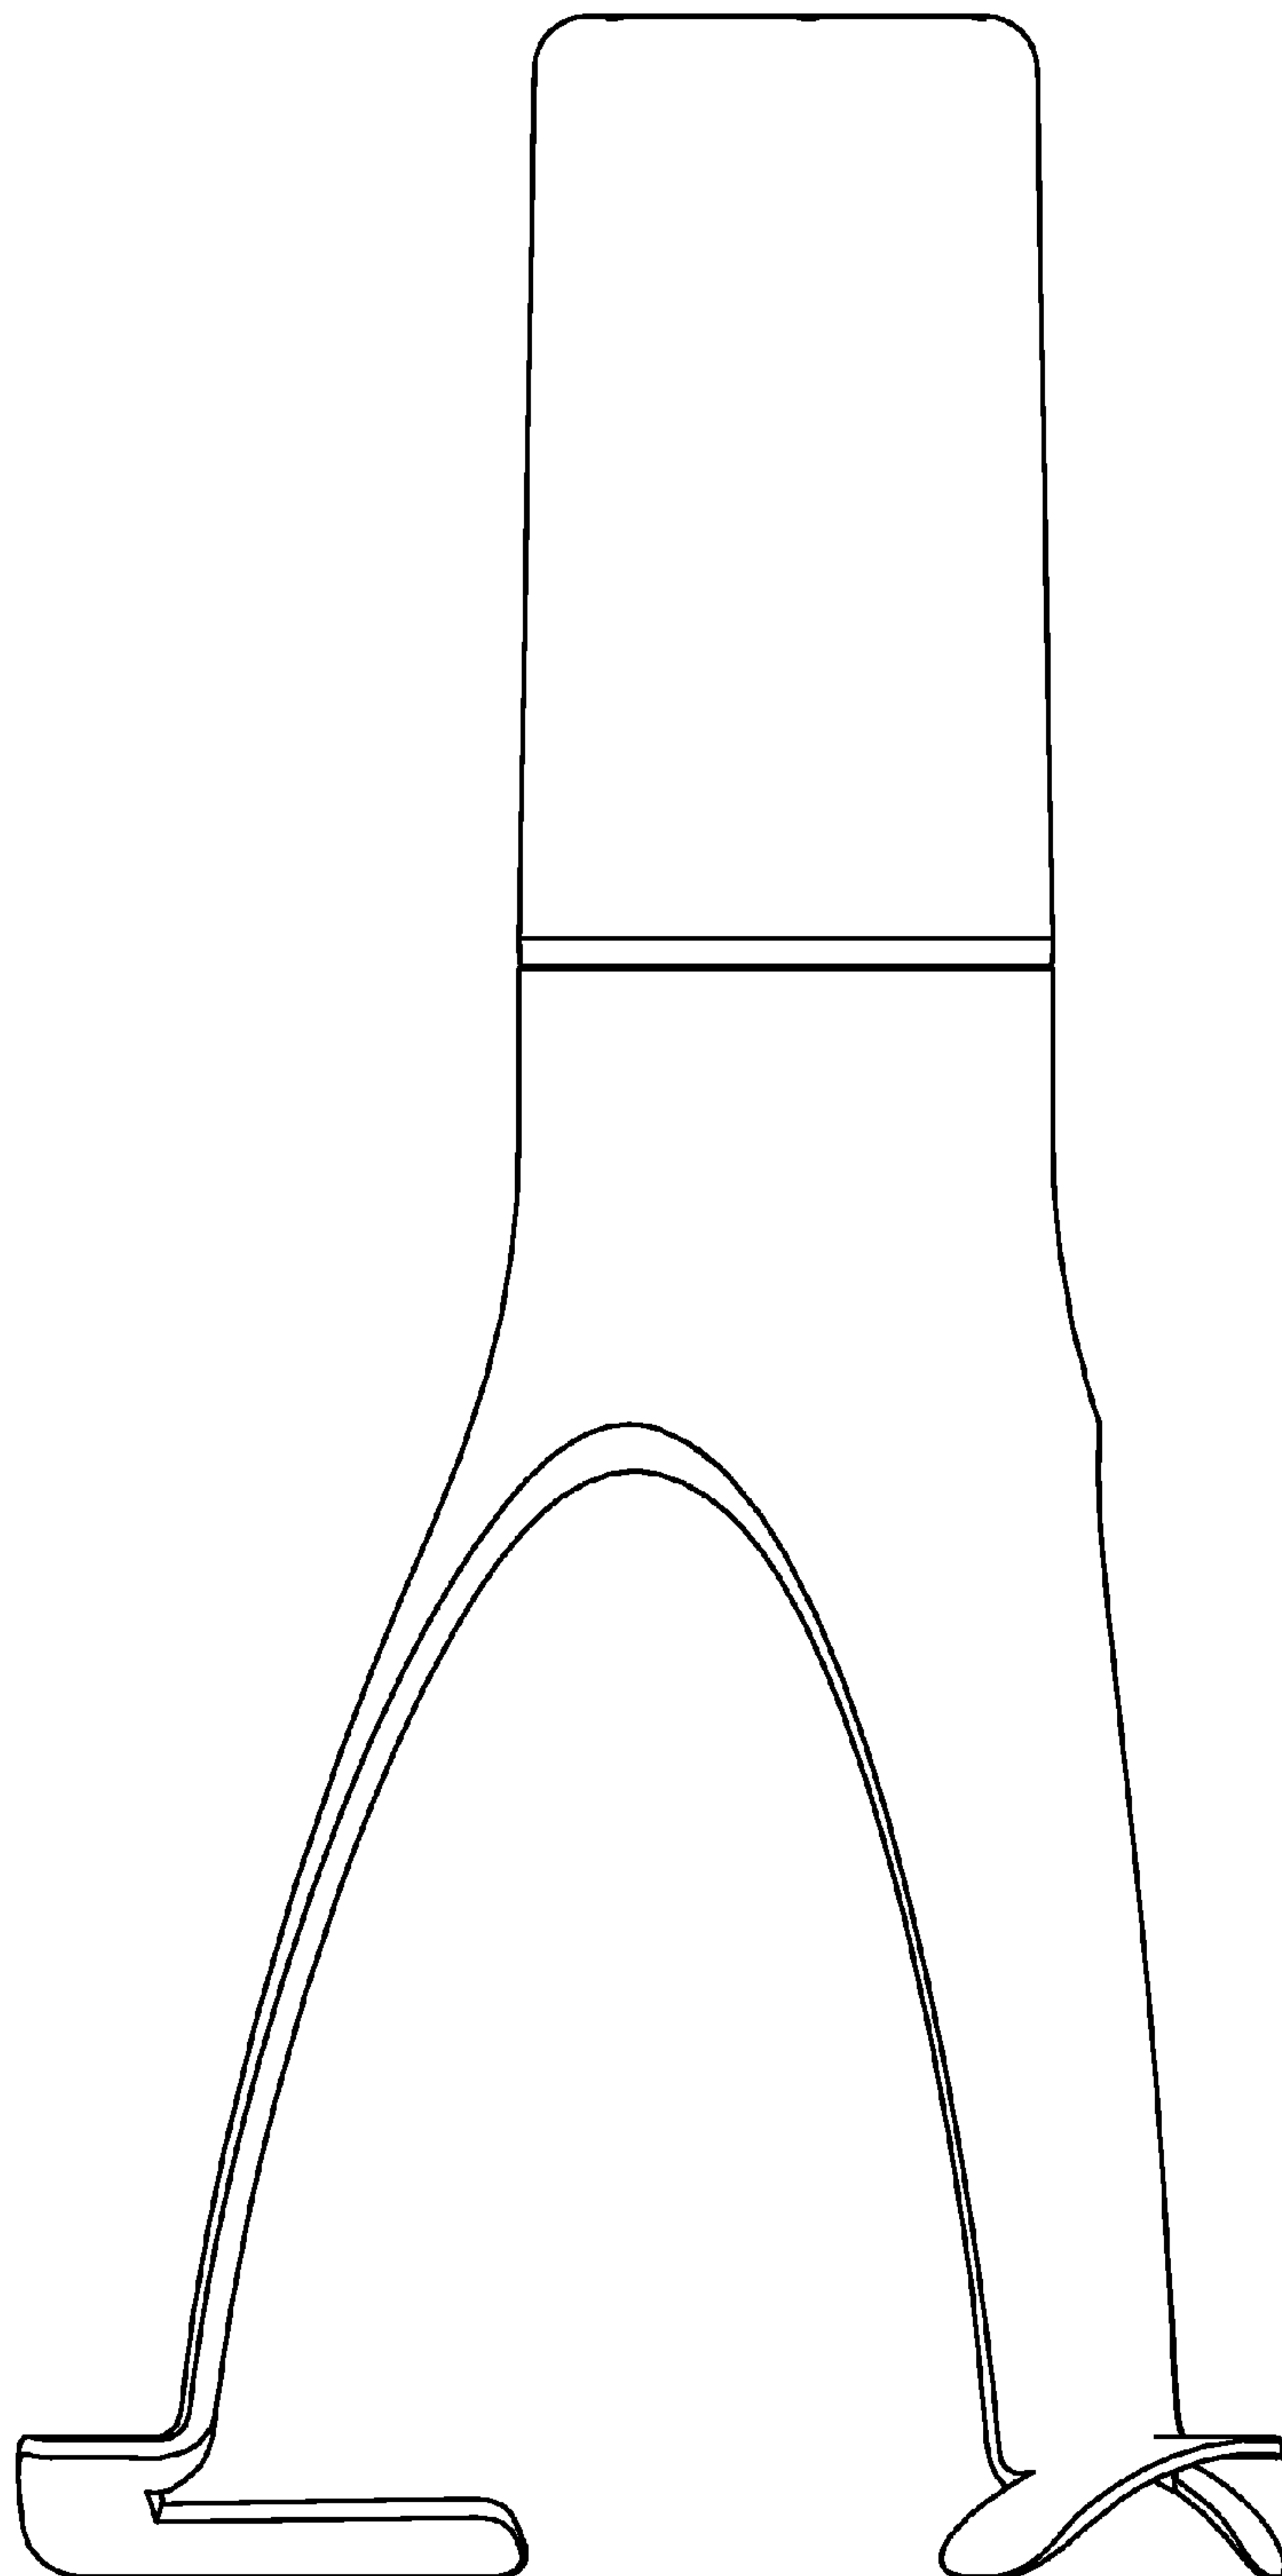


FIGURE 4

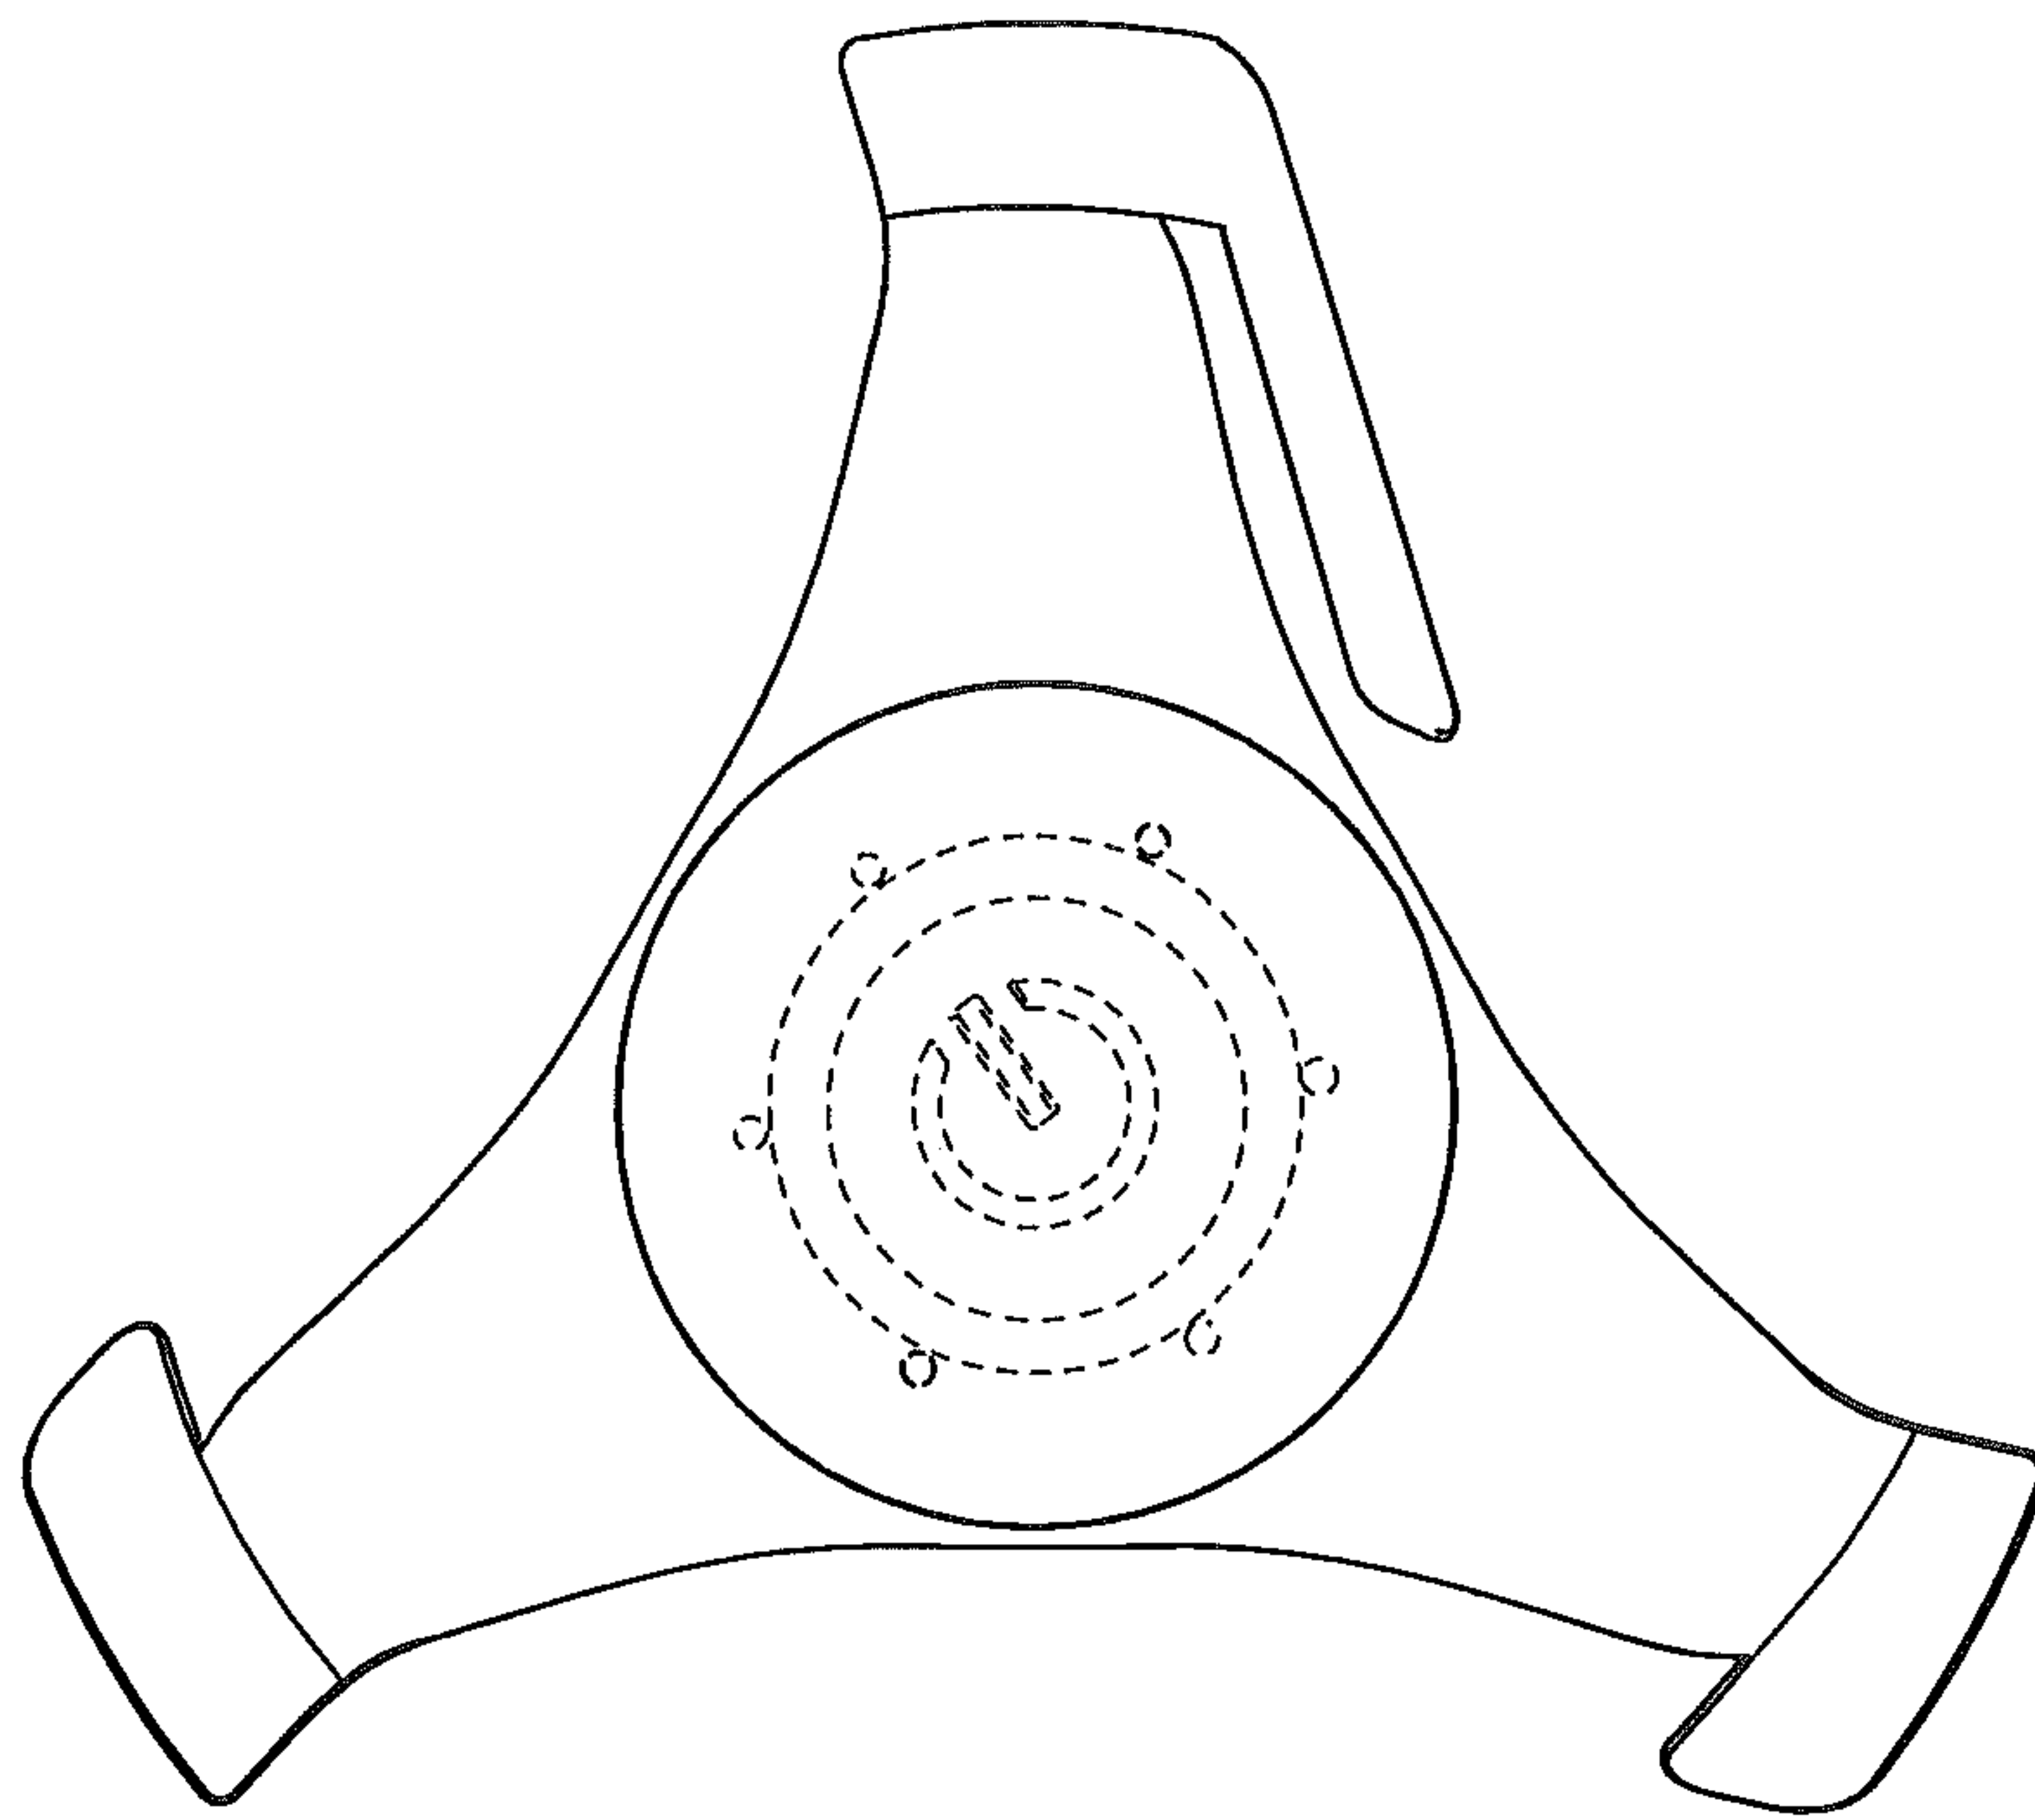


FIGURE 5

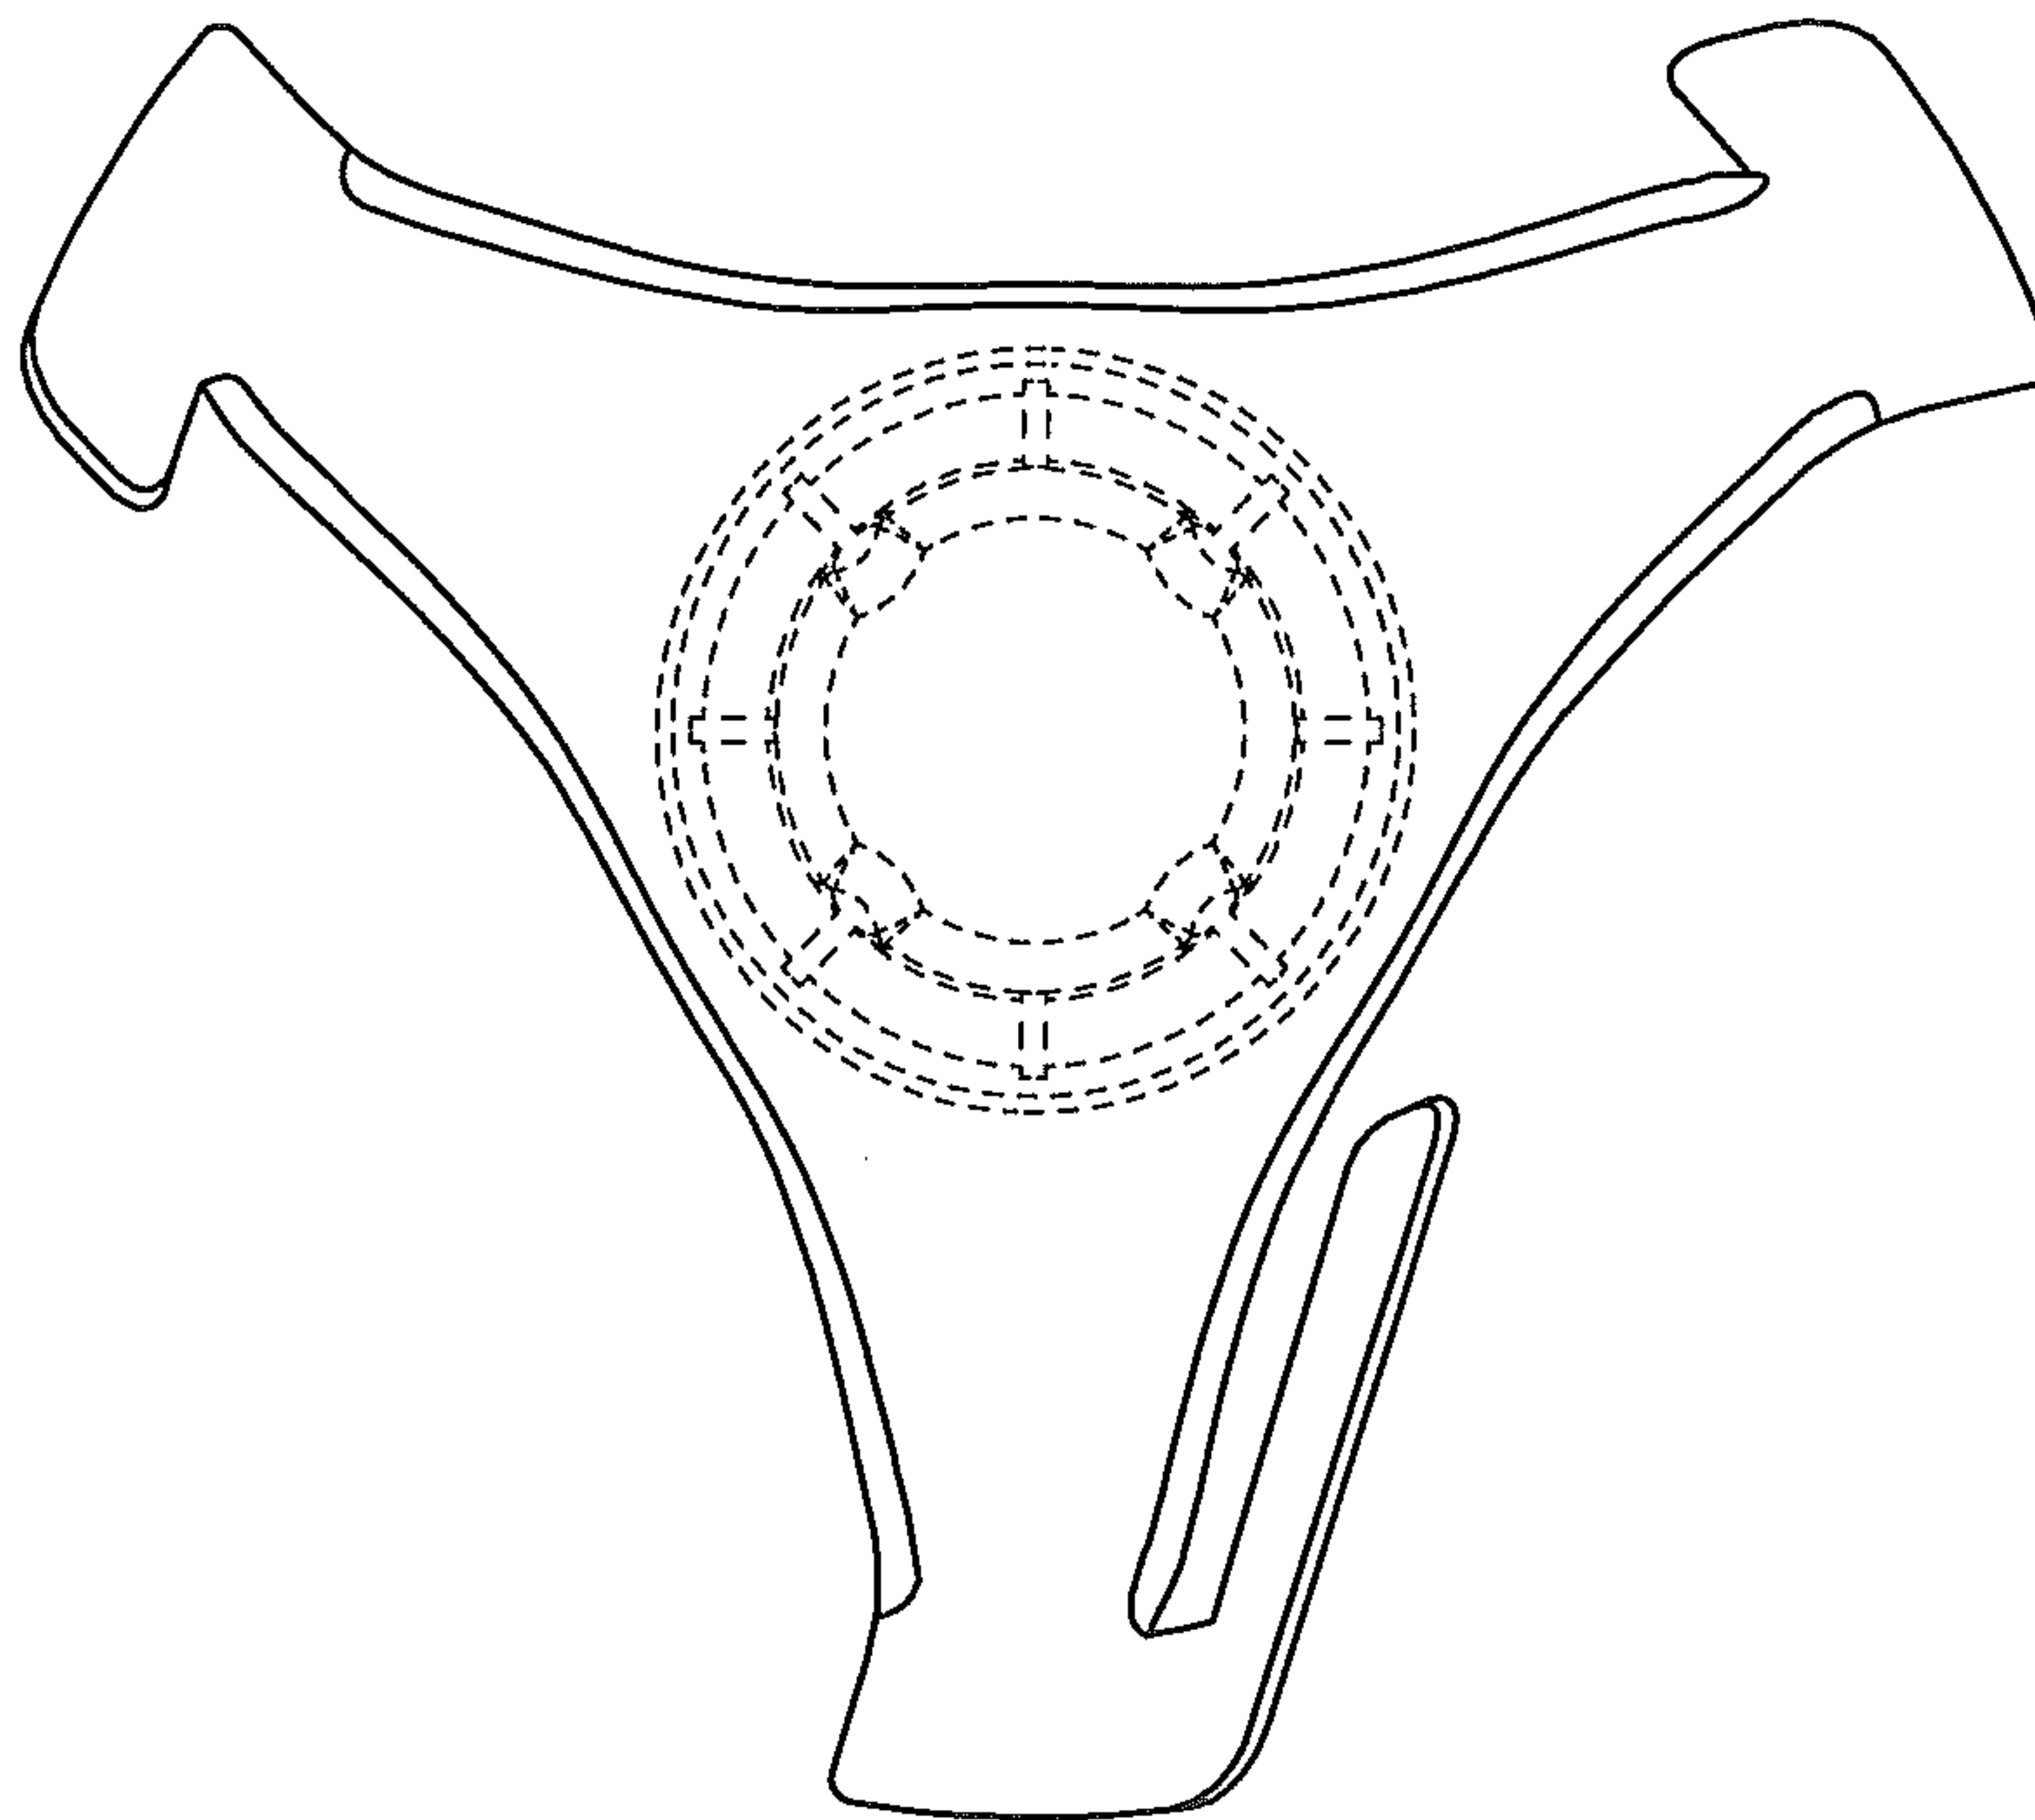


FIGURE 6