



US00D699688S

(12) **United States Design Patent**  
**Ling et al.**

(10) **Patent No.:** **US D699,688 S**

(45) **Date of Patent:** **\*\* Feb. 18, 2014**

(54) **HVAC CONTACTOR**

(75) Inventors: **Juan Ling**, Jiangsu (CN); **Xiaojiang Zhu**, Jiangsu (CN); **Randy Ruiz**, St. Peters, MO (US); **Brad Zikes**, Sunset Hills, MO (US)

(73) Assignee: **Emerson Electric Co.**, St. Louis, MO (US)

(\*\*) Term: **14 Years**

(21) Appl. No.: **29/412,351**

(22) Filed: **Feb. 2, 2012**

(30) **Foreign Application Priority Data**

Jan. 21, 2012 (CN) ..... 2012 3 0017974

(51) **LOC (10) Cl.** ..... **13-03**

(52) **U.S. Cl.**  
USPC ..... **D13/159; D13/177**

(58) **Field of Classification Search**  
USPC ..... D13/158, 159, 173, 177, 184;  
200/43.14, 50.01, 50.21, 50.23;  
335/106, 133, 202; 361/44, 50, 71,  
361/115, 608, 634

See application file for complete search history.

(56) **References Cited**

**U.S. PATENT DOCUMENTS**

4,739,293 A \* 4/1988 Hurley et al. .... 335/132  
4,774,484 A 9/1988 Lehman et al.  
4,899,120 A \* 2/1990 Ohtake et al. .... 335/132  
D344,715 S 3/1994 Hsiao et al.  
6,297,717 B1 10/2001 Heckenkamp  
D456,013 S 4/2002 Heckenkamp  
6,411,184 B1 6/2002 Comtois et al.  
D463,378 S 9/2002 Allada et al.

D494,546 S 8/2004 Nurdogan  
D617,288 S 6/2010 Yang  
7,973,625 B2 7/2011 Chandrappa et al.  
D656,467 S 3/2012 Okubo et al.  
D656,903 S 4/2012 Suzuki et al.  
D673,509 S 1/2013 Vanderheyden et al.  
8,514,041 B2 8/2013 Naka et al.  
2002/0192990 A1 12/2002 Alexandre  
2004/0217831 A1 \* 11/2004 Bauer et al. .... 335/202  
2006/0098375 A1 5/2006 Lluch et al.  
2009/0247019 A1 10/2009 Hadir et al.  
2011/0133870 A1 6/2011 Annis et al.  
2012/0313788 A1 12/2012 Wan

**OTHER PUBLICATIONS**

Notice of Allowance dated Nov. 6, 2013, issued in co-pending Design U.S. Appl. No. 29/412,350; 12 pgs.

\* cited by examiner

*Primary Examiner* — Selina Sikder

(74) *Attorney, Agent, or Firm* — Harness, Dickey & Pierce, P.L.C.


(57) **CLAIM**

The ornamental design for a HVAC contactor, as shown and described.

**DESCRIPTION**

FIG. 1 is a perspective view of a HVAC contactor;  
FIG. 2 is a front view hereof;  
FIG. 3 is a back view thereof wherein the broken lines form no part of the claimed design;  
FIG. 4 is a right side view thereof;  
FIG. 5 is a left side view thereof;  
FIG. 6 is a top view thereof wherein the broken lines form no part of the claimed design; and,  
FIG. 7 is a bottom view hereof.

**1 Claim, 5 Drawing Sheets**

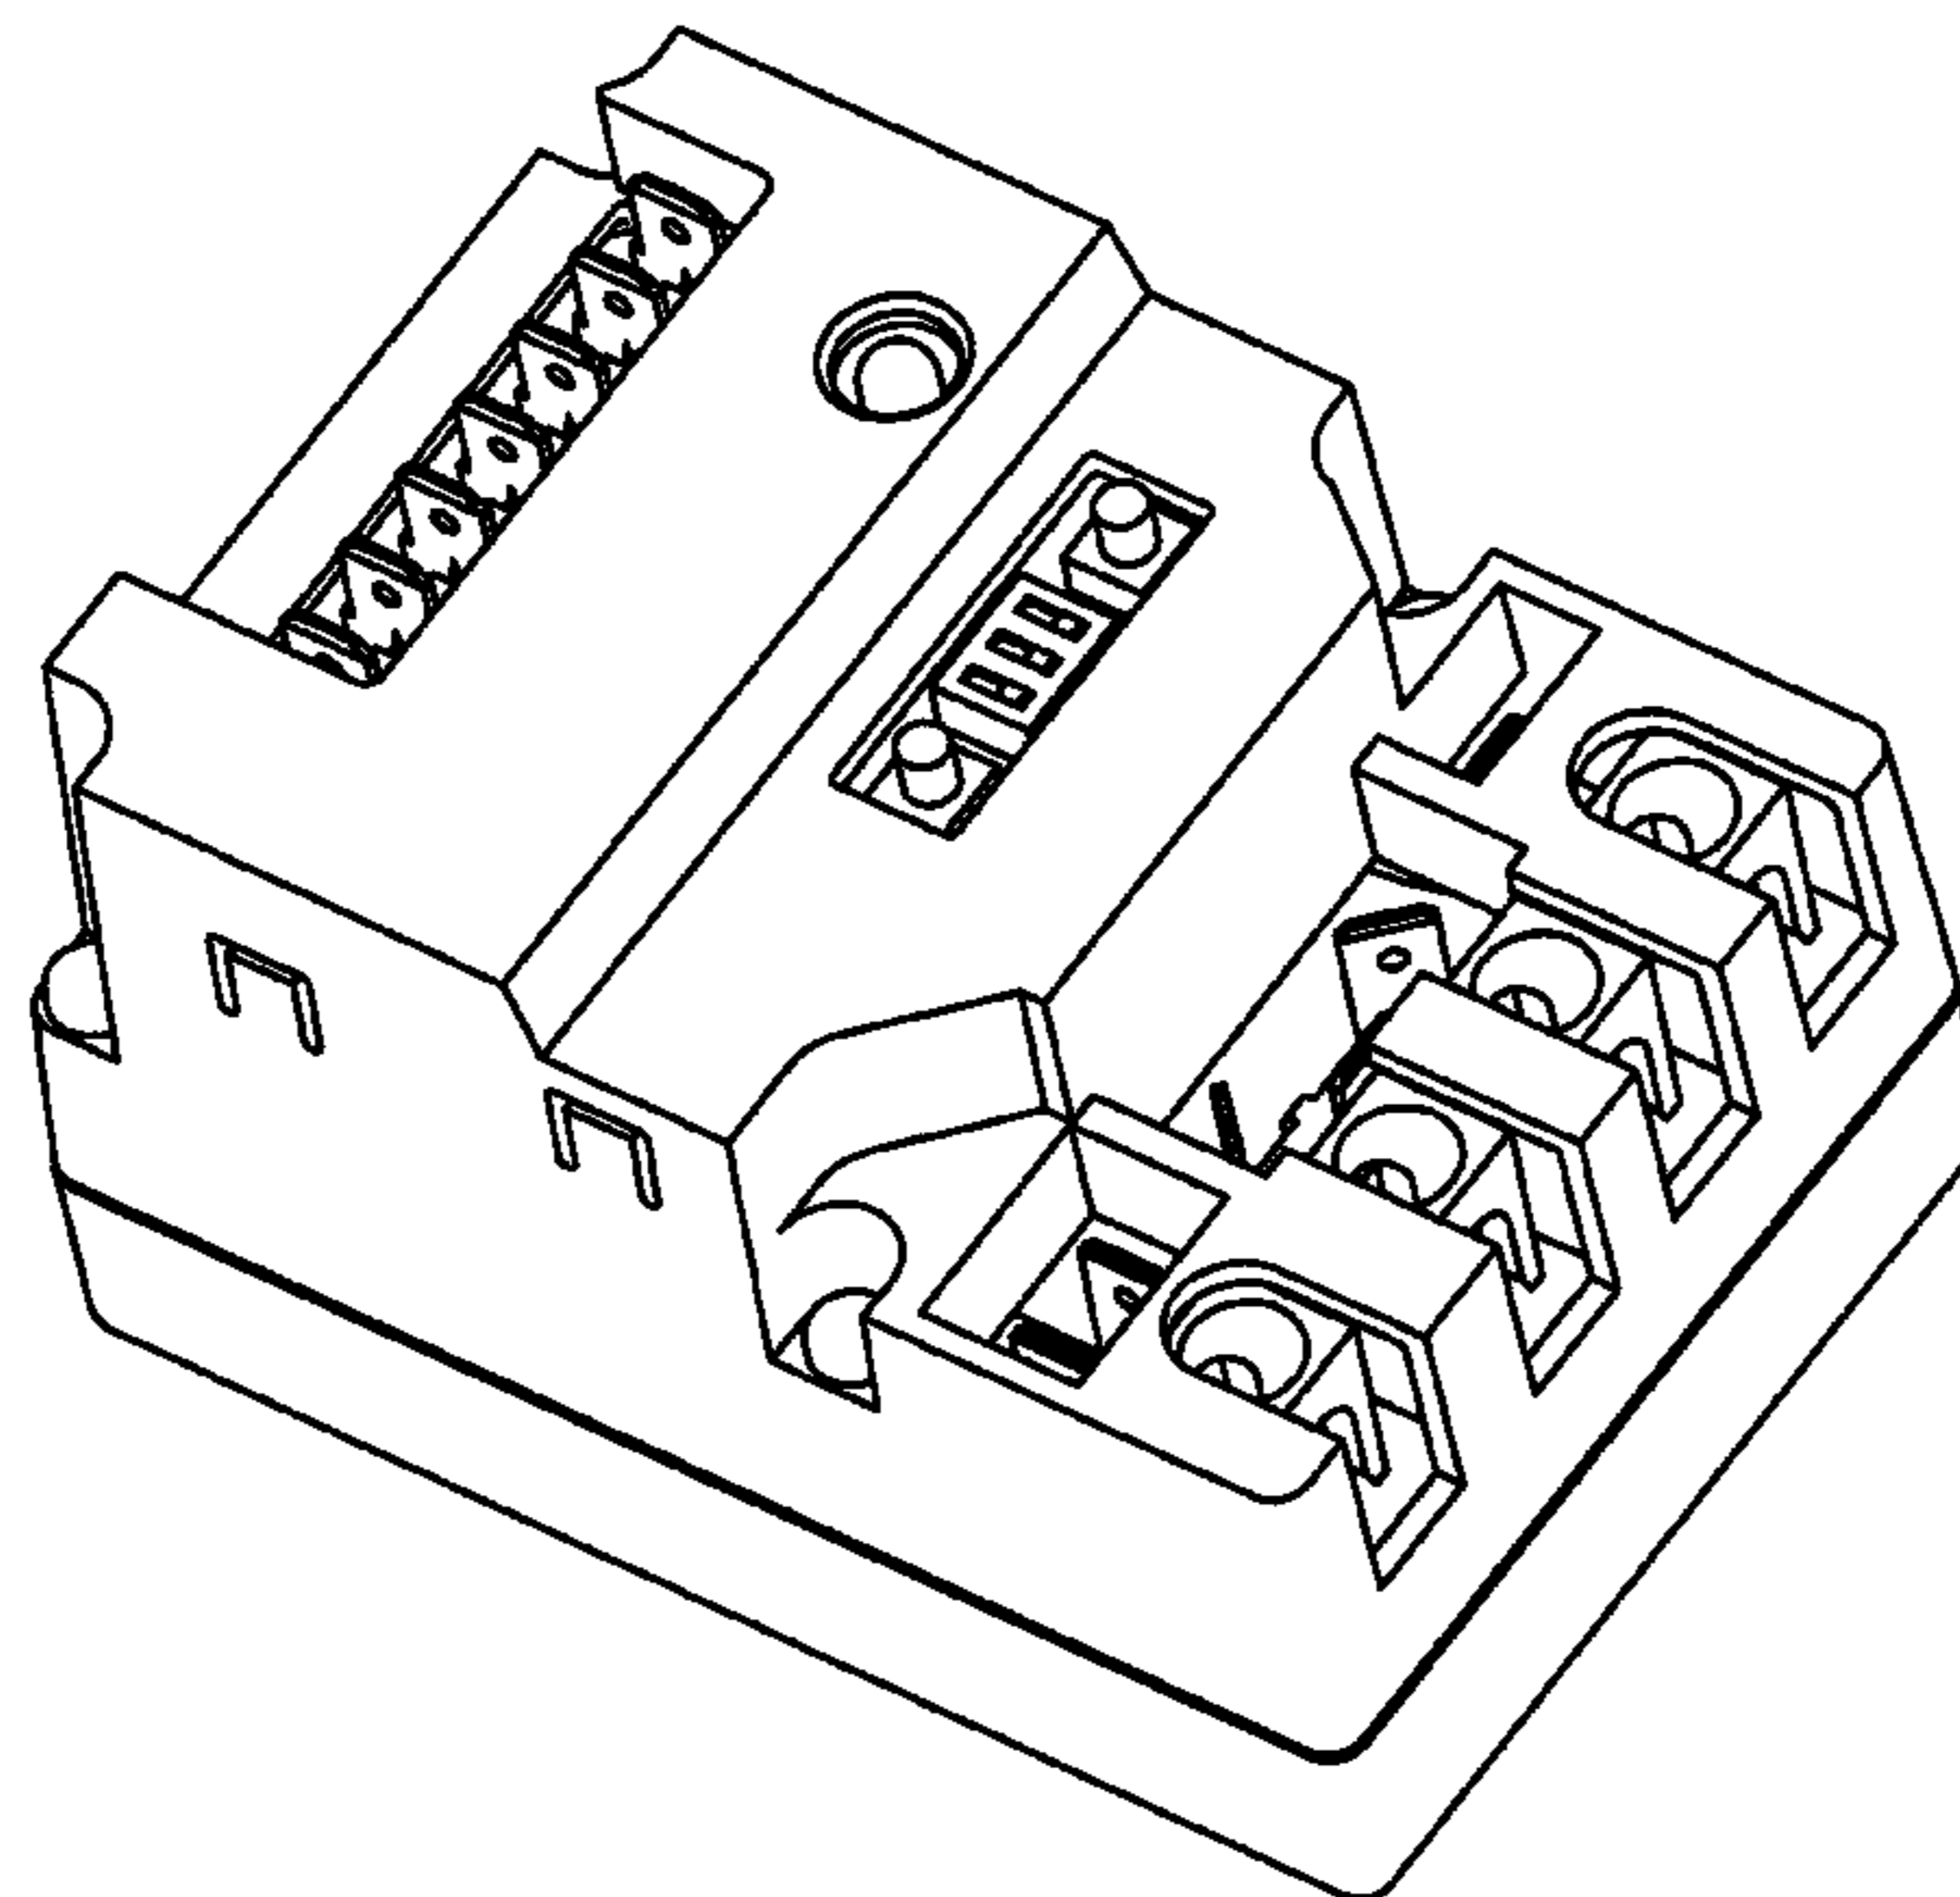

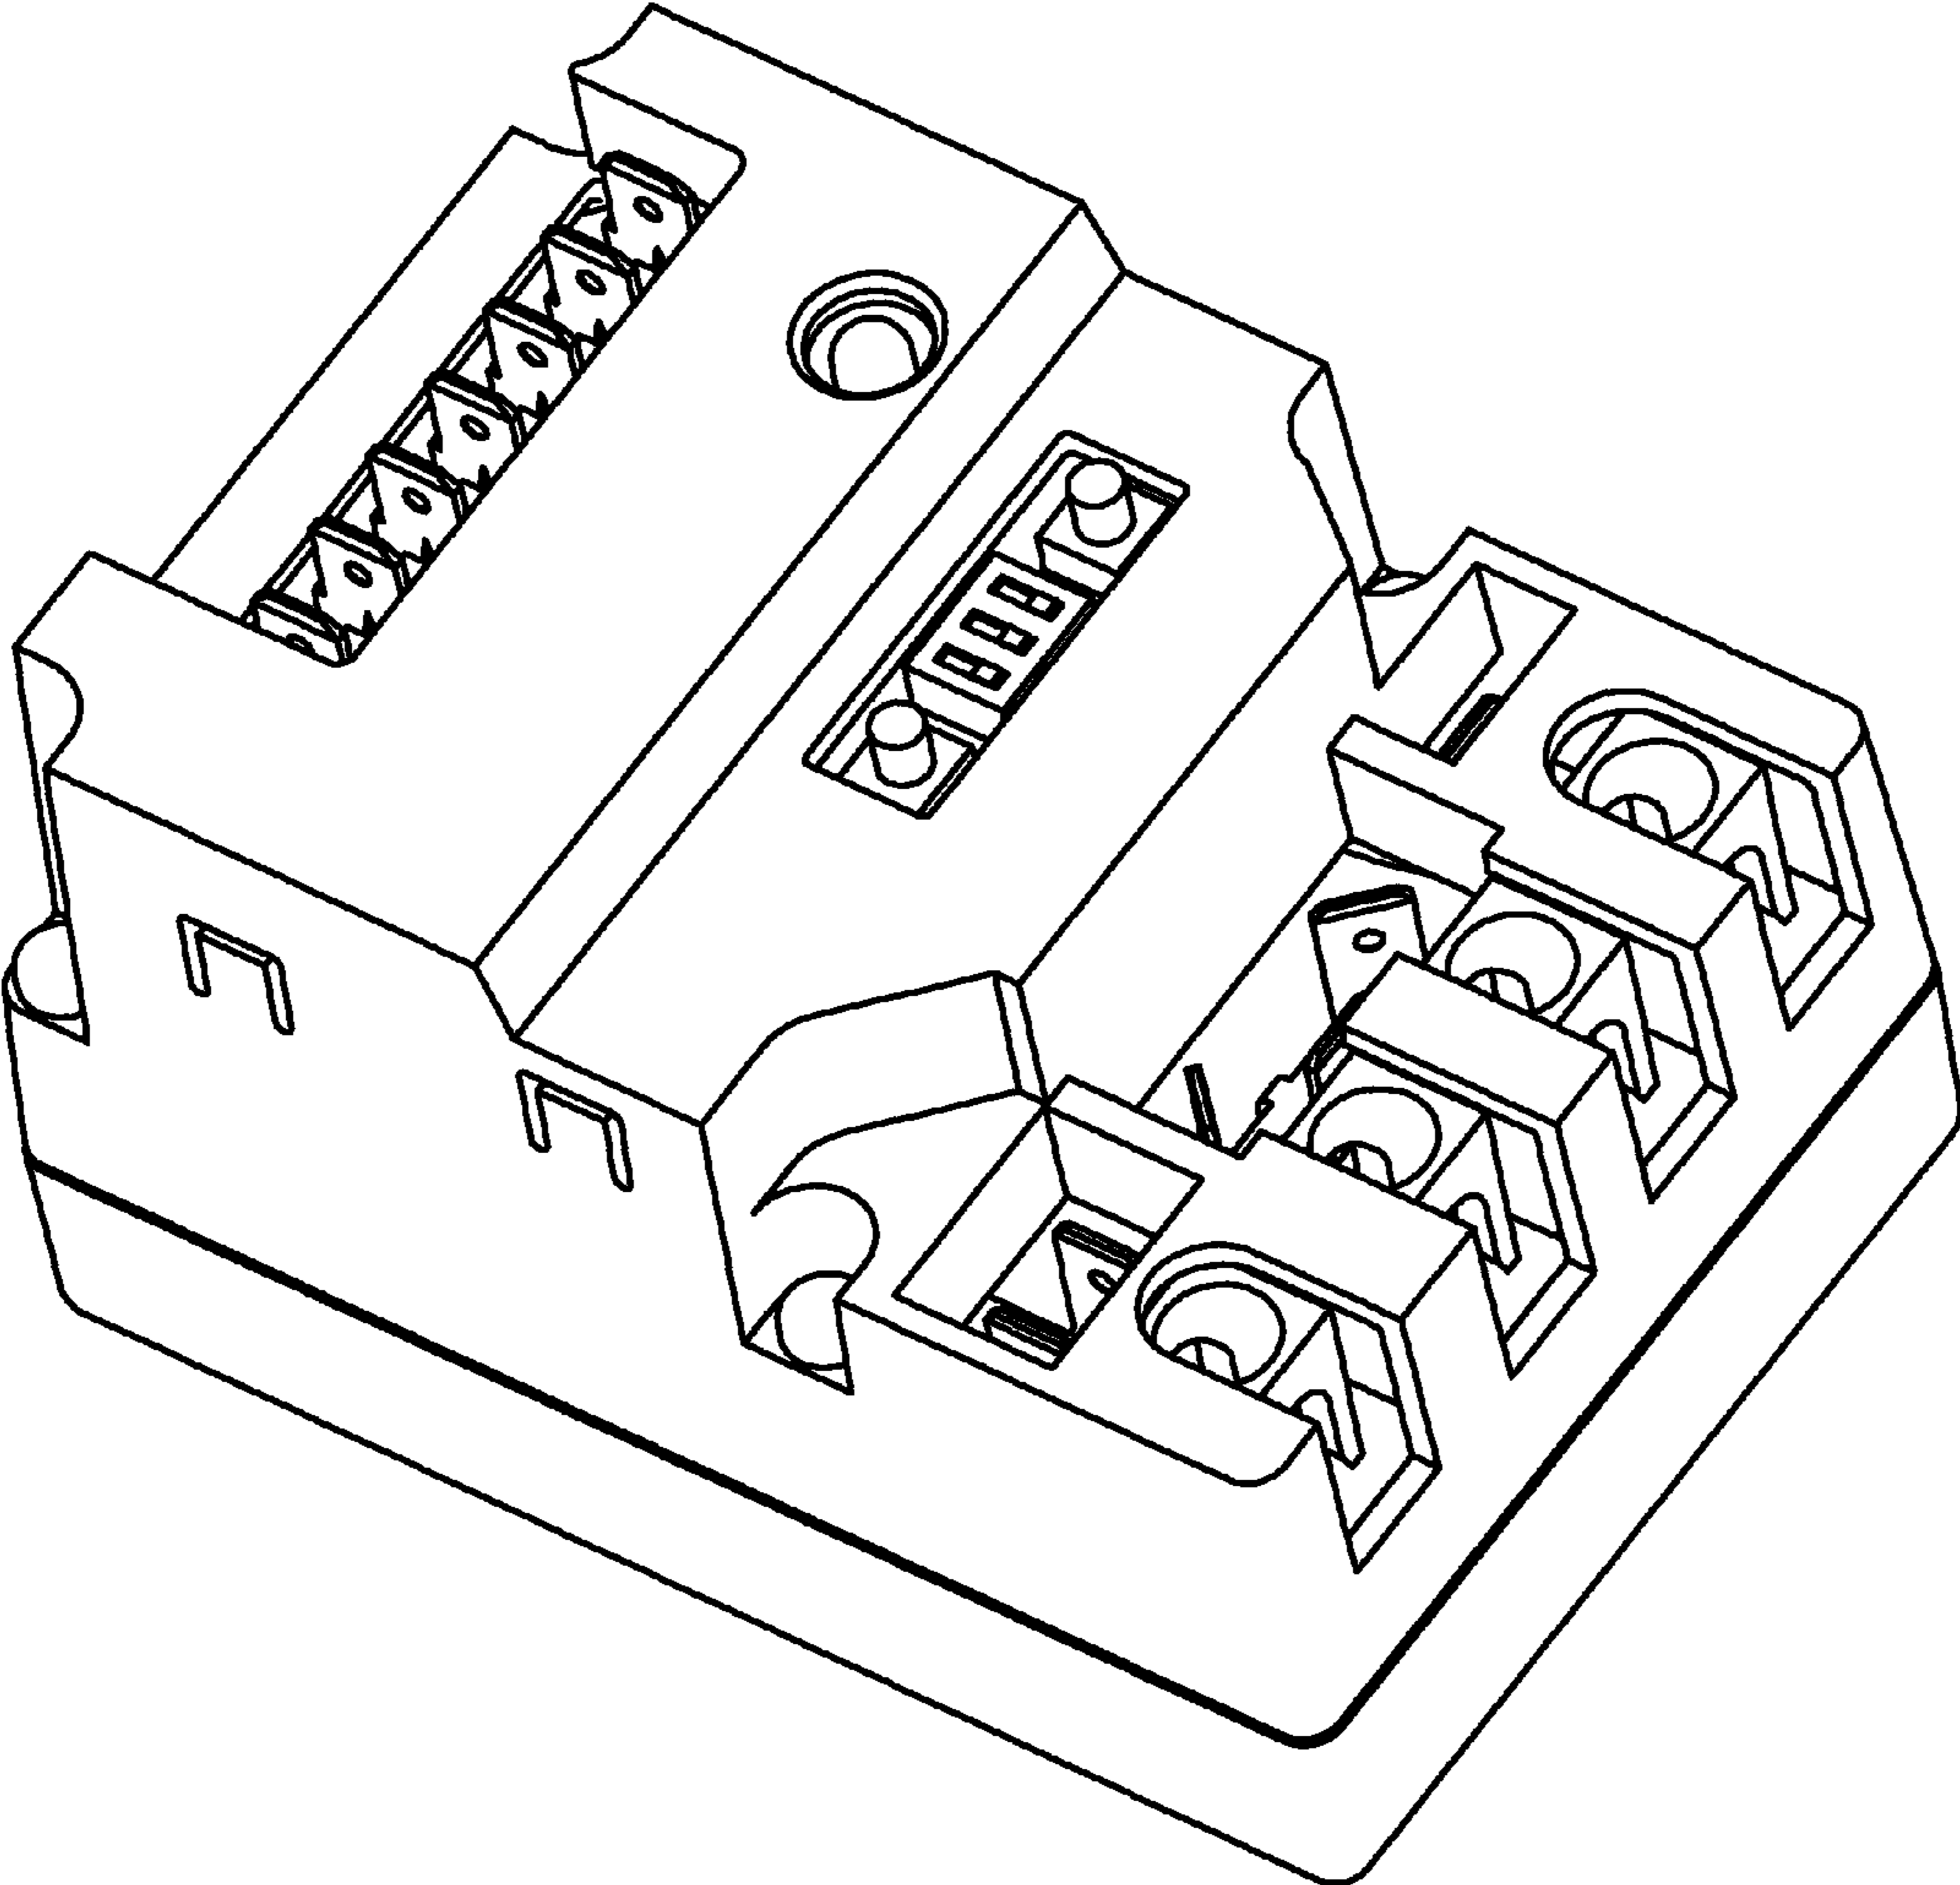


FIG. 1

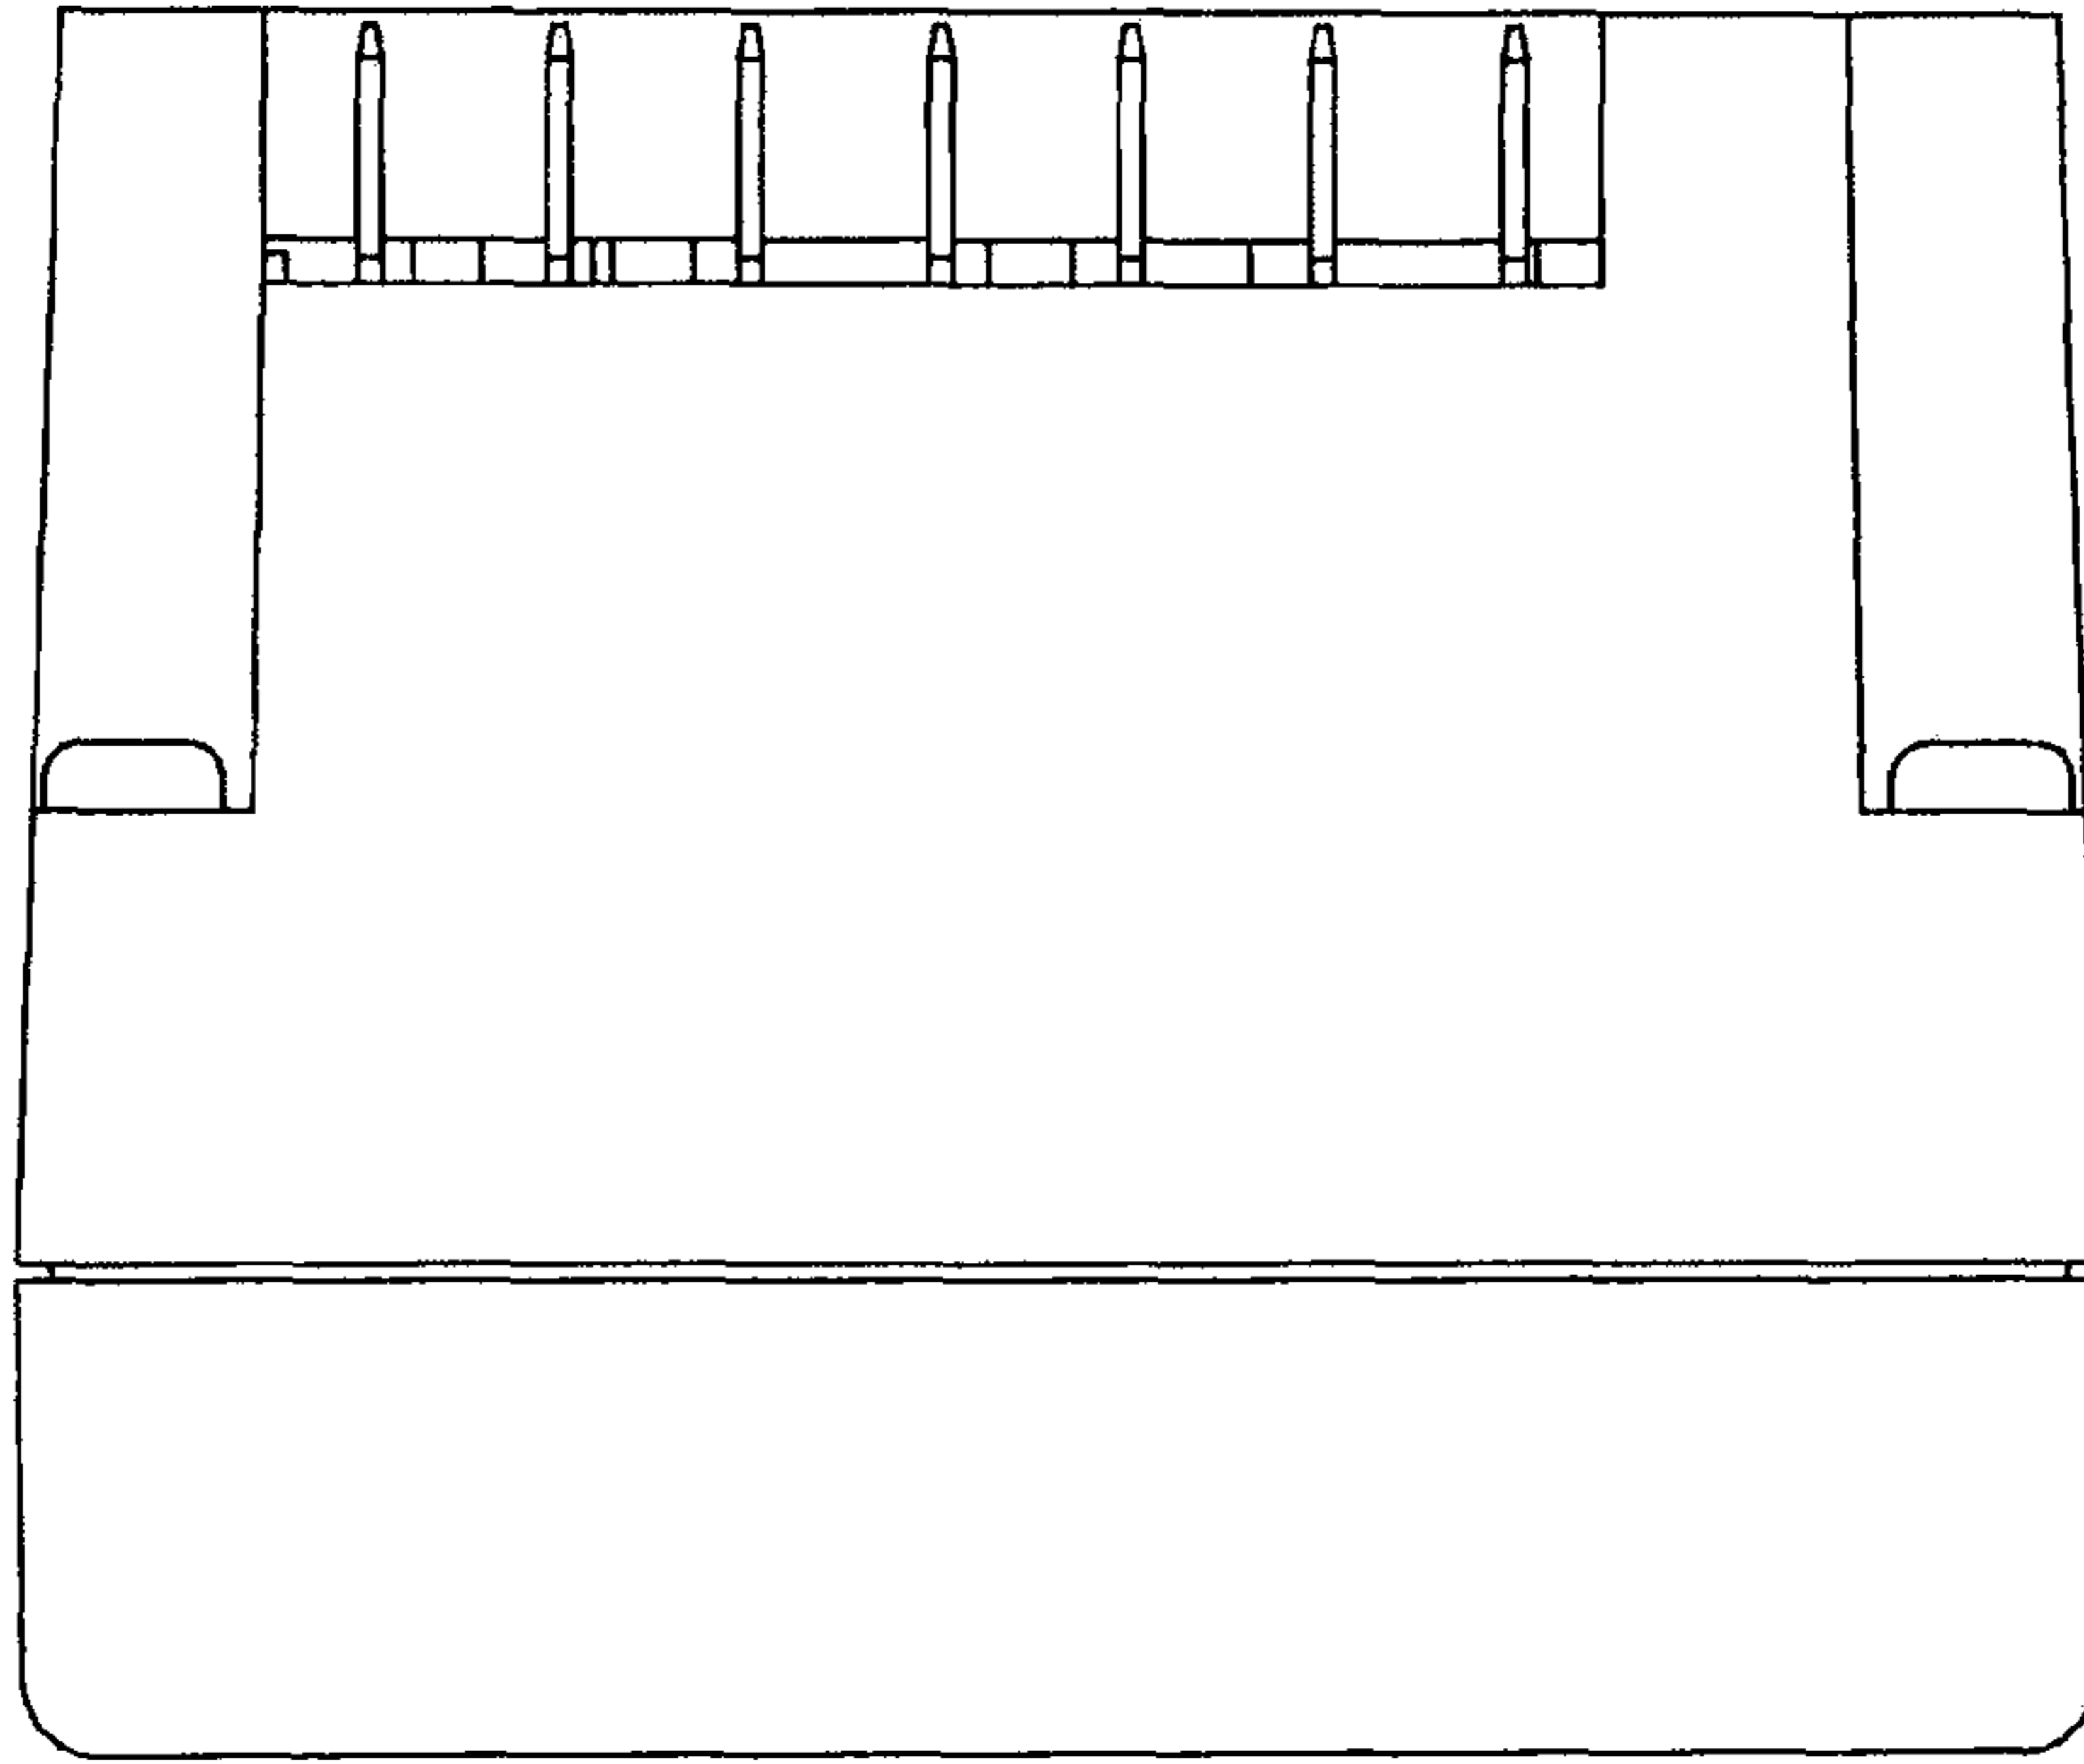


FIG. 2

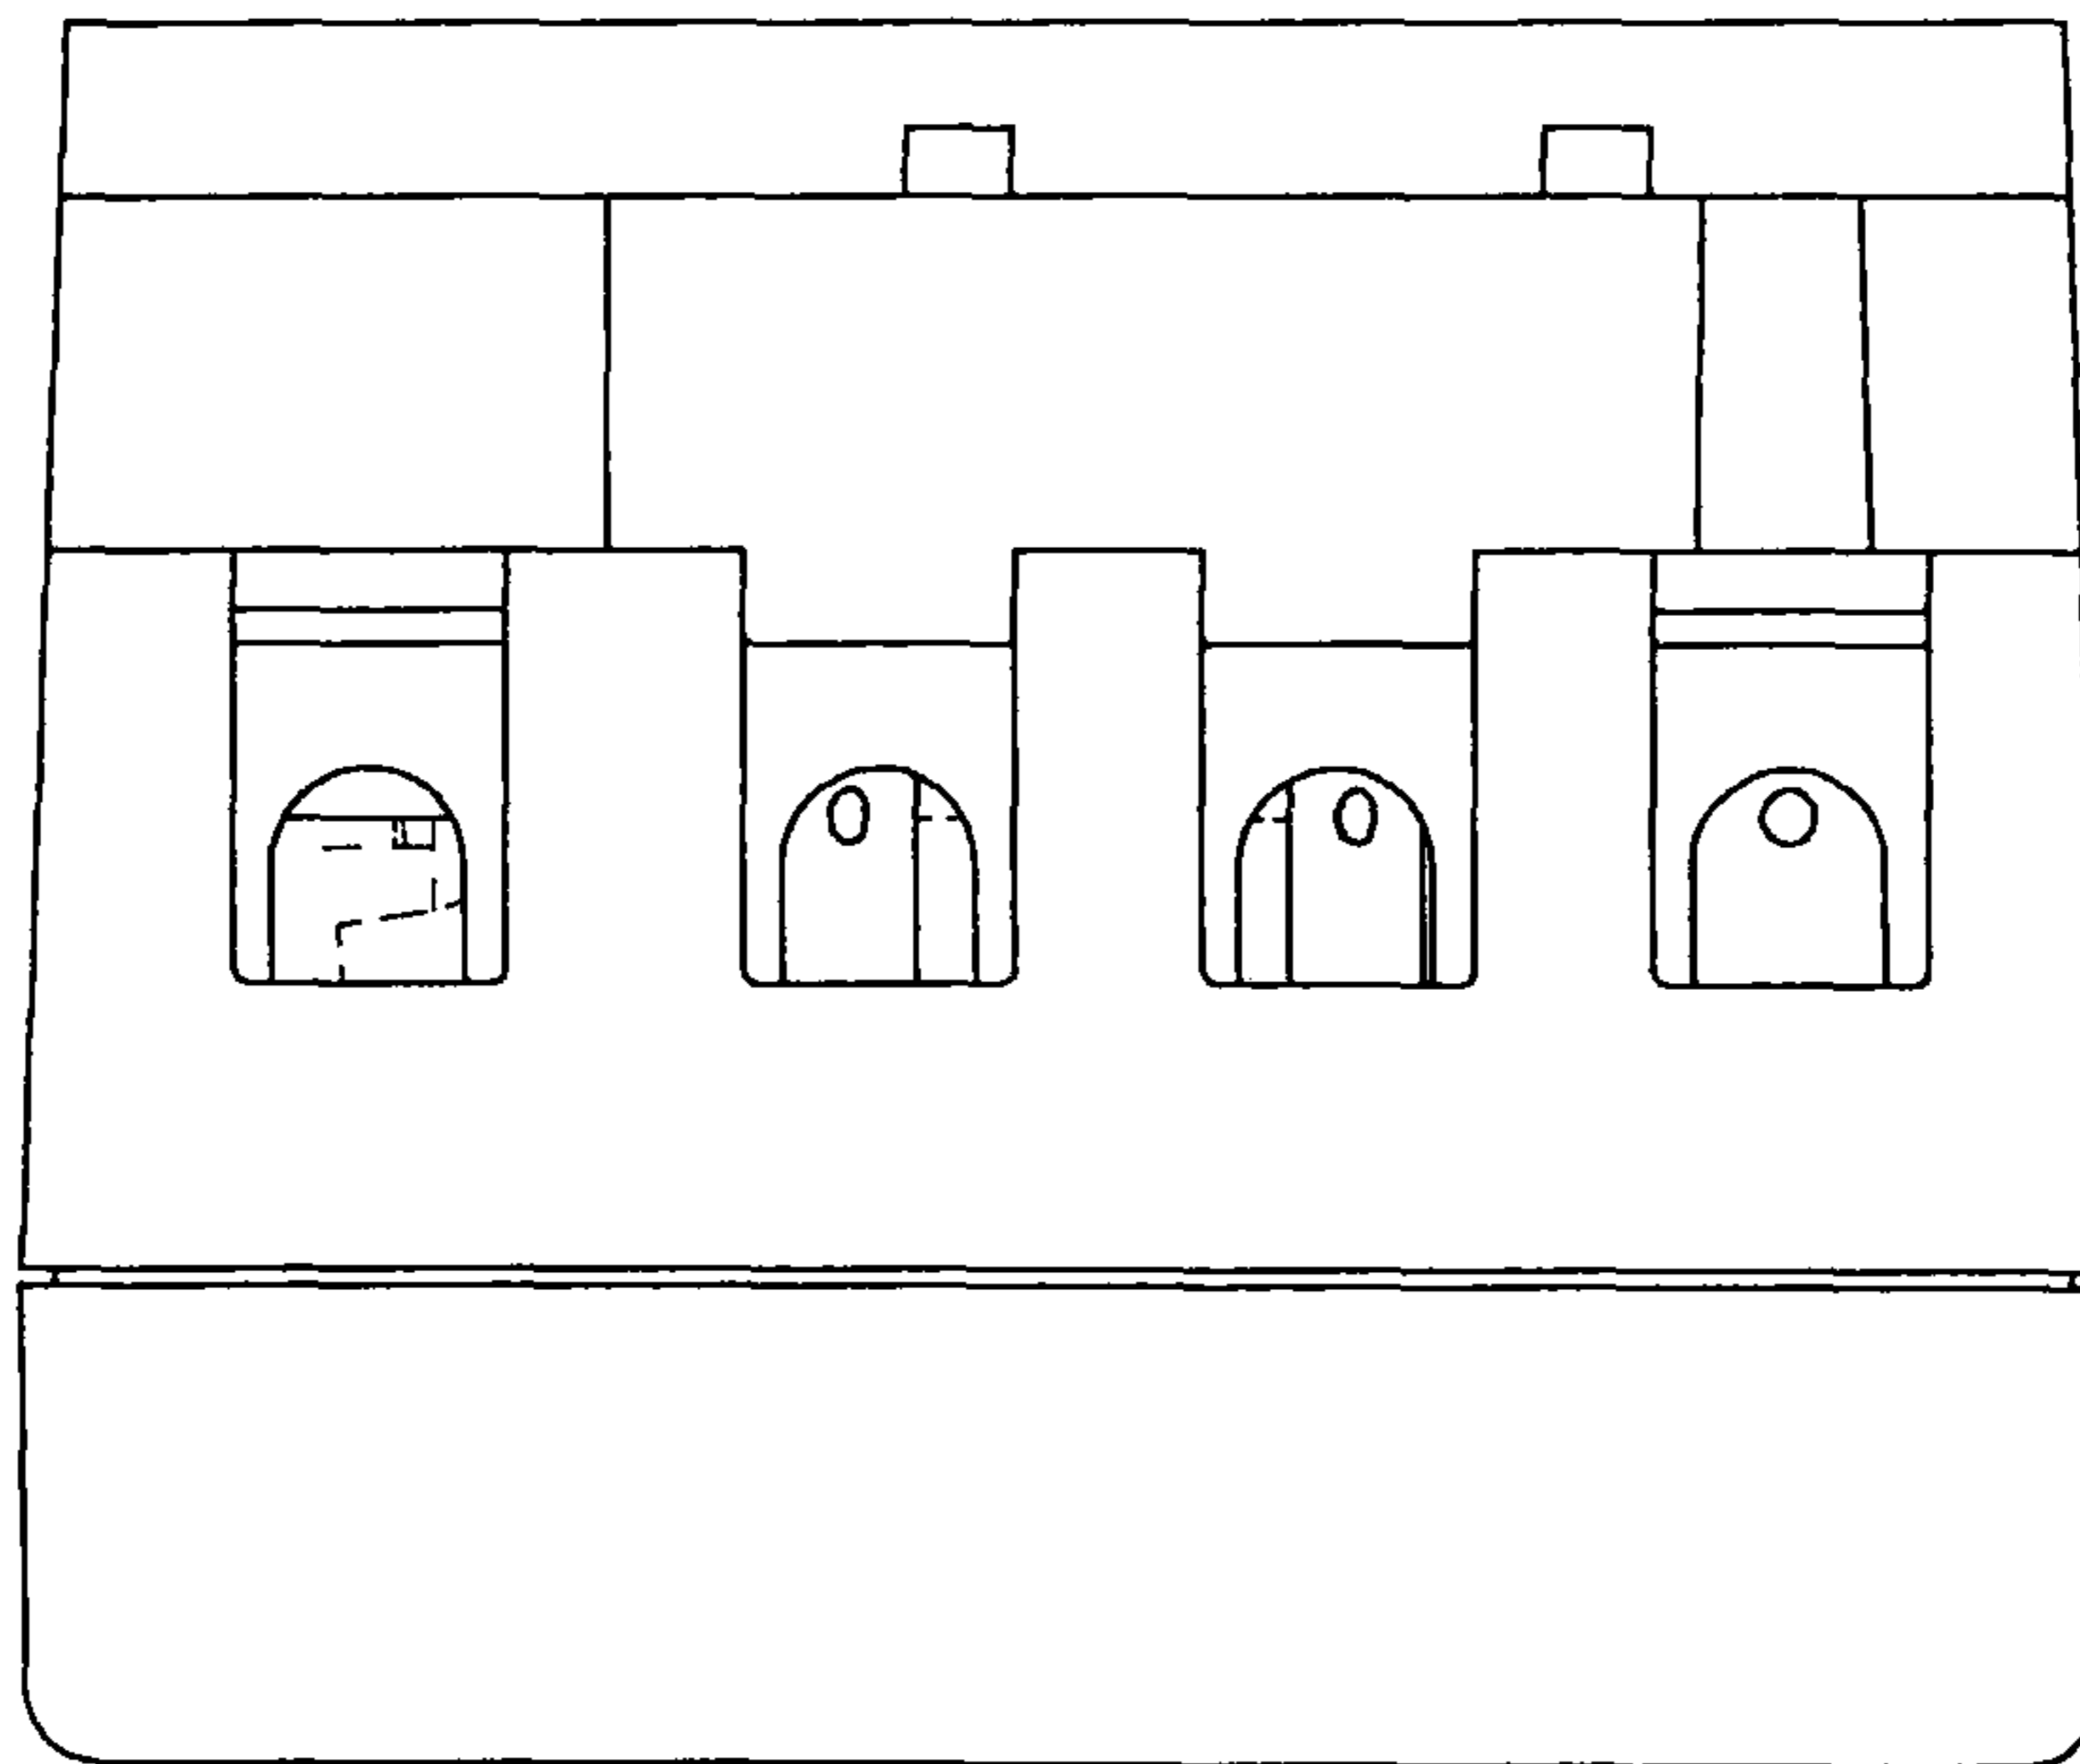


FIG. 3

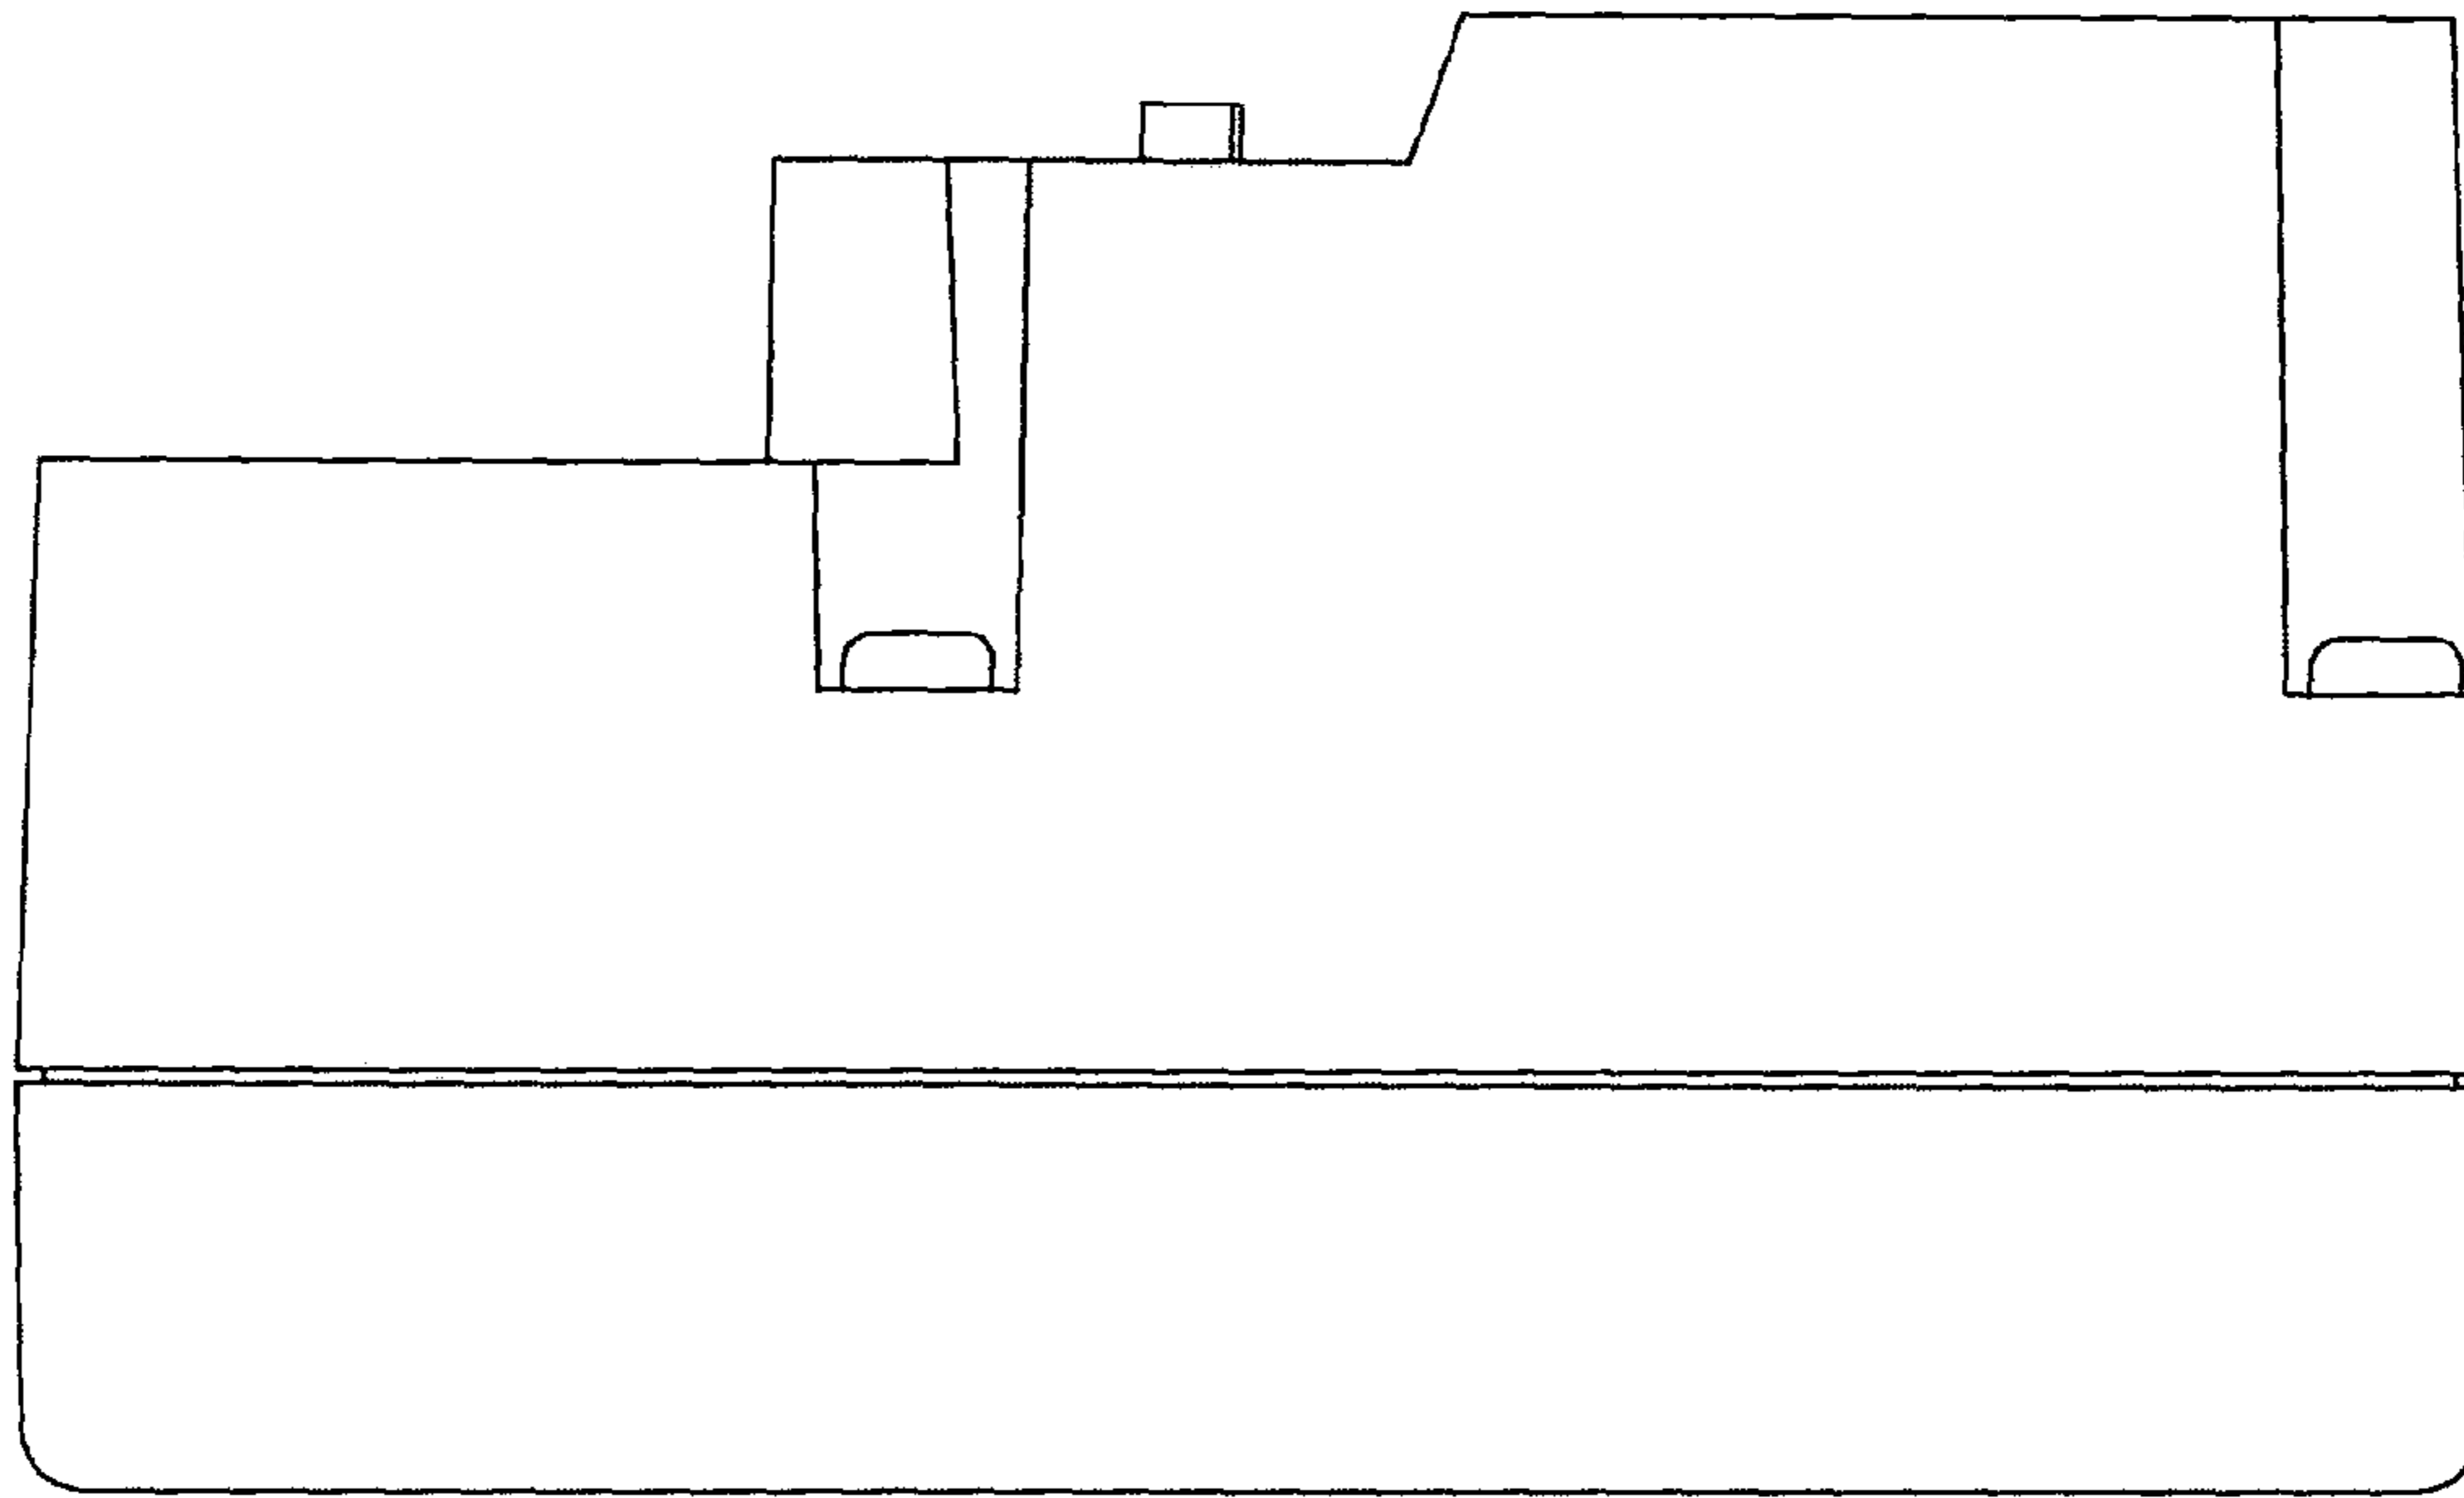


FIG. 4

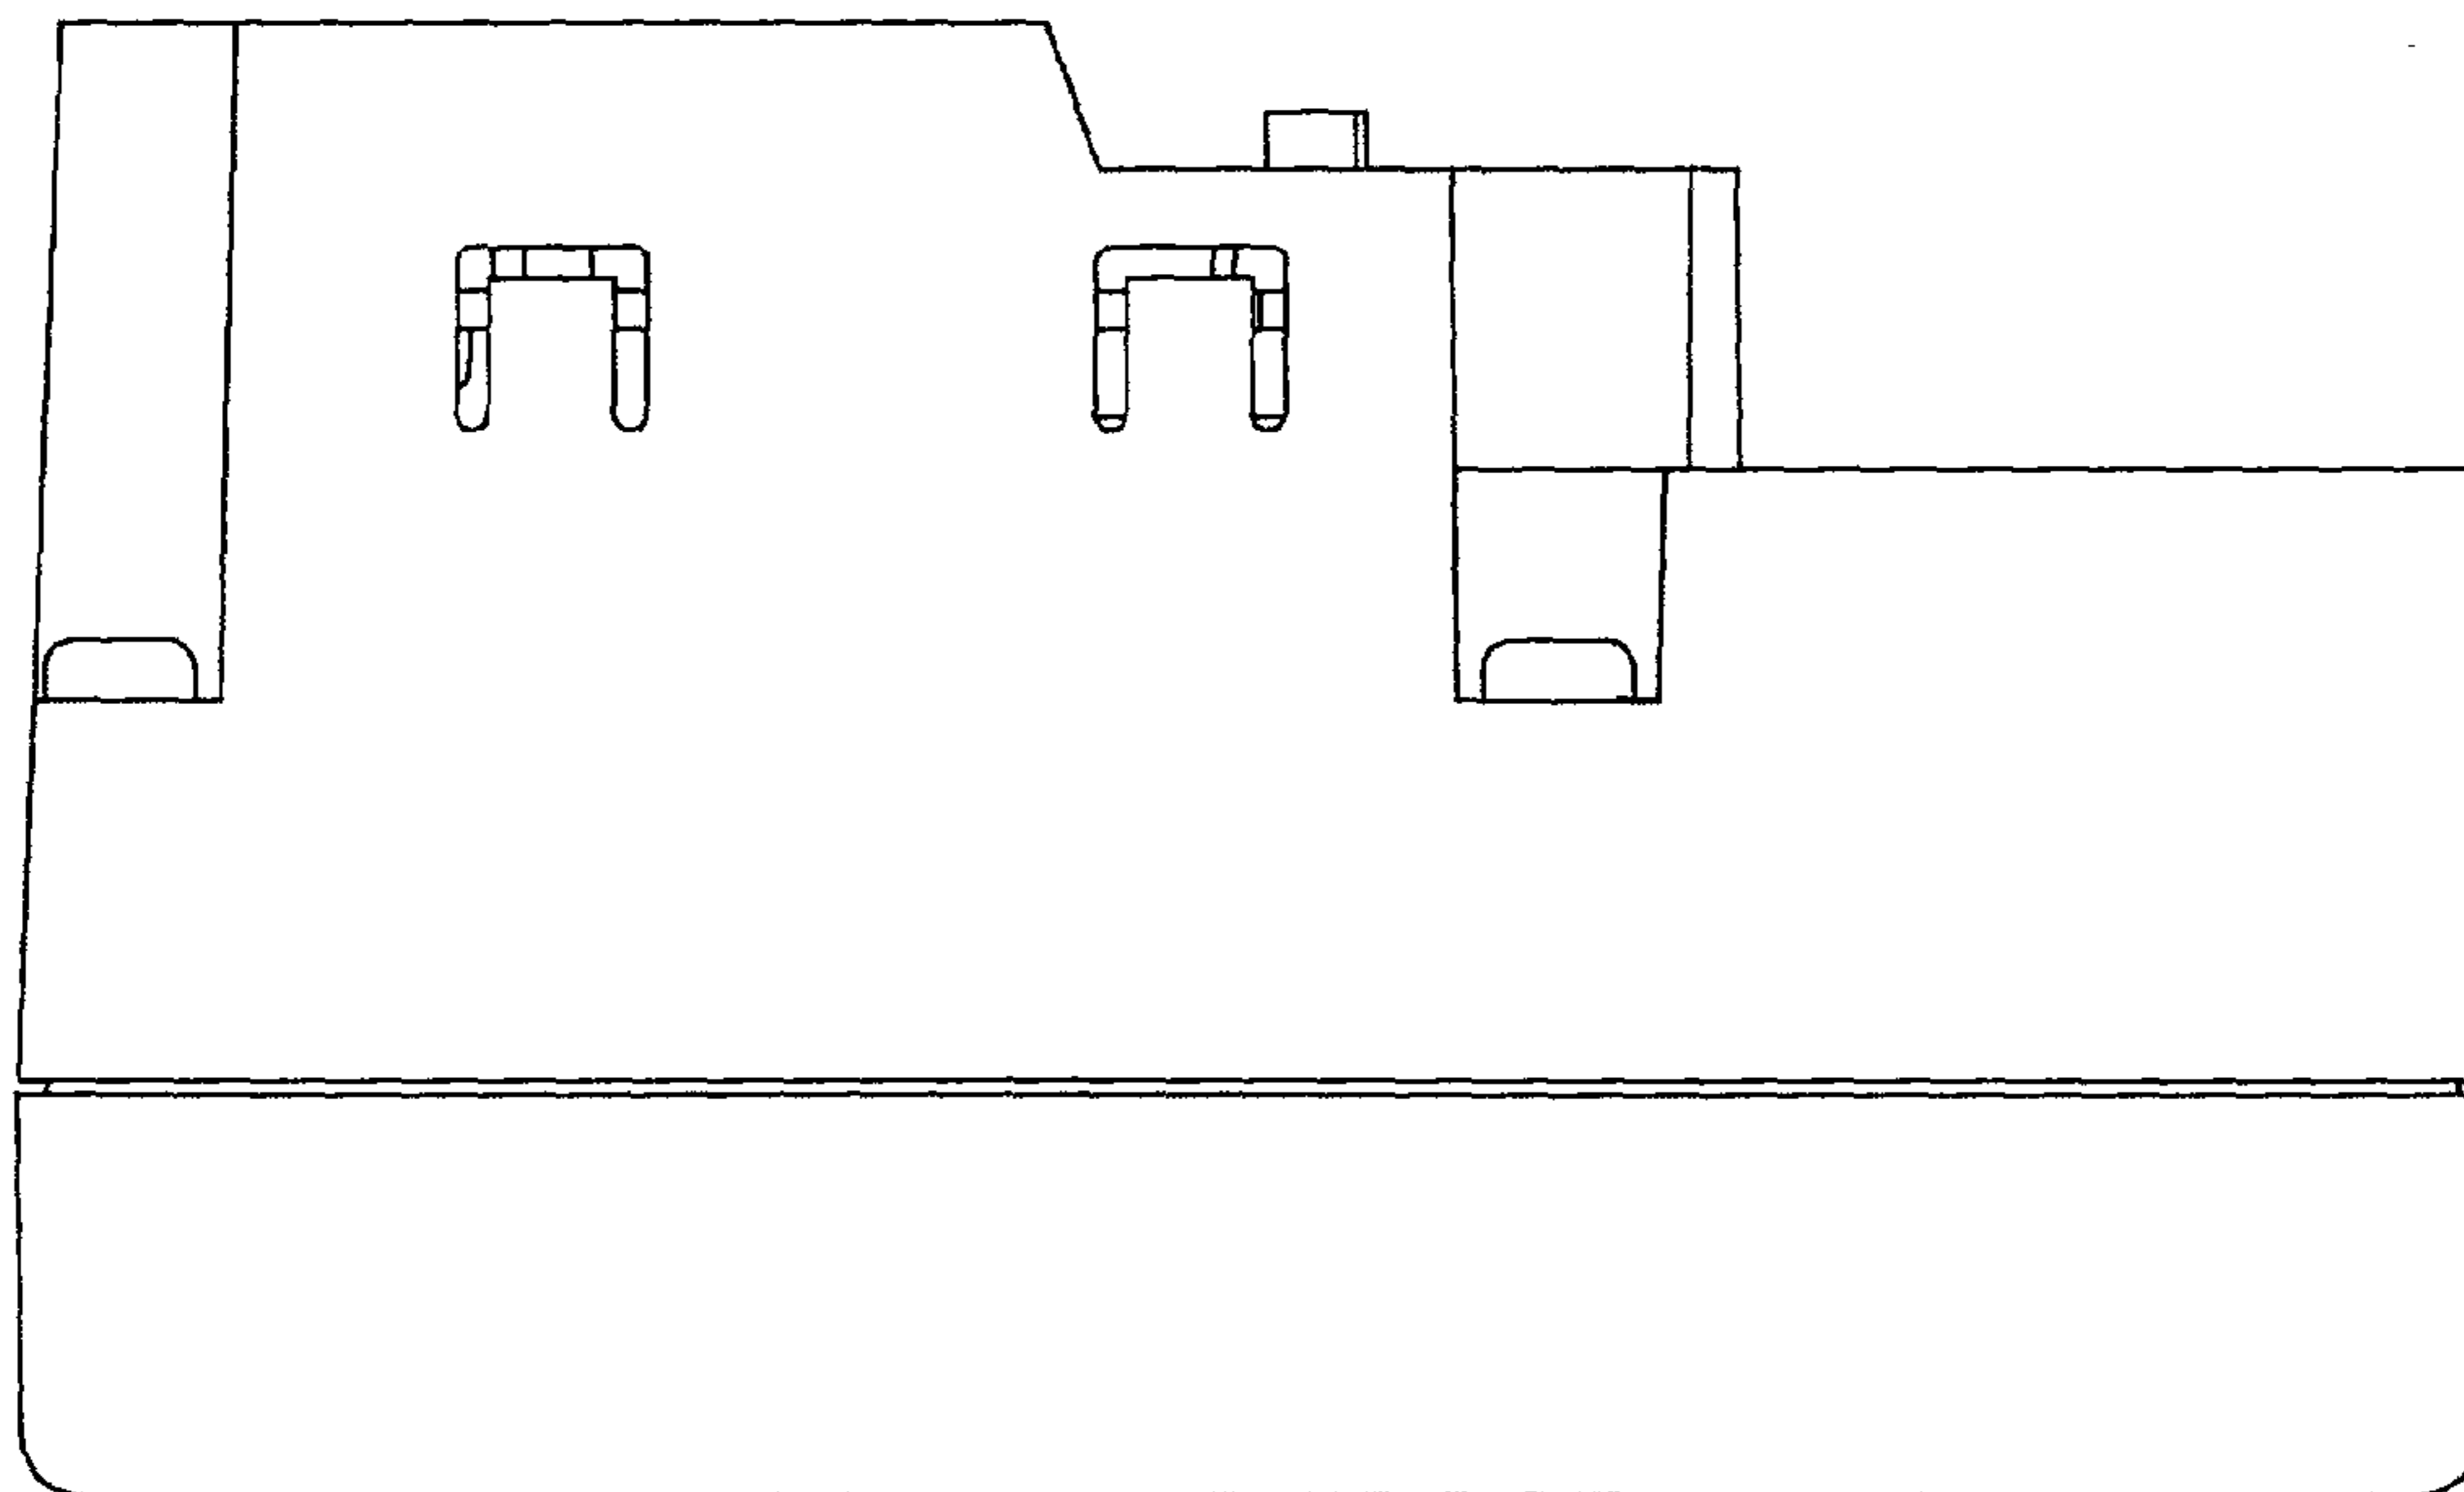


FIG. 5

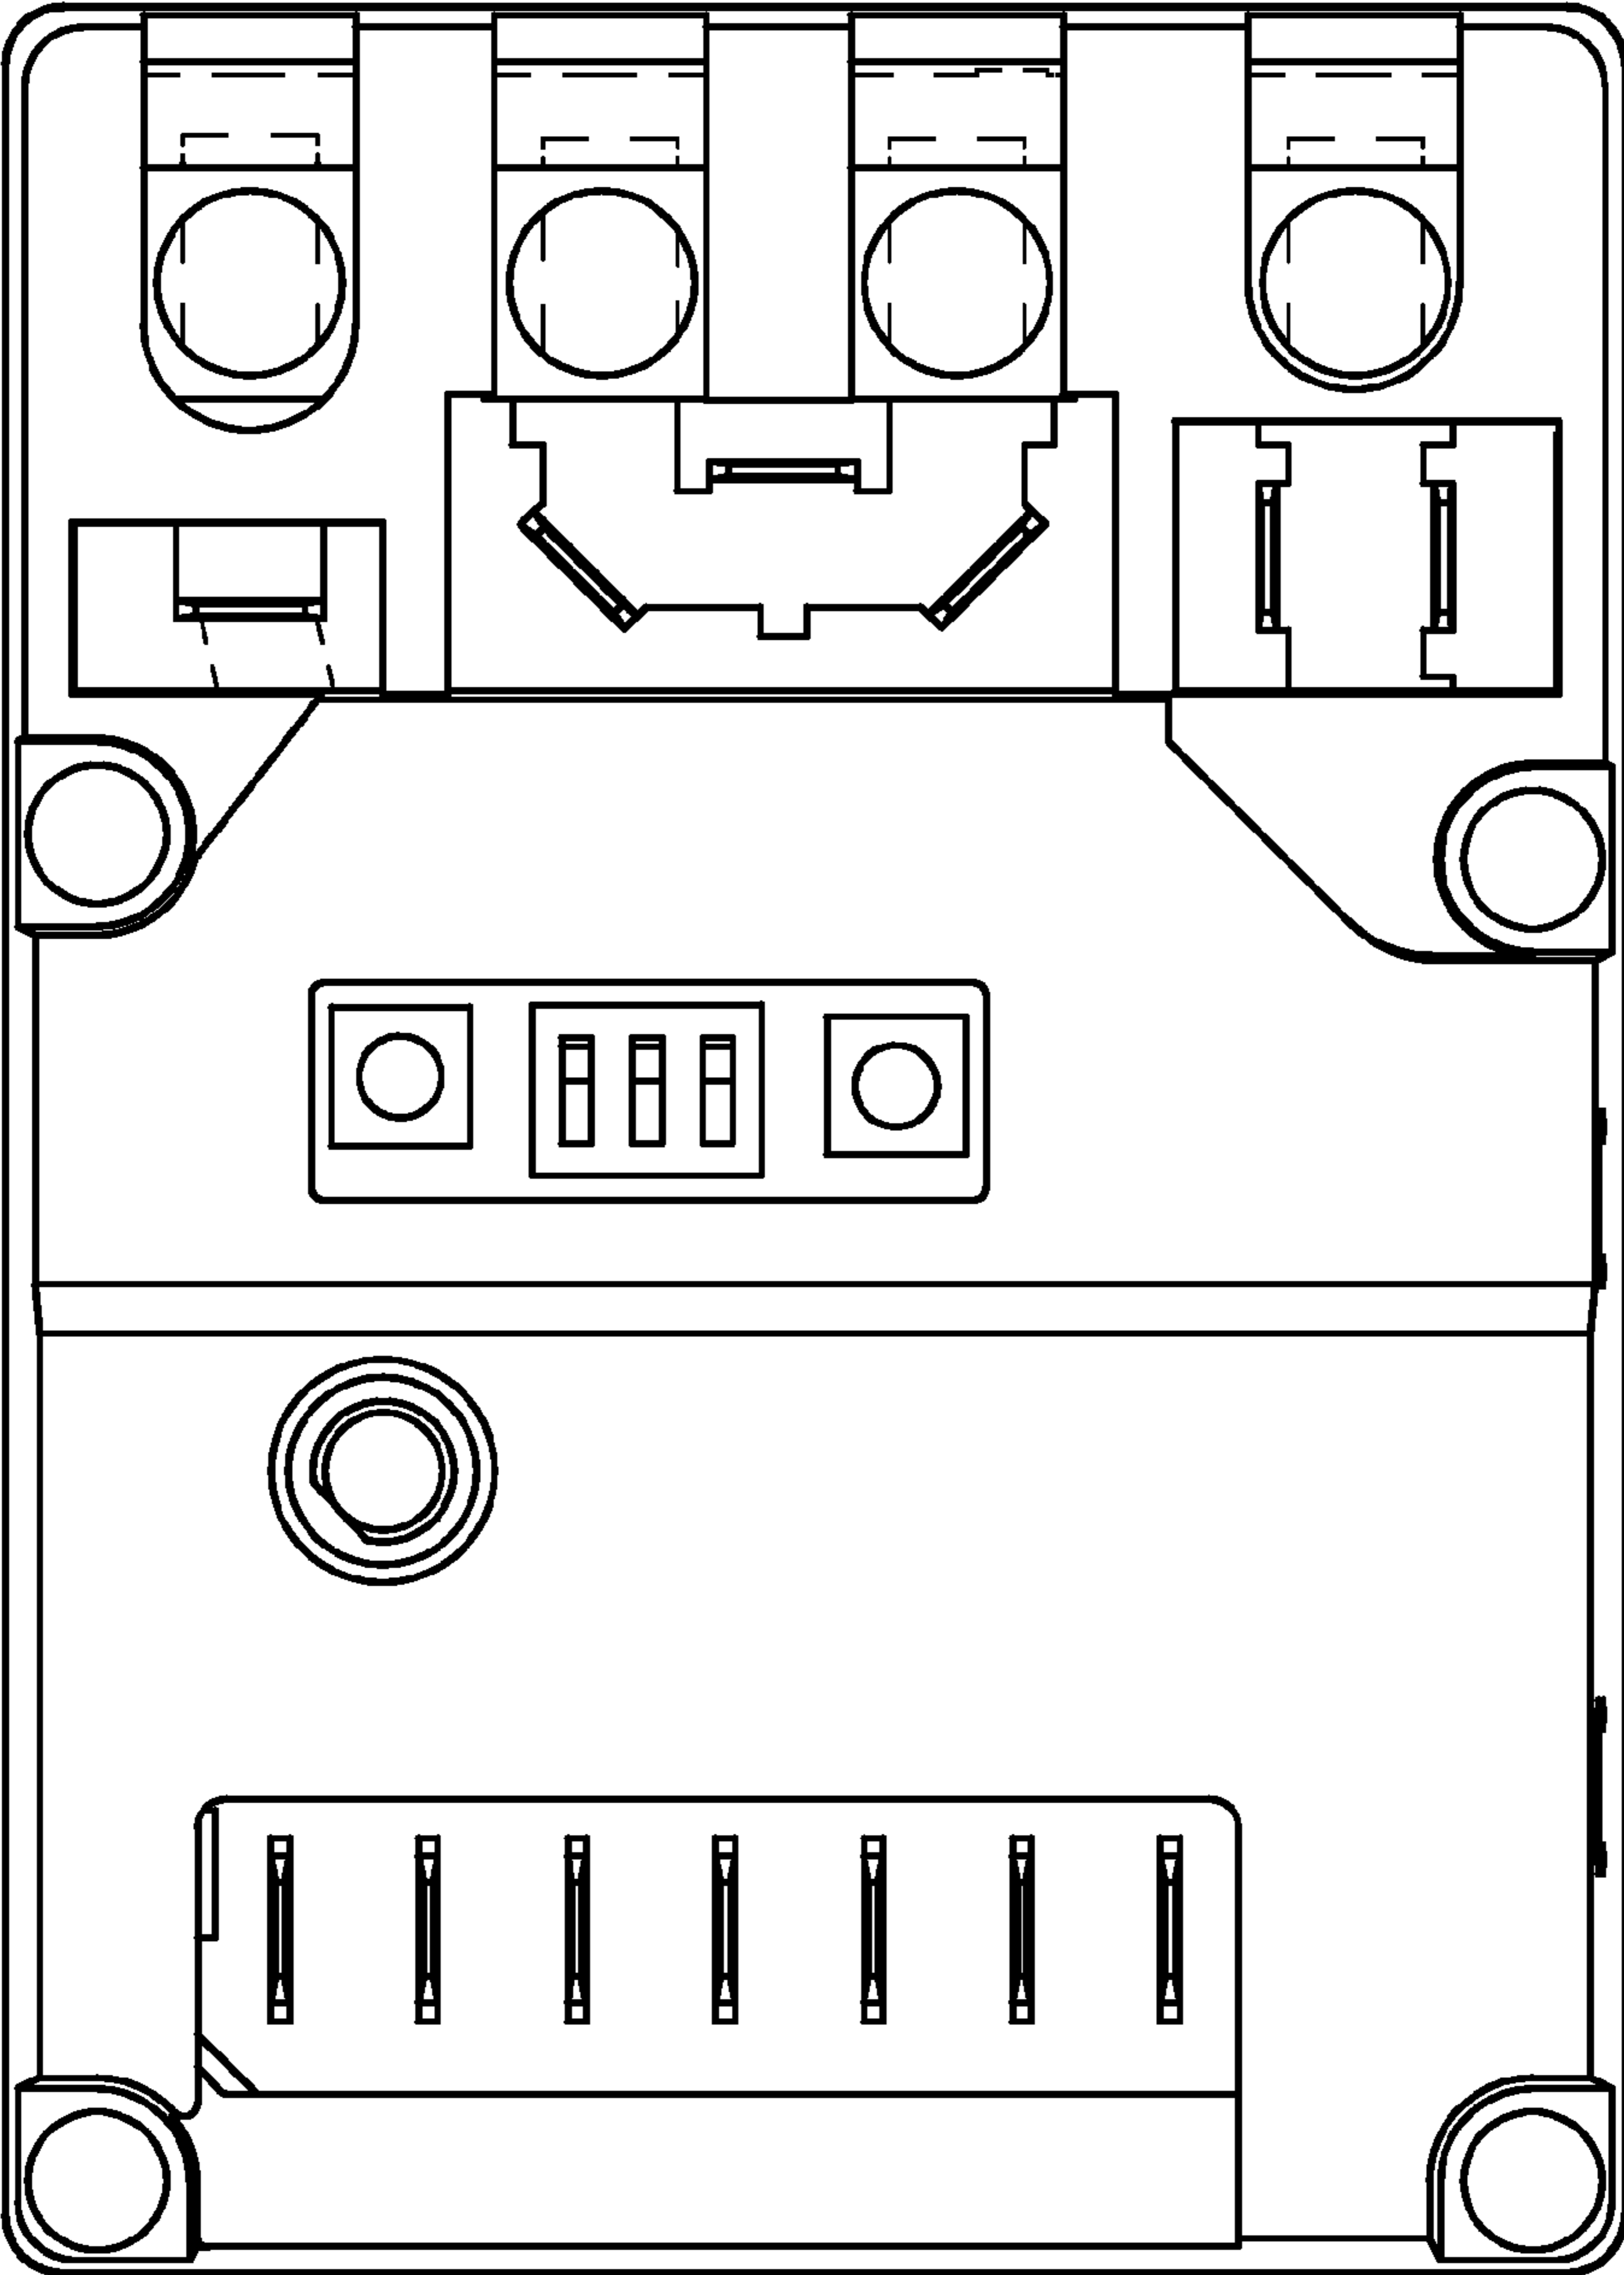


FIG. 6

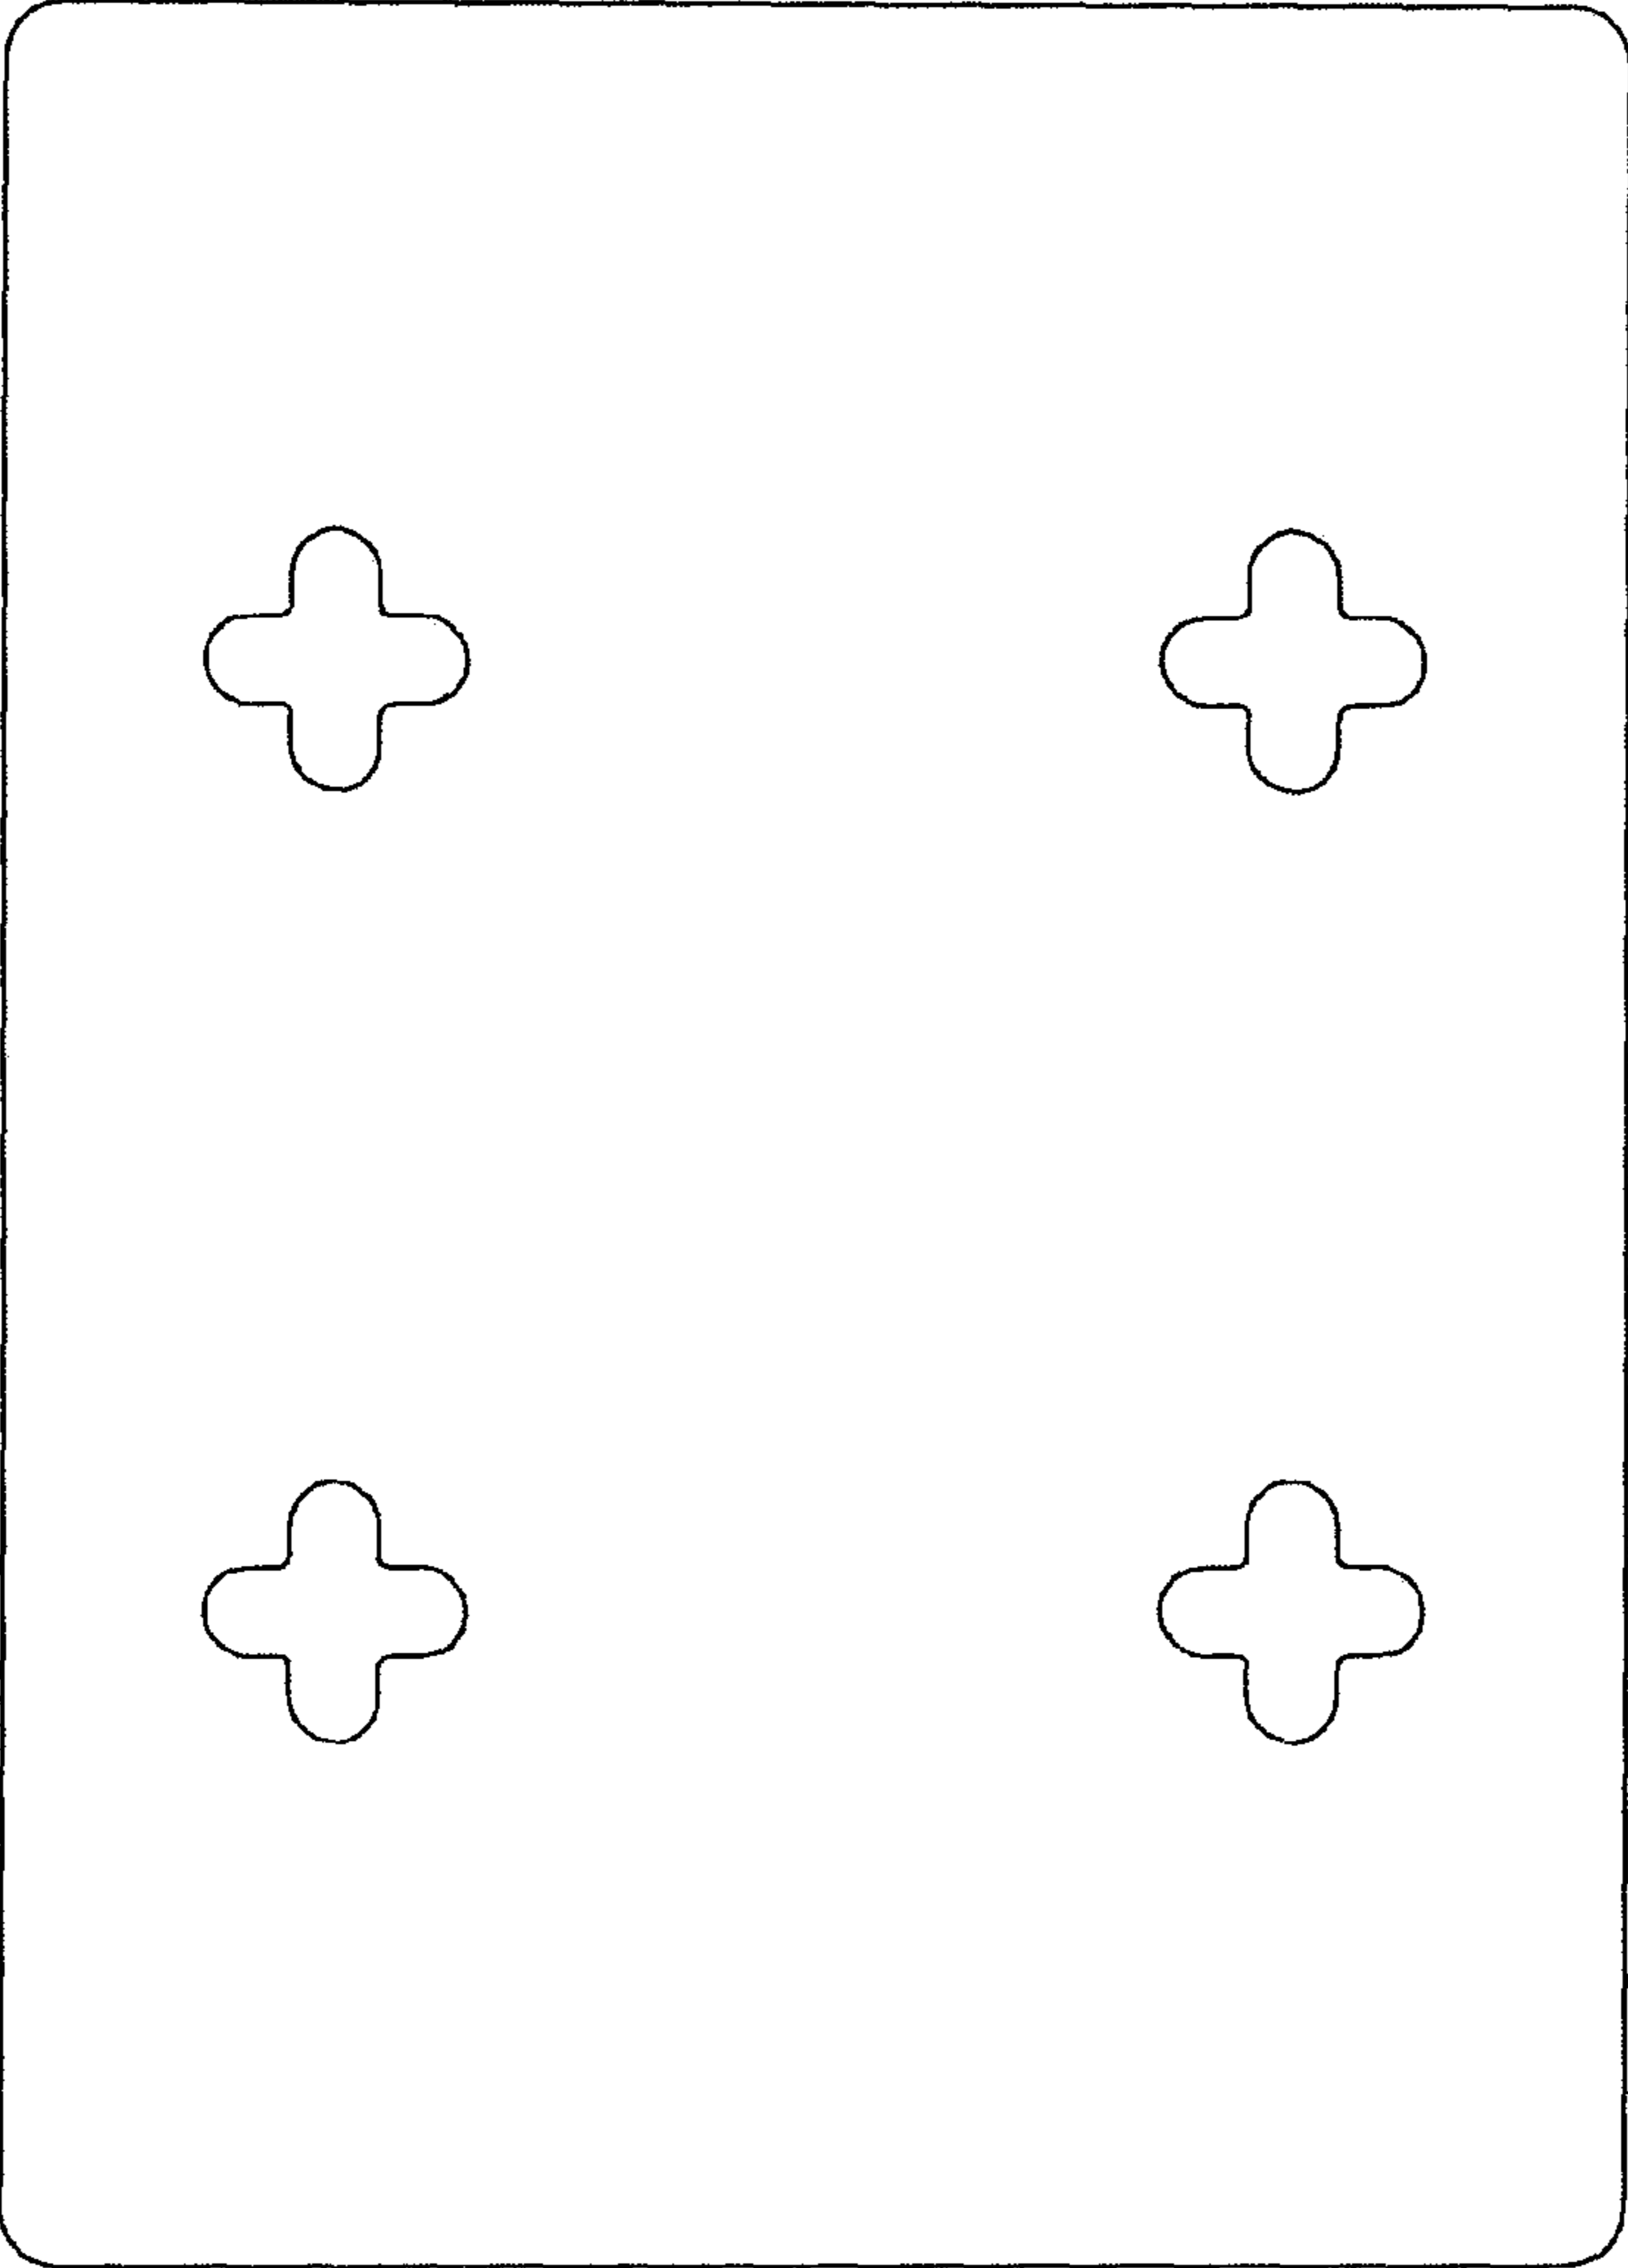


FIG. 7