



(12) **United States Design Patent**
Sedic

(10) **Patent No.: US D961,800 S**
(45) **Date of Patent: ** *Aug. 23, 2022**

- (54) **STIMULATION DEVICE**
- (71) Applicant: **foreo inc.**, Las Vegas, NV (US)
- (72) Inventor: **Filip Sedic**, Stockholm (SE)
- (73) Assignee: **FOREO Inc.**, Las Vegas, NV (US)
- (*) Notice: This patent is subject to a terminal disclaimer.
- (**) Term: **15 Years**
- (21) Appl. No.: **29/805,331**
- (22) Filed: **Aug. 26, 2021**

Related U.S. Application Data

- (63) Continuation of application No. 29/705,120, filed on Sep. 10, 2019, now Pat. No. Des. 932,041.
- (51) **LOC (13) Cl.** **28-03**
- (52) **U.S. Cl.**
USPC **D24/215**
- (58) **Field of Classification Search**
USPC D24/200, 211, 212, 213, 214, 215;
D28/7, 78; D10/1
CPC ... A61H 2015/0042; A61H 7/007; A61H 9/00
See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

D581,543	S	*	11/2008	Ferber		D24/215
D665,915	S	*	8/2012	Ma		D24/215
D737,990	S	*	9/2015	Lee		D24/215
D845,631	S	*	4/2019	Sedic		D4/100
D850,111	S	*	6/2019	Sedic		D4/100
D870,909	S	*	12/2019	Sedic		D24/215

D882,268	S	*	4/2020	Sedic		D4/100
D882,807	S	*	4/2020	Xiong		D24/214
D886,642	S	*	6/2020	Zhou		D10/22
D893,199	S	*	8/2020	Sedic		D4/137
D895,821	S	*	9/2020	Lin		D24/200
D932,040	S	*	9/2021	Sedic		D24/215
D932,041	S	*	9/2021	Sedic		D24/215
D932,043	S	*	9/2021	Sedic		D24/215

OTHER PUBLICATIONS

Amazon, "Foreo Bear Mini" Earliest review date Oct. 25, 2020. https://www.amazon.com/FOREO-App-connected-Microcurrent-Intensities-Lavender/dp/B08G9B22QS/ref=cm_cr_arp_d_product_top?ie=UTF8. Shown on p. 1. (Year: 2020).*

Foreo, "BEAR Mini", Access date May 11, 2022. <https://www.foreo.com/bear-collection>. (Year: 2022).*

* cited by examiner

Primary Examiner — Michael A Maharajh
(74) *Attorney, Agent, or Firm* — Evan Feldstein

(57) **CLAIM**

I claim the ornamental design for a stimulation device, as shown and described.

DESCRIPTION

FIG. 1 is a front view of a stimulation device.
FIG. 2 is a right side view of the stimulation device.
FIG. 3 is a left side view of the stimulation device.
FIG. 4 is a rear view of the stimulation device.
FIG. 5 is a bottom view of the stimulation device.
FIG. 6 is a top view of the stimulation device; and,
FIG. 7 is a perspective view of the stimulation device.
The broken lines shown in the drawings are for the purpose of illustrating portions of the stimulation device, which form no part of the claimed design.

1 Claim, 7 Drawing Sheets

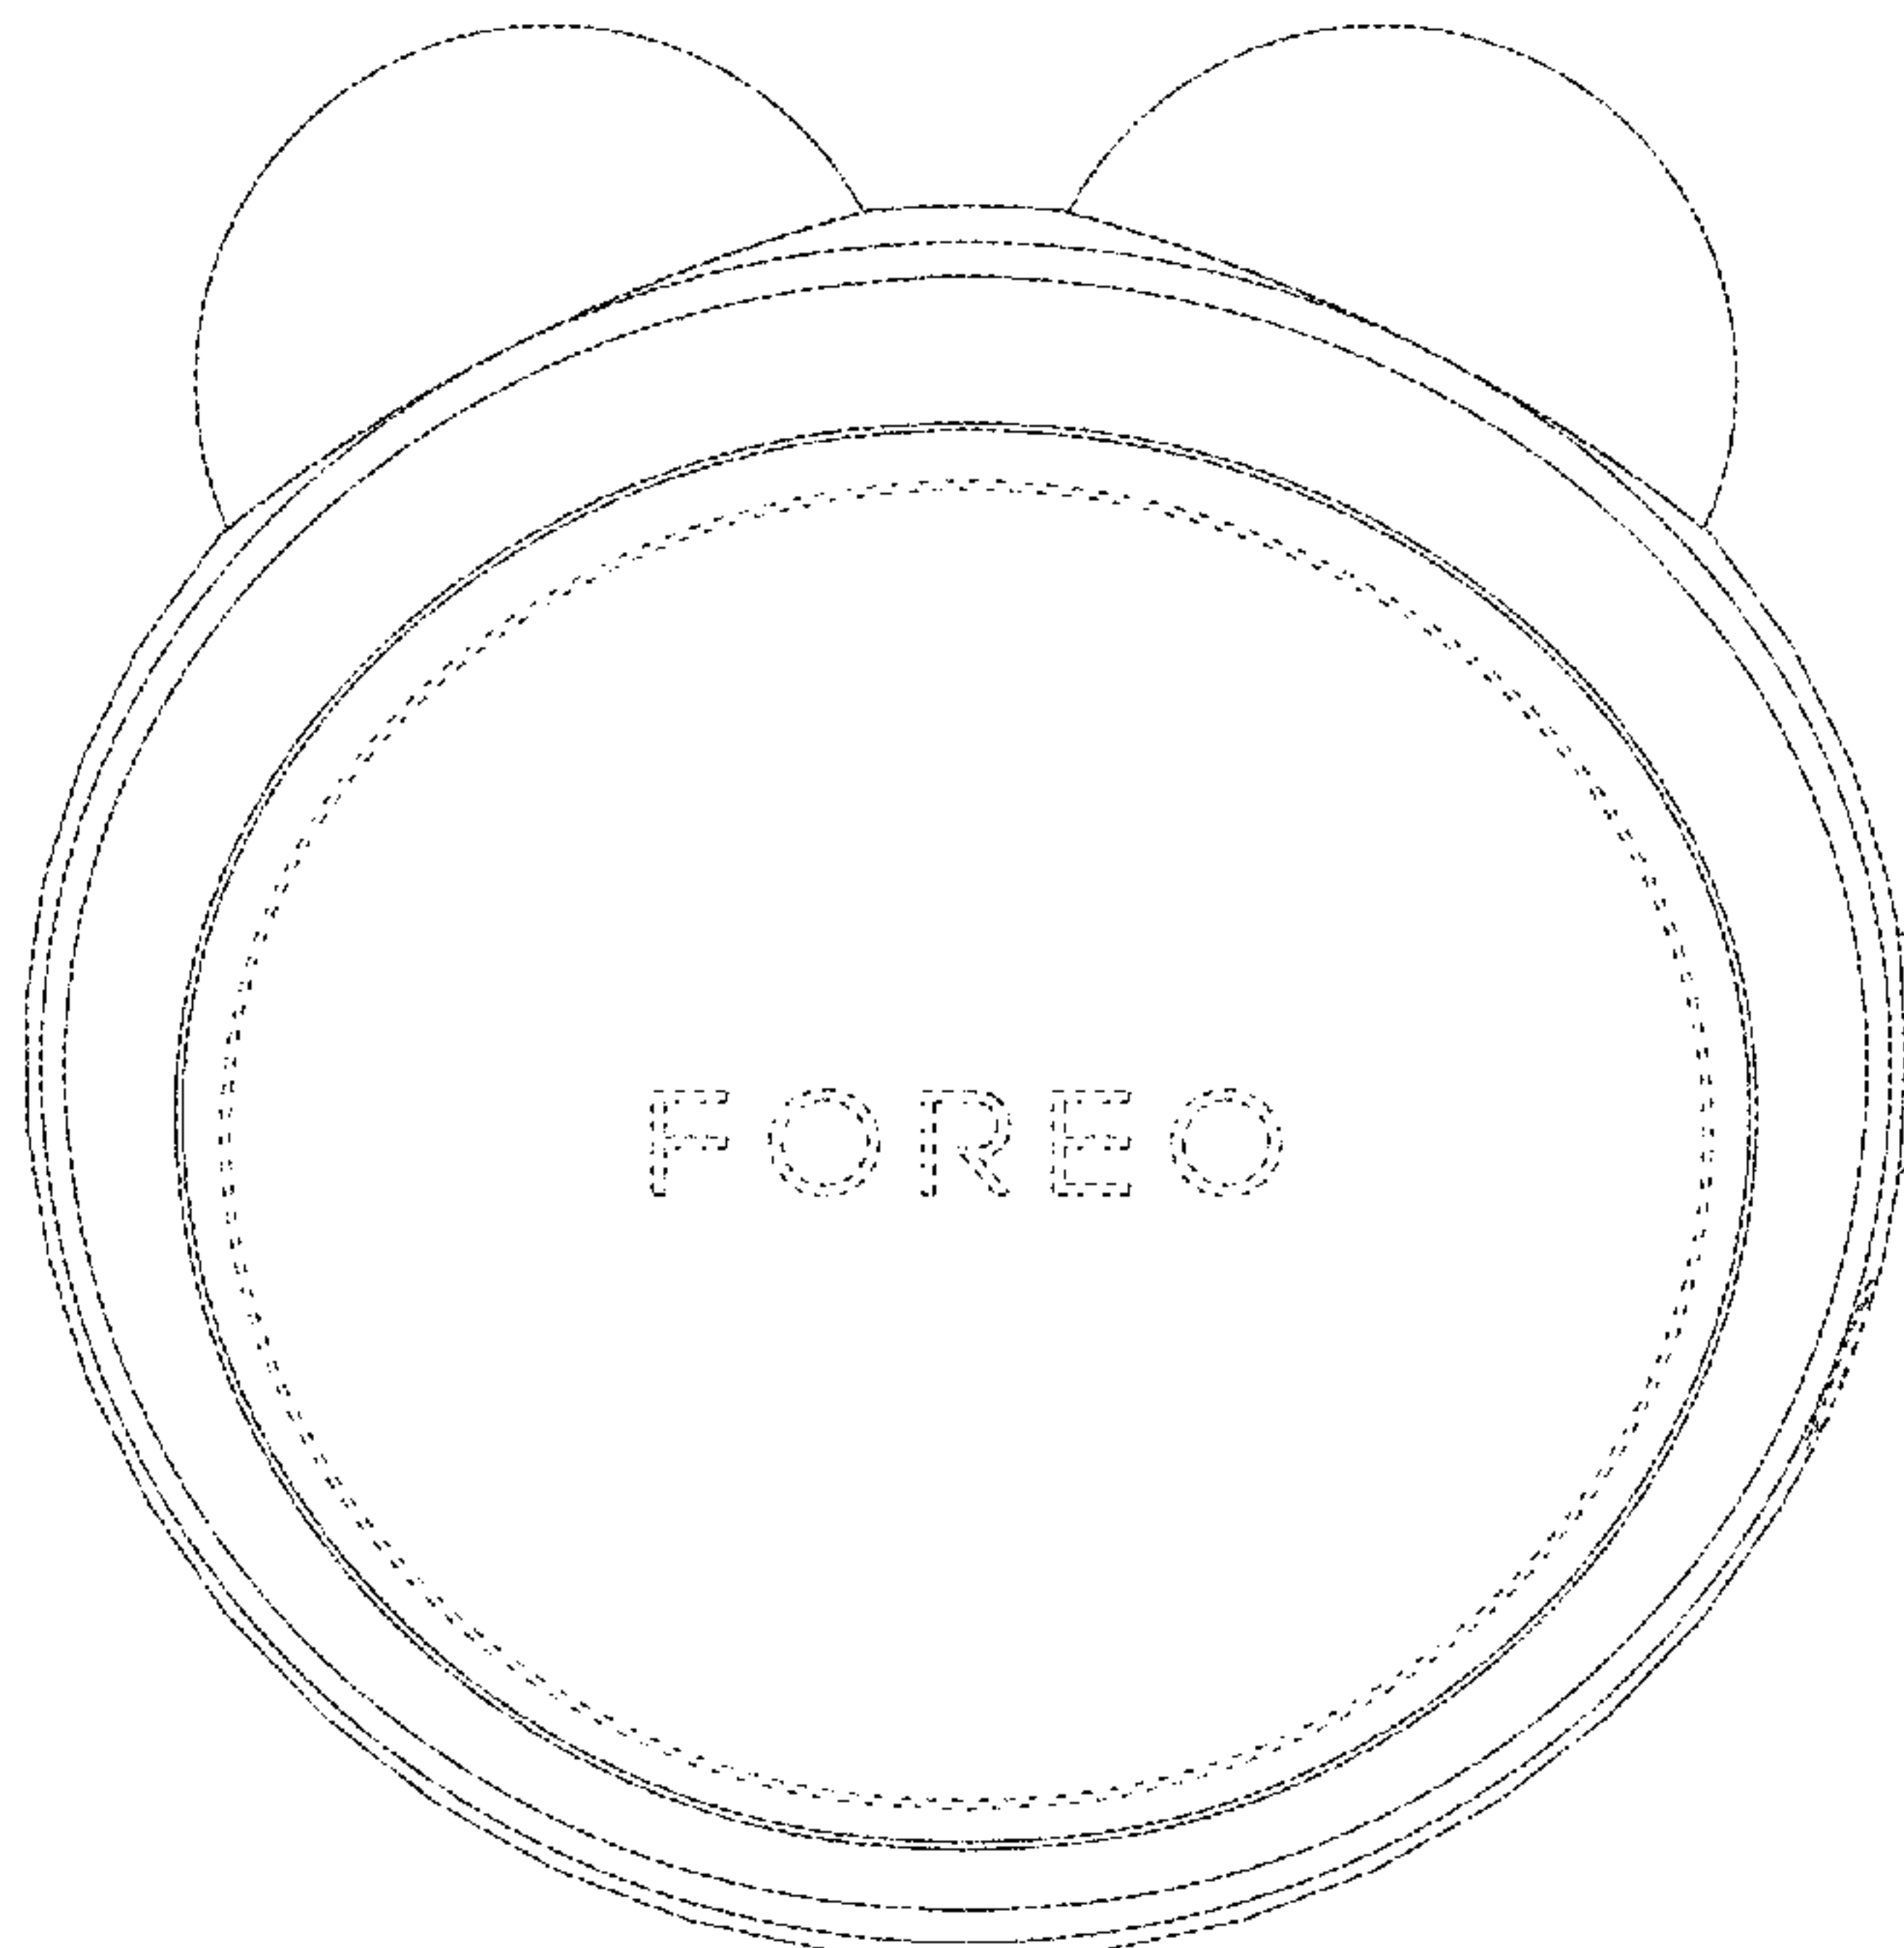




FIG. 1

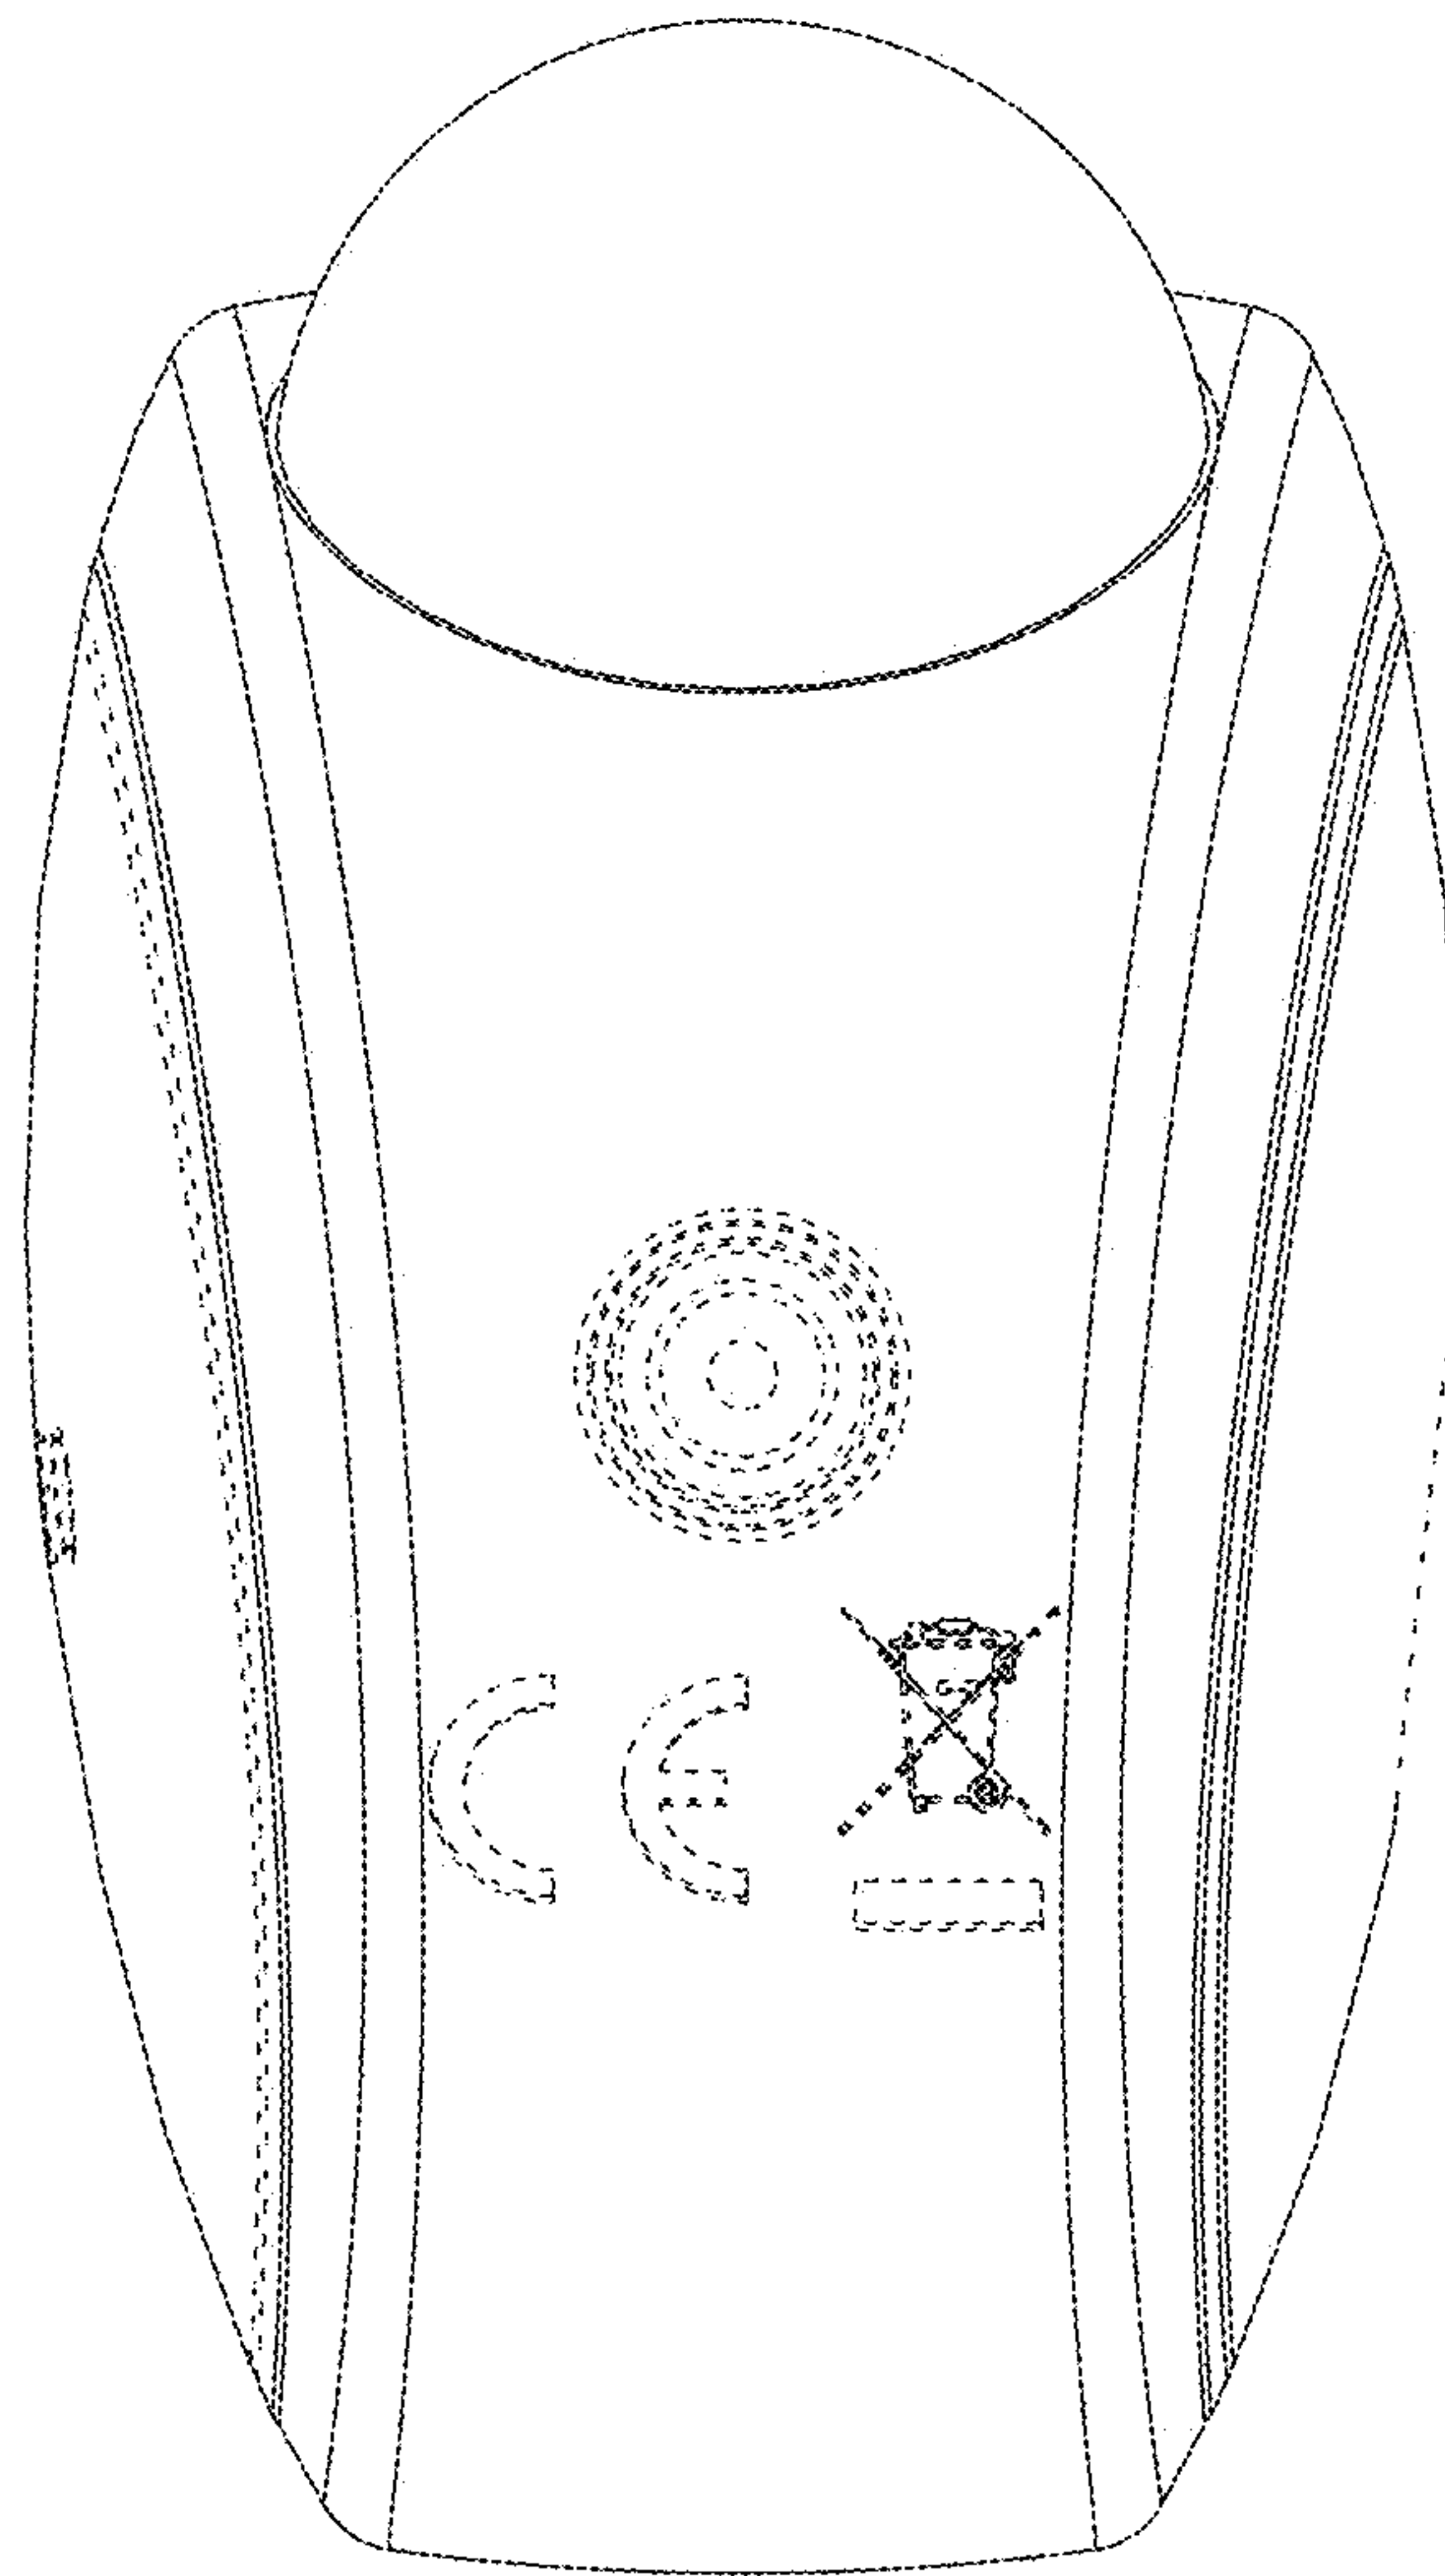


FIG. 2

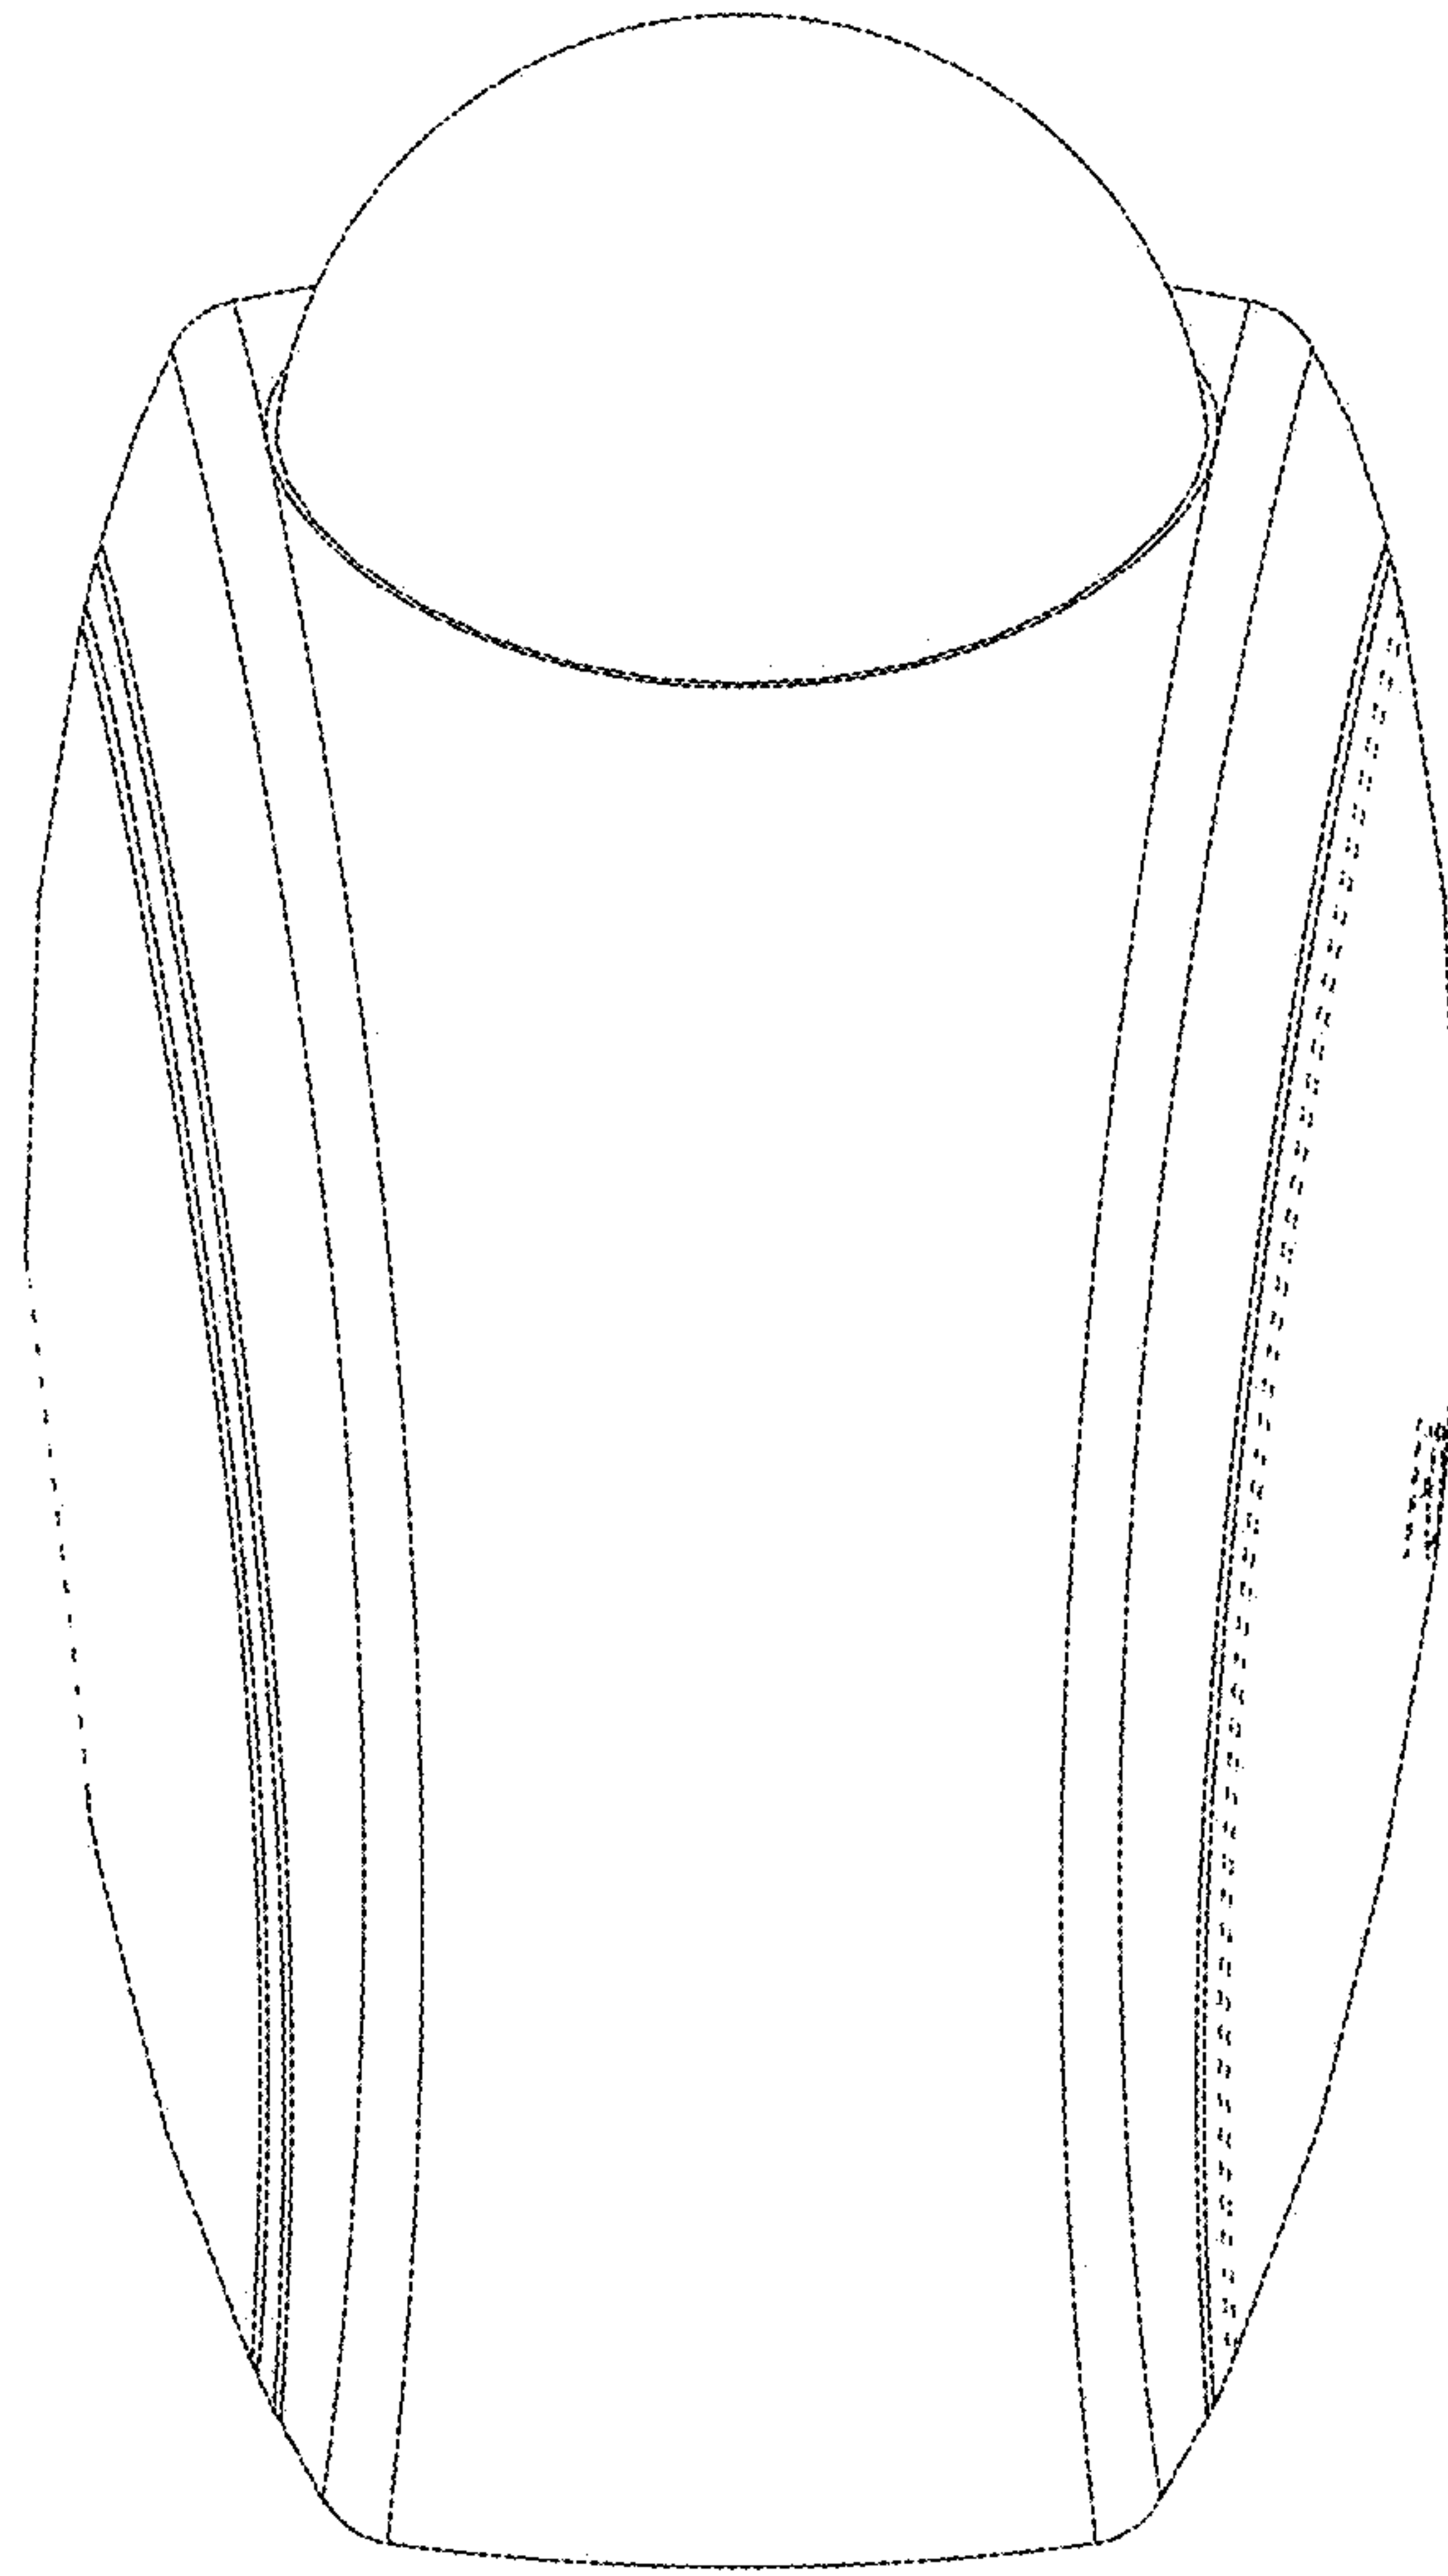


FIG. 3

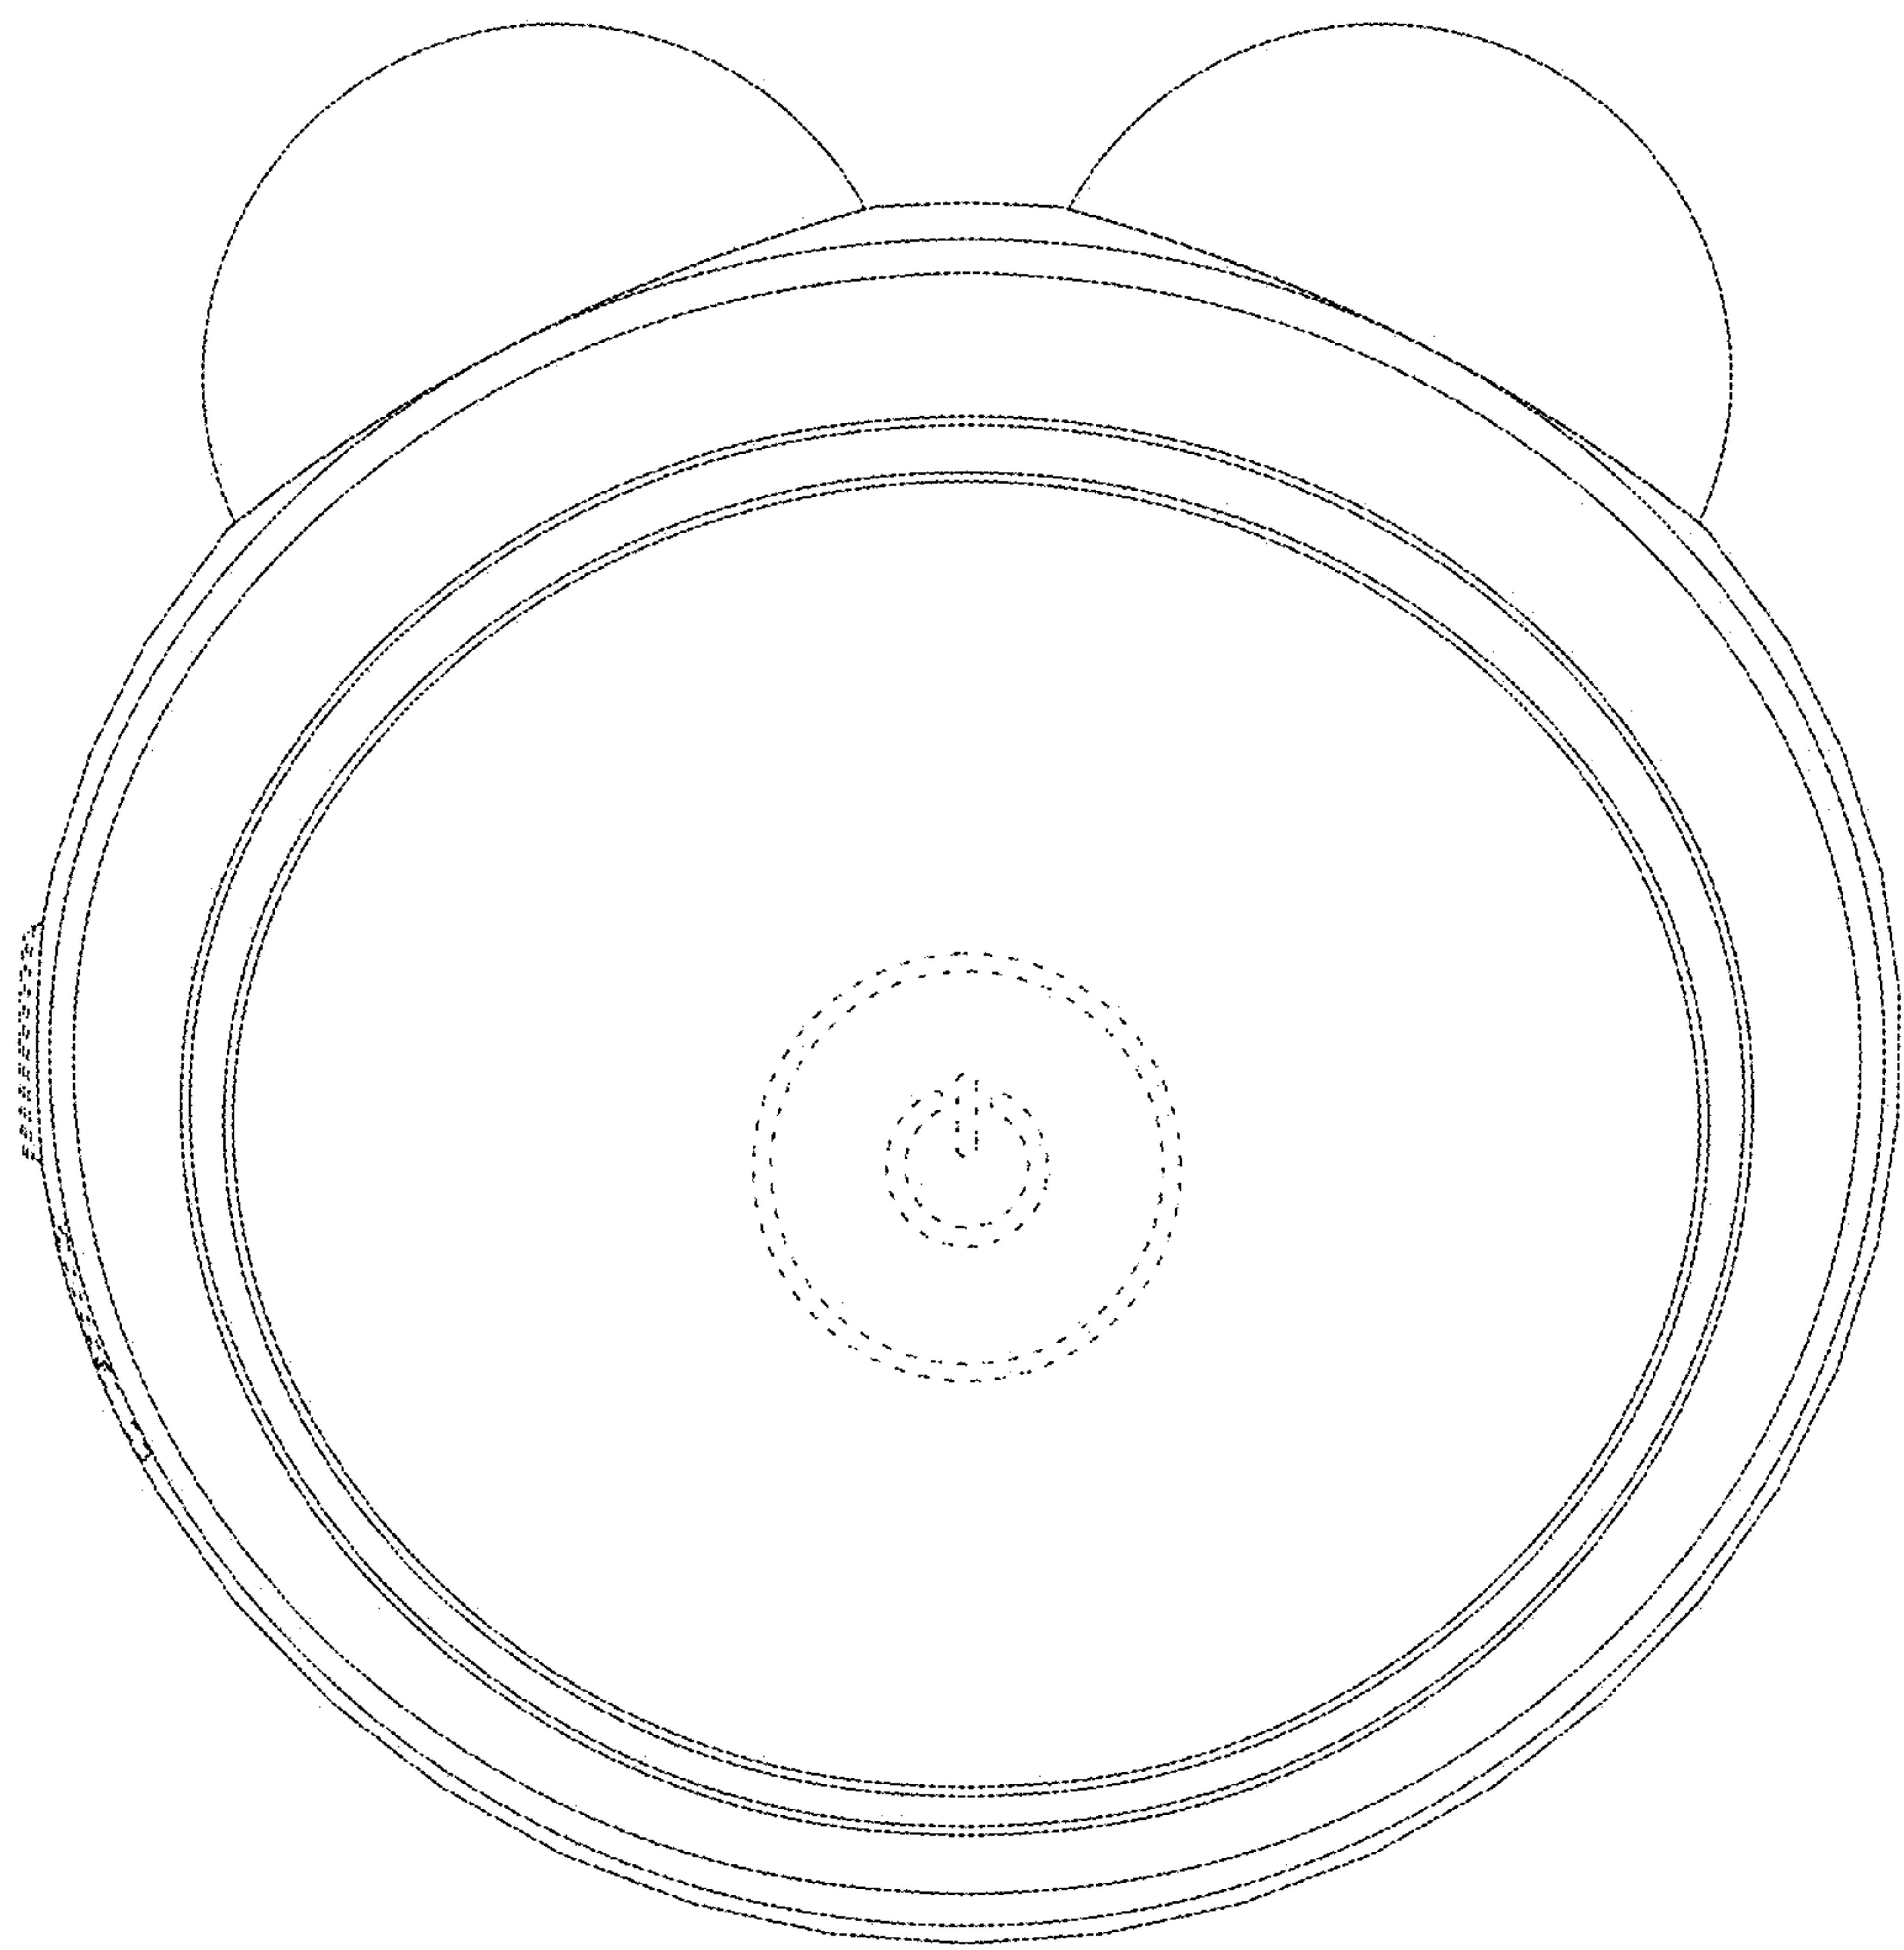


FIG. 4

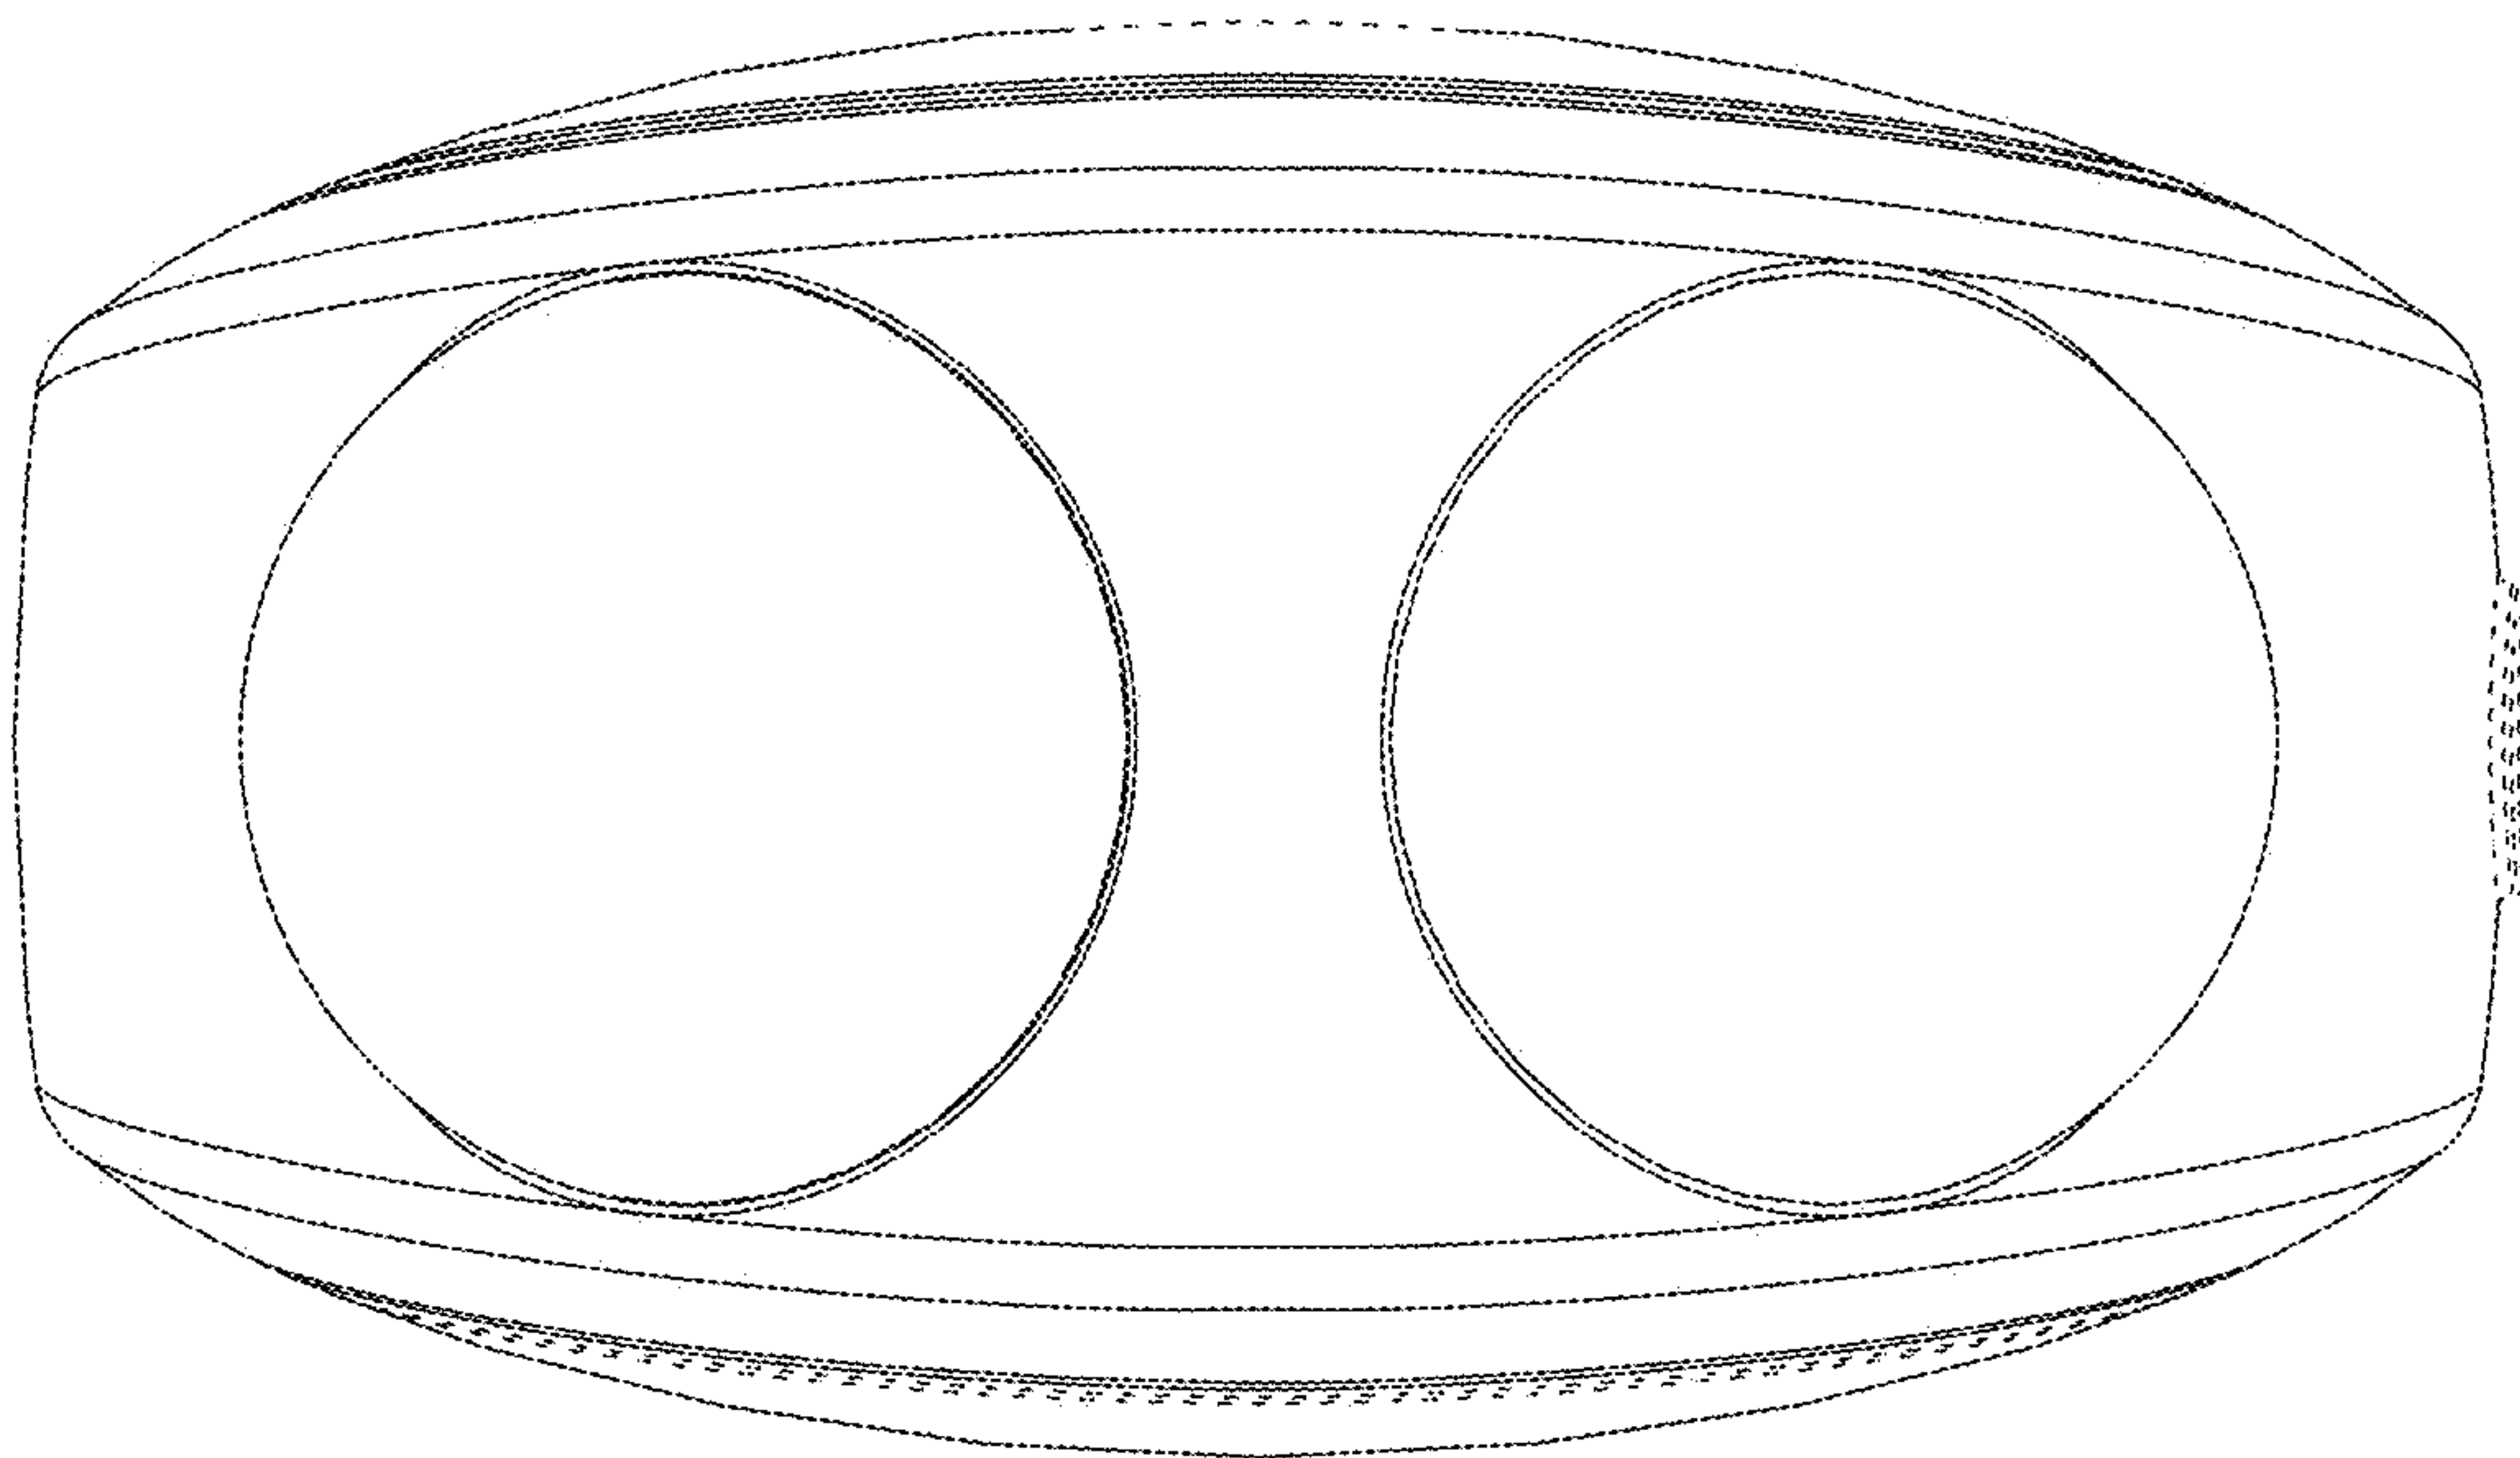


FIG. 5

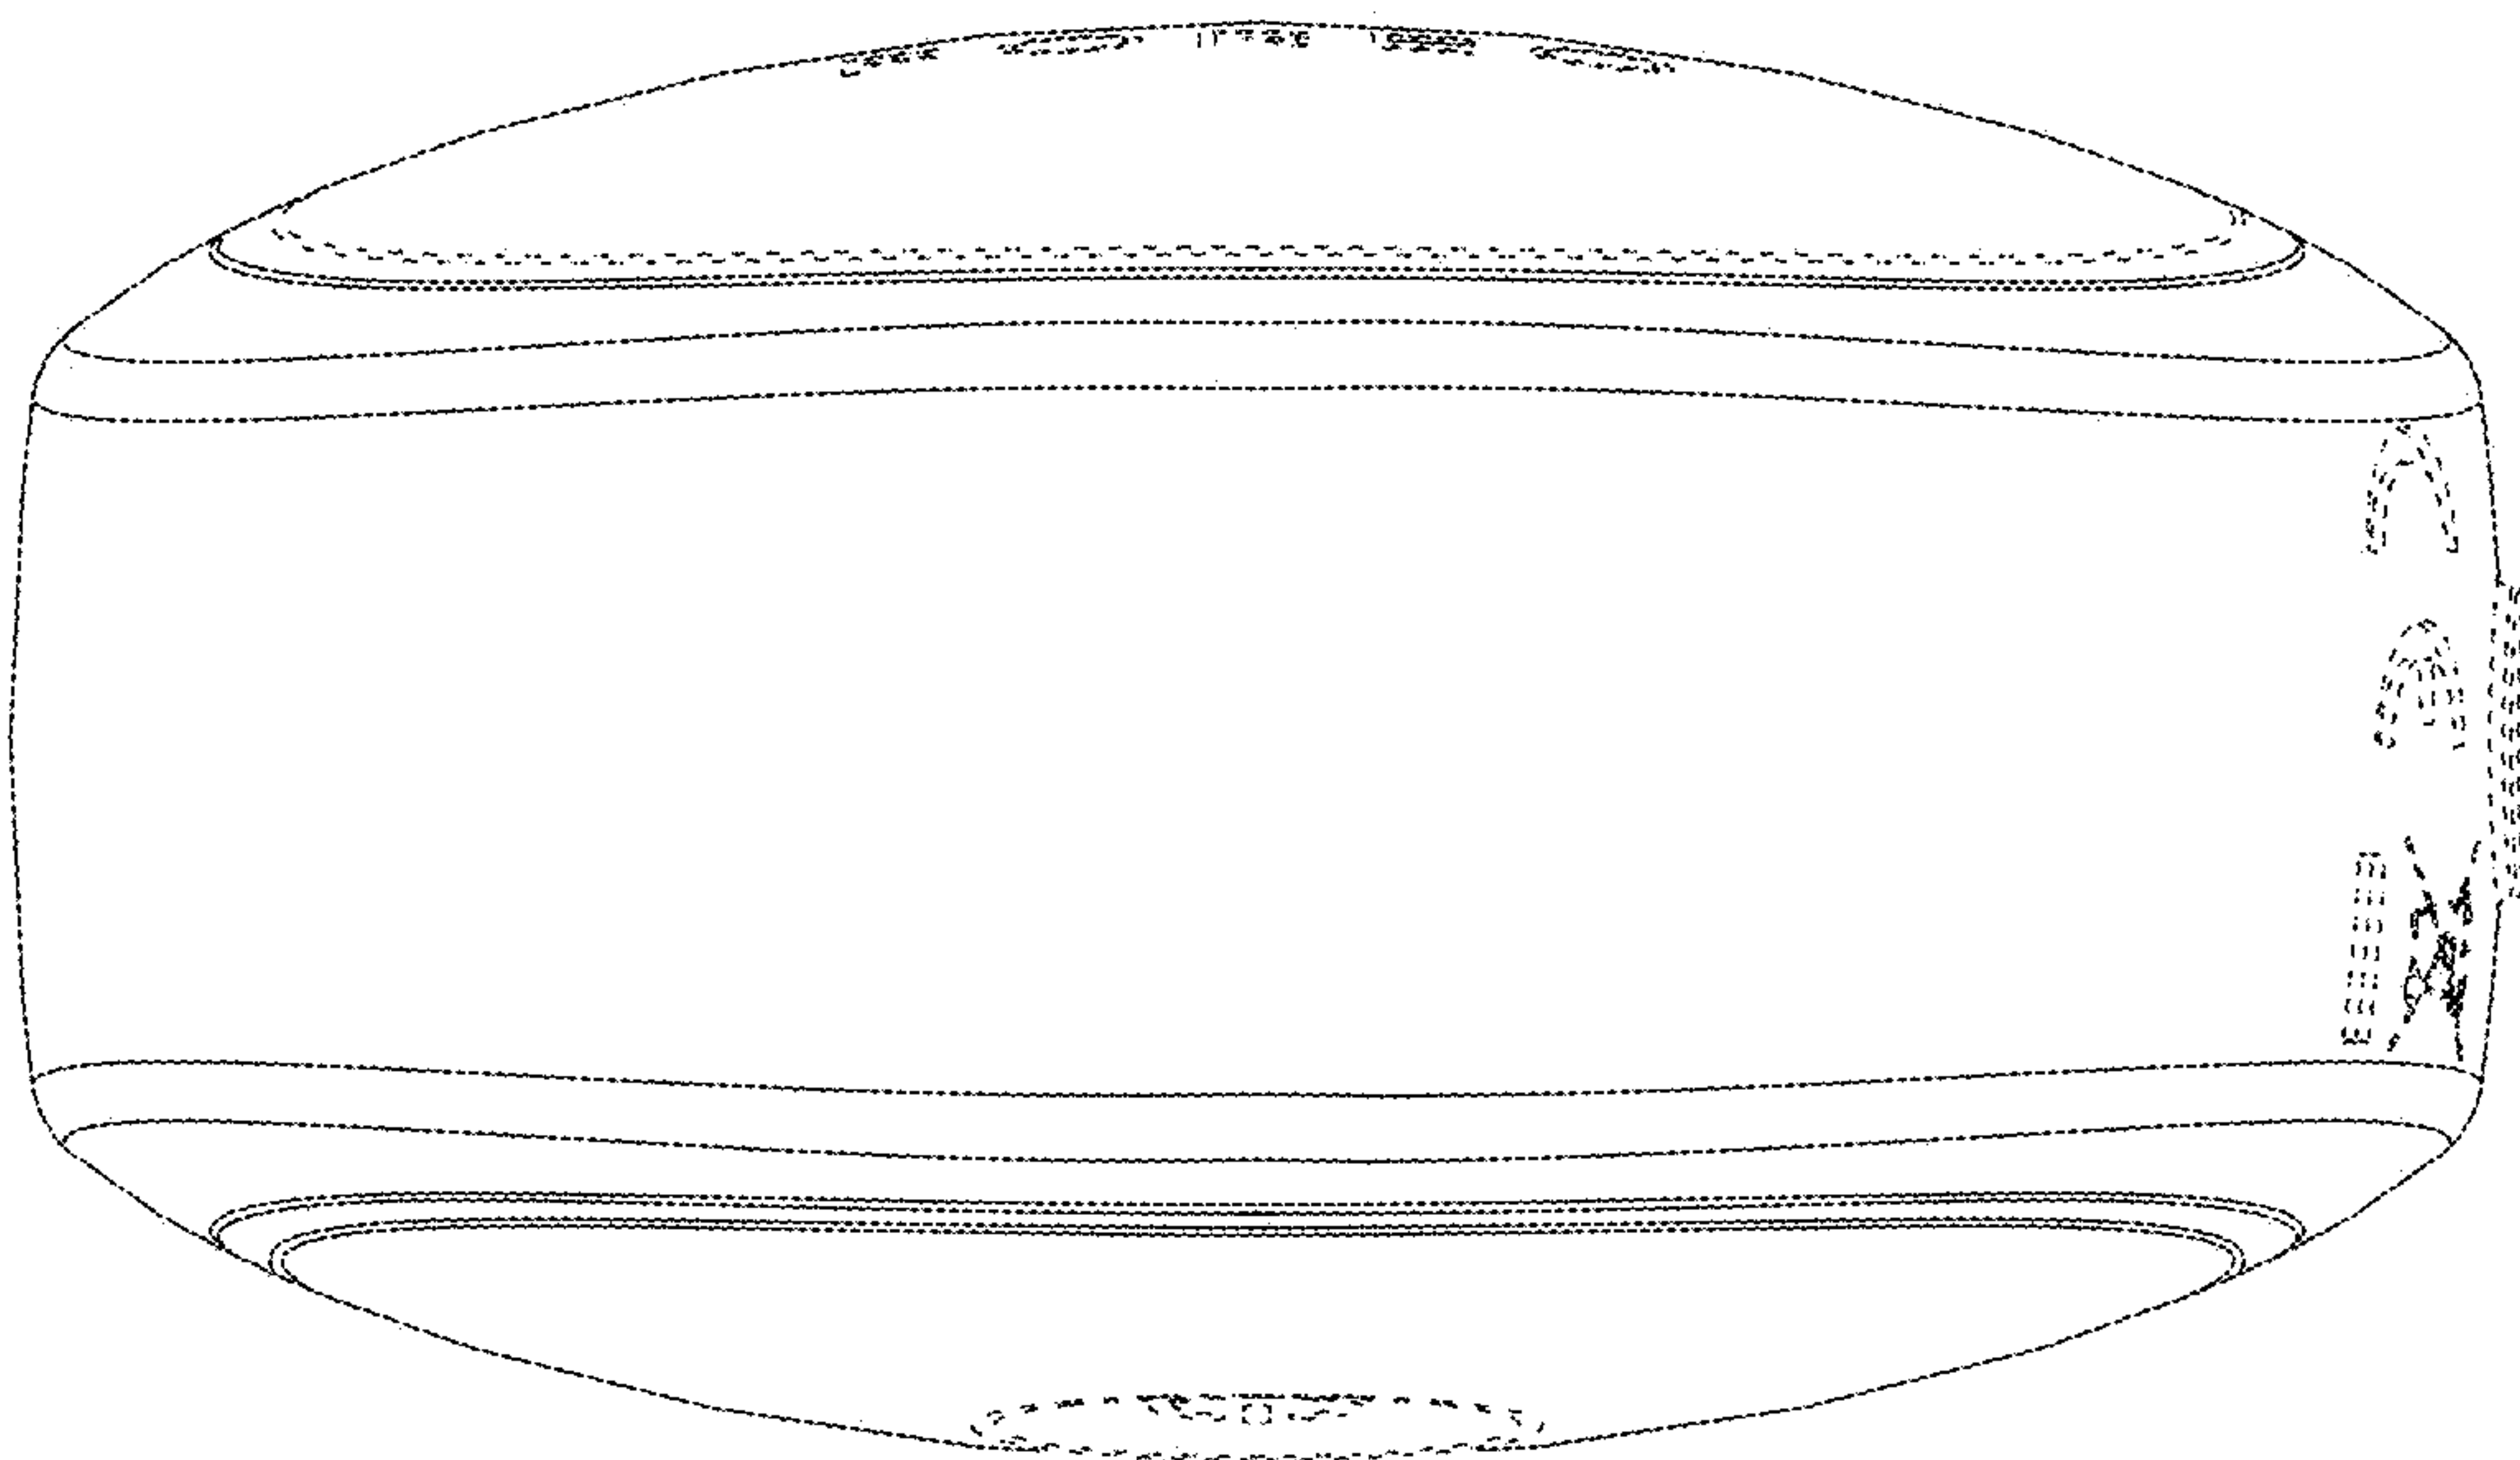


FIG. 6

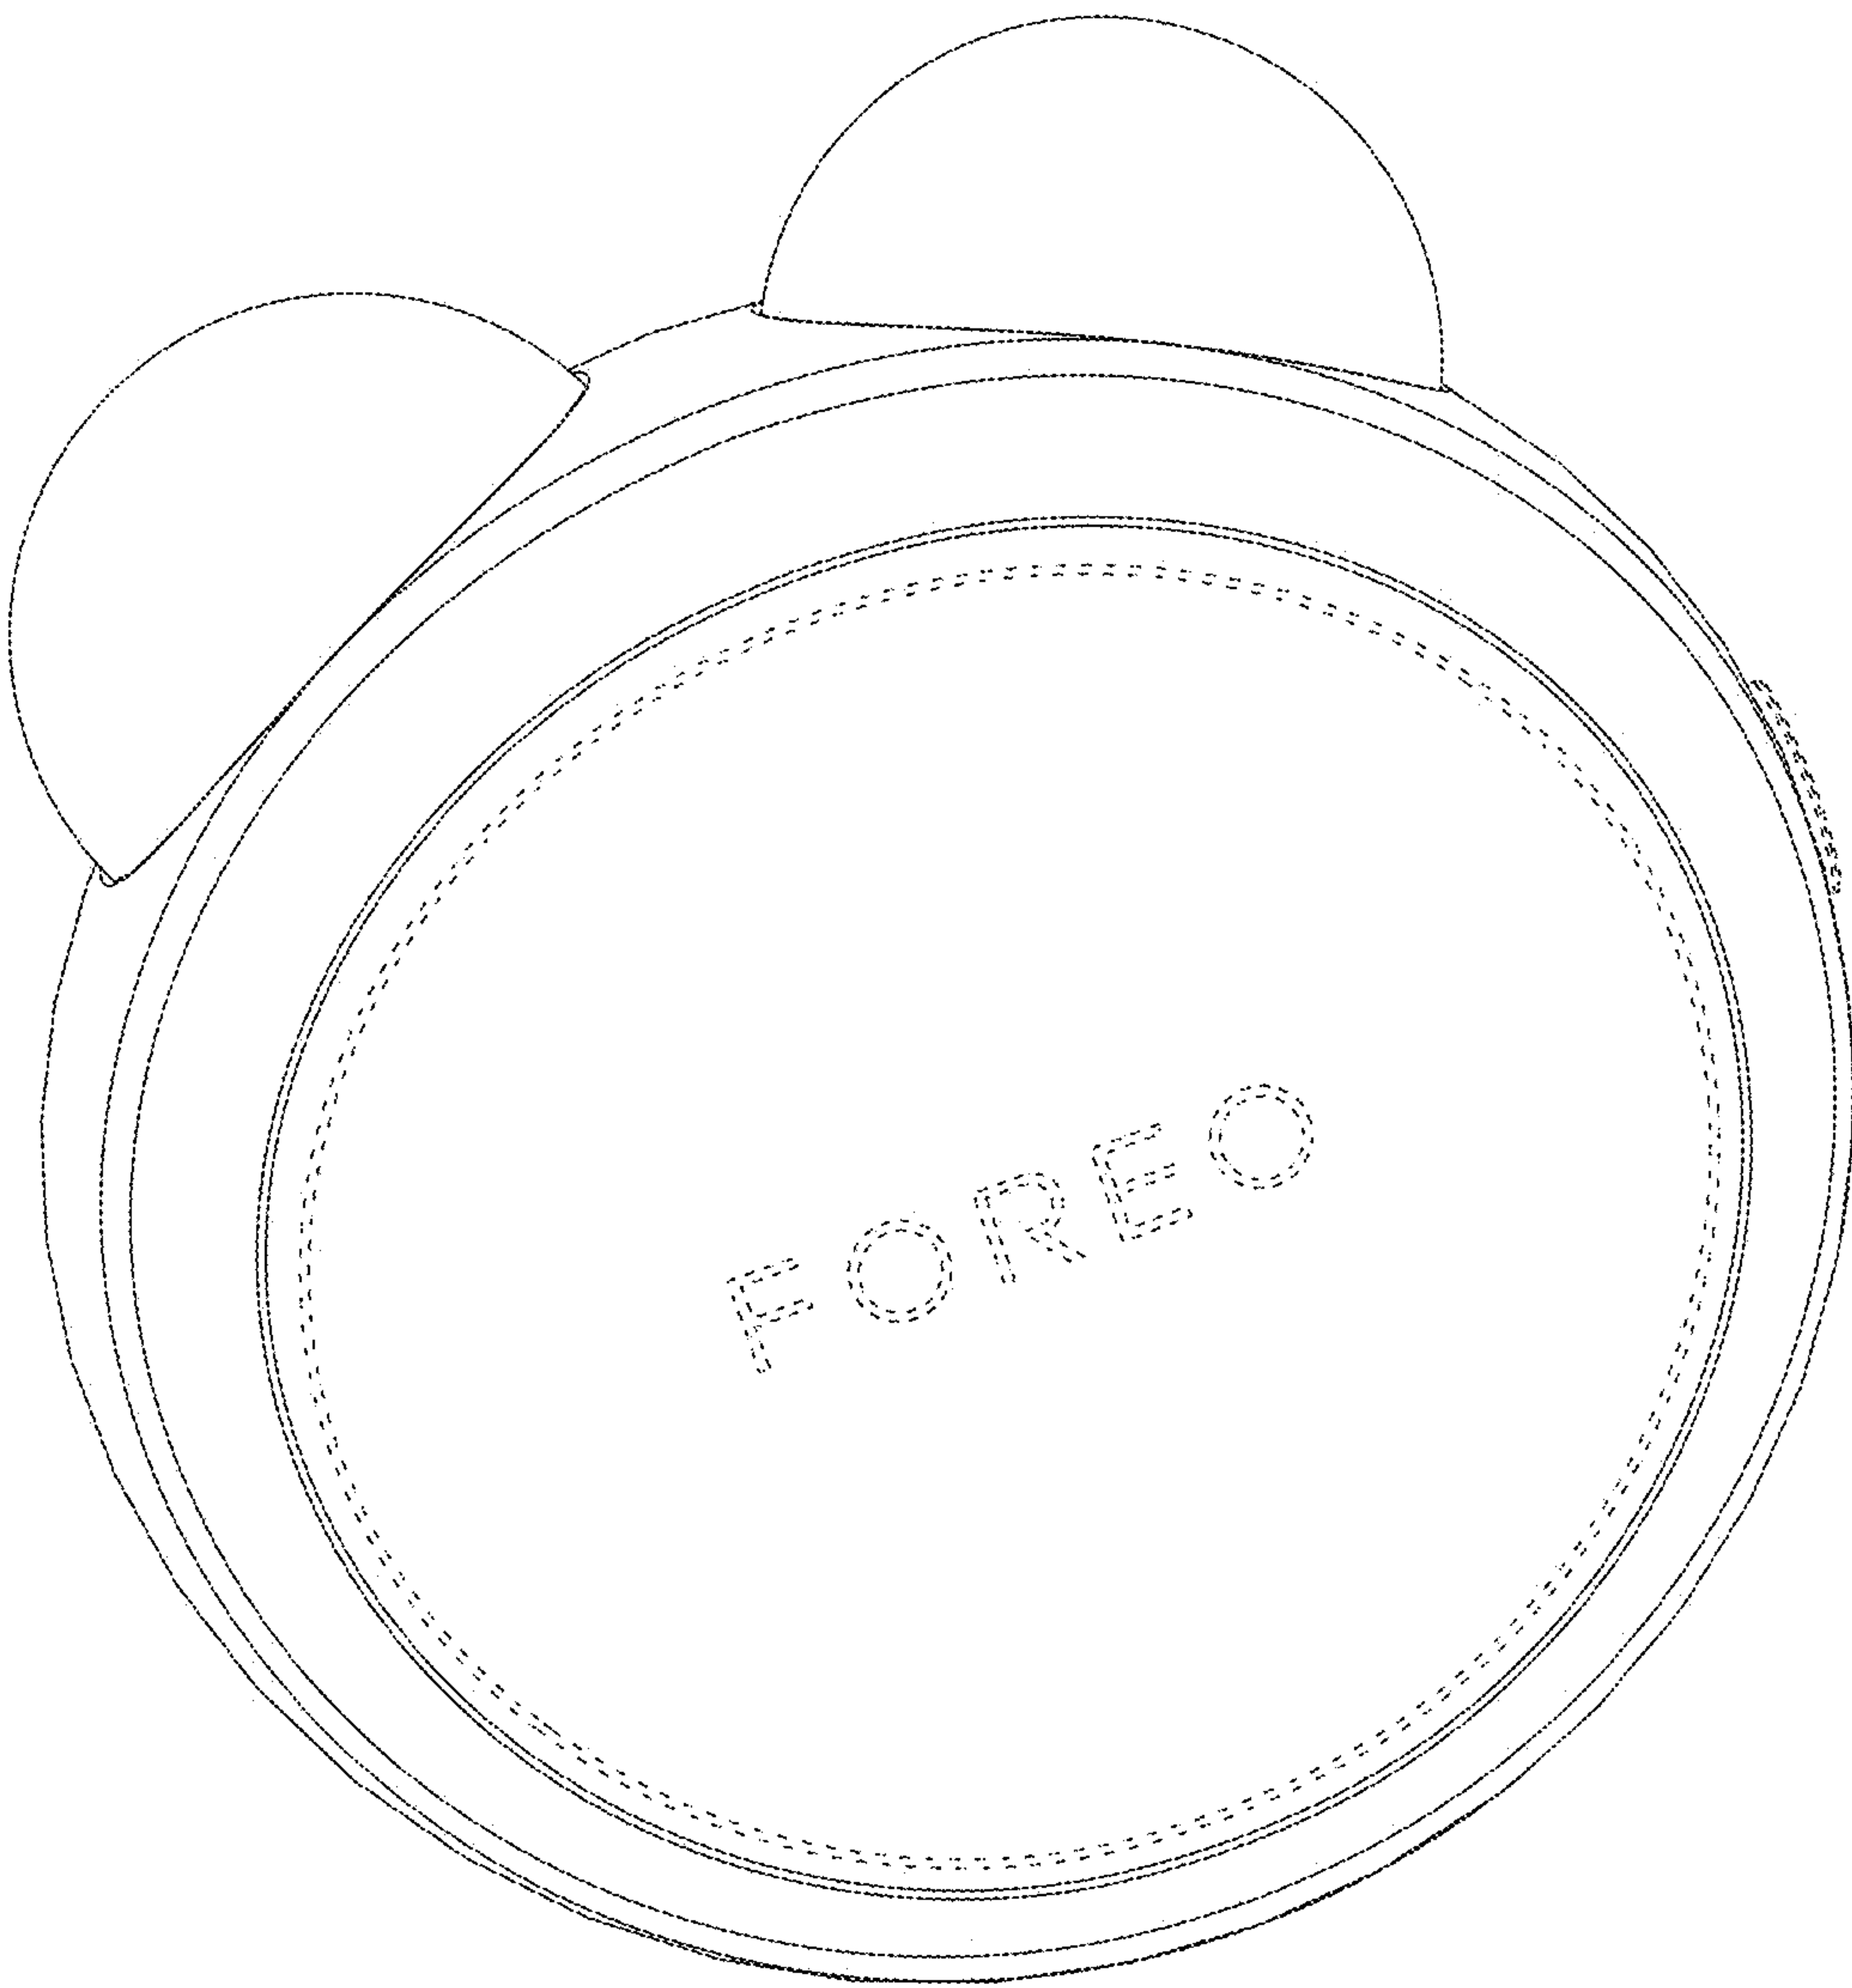


FIG. 7