



US00RE44084E

(19) **United States**
(12) **Reissued Patent**
Kern et al.

(10) **Patent Number:** **US RE44,084 E**
(45) **Date of Reissued Patent:** **Mar. 19, 2013**

(54) **CONTROL SYSTEM FOR STAND-BY ELECTRICAL GENERATOR**

(75) Inventors: **Robert D. Kern**, Waukesha, WI (US);
Steven J. Wilcox, Delafield, WI (US);
Gerald C Ruehlow, Oconomowoc, WI (US);
Frank X. Wedel, Lake Mills, WI (US);
Graham McLean, Lymm (GB);
Phillip Harrison, Lymm (GB);
Hongping Zhou, Preston (GB)

(73) Assignee: **Generac Power Systems, Inc.**,
Waukesha, WI (US)

(21) Appl. No.: **13/419,193**

(22) Filed: **Mar. 13, 2012**

Related U.S. Patent Documents

Reissue of:

(64) Patent No.: **6,657,416**
Issued: **Dec. 2, 2003**
Appl. No.: **09/882,745**
Filed: **Jun. 15, 2001**

(51) **Int. Cl.**
H02P 15/00 (2006.01)
H02P 3/00 (2006.01)

(52) **U.S. Cl.** **322/29**; 290/40 A; 290/40 R; 290/40 B;
307/7; 307/8; 307/57; 307/64; 322/10; 322/12

(58) **Field of Classification Search** 322/10,
322/12, 29; 290/40 A, 40 B, 40 R; 307/7,
307/8, 57, 64

See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

4,204,249	A *	5/1980	Dye et al.	307/64
4,357,545	A *	11/1982	Le Grand et al.	307/130
4,651,019	A *	3/1987	Gilbert et al.	307/43
4,967,096	A *	10/1990	Diemer et al.	290/38 R
5,323,328	A	6/1994	Tanaka	

5,461,263	A *	10/1995	Helfrich	307/64
5,465,011	A *	11/1995	Miller et al.	307/64
5,612,580	A *	3/1997	Janonis et al.	307/64
5,619,077	A *	4/1997	Green et al.	307/38
5,706,207	A	1/1998	Kurten et al.	
5,734,255	A	3/1998	Thompson et al.	
5,754,033	A *	5/1998	Thomson	307/57
5,973,481	A *	10/1999	Thompson et al.	290/2
6,351,692	B1	2/2002	Eaton et al.	
6,633,799	B2	10/2003	Krakovich et al.	
6,697,951	B1	2/2004	Sinha et al.	

OTHER PUBLICATIONS

“Entelligent NST Bind 3.1—A LonWorks binding tool for empower controls”, Encorp, Inc., Windsor, CO, Jun. 18, 2011, 96 pages.
Generac, Owner’s Manual, DG 50 Genset, OC6147rev0, Jun. 6, 2001.
Generac, Owner’s Manual, DG 50 Genset, OD2773rev0, Apr. 16, 2001.
Generac, Owner’s Manual, DG 50 Genset, C7363rev2, Feb. 28, 2001.
Generac, Owner’s Manual, DG 50 Genset, OE3611revB, Nov. 11, 2003.
Generac, Owners Manual, DG 50 Genset, OD9102revC, Aug. 26, 2003.
Generac, Owner’s Manual, DG 50 Genset, OD8944revC, Aug. 26, 2003.
“Generator System Monitoring And Control For Window”, Kohler Power Systems, G6-38, Sep. 1998, 6 pages.

(Continued)


Primary Examiner — J. San Martin

(74) *Attorney, Agent, or Firm* — Boyle Fredrickson, S.C.

(57) **ABSTRACT**

A generator structure is provided for generating an AC power for a load. The generator structure includes a generator connectable to a load and an engine operatively connected to the generator for driving the same. A generator controller is operatively connected to the engine for controlling operation thereof and operatively connected to a generator for controlling the AC power generated thereby. A communications link connects the generator control to a network.

21 Claims, 11 Drawing Sheets

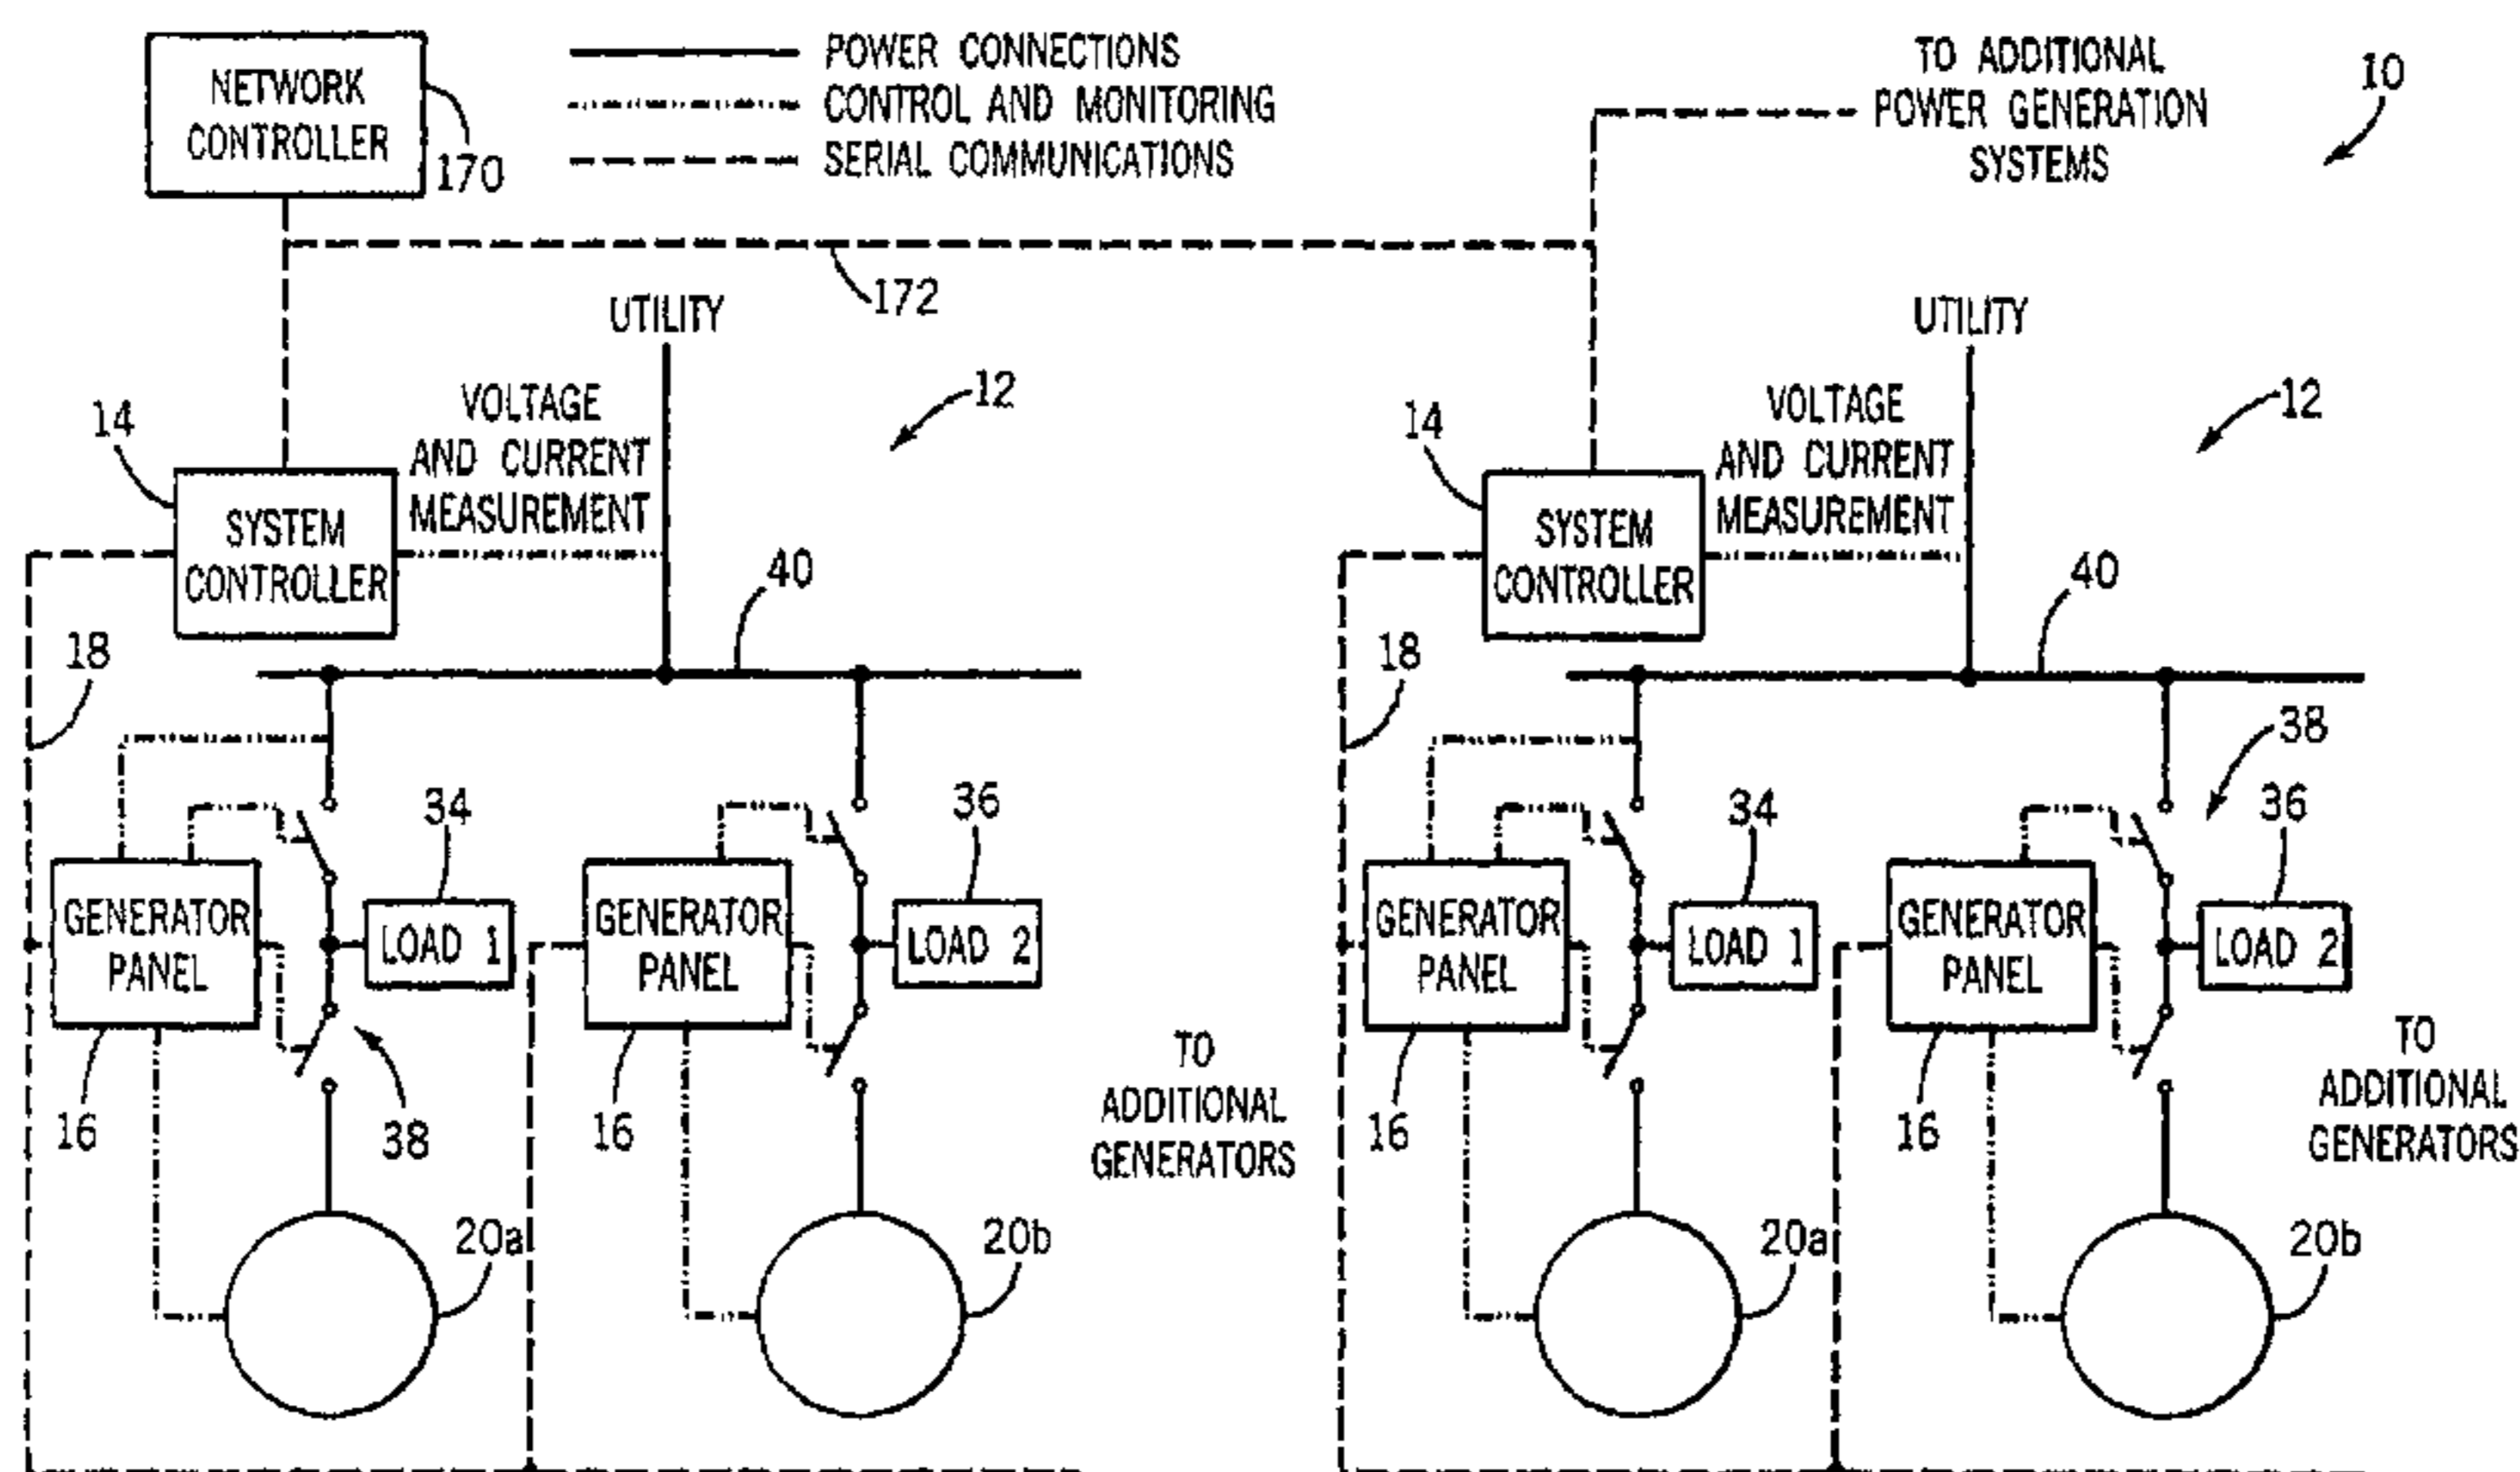

OTHER PUBLICATIONS

- “Application of PLC’s In Engine Generator Control Switchgear”, Forste, Presentation for E.G.S.A., Cancun, Mexico, Sep. 19, 1995, 30 pages.
- “Enpower-GPC Generator Power Control” Product Data Sheet, Encorp, Inc. 621 Ennovation Circle, Suite D, Windsor, CO 80550, 1996-1997, 4 pages.
- “Enpower-MMC Meter/Monitor Control” Product Data Sheet, Encorp, Inc. 621 Ennovation Circle, Suite D, Windsor, CO 80550, 1996-1997, 4 pages.
- “Enpower—UPC Utility Power Control” Product Data Sheet, Encorp, Inc. 621 Ennovation Circle, Suite D, Windsor, CO 80550, 1996-1997, 4 pages.
- “Entelligent”, <http://encorp.com/html/entelligent.html>, 1 page, Dec. 1997.
- “Advanced, Utility-Grade Power Control Products”, http://encorp.com/html/power_control.html, 2 pages, Dec. 1997.
- The entelligent—VMM (Virtual Maintenance Monitor™), [http://www.encorp.com/products/products_software/vmm/v . . .](http://www.encorp.com/products/products_software/vmm/v...), May 2000, 2 pages.
- “What is our Virtual Power Plant Solution”, http://encorp.com/html/vpp_solution.html, 2 pages, Dec. 1997.
- “The Encorp Virtual Power Plant Solution”, Encorp, Inc. Windsor CO, 10 pages, Jun. 2012.
- “‘Peak Sharing’ A Win-Win Solution to Reliably and Cost-Effectively Reduce System Peak Demands”, <http://encorp.com/html/win-win.html>, Jan. 1998, 7 pages.
- “New Products from Woodward”, <http://www.woodward.com/engine/newprod.htm>, Jun. 2012, 2 pages.
- “Entelligent VPP”, Encorp, Inc., Windsor, CO, Oct. 9, 2000, 32 pages.
- “Energy Automation Tools—A Suite of Programs for Configuring and Monitoring Empower Controls”, Encorp, Inc., Windsor, CO, Apr. 25, 2000, 262 pages.
- “Enpower Developers Guide—Building Custom Applications with empower Controls”, Encorp, Inc., Windsor, CO, Jun. 1, 2000, 450 pages.
- “Enpower Hardware—A guide to empower controls: revision 2.0 and above”, Encorp, Inc., Windsor, CO, Jun. 1, 2000, 72 pages.
- “Encorp, Inc. The Energy Automation Company”, PowerPoint, 15 pages, undated.
- “Release Notes for Enpower 3.0 Firmware Development—Date: Aug. 3, 2000—Control Platform: Revision 2 hardware”, Encorp, Inc., Windsor, CO.
- “Gilder Group’s Inaugural Powercosm Conference—the Virtual Power Plant in the Powercosm”, PowerPoint, Coronado Island, CA—Jun. 15, 2000, 43 pages.
- “Entelligent—VMM—Virtual Maintenance Monitor Software User Guide”, Encorp, Inc., Windsor, CO, Jun. 22, 2012, 24 pages.
- “Enpower-GPC with kW Sharing Software—User Guide—Standard Binding Set”, Encorp, Inc., Windsor, CO, Feb. 27, 1998, 55 pages.
- “Enpower Products, GPC/MMC/UPC, Installation And Configuration Guide”, Encorp, Inc., Windsor, CO, Dec. 3, 1998, 50 pages.
- “Entelligent NST Binding Software 3.0, LonWorks Binding Tool for empower Controls”, Encorp, Inc. Windsor, CO, Aug. 4, 1999, 95 pages.
- “Virtual Maintenance Monitor—Developers Guide”, Encorp, Inc., Windsor, CO, Aug. 14, 2001, 268 pages.
- “Power Command Network—Smart Products, Intelligent Systems, Powerful Solutions”, Onan Corporation, Sep. 1995 Bulletin PCN-007, 8 pages.
- “Utility Deregulation and The Role of Standby Generators”, Whitham, Jeff, Encorp. Inc., Power-Gen ’96, Orlando, FL, Dec. 5, 1996, 4 pages.
- “Integrated Gen-Set Controls For Peak Sharing Applications”, Whitman, Diesel Progress Engines & Drives, May 1996, 2 pages.
- “‘Peak Sharing’—A Win-Win Solution to Reliably and Cost-Effectively Reduced System Peak Demands”, Whitman, Encorp, Inc., Windsor, CO, undated, 8 pages.
- “Enpower Hardware—A guide to empower controls” revisins 2.0 and above, Encorp, Inc., Windsor, CO, Nov. 2, 2000, 81 pages.
- “The Encorp Virtual Power Plan Solution”, Slideshow, Jun. 4, 2012, 19 pages.
- Drawings by Greg Miller, Encorp, Inc., Windsor, CO, Oct. 30, 1997, 3 pages.
- “PowerCommand Paralleling Generator Set Control”, Onan Corporation, Jan. 1996 Bulletin S-1005, 6 pages.
- “Enpower Training Course” May 1-5, 1999, Slideshow, 51 pages.
- “Arizona Corporation Commission Distributed Generation & Interconnection Workgroup Meeting—The Business Care for the Virtual Power Plant”, Slideshow, Phoenix, AZ, Oct. 25, 1999, 47 pages.
- “Energy Automation Tools—A suite of programs for configuring and monitoring empower controls”, Encorp, Inc., Apr. 30, 2000, 254 pages.
- “Entelligent VPP Virtual Power Plant”, Encorp, Inc., Nov. 3, 1999, 48 pages.
- “Closed Transition Soft Load Automatic Transfer Switches Free Standing 800-4000 Amperes”, Cutler-Hammer, Inc., 1999, 8 pages.
- “Awaiting the Much Anticipated Arrival of Micro-generation?—An automotive-based engine—redesigned to be an efficient, durable natural-gas-fired genset—shows promise to become one of the first commercially available micro-generators”, Salter et al, Prime Power, Consulting-Specifying Engineer’s 1998, EGSA Supplement, 10 pages.
- “Woodward Governor Company Engine Controls 1996 Complete Line Catalog”, Woodward Engine Controls, 1995, 105 pages.
- “EGCP-1 Engine Generator Control Package” Product Specification 03208, 99/10/F, Woodward, Fort Collins, CO, 1999, 4 pages.
- “Wexler manufacturers powerful genset controllers!”, www.wexler.co.il, Jun. 21, 2012, 2 pages.
- “Software Operation, Monitoring and Control for Windows(r)—Decision-Maker 340 Genset Controller, M340 Transfer Switch Controller, M340+ Transfer Switch Controller, PM340 Power Monitor”, Kohler Power Systems, TP-5972, Dec. 1998, 60 pages.
- “Instructions for Cutler-Hammer Closed Transition Soft Load Generator Control Logic”, IB4502TE0002, Cutler-Hammer, May 2001, 108 pages.
- “Kohler Power Systems Selects Encorp Control System”, [http://encorp.com/newsroom/press_kohler/body_press_kohle . . .](http://encorp.com/newsroom/press_kohler/body_press_kohle...), Feb. 1, 2011, 2 pages.
- “Onan PowerCommand Digital Paralleling: First, a breakthrough GenSet. Now, an innovation application.”, Onan Corporation, Minneapolis, MN, Bulletin F-1122 Jul. 1995, 4 pages.
- “PowerCommand Network—Real Time Monitoring and Control for Emergency Power Systems”, Onan Corporation, Minneapolis, MN 55432, R-1089a, Oct. 1996, 2 pages.

* cited by examiner

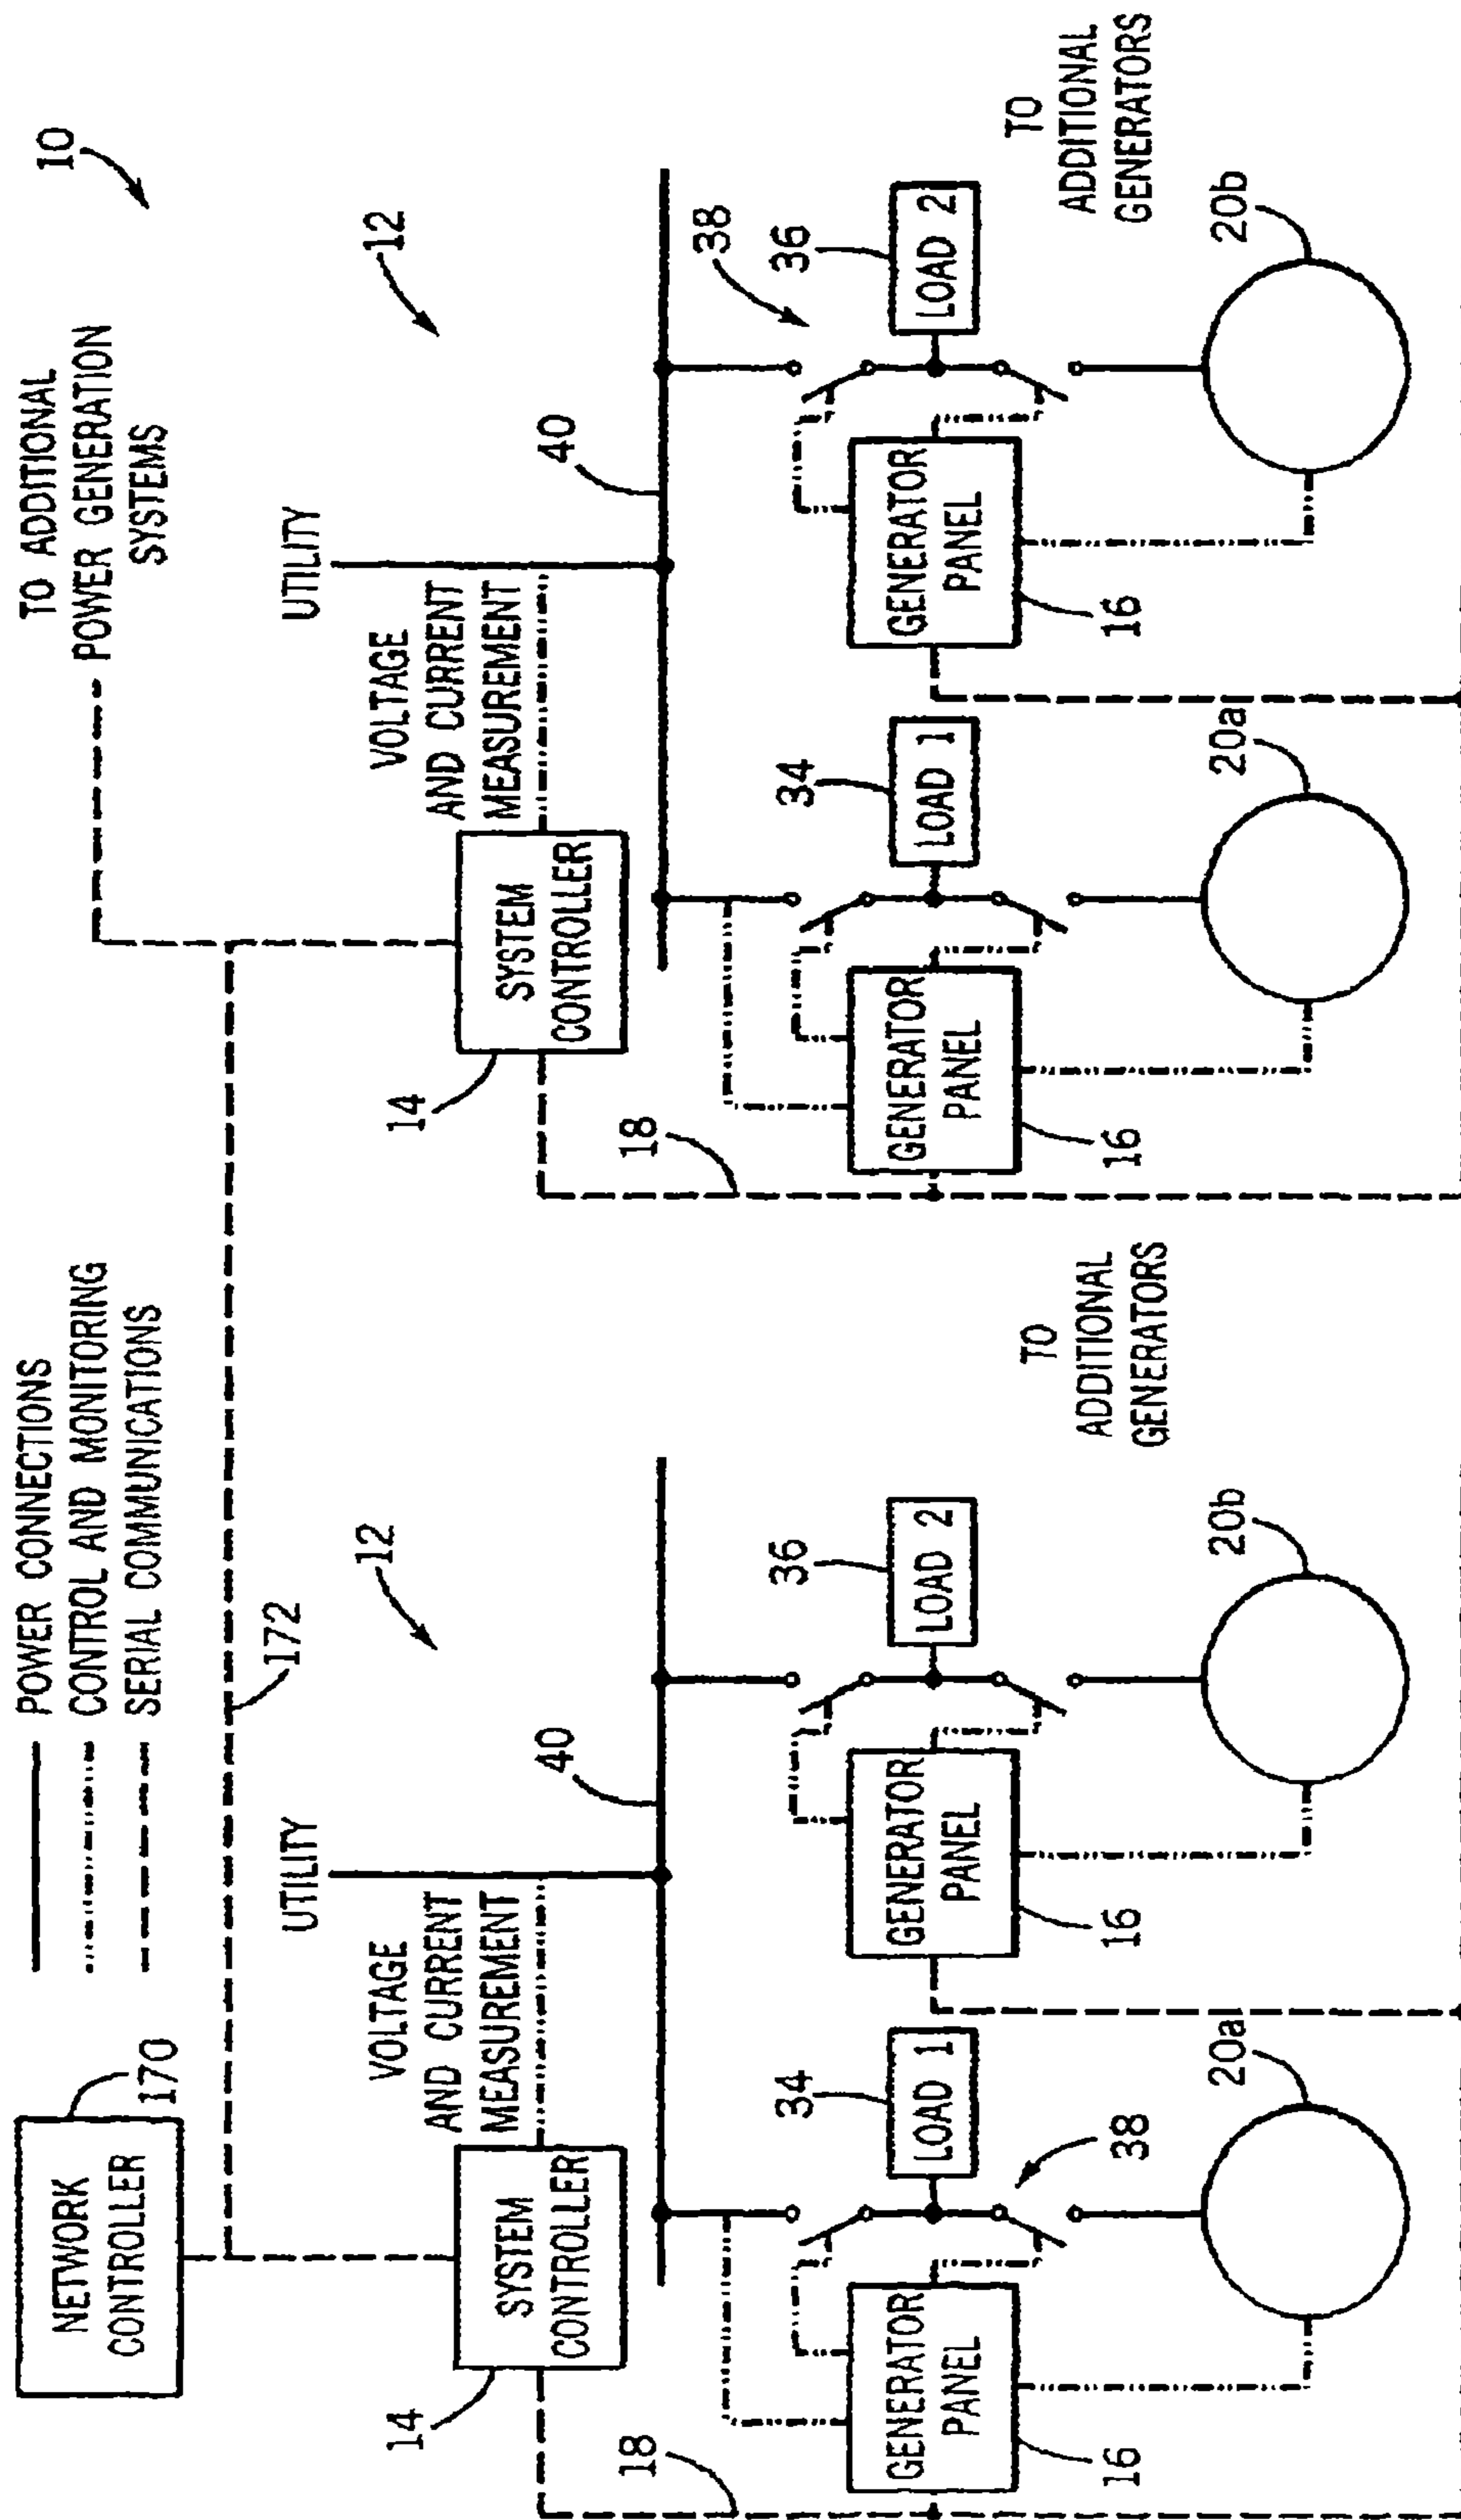


FIG. 1

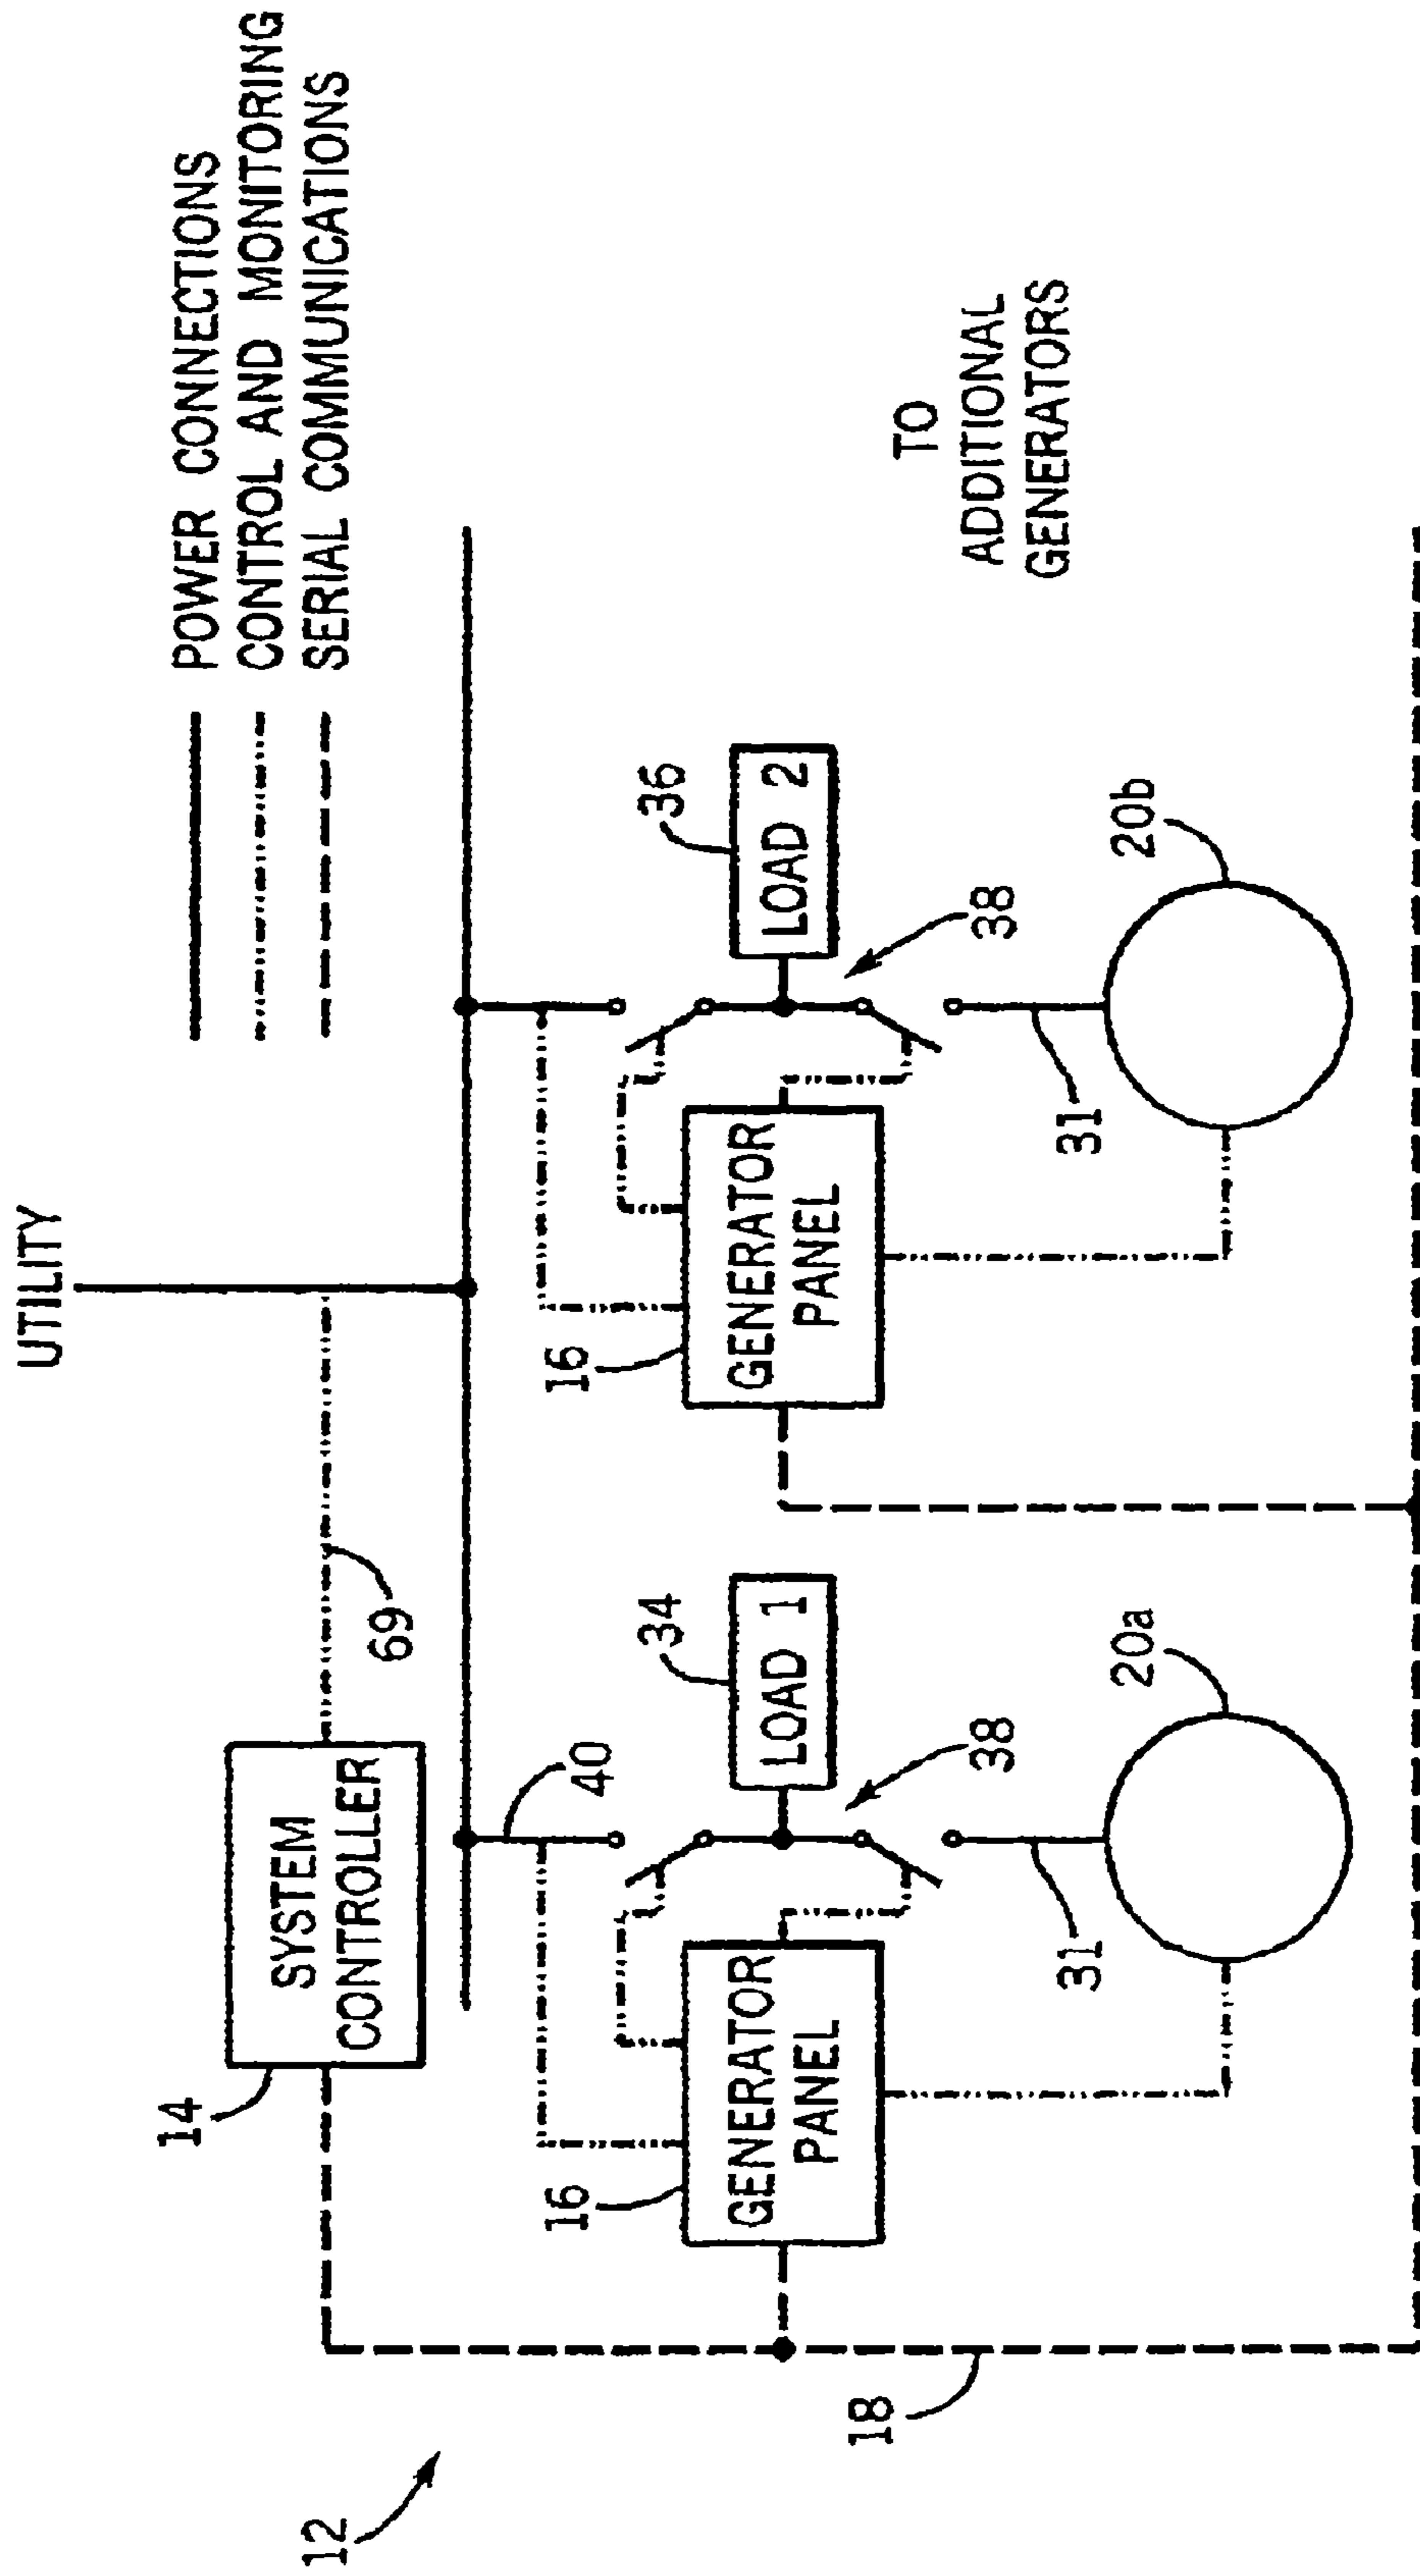


FIG. 2

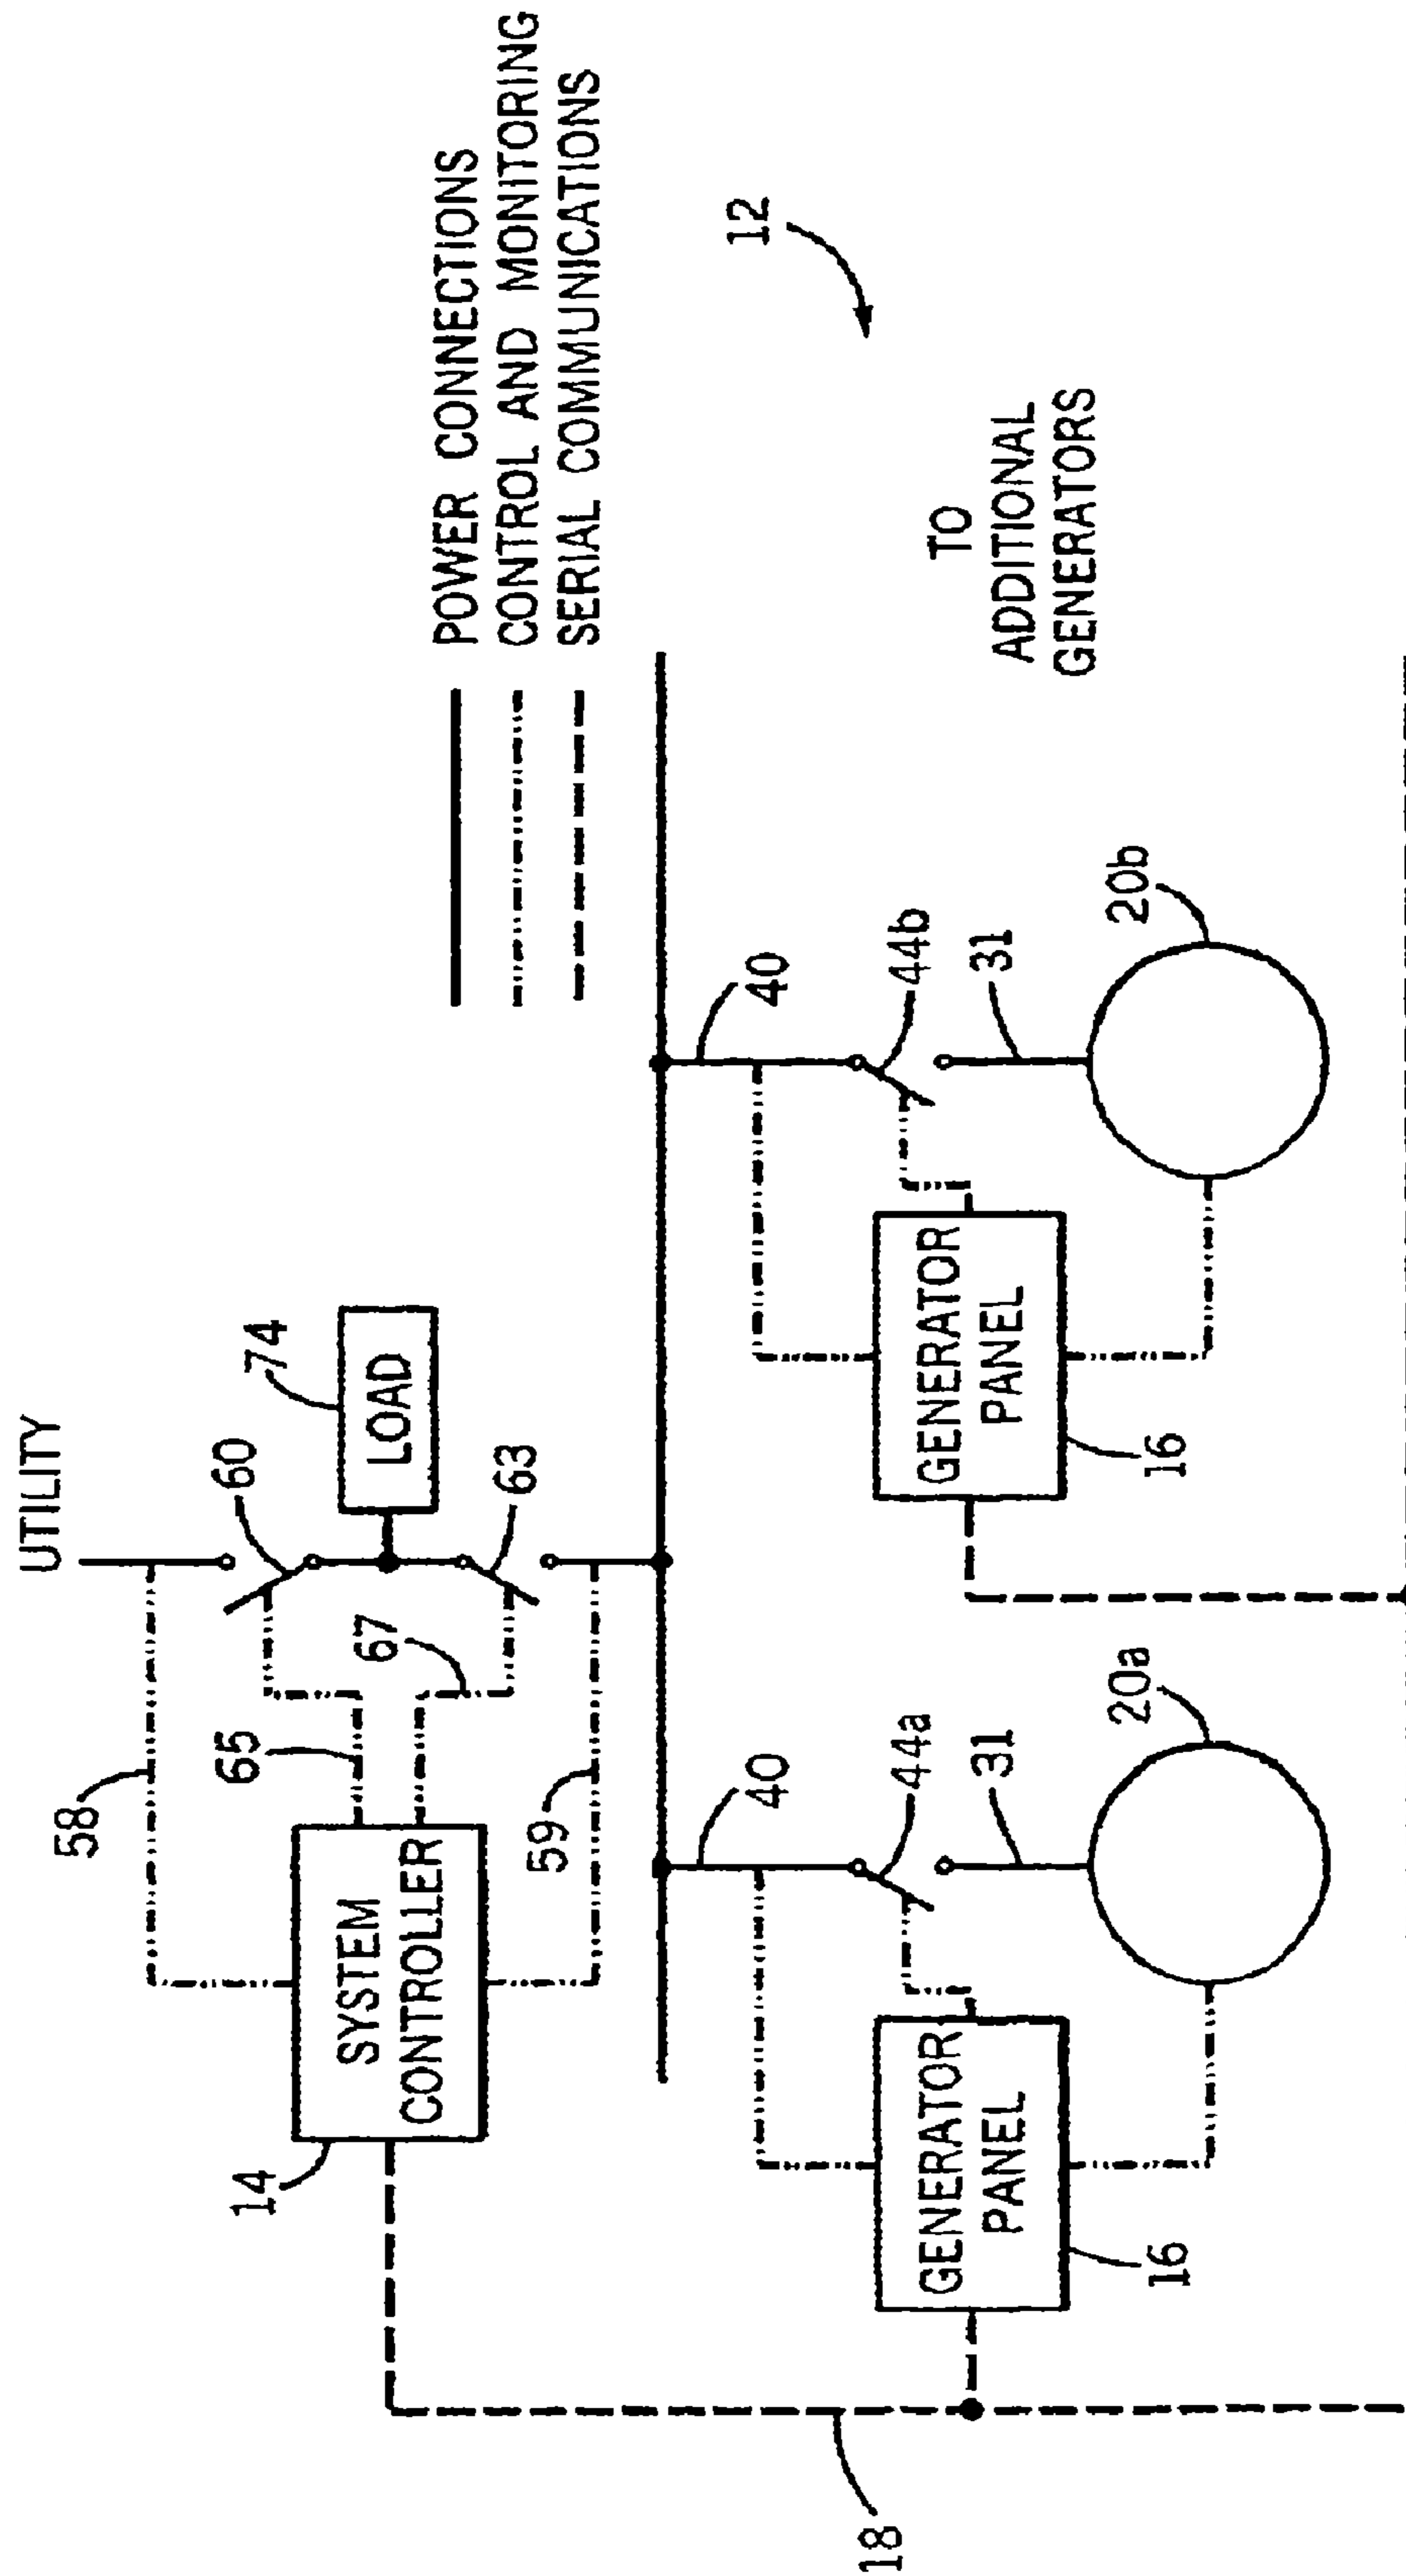


FIG. 3

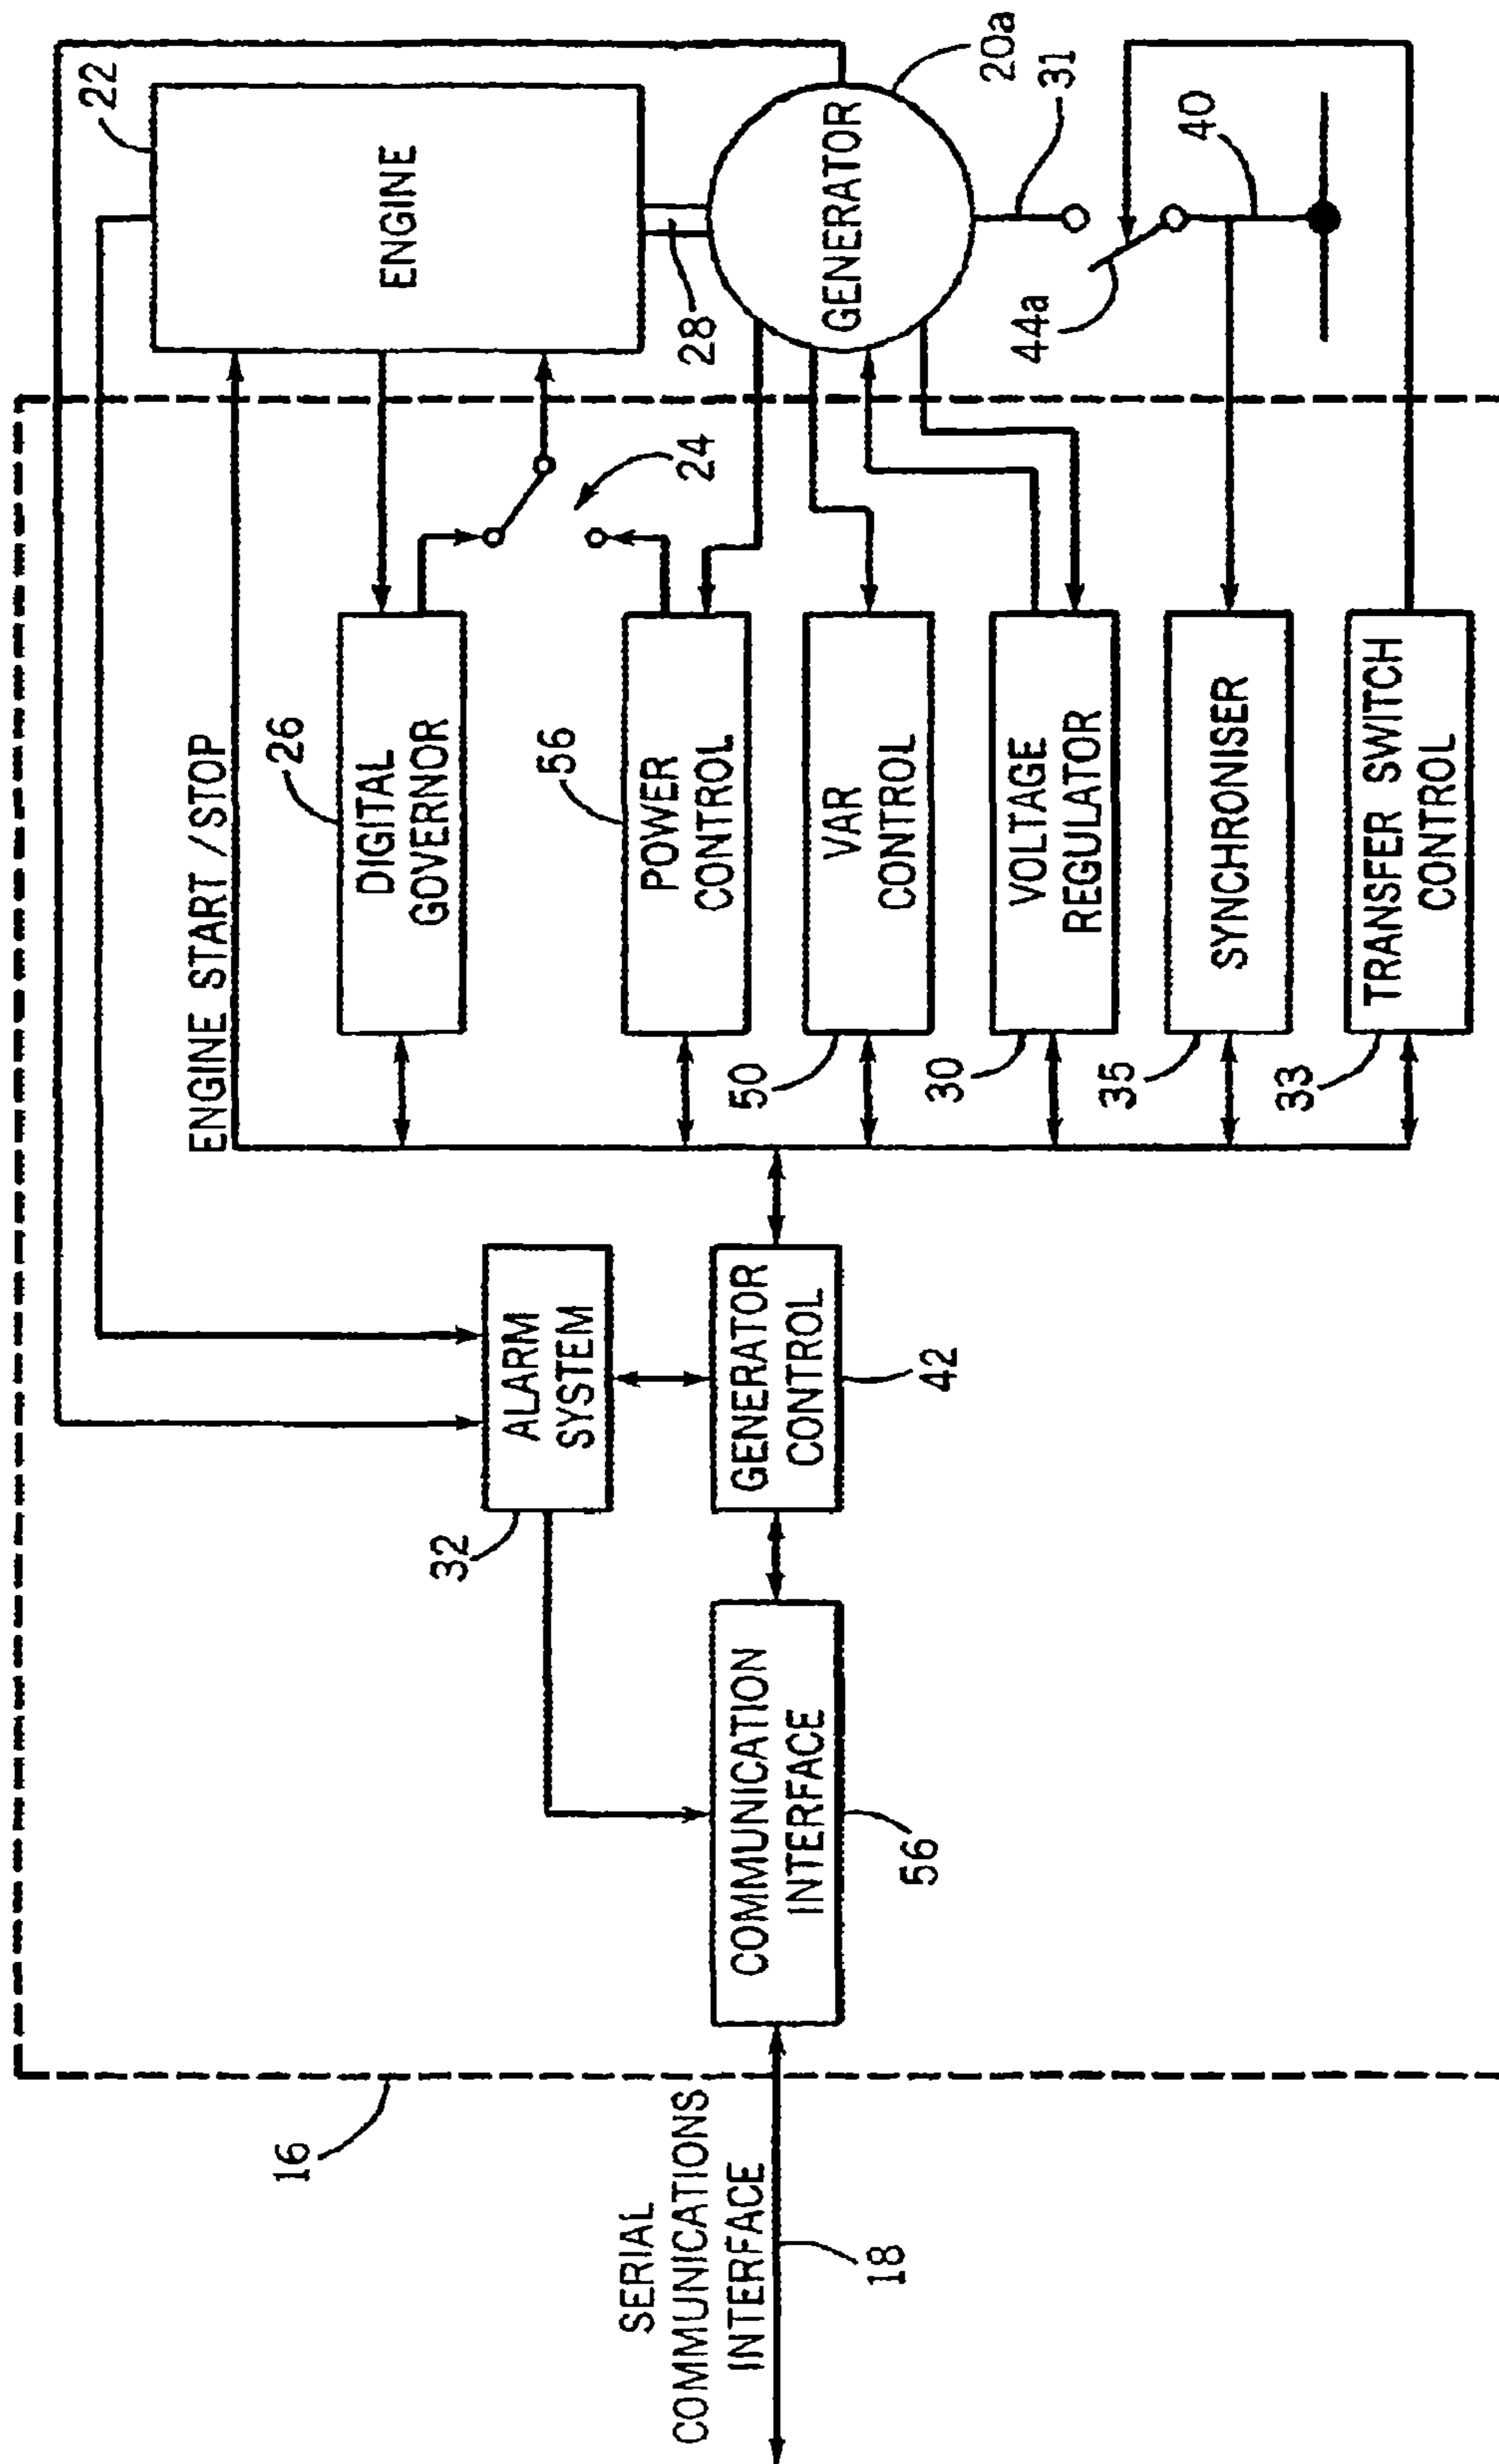


FIG. 4a

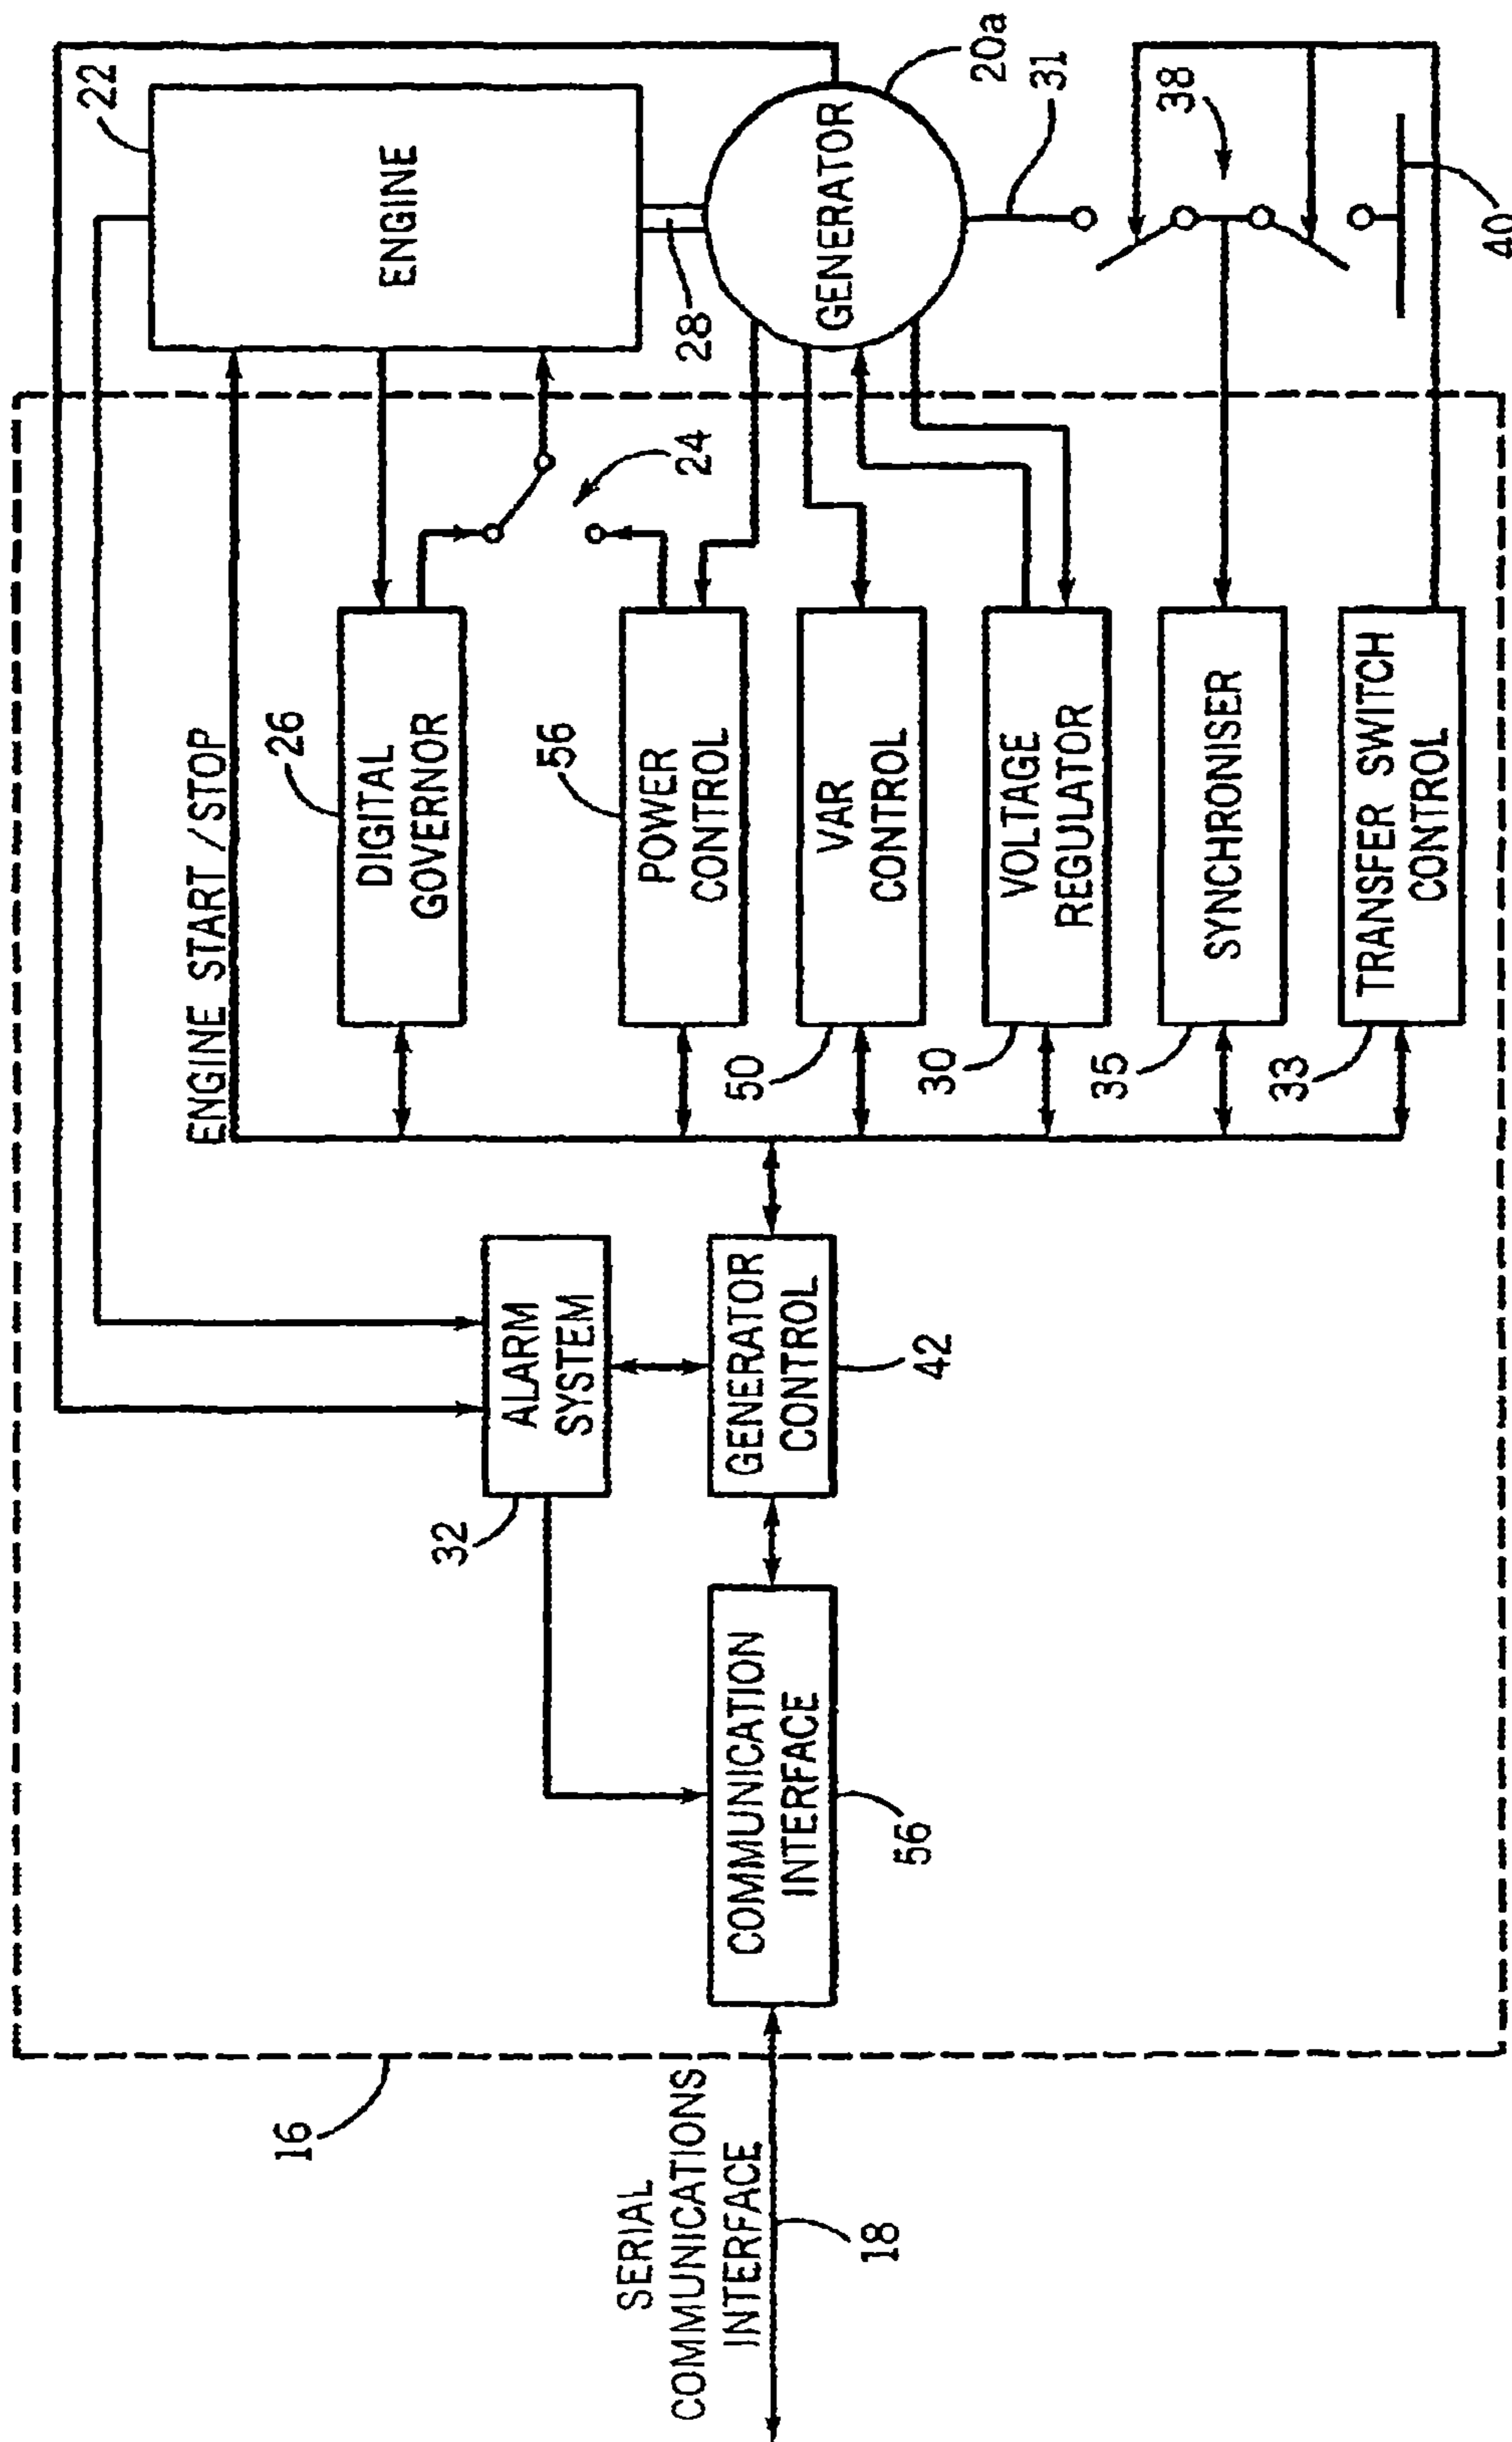


FIG. 4b

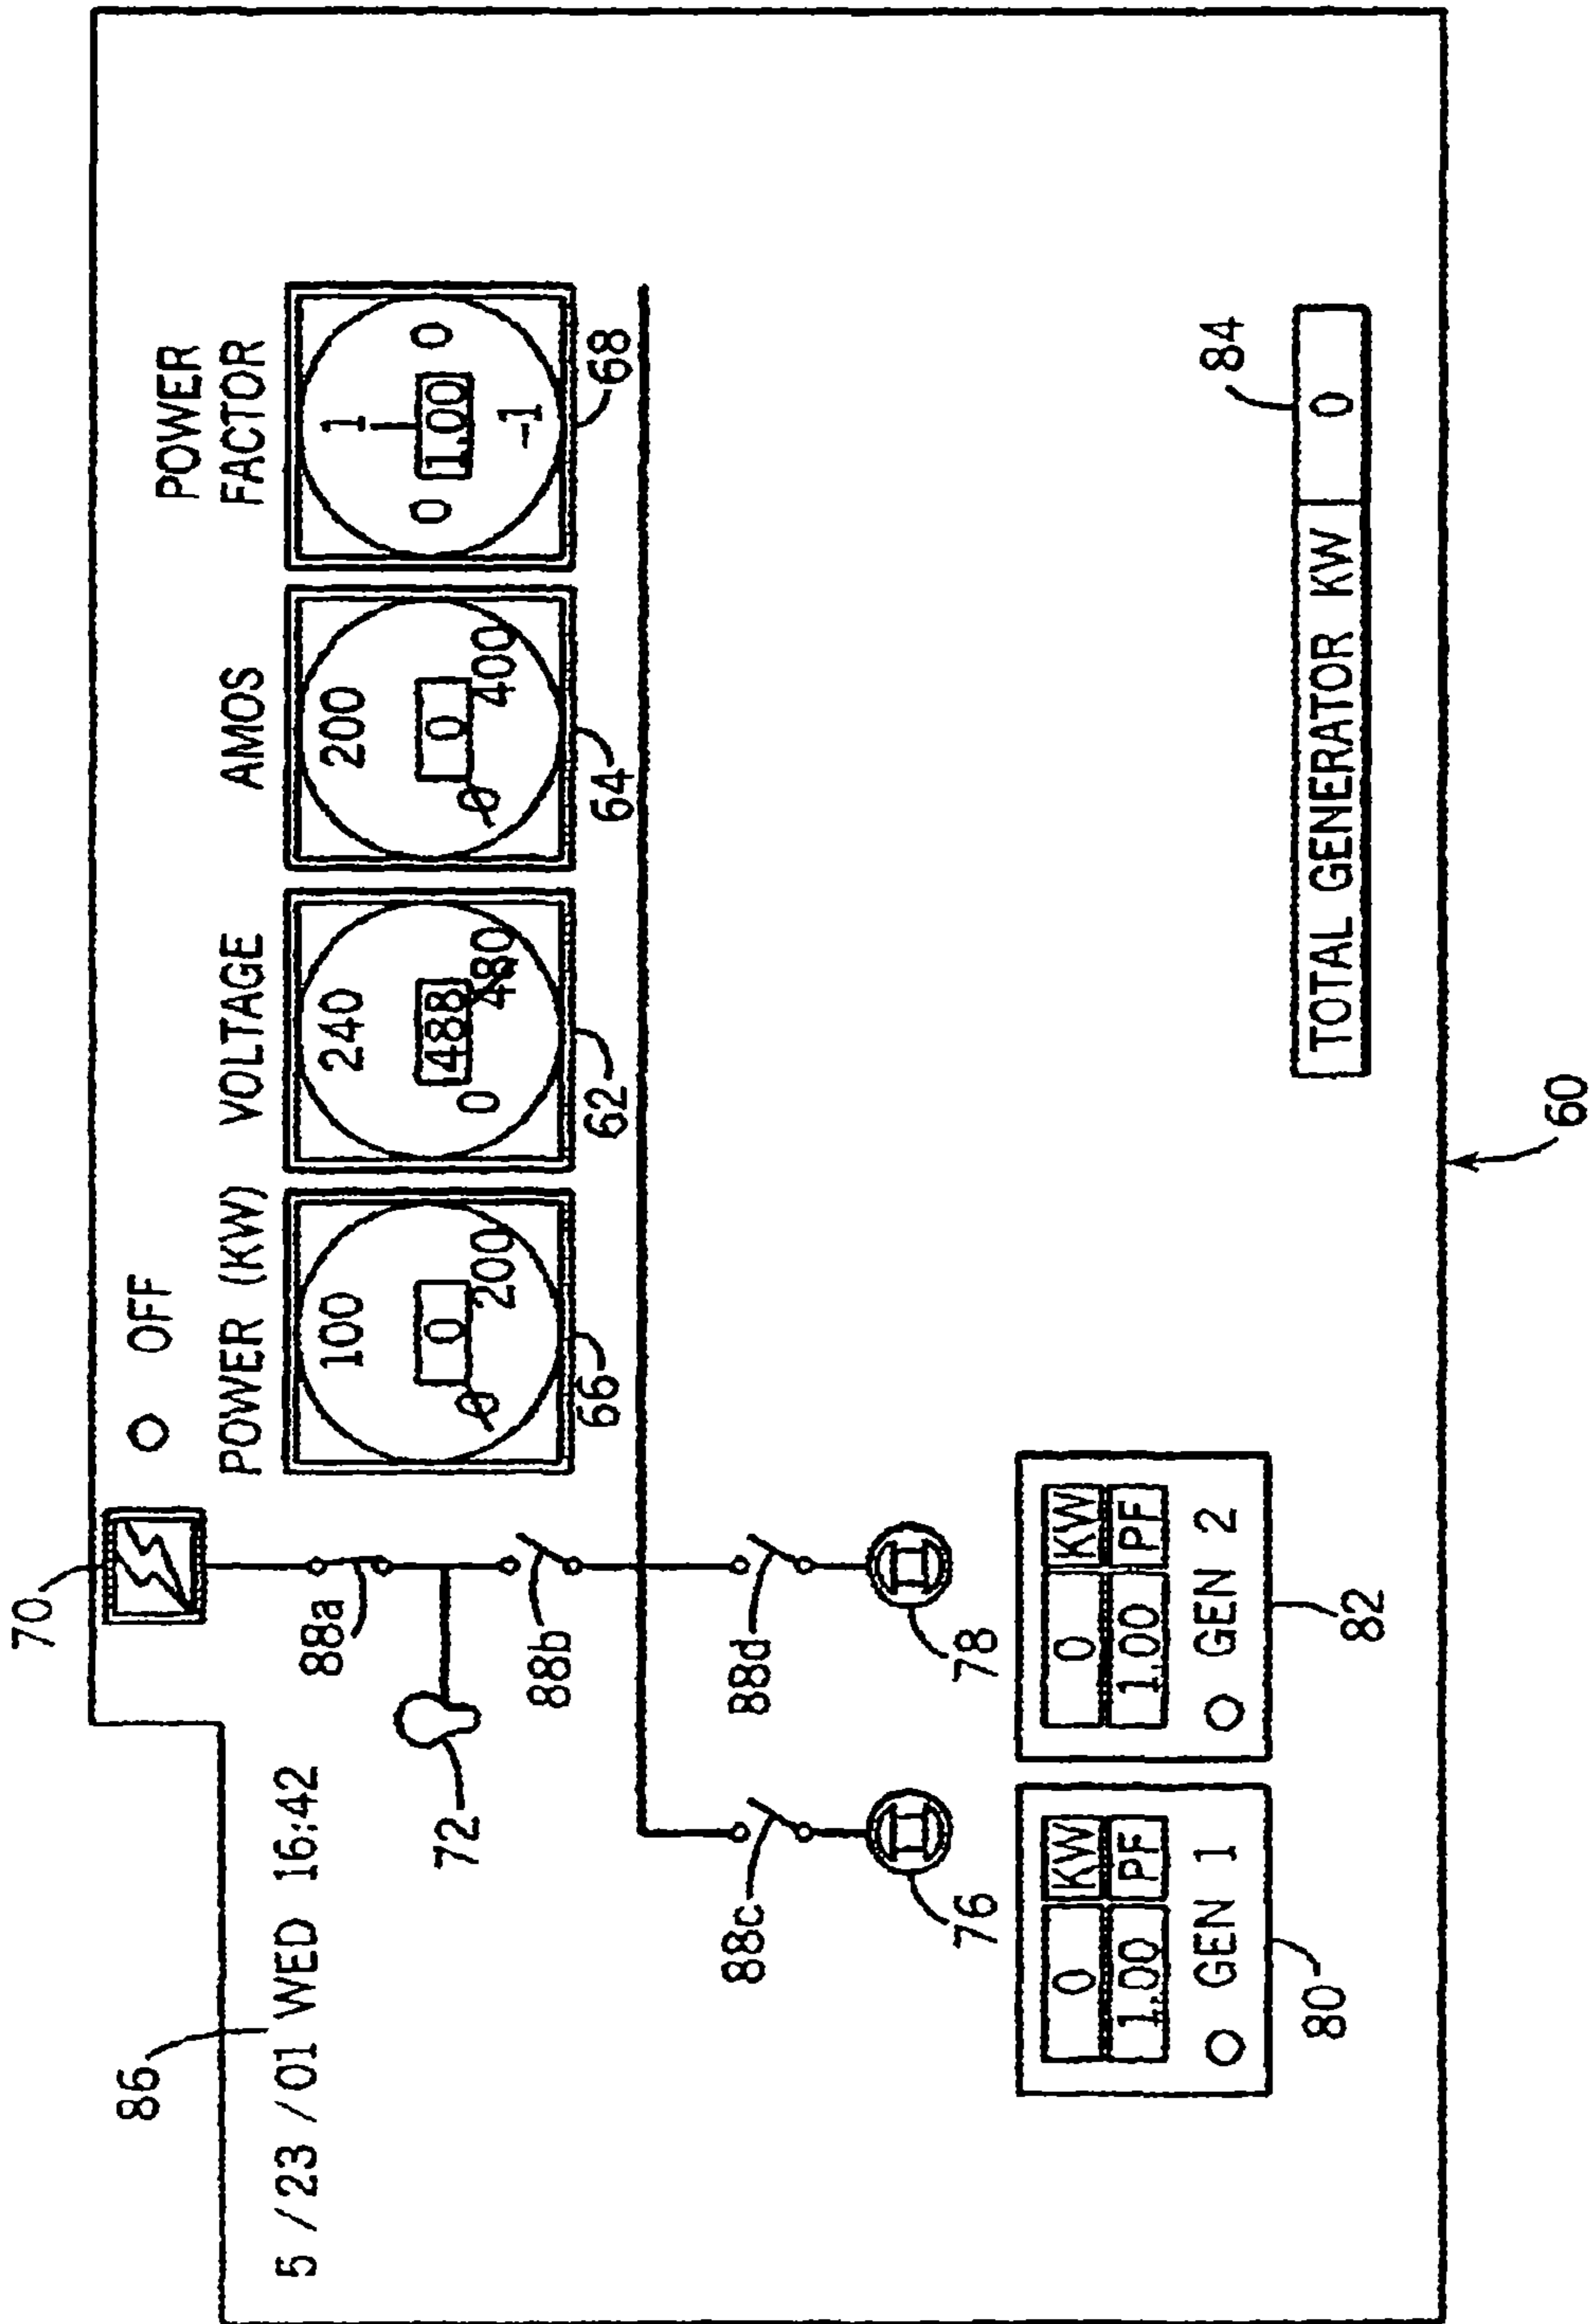


FIG. 5

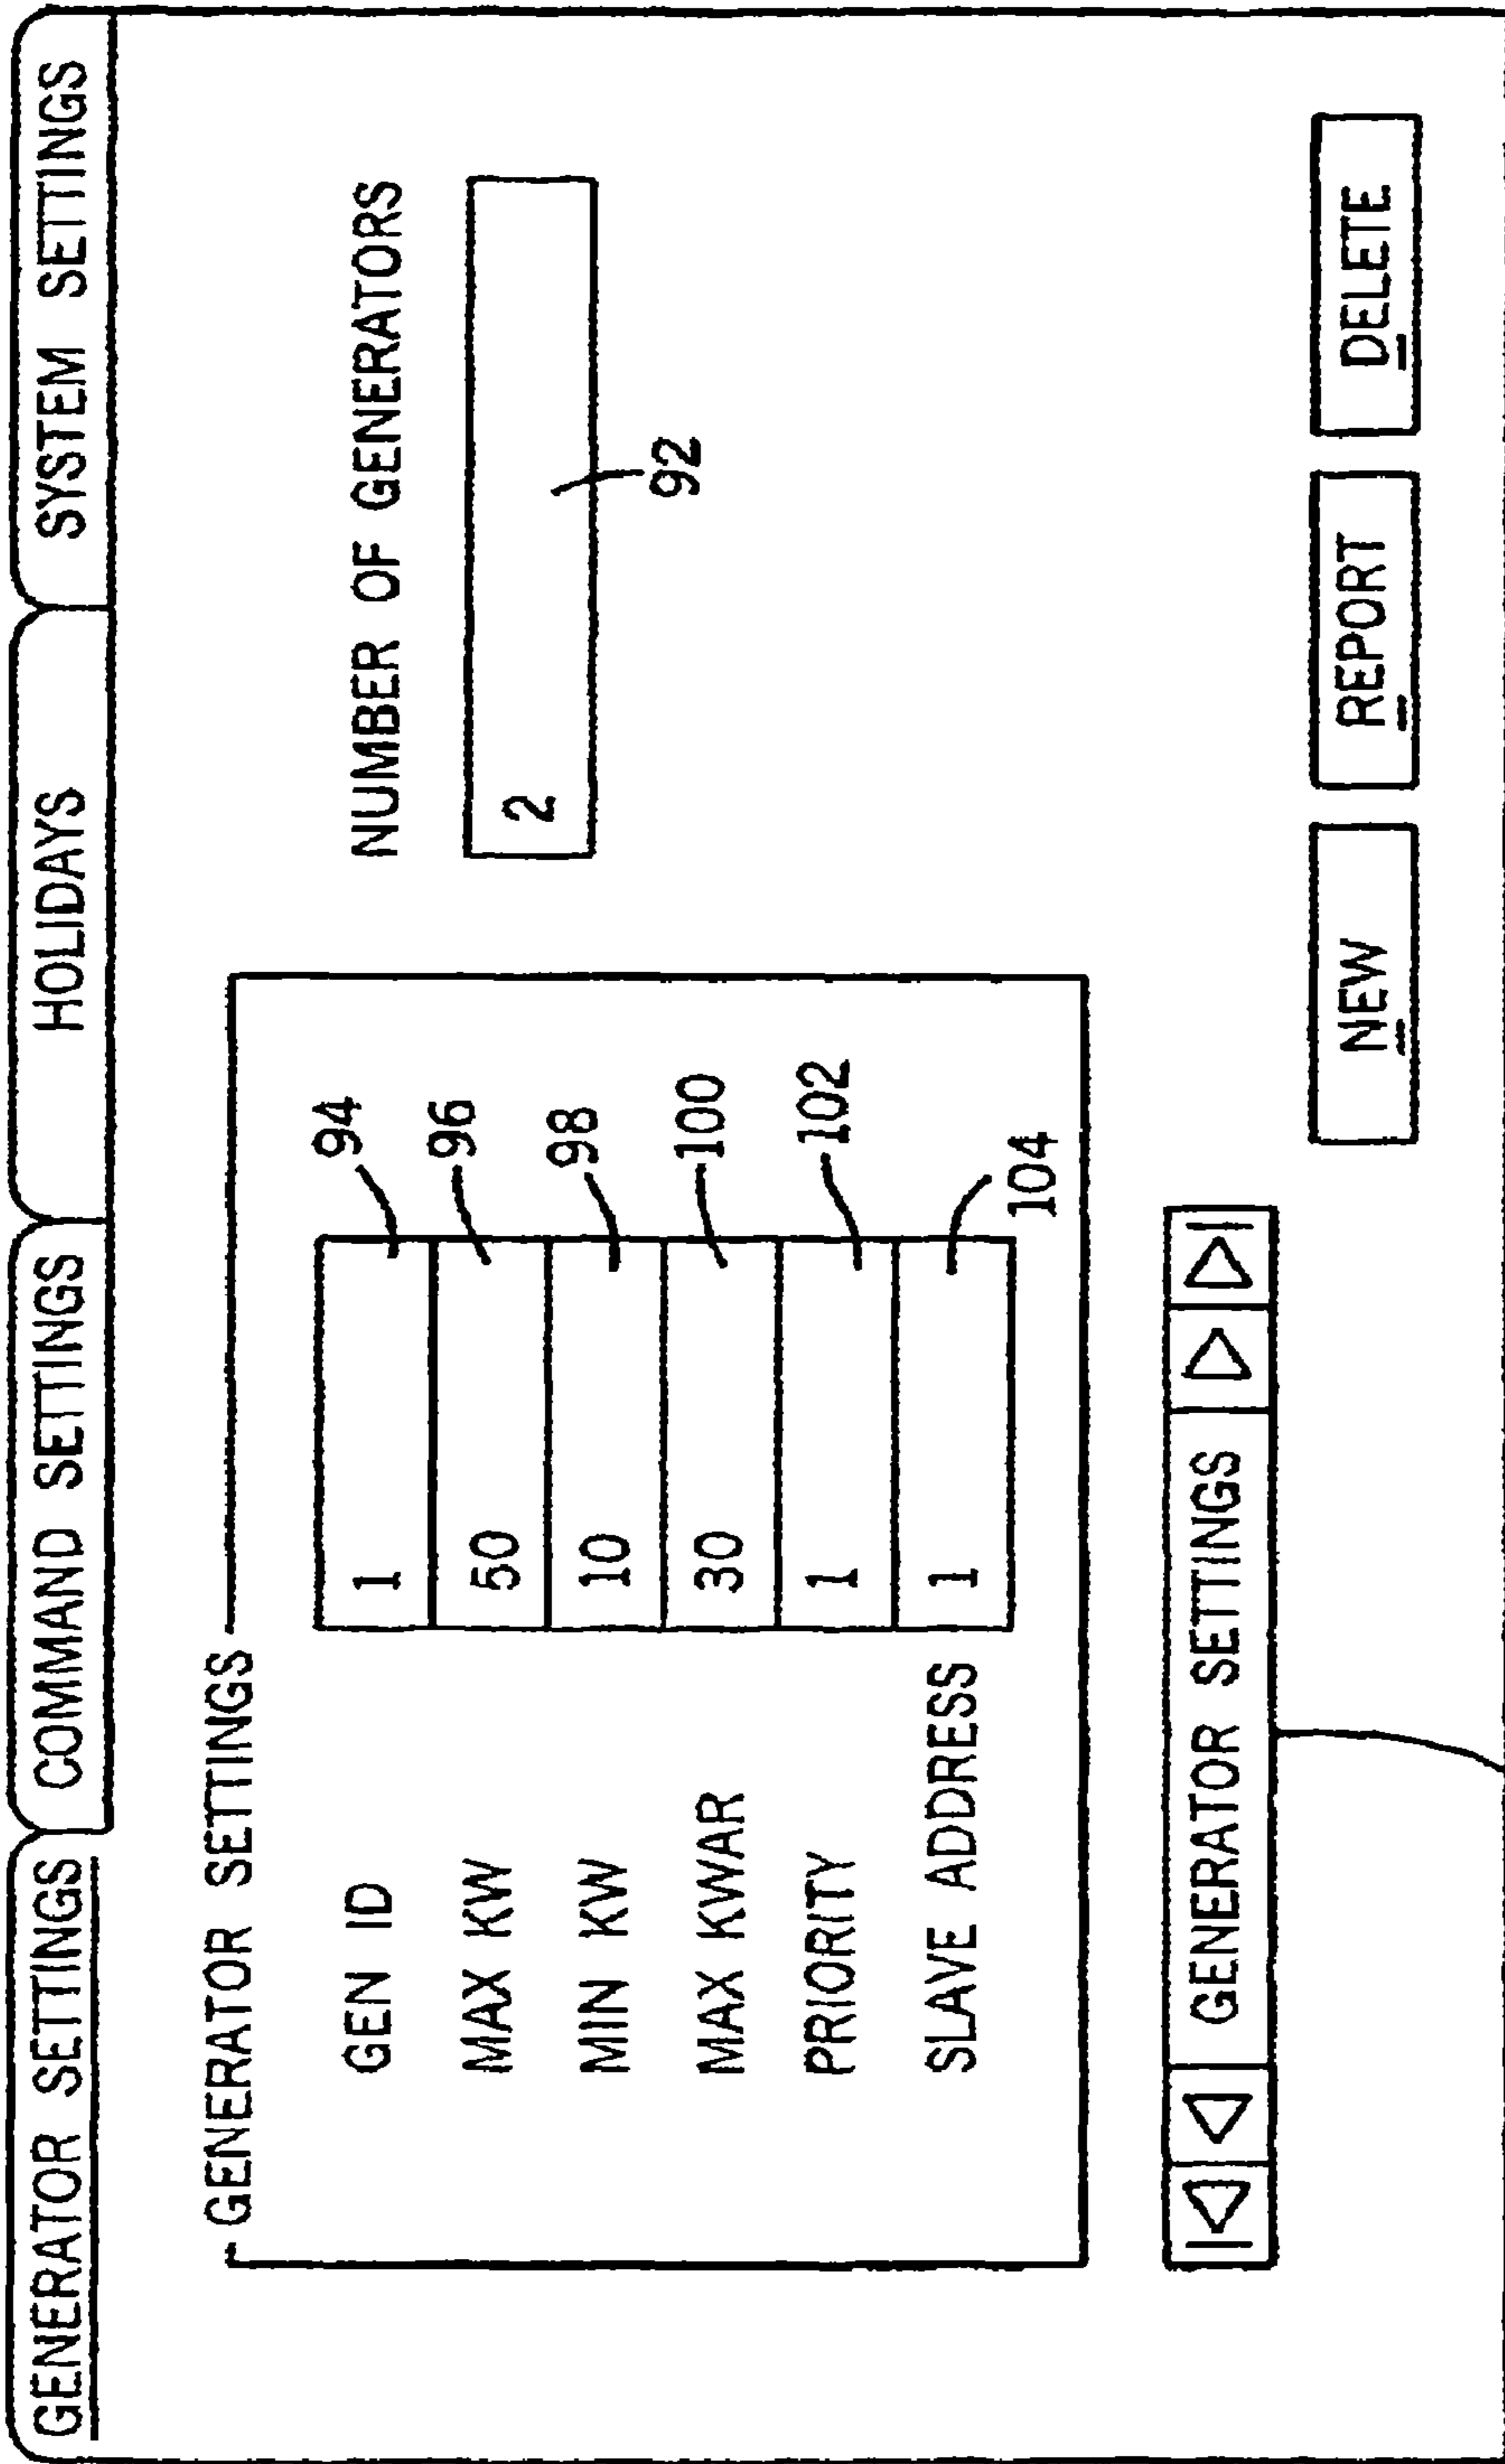


FIG. 6

GENERATOR SETTINGS COMMAND SETTINGS HOLIDAYS SYSTEM SETTINGS

COMMAND SETTINGS 108

COMMAND ID 50

COMMAND MODE BASE LOAD 110

50 112 1 DAY 114

JAN 116 MONTH 1 118 DAY

DEC 120 MONTH 30 122 DAY

8 124 HOUR 0 126 MIN

20 128 HOUR 0 130 MIN

132a HOLIDAY SU MO TU WE TH FRI SAT 132h

132b 132c 132d 132e 132f 132g

131

COMMAND SETTINGS < > >> >>>

NEW REPORT DELETE

106

FIG. 7

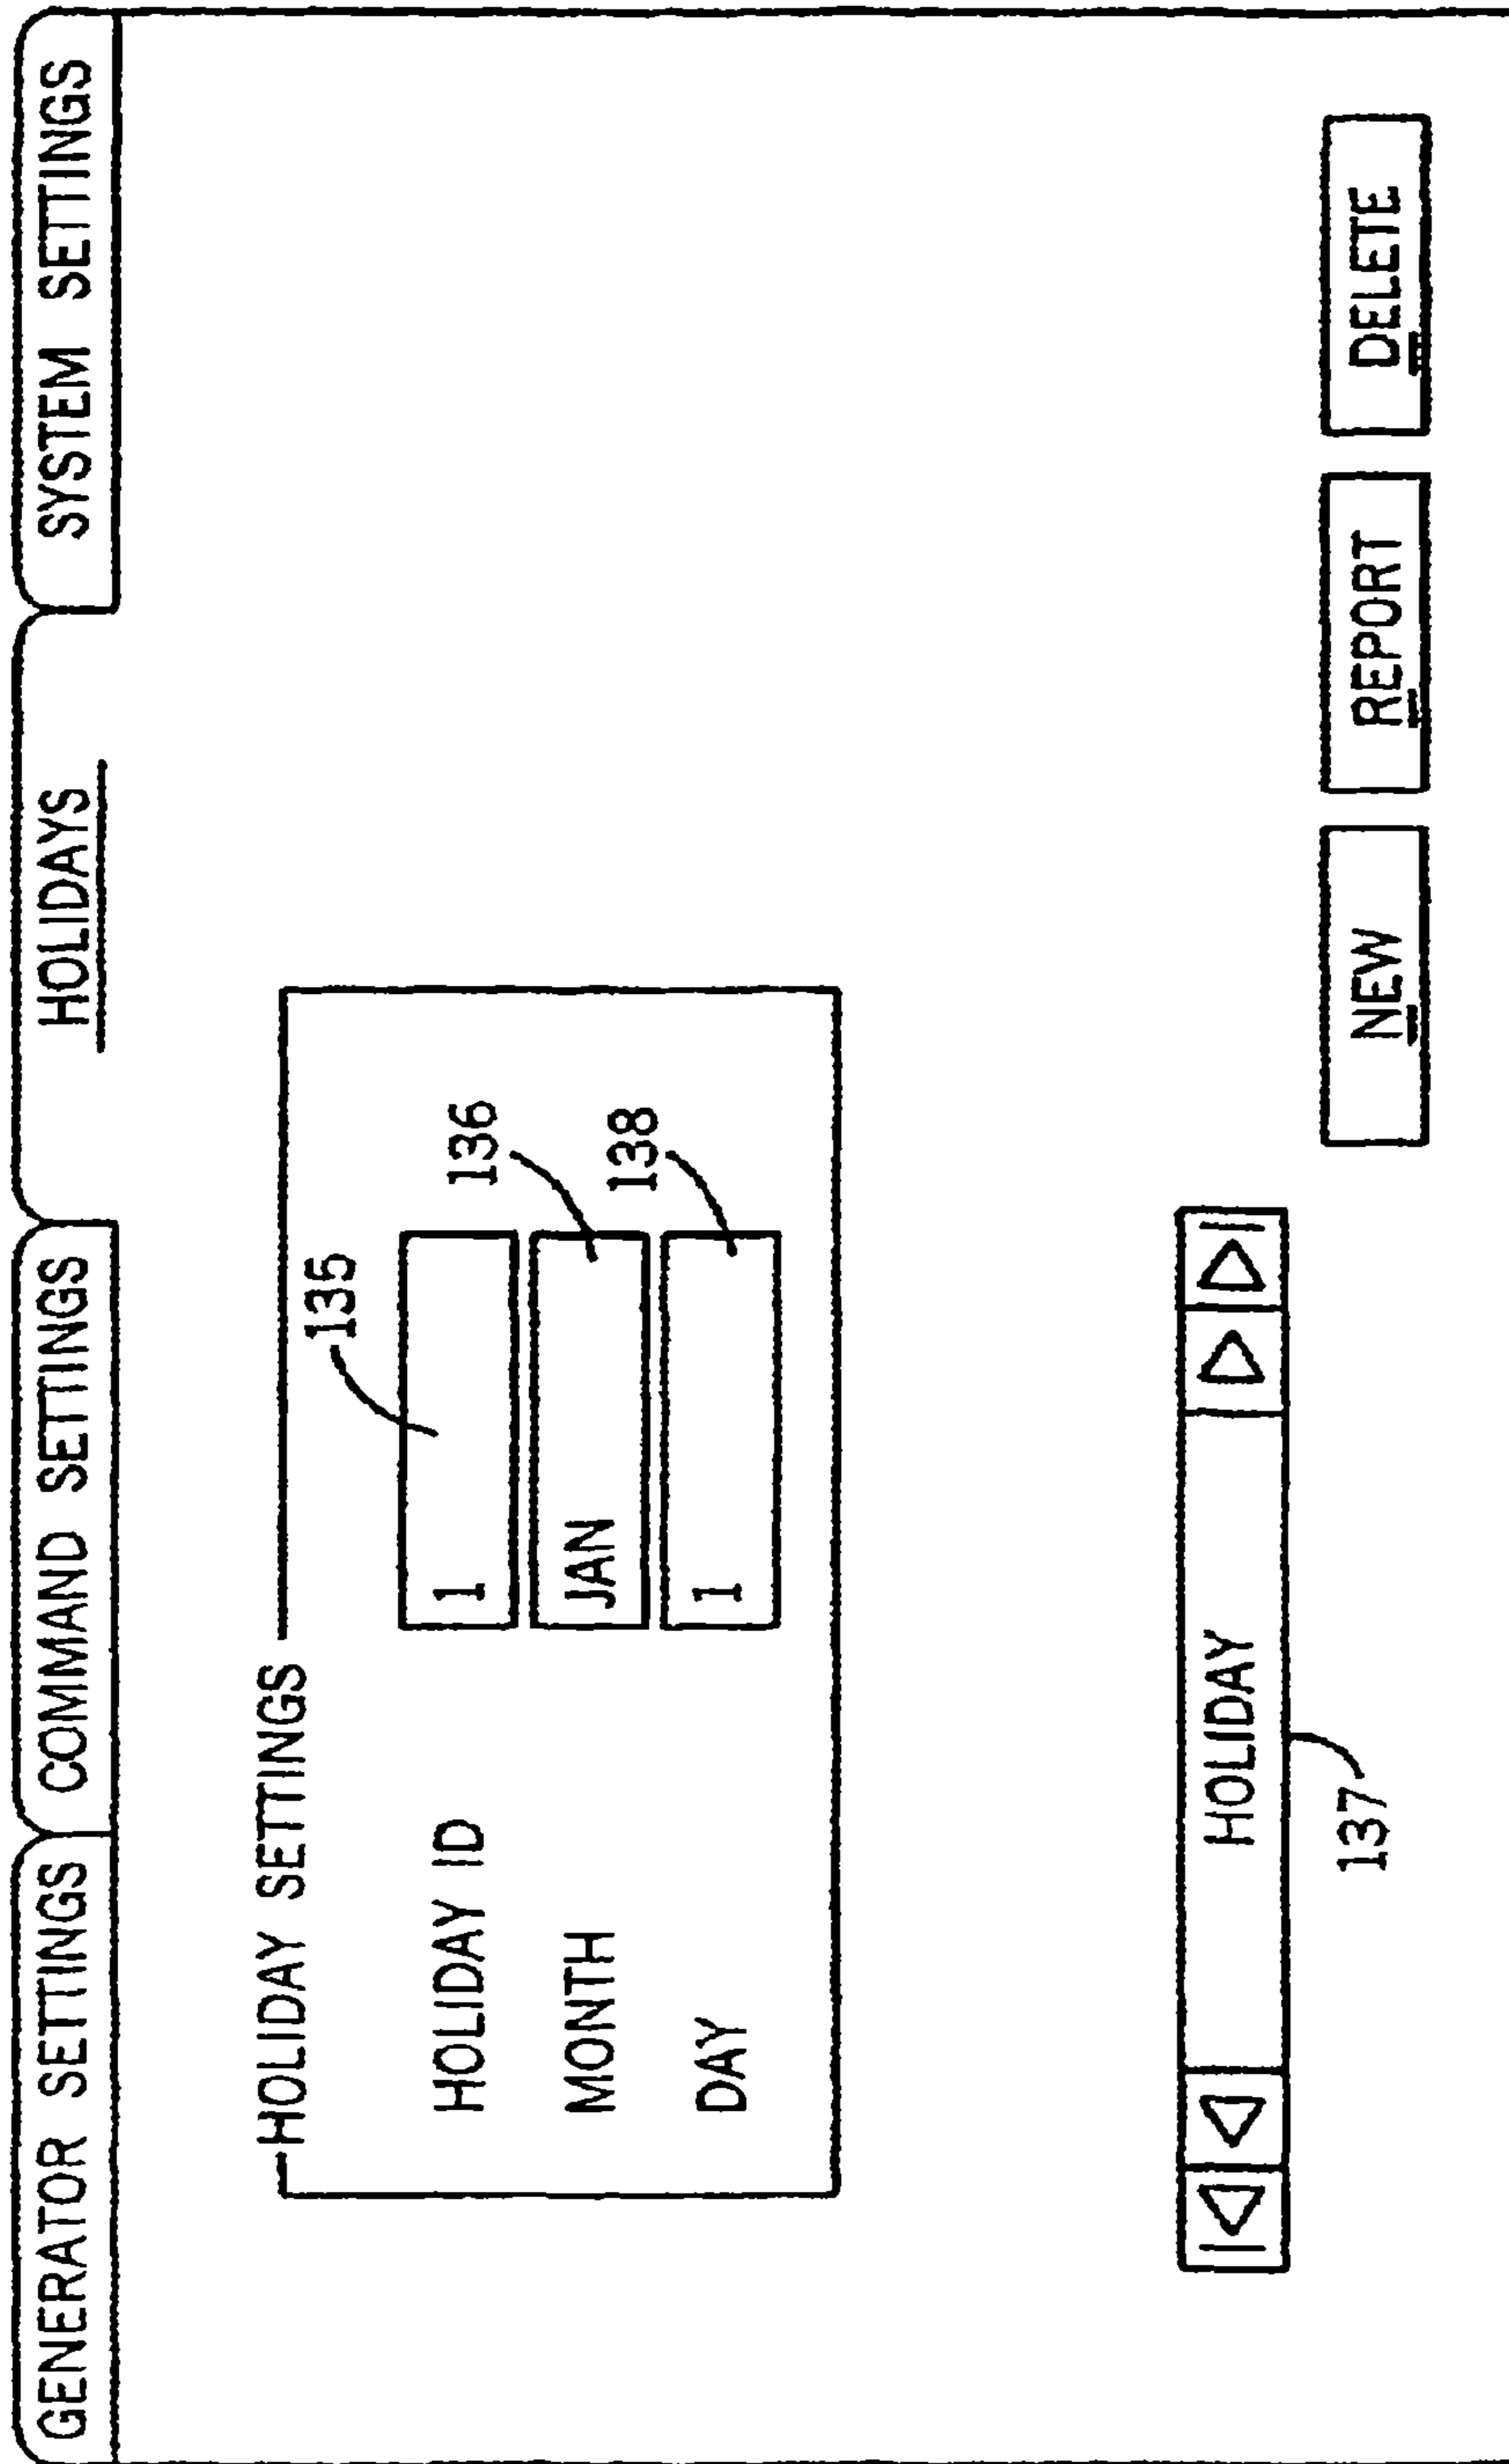


FIG. 8

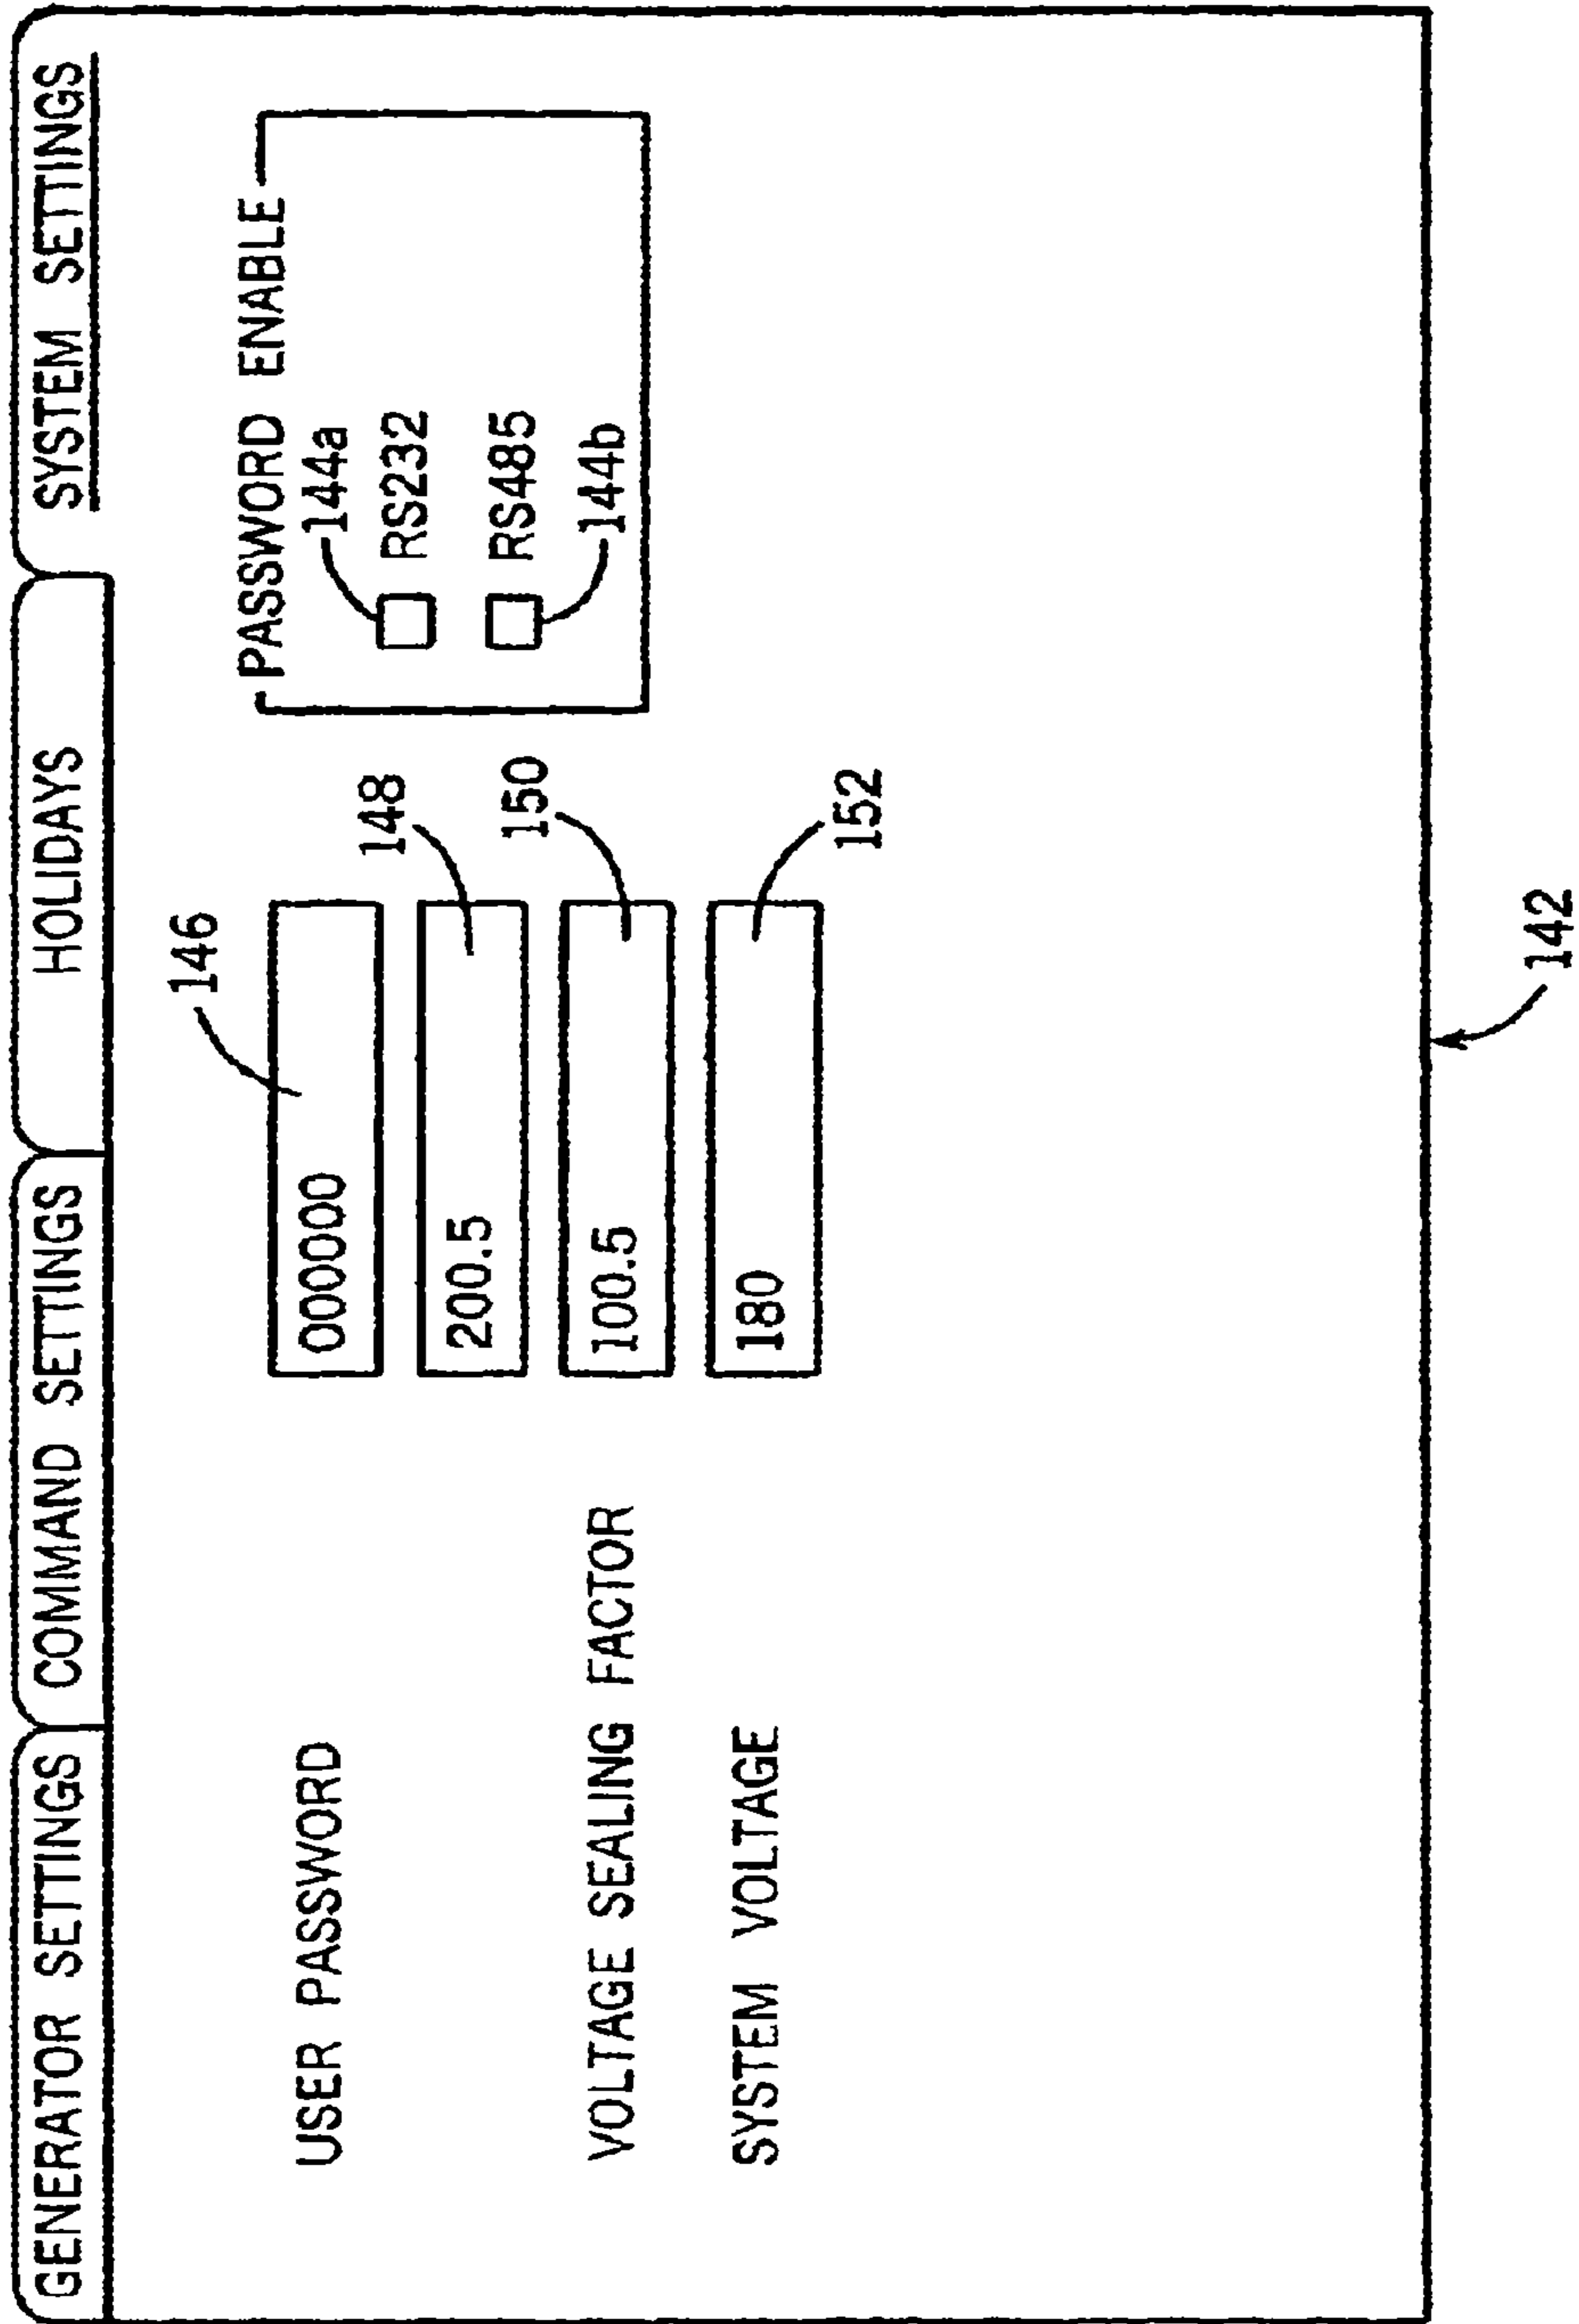


FIG. 9

The interface consists of two main parts. On the left is a calendar view for June 2000, showing days of the week (SUN to SAT) and dates (1 to 30). The date '5' is circled, and a label '156' points to this circled date. On the right is a date and time selection area with labels: MONTH, DAY, YEAR, WEEKDAY, HOUR, and MIN. Each label has a corresponding input field. The fields contain: MONTH (DEC 158), DAY (15 160), YEAR (00 162), WEEKDAY (FRI 164), HOUR (10 166), and MIN (10 168). Below these fields are two buttons: 'OK' and 'CANCEL'. A label '154' points to the entire right-hand section of the interface.

FIG. 10

1

**CONTROL SYSTEM FOR STAND-BY
ELECTRICAL GENERATOR**

Matter enclosed in heavy brackets [] appears in the original patent but forms no part of this reissue specification; matter printed in italics indicates the additions made by reissue.

FIELD OF THE INVENTION

This invention relates generally to engine driven, electrical generators, and in particular, to a control system for controlling operation of the engine and the electrical generator driven therewith.

BACKGROUND AND SUMMARY OF THE
INVENTION

Electrical generators are used in a wide variety of applications. As is conventional, electrical generators utilize a single driving engine coupled to a generator or alternator through a common shaft. Upon actuation of the engine, the crankshaft rotates the common shaft so as to drive the alternator which, in turn, generates electrical power.

Typically, an individual electrical generator operates in either a stand-by mode or a parallel mode. In the stand-by mode, the electrical power provided by a utility is monitored such that if the commercial electrical power from the utility fails, the engine of the electrical generator is automatically started causing the alternator to generate electrical power. When the electrical power generated by the alternator reaches a predetermined voltage and frequency desired by the customer, a transfer switch transfers the load imposed by the customer from the commercial power lines to the electrical generator.

Alternatively, in the parallel mode, the electrical generator supplies electrical power in parallel with the utility grid. As such, the electrical power generated by the electrical generator must be synchronized with the commercial electrical power supplied by the utility. Typically, multiple items such as governors, voltage regulators and the like are required to synchronize the electrical power generated by the electrical generator with the commercial electrical power supplied by the utility. This additional equipment is provided in separate cabinet units from the electrical generator itself, which adds significantly to the cost of the electrical generator.

Therefore, it is a primary object and feature of the present invention to provide an electrical generator incorporating a control system which controls operation of the electrical generator in a stand-by mode or a parallel mode.

It is a further object and feature of the present invention to provide an electrical generator which has the ability to supply electrical power to a load independent of the utility grid, or which may supply electrical power in parallel with the utility grid.

It is a still further object and feature of the present invention to provide an electrical generator which is simple to operate and less expensive to manufacture than prior electrical generators.

In accordance with the present invention, a control system is provided for controlling operation of an engine driven, electrical generator. The electrical generator generates AC power and AC voltage for a load. The AC power has a magnitude and a power factor and the AC voltage has a magnitude and a frequency. The control system includes a generator control operatively connected to the engine for controlling

2

operation thereof and operatively connected to the generator for controlling the AC power generated thereby. A communications link operatively connects the generator control to a network.

A user interface is operatively connected to the network. The user interface allows the user to communicate with the generator control so as to set predetermined operating parameters of the engine and the generator.

The control system may include a transfer switch having a first input connectable to a utility source for providing AC power, a second input operatively connected to the generator, and an output connectable to the load. The transfer switch is selectively movable between a first position connecting the utility source to the load and a second position connecting the generator to a load. The transfer switch is also operatively connected to the generator control such that the generator control controls movement of the transfer switch between the first and second positions.

It is contemplated to interconnect the load to a utility source which provides AC power having a magnitude and a power factor and AC voltage having a magnitude and a frequency. The control system includes a synchronizer for determining the magnitude and frequency of the AC voltage of the utility source and a magnitude and frequency of the AC voltage generated by the generator. The synchronizer is operatively connected to the generator control. The generator control varies the magnitude and frequency of the AC voltage generated by the generator to match the magnitude and frequency of the AC voltage provided by the utility source. A switch is operatively connected to the generator control and is movable between a first closed position for interconnecting the generator and the load and a second open position. The generator control moves the switch to the closed position in response to the magnitude and frequency of the AC voltage generated by the generator being generally equal to the magnitude and frequency of the AC voltage provided by the utility source.

The generator control may include a digital governor connectable to the engine for controlling the engine speed of the engine. The digital governor includes a throttle valve movable between a first opened position where the engine speed is at maximum and a second closed position where the engine speed is at minimum. The generator control may also include a volt-ampere-reactive (VAR) control for varying the power factor of the AC power generated by the generator to the predetermined level. In addition, the generator control includes a voltage regulator for controlling the magnitude of the AC voltage generated by the generator. An alarm system is connectable to the engine for monitoring various engine parameters. The alarm system communicates with the generator control and generates an alarm signal in response to a predetermined condition on the engine.

In accordance with a further aspect of the present invention, a generator structure is provided for generating AC power for a load. The generator structure includes a generator connectable to a load. The generator generates AC power having a magnitude and a power factor and an AC voltage having a magnitude and a frequency. An engine is operatively connected to the generator for driving the generator. The engine has an adjustable engine speed. A generator control is operatively connected to the engine for controlling operation thereof and is operatively connected to the generator for controlling AC power generated thereby. A communications link operatively connects the generator control to a network.

The generator structure may include a transfer switch having a first input connectable to a utility source for providing AC power, a second input operatively connected to the gen-

erator and an output connectable to the load. The transfer switch is selectively movable between a first position for connecting the utility source to the load and a second position for connecting the generator to the load. The transfer switch is operatively connected to the generator control such that the generator control controls movement of the transfer switch between first and second positions in response to AC power supplied by the utility source.

It is contemplated that the load be a utility source which provides AC power having a magnitude and a power factor and an AC voltage having magnitude and a frequency. The generator control includes a synchronizer for monitoring the magnitude and frequency of the AC voltage provided by the utility source and a magnitude and frequency of the AC voltage generated by the generator. The generator control varies the magnitude and frequency of the AC voltage generated by the generator to match the magnitude and frequency of the AC voltage of the utility source. The generator control may also include a volt-ampere-reactive (VAR) control for varying the power factor of the AC power generated by the generator.

A switch may be operatively connected to the generator control and be movable between a first closed position wherein the generator is connected to the utility source and a second open position. The generator control moves the switch to the closed position in response to the magnitude and frequency of the AC voltage generated by the generator being generally equal to the magnitude and frequency of the AC voltage provided by the utility source. The generator control includes a digital governor connected to the engine for controlling the engine speed of the engine. The digital governor includes a throttle valve which is movable between a first open position wherein the engine speed is at a maximum and a second closed position wherein the engine speed is at a minimum. A generator control includes a voltage regulator for regulating the magnitude of the AC voltage generated by the generator.

In accordance with a still further aspect of the present invention, a method is provided for providing AC power to a load. The method includes the steps of setting various operating parameters for a generator structure and transmitting the same to the generator structure over a network. AC power and AC voltage are generated with the generator structure in response to the various operating parameters set. The AC power has a magnitude and a power factor and the AC voltage has a magnitude and a frequency.

It is contemplated that the load be a utility source which provides AC power having a magnitude and a power factor and AC voltage having a magnitude and a frequency. The method includes the additional step of monitoring the magnitude and frequency of the AC voltage provided by the utility source and the magnitude and frequency of the AC voltage generated by the generator structure. The magnitude and frequency of the AC voltage generated by the generator structure is varied so as to match the magnitude and frequency of the AC voltage provided by the utility source. The generator structure and the utility source are interconnected in response to the magnitude and frequency of the AC voltage generated by the generator structure be generally equal to the magnitude and frequency of the AC voltage provided by the utility source.

In addition, the power factor of the AC power generated by the generator structure may be varied to a predetermined level and the AC voltage generated by the generator structure may be adjusted to a user selected magnitude.

BRIEF DESCRIPTION OF THE DRAWINGS

The drawings furnished herewith illustrate a preferred construction of the present invention in which the above advan-

tages and features are clearly disclosed as well as others which will be readily understood from the following description of the illustrated embodiment.

In the drawings:

FIG. 1 is a schematic view of a network system for controlling and managing the distribution of electrical power;

FIG. 2 is a schematic view of a first embodiment of a power generation system;

FIG. 3 is a schematic view of a second embodiment of a power generation system;

FIG. 4a is a schematic view of a generator structure for generating electrical power for the power generation system of FIG. 3;

FIG. 4b is a schematic view of the generator structure of FIG. 4a for the power generation system of FIG. 2;

FIG. 5 is a display screen for monitoring the supply and distribution of electrical power provided by the power generation systems of FIGS. 1 and 2;

FIG. 6 is a generator settings display screen for allowing the user to provide the generator settings for the generator structure of FIG. 4;

FIG. 7 is a command settings display screen for controlling the starting and stopping of the generator structure of FIG. 4;

FIG. 8 is a holiday settings display screen for allowing a user to specify days on which the generator structure of FIG. 4 is not operated;

FIG. 9 is a system setting display screen for allowing the user to specify the settings of the power generation system of FIGS. 2-3; and

FIG. 10 is a clock programming screen for allowing a user to program a day and a time for use with the screens of FIGS. 5-9.

DETAILED DESCRIPTION OF THE DRAWINGS

Referring to FIG. 1, a network control system for controlling and monitoring a plurality of power generation systems is generally generated by the reference numeral 10. Each of the power generation systems is generally designated by the reference numeral 12. Each power generation system includes system controller 14 operatively connected to a plurality of generator panels 16 by serial communications link 18. Each generator panel 16 is operatively connected to a corresponding generator 20a and 20b, as hereinafter described.

As best seen in FIGS. 4a-4b, generator panel 16 is operatively connected an engine 22 and a corresponding generator 20a or 20b. It can be appreciated that the following description of generator panel 16 operatively connected to generator 20a will be understood to describe a second generator panel 16 operatively connected to generator 20b, as if fully described herein. Engine 22 receives fuel such as natural gas or liquid propane vapor through an intake. The fuel provided to engine 22 is compressed and ignited within the cylinders thereof so as to generate reciprocating motion of the pistons of engine 22. The reciprocating motion of the pistons of engine 22 is converted to rotary motion by a crankshaft. The crankshaft is operatively coupled to generator 20a through shaft 28 such that as the crankshaft is rotated by operation of engine 22, shaft 28 drives generator 20a which, in turn, converts the mechanical energy by engine 22 to electrical power on output 31 of generator 20a for transmission and distribution.

Digital governor 26 is operatively connected to throttle 24 which controls the volume of intake air to engine 22. As is known, digital governor 26 protects engine 22 from over-speed conditions and maintains engine 22 at a desired engine speed which, in turn, causes generator 20a to generate a

desired electrical power at a desired frequency. Digital governor **26** controls the engine speed of engine **22** by regulating the position of throttle **24**, and hence, the amount of fuel and air provided to the combustion chamber of engine **22**. As is known, throttle **24** is movable between a wide-open position wherein engine **22** runs at full power and a closed position wherein engine **22** runs at minimum power. Generator control **42** controls operation of digital governor **26**, and hence, throttle **24**, as hereinafter described.

As is conventional, generator **20a** generates AC voltage having a magnitude and a frequency and AC current having a magnitude and a frequency. In alternating current power transmission and distribution, the cosine of the phase angle (θ) between the AC voltage and the AC current is known as the power factor. The AC power generated by generator **20a** may be calculated in according to the expression:

$$P=I \times V \times \cos \theta$$

wherein P is the AC power; I is the root means square of the AC current; and V is the root means square of the AC voltage.

The magnitude of the AC output voltage of generator **20a** is monitored by voltage regulator **30**. As is conventional, generator **20a** includes an armature winding or exciter which controls the magnitude of the AC output voltage of generator **20a**. Voltage regulator **30** acts to increase or decrease the excitation of the exciter of generator **20a** to the degree needed to maintain the magnitude of the AC output voltage at a desired value.

It is contemplated to operatively connect engine **22** and generator **20a** to an alarm system **32**. Alarm system **32** monitors various operating conditions of engine **22** and generator **20a** and provides a warning if any of the operating conditions fall outside normal operating levels. In addition, alarm system **32** is operatively connected to generator control **42** such that generator control **42** may shut down generator **20a** in response to certain, predetermined alarm conditions on engine **22** and/or generator **20a** so as to prevent damage to power generation system **12**.

Referring to FIGS. **2** and **4b**, it is contemplated to connect generators **20a** and **20b** to corresponding loads **34** and **36**, respectively, through corresponding transfer switches **38**. Each transfer switch **38** isolates the electrical power supplied by a utility on supply line **40** from the electrical power supplied at outputs **31** of corresponding generators **20a** and **20b**. Electrical power supplied on supply line **40** is monitored such that if the electrical power from the utility fails, engines **22** are started by generator controls **42**, FIG. **4b**, in a conventional manner. With engines **22** of power generation systems **12** started, generators **20a** and **20b** generate electrical power, as heretofore described. When the electrical power generated by generators **20a** and **20b** reaches the magnitude and frequency desired by the user, generator control **42** through transfer switch control **33** causes transfer switches **38** to transfer loads **34** and **36** from supply line **40** to corresponding outputs **31** of generators **20a** and **20b**, respectively. In response to restoration of electrical power on supply line **40** by the utility, generator controls **42** through transfer switch controls **33** cause transfer switches **38** to transfer loads **34** and **36** from outputs **31** of generators **20a** and **20b**, respectively, to supply line **40**. Thereafter, engines **22** are stopped by corresponding generator controls **42**. By stopping engines **22**, generators **20a** and **20b** no longer generate electrical power.

Alternatively, referring to FIGS. **3** and **4a**, in the event of a power outage, generators **20a** and **20b** may be put in parallel with each other in order to supply electrical power to load **74**. Generators **20a** and **20b** are put in parallel with each other by

connecting outputs **31** of generators **20a** and **20b** to supply line **40**. However, prior to connecting outputs **31** of generators **20a** and **20b** to supply line **40**, it is necessary to match the magnitude of the AC output voltage of generator **20a** with the magnitude of the AC output voltage of generator **20b**. In addition, the outputs of generators **20a** and **20b** must be synchronized. In order to synchronize the outputs of generators **20a** and **20b**, the phase sequences and the frequencies of the outputs of generators **20a** and **20b** must be identical. Once synchronized, generator control **42** through transfer switch control **33** causes transfer switches **44a** and **44b** to close such that outputs **31** of generators **20a** and **20b**, respectively, are coupled to supply line **40**. Thereafter, supply line **40** is connected to load **74**, as hereinafter described.

It is also contemplated to put generators **20a** and **20b** in parallel with the utility by connecting outputs **31** of generators **20a** and **20b** to the utility. In order to put generators **20a** and **20b** in parallel with the utility, it is necessary to match the magnitude of the AC output voltages of generators **20a** and **20b** with the magnitude of the AC voltage of the utility. In addition, the outputs of generators **20a** and **20b** must be synchronized with the utility. In order to synchronize the outputs of generators **20a** and **20b** with the utility, the phase sequences and the frequencies of the outputs of generators **20a** and **20b** must be identical in phase and frequency with the utility.

Referring back to FIGS. **4a** and **4b**, by way of example, voltage matching is accomplished by voltage regulators **30** of generator panels **16**. Each voltage regulator **30** is supplied with the magnitude of the AC voltage provided by the utility, as hereinafter described, and thereafter, raises or lowers the AC voltage provided by corresponding generators **20a** or **20b** to precisely match the magnitude of the AC voltage provided by the utility under the control of corresponding generator controls **42** of generator panels **16**. As such, it is contemplated to operatively connect generator controls **42** of generator panels **16** to supply line **40** to monitor the utility. Synchronization is achieved by increasing or decreasing the engine speed, as heretofore described, such that phase sequence and the frequency of the AC outputs of generators **20a** and **20b** are identical to the phase and frequency supplied by the utility. Synchronizers **35** monitor the AC power provided by the utility and provide such information to corresponding generator controls **42**. Once synchronization is achieved, transfer switches **44a** and **44b** are closed by generator controls **42** through transfer switch controls **33** such that outputs **31** of generators **20a** and **20b**, respectively, are coupled to supply line **40**. Thereafter, supply line **40** is connected to the utility, as hereinafter described.

When generators **20a** and **20b** are connected in parallel with the utility, the AC output voltages of generators **20a** and **20b** cannot be varied by excitation of corresponding exciters of generators **20a** and **20b**. Excitation of exciters of generators **20a** and **20b** controls the power factors of the electrical power supplied by generators **20a** and **20b** to the utility. As such, the excitation of exciters of generators **20a** and **20b** when generators **20a** and **20b** are connected in parallel with the utility is known as volt-ampere-reactance (VAR) control, block **50**.

Further, when generators **20a** and **20b** are connected in parallel with the utility, the opening and closing of throttles **24** by digital governors **26** does not change the engine speeds of corresponding engines **22**. The opening and closing of throttles **24** increases the AC power supplied to the utility by generators **20a** and **20b**. As such, the opening and closing of throttles **24** when generators **20a** and **20b** are connected in parallel with the utility is known as power control, block **52**.

Generator controls **42** of the generator panels **16** are operatively connected to serial communications link **18** by communication interfaces **56**. In the preferred embodiment, each communication interface **56** is a RS485. Referring to FIGS. **2** and **3**, serial communications link **18** allows system controller **14** to communicate with generator controls **42** of generator panels **16**. System controller **14** includes a microcontroller and a visual display. The microcontroller executes a software program which is displayed on the visual display of system controller **14**. The software program allows a user to monitor the electrical power supplied by the utility; to monitor various operating conditions of the engines and generators of the power generation systems **12**; and to control various operating parameters of power generation systems **12**.

Referring to FIG. **3**, in a first embodiment, system controller **14** is operatively connected by line **58** to the utility to monitor the utility and to measure the voltage and current provided by the utility. In addition, system controller **14** is operatively connected by line **59** to supply line **40** to monitor the electrical power supplied by generators **20a** and **20b**. System controller **14** is also operatively connected to switches **61** and **63** by lines **65** and **67** in order to control the opening and closing of switches **61** and **63**, for reasons hereinafter described. In an alternate embodiment, FIG. **2**, system controller **14** is connected by line **69** to the utility to monitor the utility and to measure the voltage and current provided by the utility.

The magnitudes of the voltage and current provided by the utility are displayed on display screen **60**, FIG. **5**. Display screen **60** includes voltage display **62** for displaying the magnitude of the rms voltage provided by the utility and current display **64** for displaying the magnitude of the rms current provided by the utility. System controller **14** calculates the power supplied by the utility and power factor of the power supplied and displays the same on display screen **60** at power display **66** and power factor display **68**, respectively.

Display screen **60** also includes utility icon **70** representing the utility, load icon **72** representing load **74**, and generator icons **76** and **78** representing corresponding generators **20a** and **20b**, respectively. Generator power displays **80** and **82** are positioned adjacent corresponding generator icons **76** and **78**, respectively, to display the power and power factor of the outputs of generators **20a** and **20b**. In addition, the total power provided by generators **20a** and **20b** is displayed by total power display **84**. Display screen **60** also includes a time display **86** for displaying the date and time, as well as, power connections having switch icons **88a-d** therein which represent the states of switches **61**, **63**, **44a** and **44b**, respectively, of FIG. **3**.

System controller **14** further includes generator settings screen **90**, FIG. **6**, for allowing a user to input a plurality of settings for generators **20a** and **20b**. Generator setting screen **90** includes number-of-generators input **92** for allowing a user to input the number of generators connected to communications link **18**. In addition, generator setting screen **90** includes inputs for identifying the generator (either generator **20a** or generator **20b**) for which the settings on the generator settings screen pertain **94**; the maximum kilowatts produced by the identified generator **96**; the recommended minimum kilowatts for efficient operation of the identified generator **98**; the maximum power which may be produced by the identified generator in volt-ampere-reactance **100**; the priority of operation of the identified generator as compared to the other generators of the power generation system **102**; and a slave address for the generator control **42** of generator panel **16** for

the identified generator **104**. Generator settings scroll bar **105** is provided for allowing a user to scroll through the settings for each generator.

Referring to FIG. **7**, system controller **14** further includes a command settings screen generally designated by the reference numeral **106**. Command settings screen **106** allows a user to input various parameters for starting and stopping generators **20a** and **20b**. Command settings screen **106** includes inputs for identifying: a command (by number) for operation of the generators (either generator **20a** and generator **20b**) **108**; a mode the user desires the generators to operate during a prescribed time period **110**; the maximum kilowatts to be produced by the generators or consumed from the utility during the prescribed time period depending on the mode selected by the user **112**; and a user selected limit for the power factor of the electrical power produced by the generators or consumed from the utility during the prescribed time period depending on the mode selected by the user **114**.

Command setting screen **106** also includes inputs for identifying the prescribed time period for which a user desires the generators to operate under the identified command. These inputs include a month **116** and a day **118** for starting the identified generator and a month **120** and a day **122** for stopping the generators. Inputs are also provided for an hour **124** and a minute **126** for starting the generators on each day for which the generators are intended to operate and an hour **128** and a minute **130** for stopping the generators on each day for which the generators are intended to operate. Inputs are also provided for identifying specific days of the week and holidays **132a-h** during the prescribed time period for which the generators are intended not to operate. Command scroll bar **131** is provided for allowing the user to scroll through each command.

Referring to FIG. **8**, system controller **14** further includes a holiday screen generally designated by the reference numeral **134**. Holiday screen **134** includes inputs for a user: to identify holidays (by number) on which generators **20a** and **20b** will not be operational **135**; and to specify a month **136** and a day **138** for each holiday identified. Holiday scroll bar **137** is provided for allowing the user to scroll through each holiday identified.

As best seen in FIG. **9**, system controller **14** includes a system settings screen generally designated by the reference numeral **142**. System settings screen **142** includes inputs for a user: to specify if a password is needed **144a** to connect system controller **14** to network **172**, for reasons hereinafter described, and if a password is needed **144b** to interconnect system controller **14** to serial communications link **18**; to specify a password **[146]** which must be entered by a user *at input 146* to gain access to screens of FIGS. **6-10**; to specify a current transformer ratio which steps down the current provided by utility so as to allow such current to be measured by the ammeter of system controller **14**; to specify a voltage scaling factor to calibrate the volt meter which measures the voltage provided by the utility **150**; and to specify a system voltage **152** to be generated by power generation system **12** (typically, the utility voltage).

Referring to FIG. **10**, a clock-programming screen is generally designated by the reference numeral **154**. Clock programming screen **154** includes a scrollable calendar display **156** for displaying a calendar to a user. In addition, the clock-programming screen **154** includes inputs for allowing a user to specify the month **158**, the day of the month **160**, the year **162**, the weekday **164**, the hour **166** and the minute **168**. The day and time inputted on clock-programming screen **154** are displayed by time display **86** on display screen **60**.

In operation, for each power generation system 12, generator panels 16 and system controller 14 are connected to a common serial communications link 18. Initially, a user inputs a plurality of settings for generators 20a and 20b on generator settings screen 90 and the various parameters for starting and stopping generators 20a and 20b on command settings screen 106 of system controller 14, as heretofore described. In addition, the user enters the inputs heretofore described on holiday screen 134, system settings screen 142, and clock programming screen 154 of system controller 14. Thereafter, in order to gain access to the various screens of system controller 14, the user is prompted to enter the password provided at input 146 of system settings screen 142. After obtaining access to the various screens of system controller 14, the user may monitor power generation system 12 and/or may vary the inputs, as heretofore described.

With respect to power generation systems 12 of FIGS. 1-2 and 4b, system controller 14 monitors the electrical power supplied to supply line 40 by the utility. The magnitude of the rms voltage provided by the utility and the magnitude of the rms current provided by the utility are displayed on display screen 60, FIG. 5. In addition, the power supplied by the utility and power factor of the power supplied are displayed on display screen 60. Further, display screen 60 displays the date and time, as well as, the power connections of power generation system 12.

If the electrical power from the utility fails, generator controls 42 of generator panels 16 start engines 22 such that generators 20a and 20b generate electrical power, as heretofore described. When the electrical power generated by generators 20a and 20b reaches the magnitude and frequency desired by the user, transfer switches 38 transfer loads 34 and 36 from supply line 40 to corresponding outputs 31 of generators 20a and 20b, respectively. The power and power factor of the outputs of generators 20a and 20b, as well as, the total power provided by generators 20a and 20b to loads 34 and 36, respectively, are displayed on display screen 60. Display screen 60 also updates the power connections of power generation system 12.

In response to restoration of electrical power on supply line 40 by the utility, generator controls 42 of generator panels 16 cause transfer switches 38 to transfer loads 34 and 36 from outputs 31 of generators 20a and 20b, respectively, to the utility connected to supply line 40. Thereafter, generator controls 42 stop corresponding engines 22 such that generators 20a and 20b no longer generate electrical power.

Alternatively, generators 20a and 20b may be placed in parallel with a utility by connecting outputs 31 of generators 20a and 20b to the utility through supply line 40. As heretofore described, in order to put generators 20a and 20b in parallel with the utility, it is necessary to match the magnitudes of the AC output voltages of generators 20a and 20b with the magnitude of the AC voltage of the utility. In addition, the outputs of generators 20a and 20b must be synchronized with the utility such that the phase sequences and the frequencies of the outputs of generators 20a and 20b are identical in phase and frequency with the utility.

Once the outputs of generators 20a and 20b are synchronized with the utility and the magnitudes of the AC output voltages of generators 20a and 20b match of the AC voltage of the utility, generator controls 42 of generator panels 16 cause transfer switches 38 to close such that loads 34 and 36 are operatively connected to the utility through supply line 40 and to outputs 31 of generators 20a and 20b, respectively. The AC power and power factor provided by generators 20a and 20b, as well as, the total power provided by generators 20a and 20b, respectively, are displayed on display screen 60.

Display screen 60 also updates the power connections of power generation system 12. It can be appreciated that generator controls 42 of generator panels 16 control the power factors of the electrical power supplied by corresponding generators 20a and 20b and the AC power supplied by generators 20a and 20b, as heretofore described, in accordance with the inputs provided by a user on command settings screen 106.

Referring to the embodiment of FIGS. 3 and 4a in the event of a power outage, system controller 14 advises each of generator controls 42 of generator panels 16 accordingly. Generator controls 42 of generator panels 16 start engines 22 such that generators 20a and 20b generate electrical power, as heretofore described. When the electrical power generated by generators 20a and 20b reaches the magnitude and frequency desired by the user, transfer switches 44a and 44b close so as to connect supply line 40 to corresponding outputs 31 of generators 20a and 20b, respectively. Thereafter, system controller 14 opens switch 61 and closes switch 63 in order to connect supply line to load 74, and to hence, transfer load 74 from the utility to generators 20a and 20b. The power and power factor provided by generators 20a and 20b, as well as, the total power provided by generators 20a and 20b to load 74, are displayed on display screen 60. Display screen 60 also updates the power connections of power generation system 12.

In response to restoration of electrical power by the utility, system controller 14 advises generator controls 42 of generator panels 16 accordingly. Thereafter, system controller 14 closes switch 61 and opens switch 63 in order to connect the utility to load 74. In addition, generator controls 42 of generator panels 16 open transfer switches 44a and 44b so as to disconnect the outputs 31 of generators 20a and 20b, respectively, from supply line 40. Generator controls 42 stop corresponding engines 22 such that generators 20a and 20b no longer generate electrical power, or alternatively, system controller 14 returns to operating generators 20a and 20b, as provided by a user on command setting screen 106. Display screen 60 updates the information displayed thereon accordingly.

Alternatively, generators 20a and 20b may be placed in parallel with the utility by connecting outputs 31 of generators 20a and 20b to the utility through supply line 40. As heretofore described, in order to put generators 20a and 20b in parallel with the utility, it is necessary to match the magnitudes of the AC output voltages of generators 20a and 20b with the magnitude of the AC voltage of the utility. In addition, the outputs of generators 20a and 20b must be synchronized with the utility such that the phase sequences and the frequencies of the outputs of generators 20a and 20b are identical in phase and frequency with the utility.

Once the outputs of generators 20a and 20b are synchronized with the utility and the magnitudes of the AC output voltages of generators 20a and 20b match of the AC voltage of the utility, transfer switches 44a and 44b close such that outputs 31 of generators 20a and 20b are connected to supply line 40. Thereafter, system controller 14 closes switch 63 in order to connect supply line 40 to the utility and to load 74. The power and power factor provided by generators 20a and 20b, as well as, the total power provided by generators 20a and 20b to load 74, are displayed on display screen 60. Display screen 60 also updates the power connections of power generation system 12.

It is contemplated that system controller 14 incorporate a load shedding feature such that if the electrical power from the utility fails and if the plurality of generators in power generation system 12 are inadequate to provide sufficient

11

electrical power to support load **74**, system controller **14** may disconnect a portion of load **74** from supply line **40**. A circuit breaker with a shunt trip is provided in series with portions of load **74**. If the electrical power from the utility fails, system controller **14** trips the circuit breaker and removes a corresponding portion of load **74** from the system. It is contemplated that multiple load shedding relays be provided and the system controller **14** only shed such portion of load **74** as necessary to allow the generators of power generation system **12** to provide adequate electrical power to the load. By way of example, if one or more of the plurality of electrical generators of power generation system **12** are off line, additional portions of the load may be shed in order to for the generators in operation to provide adequate electrical power to load **74**.

Referring back to FIG. **1**, it is contemplated that network system **10** include a network controller **170** which is operatively connected to a communication network **172** such as a telephone network, a computer network, the internet, or a combination for communication thereon. Network controller **170** includes a microprocessor and one or more visual displays. It is further contemplated to interconnect systems controller **14** to *the communication* network **172**, as heretofore described. It is contemplated that the microcontroller of network controller **[172]** **170** execute a software program so as to allow a user to access each system controller **14** and selectively display the screens, FIGS. **5-10** of the selected system controller **14** on the visual display of the network controller **170**. As such, the network system **10** allows for a single user to monitor several power generation systems **12** from a single locale and to control operation of these power generation systems **12** in the heretofore described. Consequently, a user is able to view the current operating conditions of each of the power generation systems **12**, as well as, configure system controllers **14** from the remote locale. In addition, the user can obtain detailed information from individual generators **20a** and **20b** from the remote locale.

Various modes of carrying out the invention are contemplated as being within the scope of the following claims particularly pointing out and distinctly claiming the subject matter which is regarded as the invention.

We claim:

1. A control system for controlling operation of an engine-driven, electrical generator which generates AC power and AC voltage having a magnitude and a frequency for a load, the load being operatively connected to a utility source which provides AC power having a magnitude and power factor and AC voltage having a magnitude and a frequency thereto, and the engine having an adjustable engine speed, comprising:
 a generator control operatively connected to the engine for controlling operation thereof and operatively connected to the generator for controlling the AC power generated thereby;
 a synchronizer operatively connected to **[a]** *the* generator control, the synchronizer monitoring the magnitude and frequency of the AC voltage of the utility source and the magnitude and frequency of the AC voltage generated by the generator; and
 a communications link for operatively connecting the generator control to a network;
 wherein the generator control adjusts the magnitude of the AC voltage generated by the generator and adjusts the engine speed of the engine to vary the frequency of the AC voltage generated by the generator such that the magnitude and frequency of the AC voltage generated by the generation matches the magnitude and frequency of the AC voltage of the utility source.

12

2. The control system of claim **1** further comprising a user interface operatively connected to the network, the user interface allowing a user to communicate with *the* generator control so as to set predetermined operating parameters of the engine and the generator.

3. The control system of claim **1** further comprising a transfer switch having a first input connectable to the utility source for providing AC power, a second input operatively connected to the generator, and an output connectable to an alternate load, the transfer switch is selectively movable between a first position connecting the utility source to the alternate load and a second position connecting the generator to the alternate load.

4. The control system of claim **3** wherein the transfer switch is operatively connected to the generator control such that the generator control controls movement of the transfer switch between the first and second positions.

5. The control system of claim **1** further comprising a switch operatively connected to the generator control and being movable between a first closed position for interconnecting the generator and the load and a second open position, the generator control moving the switch to the closed position in response to the magnitude and frequency of the AC voltage generated by the generator being generally equal to the magnitude and frequency of the AC voltage provided by the utility source.

6. The control system of claim **1** wherein the generator control includes a digital governor connectable to the engine for controlling the engine speed of the engine.

7. The control system of claim **6** wherein the digital governor includes a throttle valve, the throttle valve movable between a first open position wherein the engine generates maximum AC power and a second closed position wherein the engine generates minimum AC power.

8. The control system of claim **1** wherein the generator control includes a voltage regulator for controlling the magnitude of the AC voltage generated by the generator.

9. The control system of claim **1** further comprising an alarm system connectable to the engine for monitoring various engine parameters, the alarm system communicating with the generator control and generating an alarm signal in response to a predetermined condition on the engine.

10. A generator structure for generating AC power for a load, the load including a utility source which provides AC power having a magnitude and power factor and AC voltage having a magnitude and frequency, comprising:

a generator connectable to the load, the generator generating AC power having a magnitude and a power factor and AC voltage having a magnitude and a frequency;

an engine operatively connected to the generator for driving the generator, the engine having an adjustable engine speed;

a generator control operatively connected to the engine for controlling operation thereof and operatively connected to the generator for controlling the AC power generated thereby, the generator control including a synchronizer for monitoring the magnitude and frequency of the AC voltage provided by the utility source and the magnitude and frequency of the AC voltage generated by the generator wherein the generator control adjusts the magnitude of the AC voltage generated by the generator and adjusts the engine speed of the engine to vary the frequency of the AC voltage generated by the generator such that the magnitude and frequency of the AC voltage generated by the generator the magnitude and frequency of the AC voltage of the utility source; and

13

a communications link for operatively connecting the generator control to a network.

11. The generator structure of claim 10 further comprising a transfer switch having a first input connectable to a utility source for providing AC power, a second input operatively connected to the generator, and an output connectable to an alternate load, the transfer switch selectively movable between a first position for connecting the utility source to the alternate load and a second position for connecting the generator to the alternate load.

12. The generator structure of claim 11 wherein the transfer switch is operatively connected to the generator control such that the generator control controls movement of the transfer switch between the first and second positions in response to the AC power supplied by the utility source.

13. The generator structure of claim 10 further comprising a switch operatively connected to the generator control and being movable between a first closed position wherein the generator is connected to the utility source and a second open position, the generator control moving the switch to the closed position in response to the magnitude and frequency of the AC voltage generated by the generator being generally equal to the magnitude and frequency of the AC voltage provided by the utility source.

14. The generator structure of claim 10 wherein the generator control includes a digital governor connectable to the engine for controlling the engine speed of the engine.

15. The generator structure of claim 14 wherein the digital governor includes a throttle valve, the throttle valve movable between a first open position wherein the engine generates maximum AC power and second closed position wherein the engine generates minimum AC power.

16. The generator structure of claim 10 wherein the generator control includes a voltage regulator for regulating the magnitude of the AC voltage generated by the generator.

17. A control system for controlling operation of an engine-driven, electrical generator which generates AC power and AC voltage having a magnitude and a frequency for a load, the load being operatively connected to a utility source which provides AC power having a magnitude and power factor and AC voltage having a magnitude and a frequency thereto, and the engine having an adjustable engine speed, comprising:

a generator control operatively connected to the engine for controlling operation thereof and operatively connected to the generator for controlling the AC power generated thereby, the generator control including a volt-ampere-reactive (VAR) control for varying the power factor of the AC power generated by the generator to a predetermined value;

a synchronizer operatively connected to [a] the generator control, the synchronizer monitoring the magnitude and frequency of the AC voltage of the utility source and the magnitude and frequency of the AC voltage generated by the generator; and

a communications link for operatively connecting the generator control to a network;

wherein the generator control varies the magnitude and frequency of the AC voltage generated by the generator to match the magnitude and frequency of the AC voltage of the utility source.

14

18. A generator structure for generating AC power for a load, the load including a utility source which provides AC power having a magnitude and power factor and AC voltage having a magnitude and frequency, comprising:

a generator connectable to the load, the generator generating AC power having a magnitude and a power factor and AC voltage having a magnitude and a frequency;

an engine operatively connected to the generator for driving the generator, the engine having an adjustable engine speed;

a generator control operatively connected to the engine for controlling operation thereof and operatively connected to the generator for controlling the AC power generated thereby, the generator control including a volt-ampere-reactive (VAR) control for varying the power factor of the AC power generated by the generator;

the generator control including a synchronizer for monitoring the magnitude and frequency of the AC voltage provided by the utility source and the magnitude and frequency of the AC voltage generated by the generator such that the generator control the magnitude and frequency of the AC voltage generated by the generator the magnitude and frequency of the AC voltage of the utility source; and

a communications link for operatively connecting the generator control to a network.

19. A method of providing AC power to a load, the load including a utility source which provides AC power having a magnitude and a power factor and an AC voltage having a magnitude and a frequency, comprising the steps of:

setting various operating parameters for a generator structure and transmitting the same to the generator structure over a network; and

generating AC power and AC voltage with a generator structure in response to the various operating parameters set, the AC power having a magnitude and a power factor and the AC voltage having a magnitude and a frequency; monitoring the magnitude and the frequency of the AC voltage provided by the utility source and the magnitude and the frequency of the AC voltage generated by the generator structure;

varying the magnitude and the frequency of the AC voltage generated by the generator structure to match the magnitude and the frequency of the AC voltage provided by the utility source, and

interconnecting the generator structure to the utility source in response to the magnitude and the frequency of the AC voltage generated by the generator structure being generally equal to the magnitude and the frequency of the AC voltage provided by the utility source.

20. The method of claim 19 comprising the additional step of varying the power factor of the AC power generated by the generator structure to a predetermined value.

21. The method of claim 19 comprising the additional step of adjusting the magnitude of the AC voltage generated by the generator structure to a user selected magnitude.